

IMPROVEMENT OF TULSA STREET E.L. HYDRAULIC AVE. TO POINT 300' EAST


PROJ. NO. DBKW 705048
CITY OF WICHITA, KANSAS
R. W. LINN, CITY ENGINEER

CITY OF WICHITA
APPROVED: _____
Date: 11-13-75
Engineering Div: 621




NOTE TO CONTRACTOR
This project will be constructed under the supervision of the CITY ENGINEER and conforming to the SPECIFICATIONS of the CITY OF WICHITA. The CONTRACTOR will reimburse the City of Wichita for all cost of Engineering, Plans and Inspection.

APPROVED AS NOTED
BY CITY ENGINEER
Date: 11-13-75
Engineering Div: 621


SAWED CONTRACTION JOINTS ARE TO BE CONSTRUCTED AT 30' 0" INTERVALS EXCEPT WHERE AN EXPANSION JOINT IS USED.

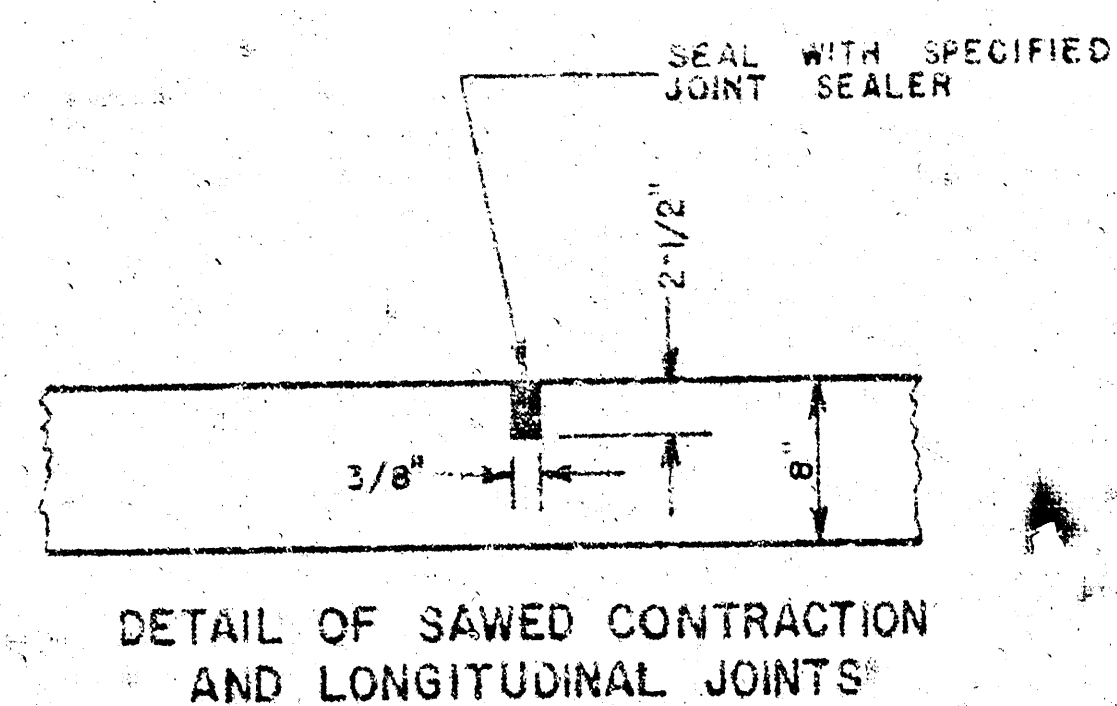

EXPANSION JOINTS ARE TO BE CONSTRUCTED AT MAXIMUM INTERVALS OF 120' 0".

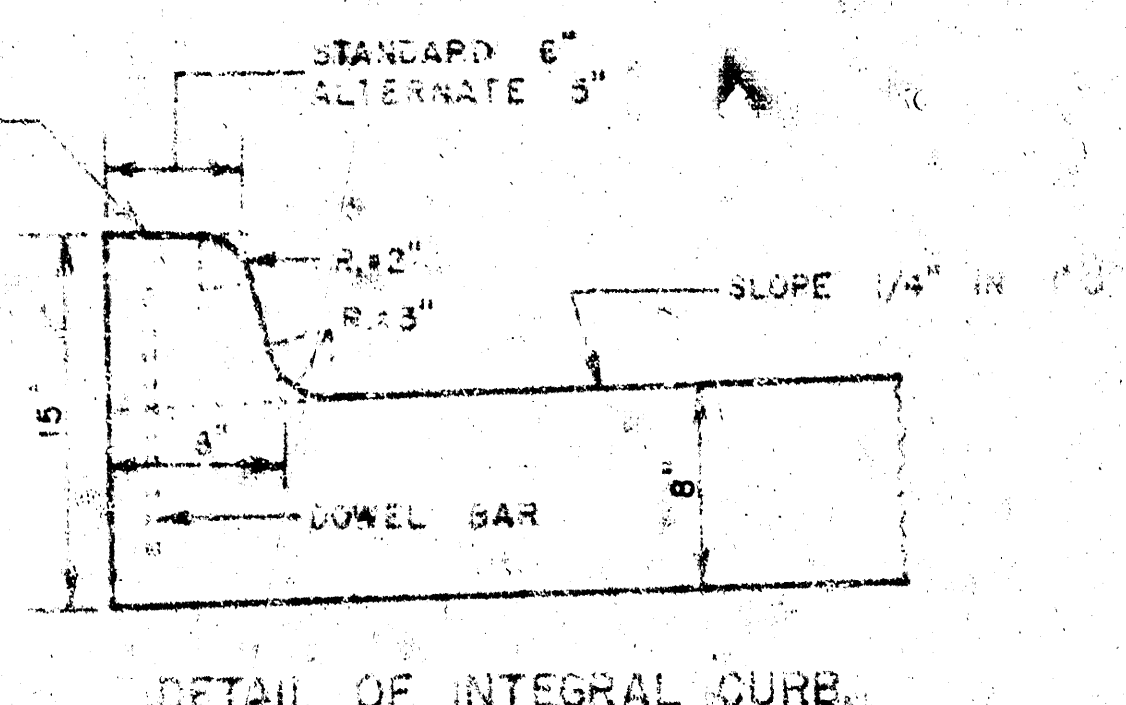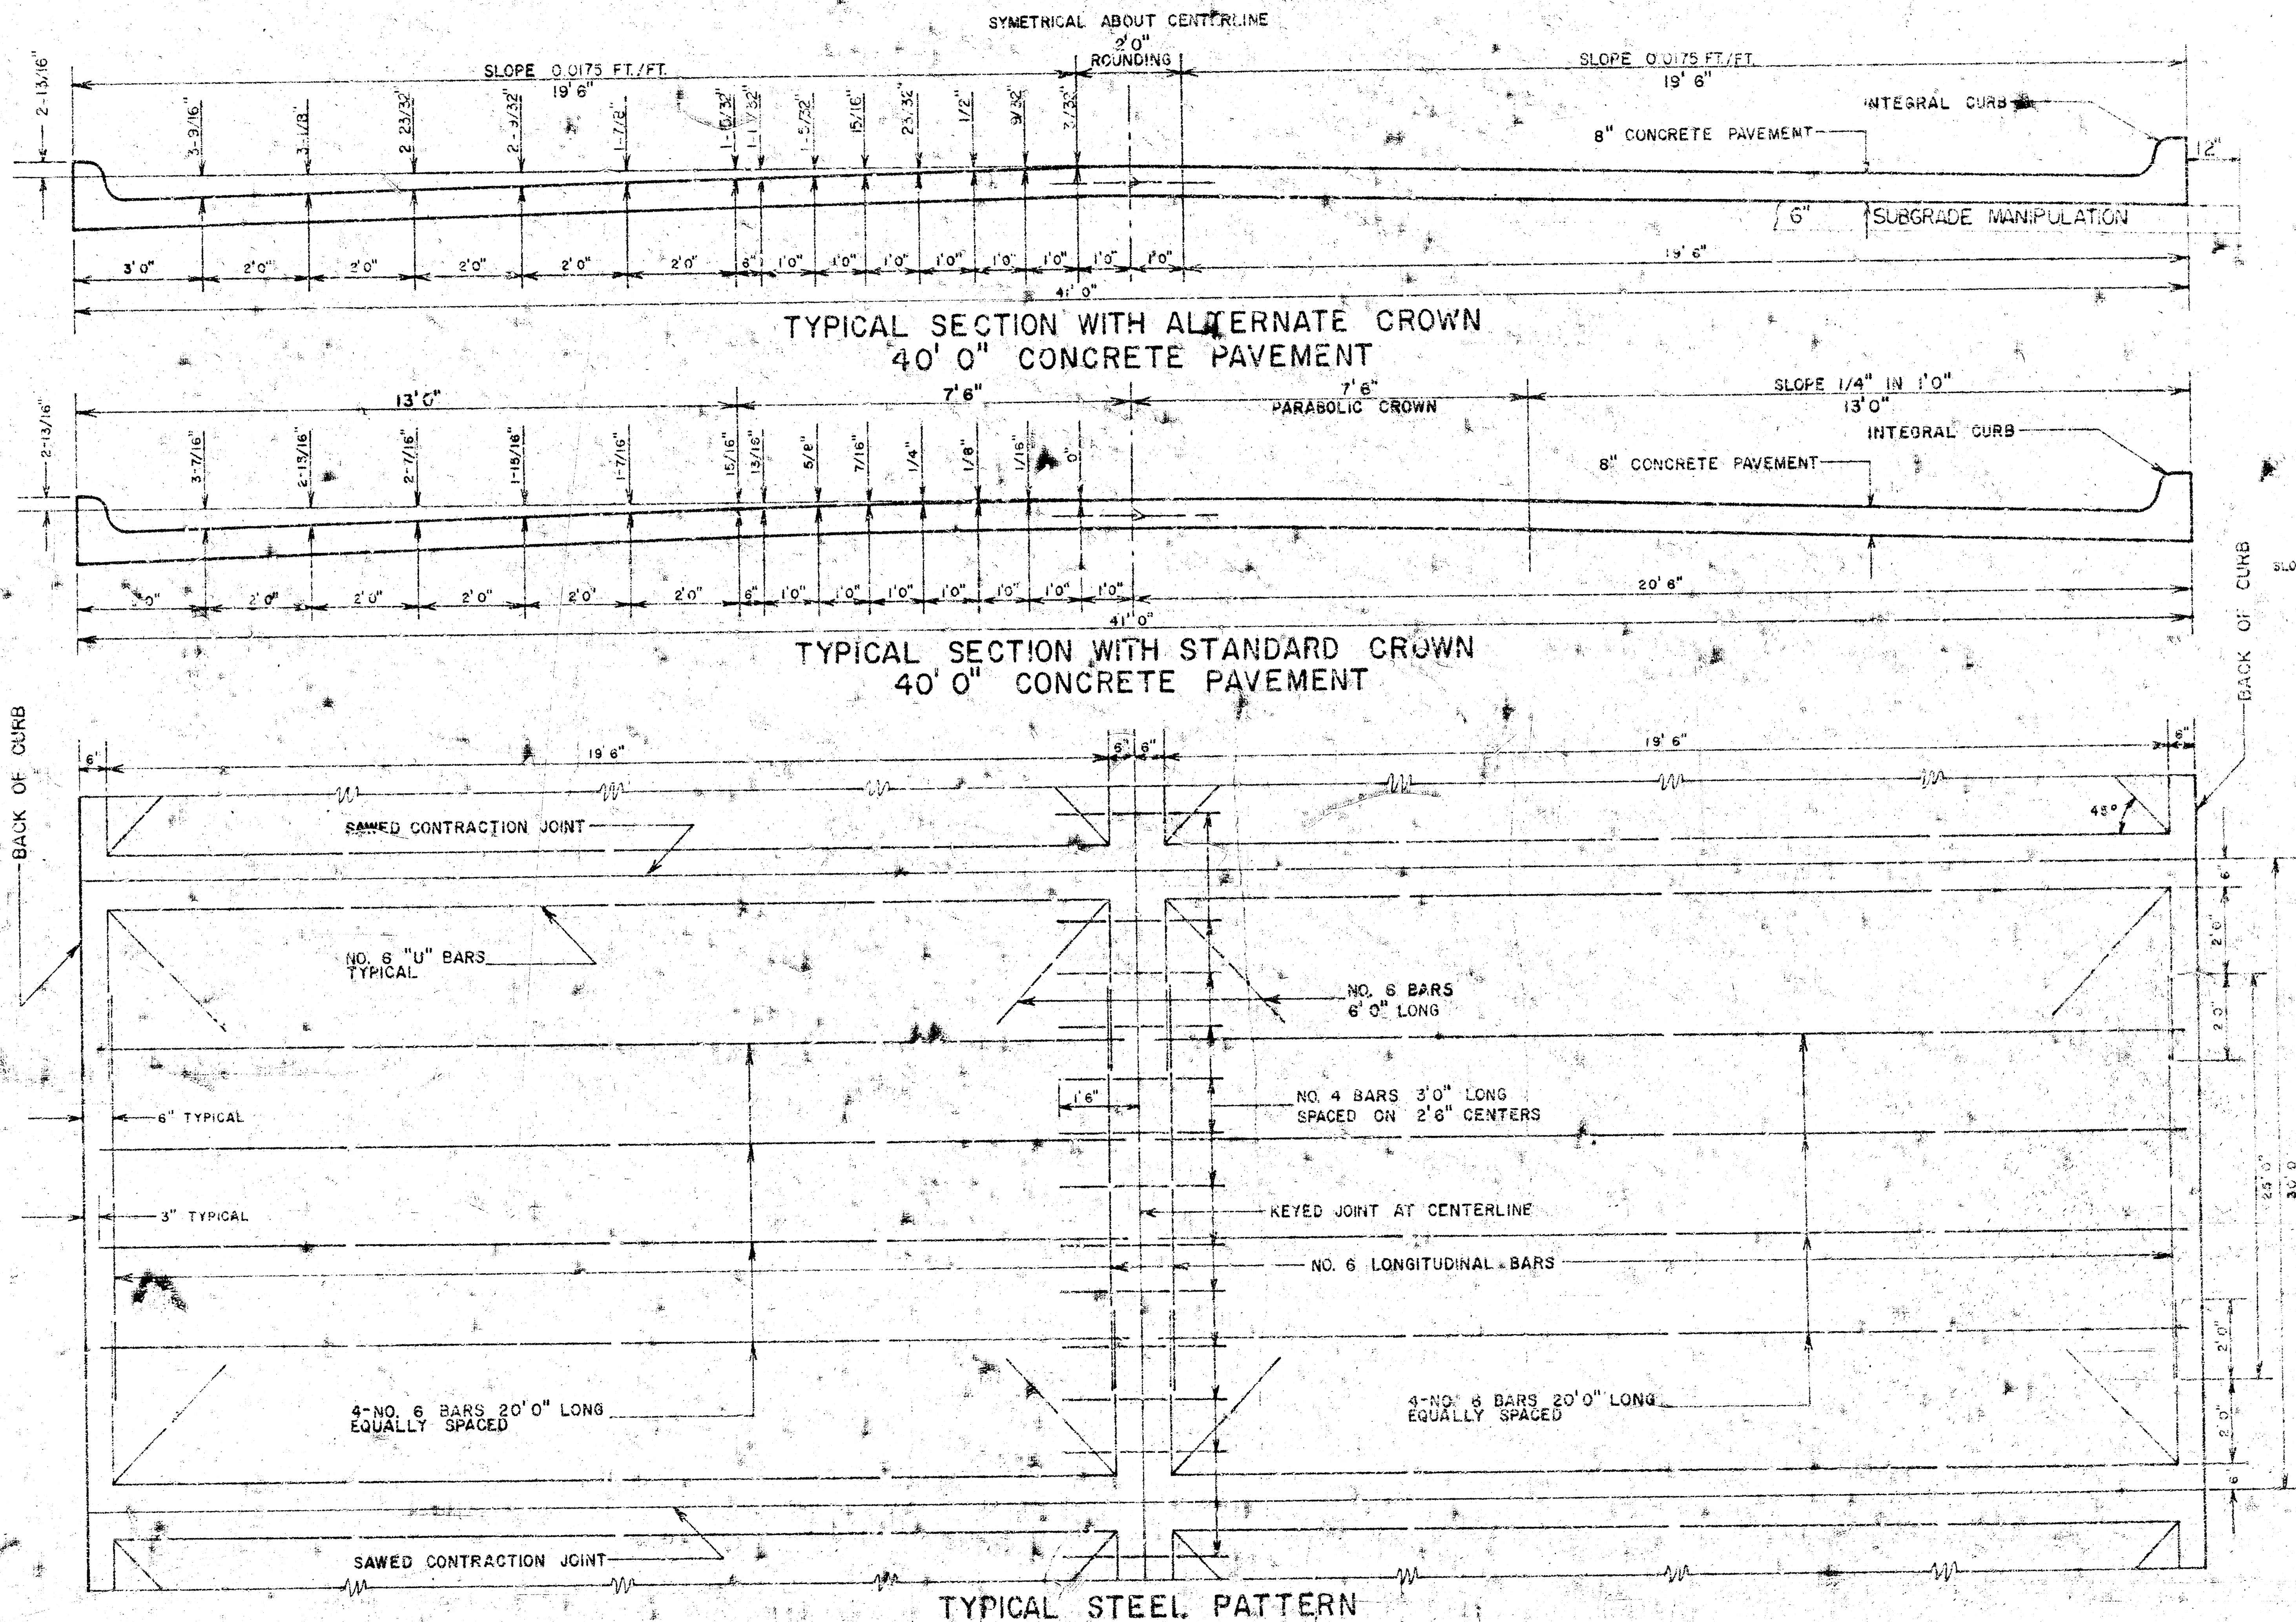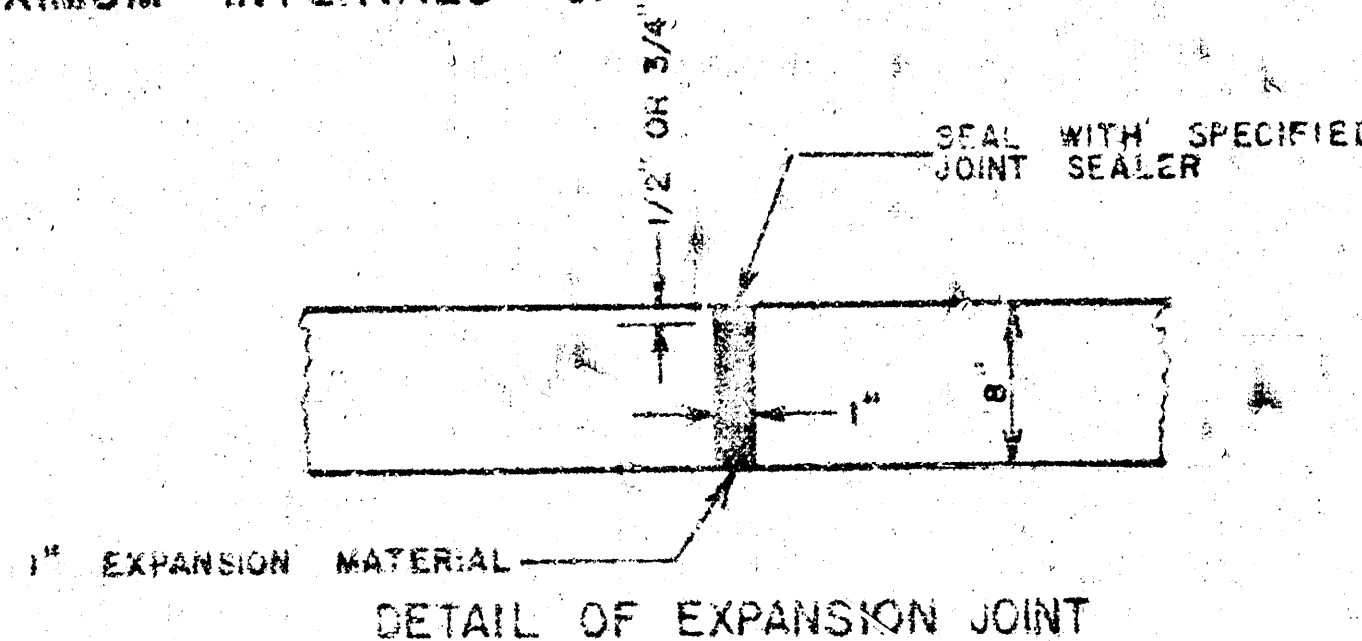


INTEGRAL CURB SHALL BE CUT THROUGH TO PAVEMENT IN UNIFORM LENGTHS OF NOT MORE THAN TEN FEET INTERVALS BETWEEN EXPANSION JOINTS. EXPANSION JOINTS HAVING THE SAME THICKNESS AS THE EXPANSION JOINTS IN THE PAVEMENT SHALL BE CONSTRUCTED IN THE INTEGRAL CURB AT THE SPECIFIED LOCATIONS. NUMBER 4 OR NUMBER 6 BARS SHALL BE INSTALLED IN THE INTEGRAL CURB AS SHOWN ON APPROXIMATELY 2' 6" CENTERS. PAVEMENT GRADES SHOWN ON PLANS ARE FOR STANDARD CROWN.

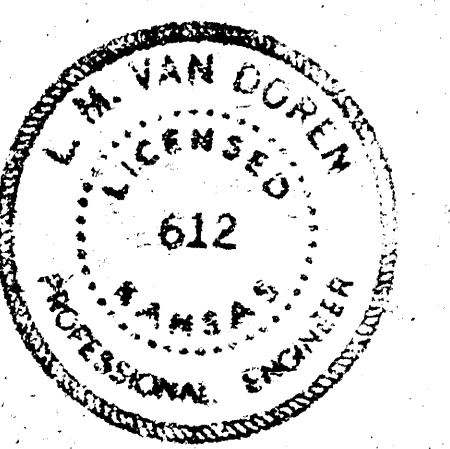


ALTERNATE NO. 1

SHEET NO. 1 OF 4

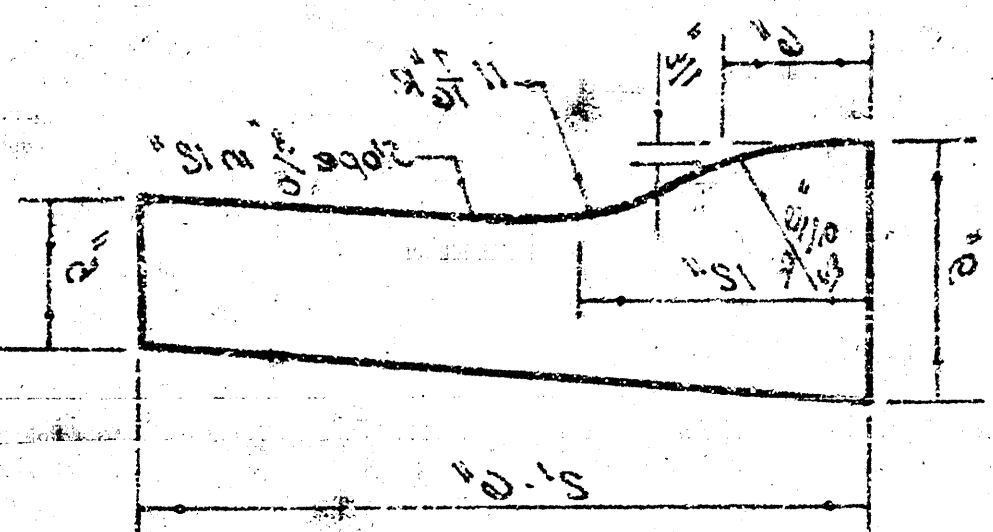

ROLL TYPE CURB & GUTTER

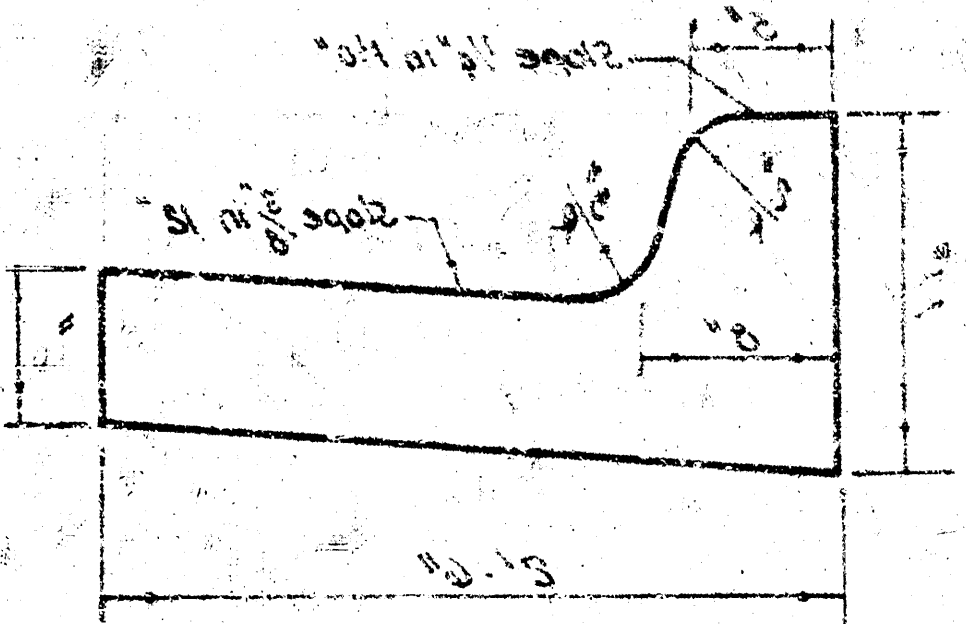


COMBINED CURB & GUTTER

CONSTRUCTED ON THE PAVEMENT CENTERLINE IN THE TOP LIFT.
 BE STAGGERED A MINIMUM DISTANCE OF 1' WITH JOINTS IN PRECEDING LIFTS AND SUCH THAT A JOINT WILL BE
 HAVING AUTOMATIC ELECTRONIC CONTROLS FOR CROWN AND GRADE. CONSTRUCTION JOINTS IN EACH LIFT SHALL
 BITUMINOUS BASE AND ASPHALTIC CONCRETE WEARING SURFACE SHALL BE PLACED WITH A LAYDOWN MACHINE
 PER 20 YD BETWEEN LIFTS OF ASPHALTIC MATERIALS WHEN ORDERED BY THE ENGINEER. TACK COAT WILL NOT
 A TACK COAT OF EMULSIFIED ASPHALT (22-14) SHALL BE APPLIED AT AN APPROXIMATE RATE .002 GALLONS

4' ASPHALTIC CONCRETE PAVEMENT WITH BITUMINOUS BASE

TYPICAL SECTION

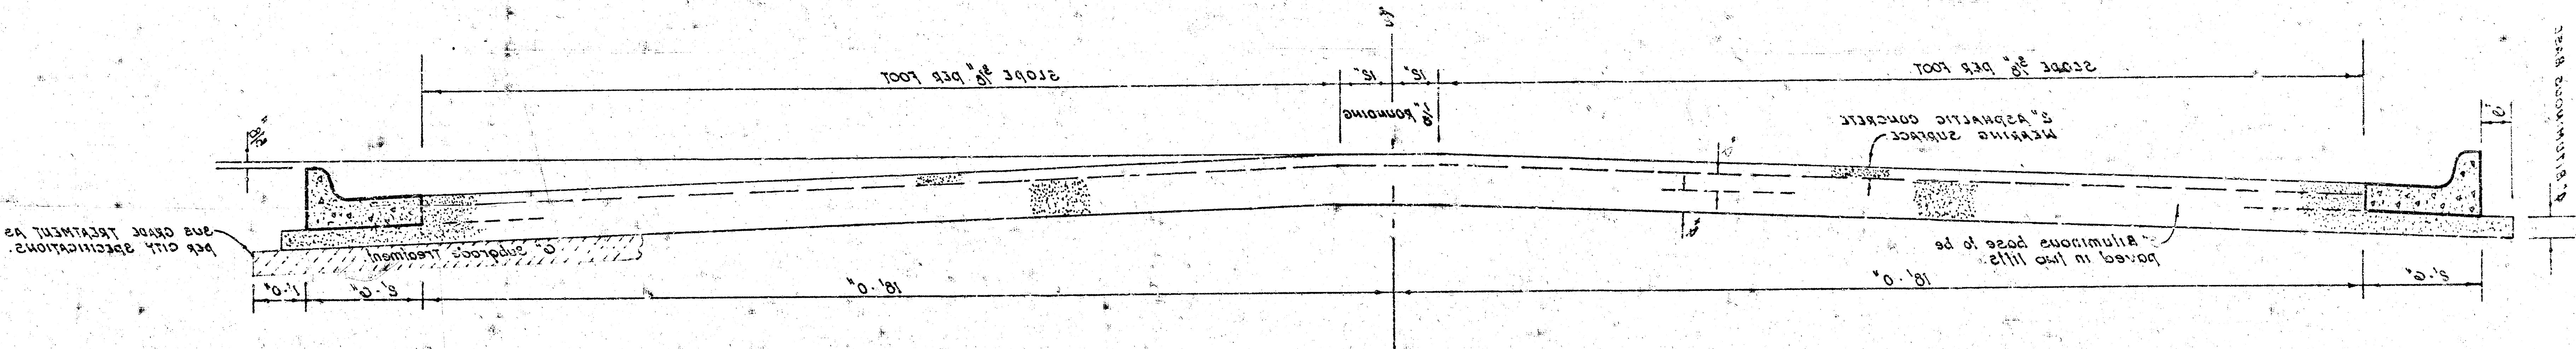

The A.C. pavement between the comp curb & gutter shall be paid as 20 yds 0" A.C. pavement (2" Bituminous Base). The Bituminous base under the comp curb & gutter shall be paid as 20 yds 4" Bituminous Base.

CITY OF WICHITA, KANSAS

DEPARTMENT of PUBLIC WORKS - Engineering Division

CITY ENGINEER R. W. LINK

DATE _____ Proj. No. _____

IMPROVEMENT OF TULSA ST.
E.L. HYDRAULIC AVE. TO POINT 300' EAST
WICHITA, KANSAS

NOTE TO CONTRACTOR
This project will be constructed under
the supervision of the CITY ENGINEER
and conforming to the SPECIFICATIONS
of the CITY OF WICHITA. The CON-
TRACTOR will reimburse the City of
Wichita for all cost of Engineering, Plans
and Inspection.

11-13-75 *2021*

