
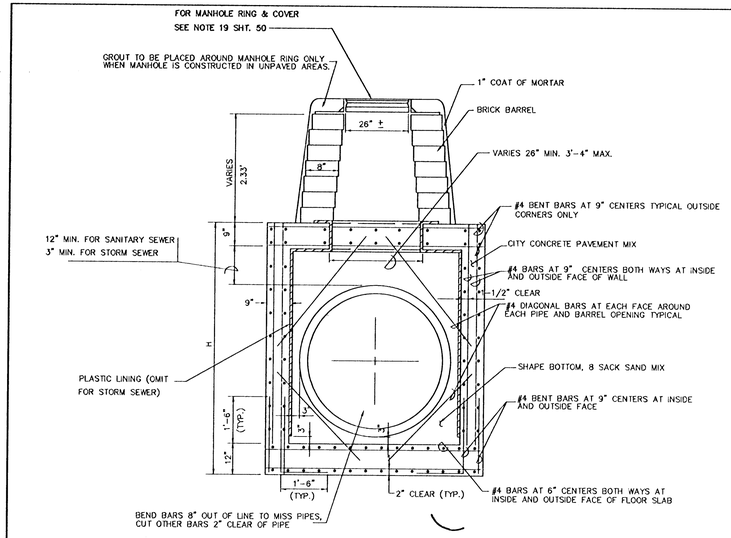


REINFORCED CONCRETE MANHOLE


DEPTH OF STACK: 0' TO 2.33'

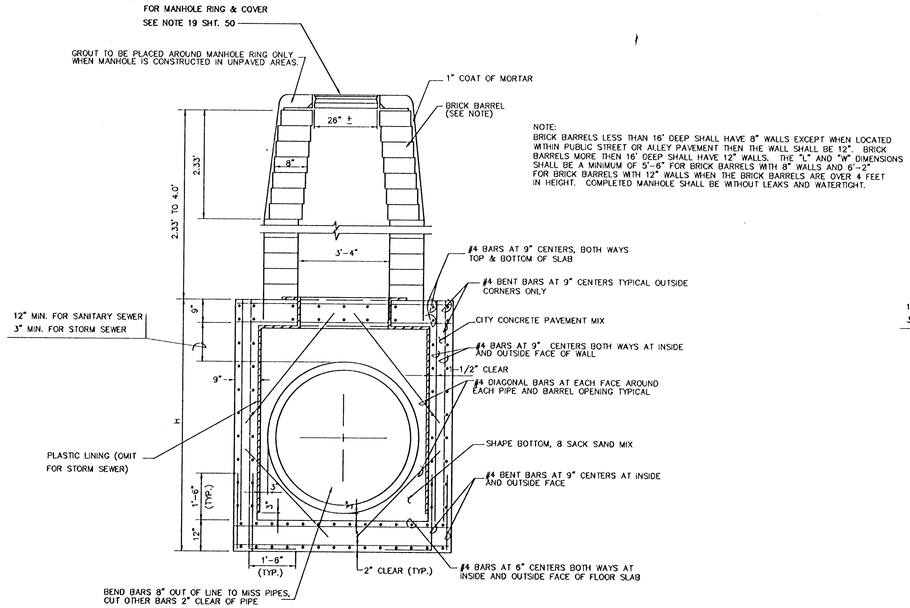

NOTE:
BRICK BARRELS LESS THAN 16' DEEP SHALL HAVE 8" WALLS EXCEPT WHEN LOCATED WITHIN PUBLIC STREET OR ALLEY PAVEMENT THEN THE WALL SHALL BE 12". BRICK BARRELS MORE THEN 16' DEEP SHALL HAVE 12" WALLS. THE "L" AND "W" DIMENSIONS SHALL BE A MINIMUM OF 5'-6" FOR BRICK BARRELS WITH 8" WALLS AND 6'-2" FOR BRICK BARRELS WITH 12" WALLS WHEN THE BRICK BARRELS ARE OVER 4 FEET IN HEIGHT. COMPLETED MANHOLE SHALL BE WITHOUT LEAKS AND WATERTIGHT.

REINFORCED CONCRETE MANHOLE

DEPTH OF STACK: 2.33' TO 4.0'

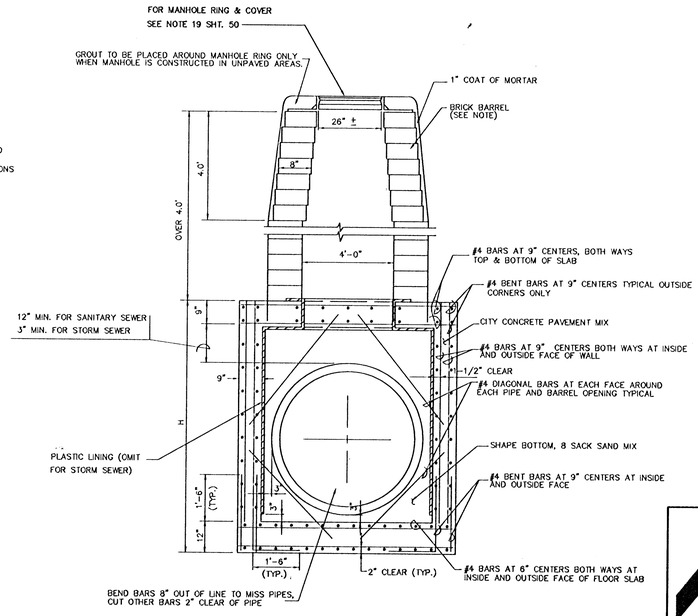

REINFORCED CONCRETE MANHOLE

DEPTH OF STACK: OVER 4.0'

MID-KANSAS ENGINEERING CONSULTANTS, INC.
411 N. WEBB ROAD
WICHITA, KS. 67206
316-684-9600

AREA "K" - 3RD STREET STORM WATER IMPROVEMENTS
PROJECT NAME

REINFORCED CONCRETE MANHOLE
SHEET TITLE

DESIGN BY:	DRAWN BY:	CHECKED BY:
FEB, 1996	93031	51 / 77
DATE	JOB NO.	SHEET OF