




BENEFIT DISTRICT
STORM WATER SEWER NO. 56
CITY OF WICHITA, KANSAS
PROJ. NO. C24-29 APRIL, 1954

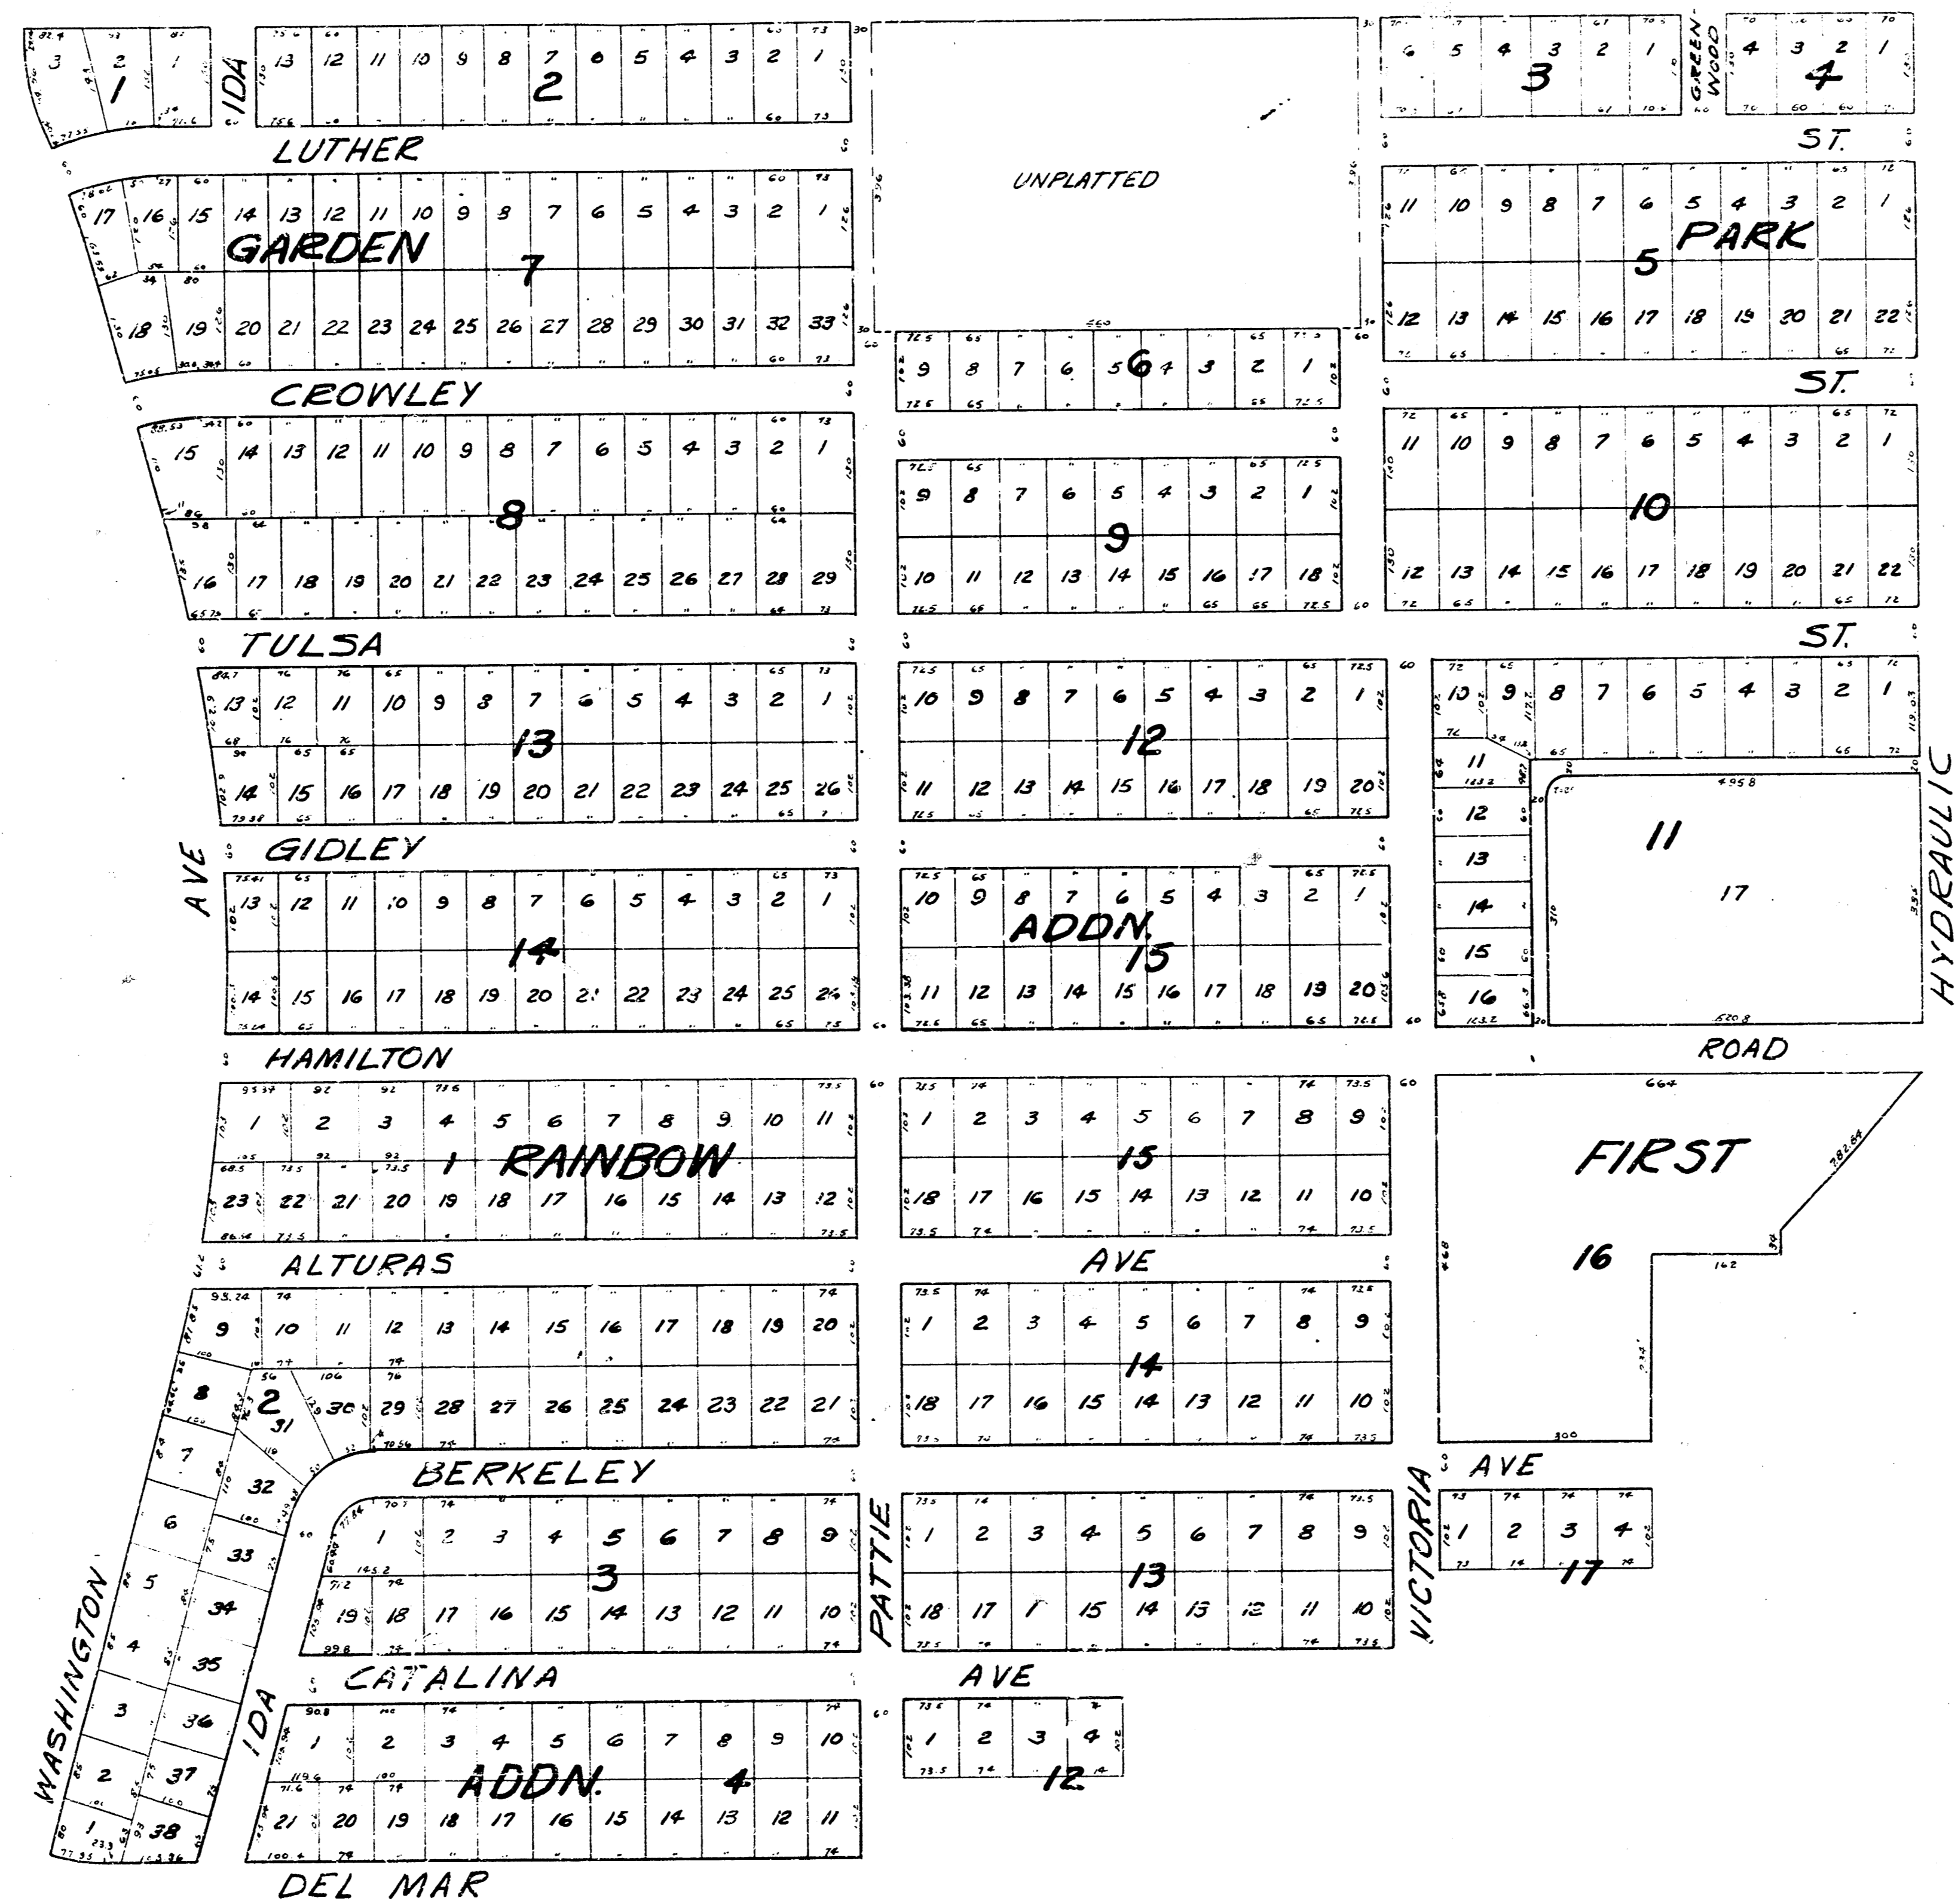

STORM WATER SEWER NO. 56
CITY OF WICHITA, KANSAS

B.E. SMITH CITY ENGINEER
PROJECT NO. C24-29 APRIL, 1954

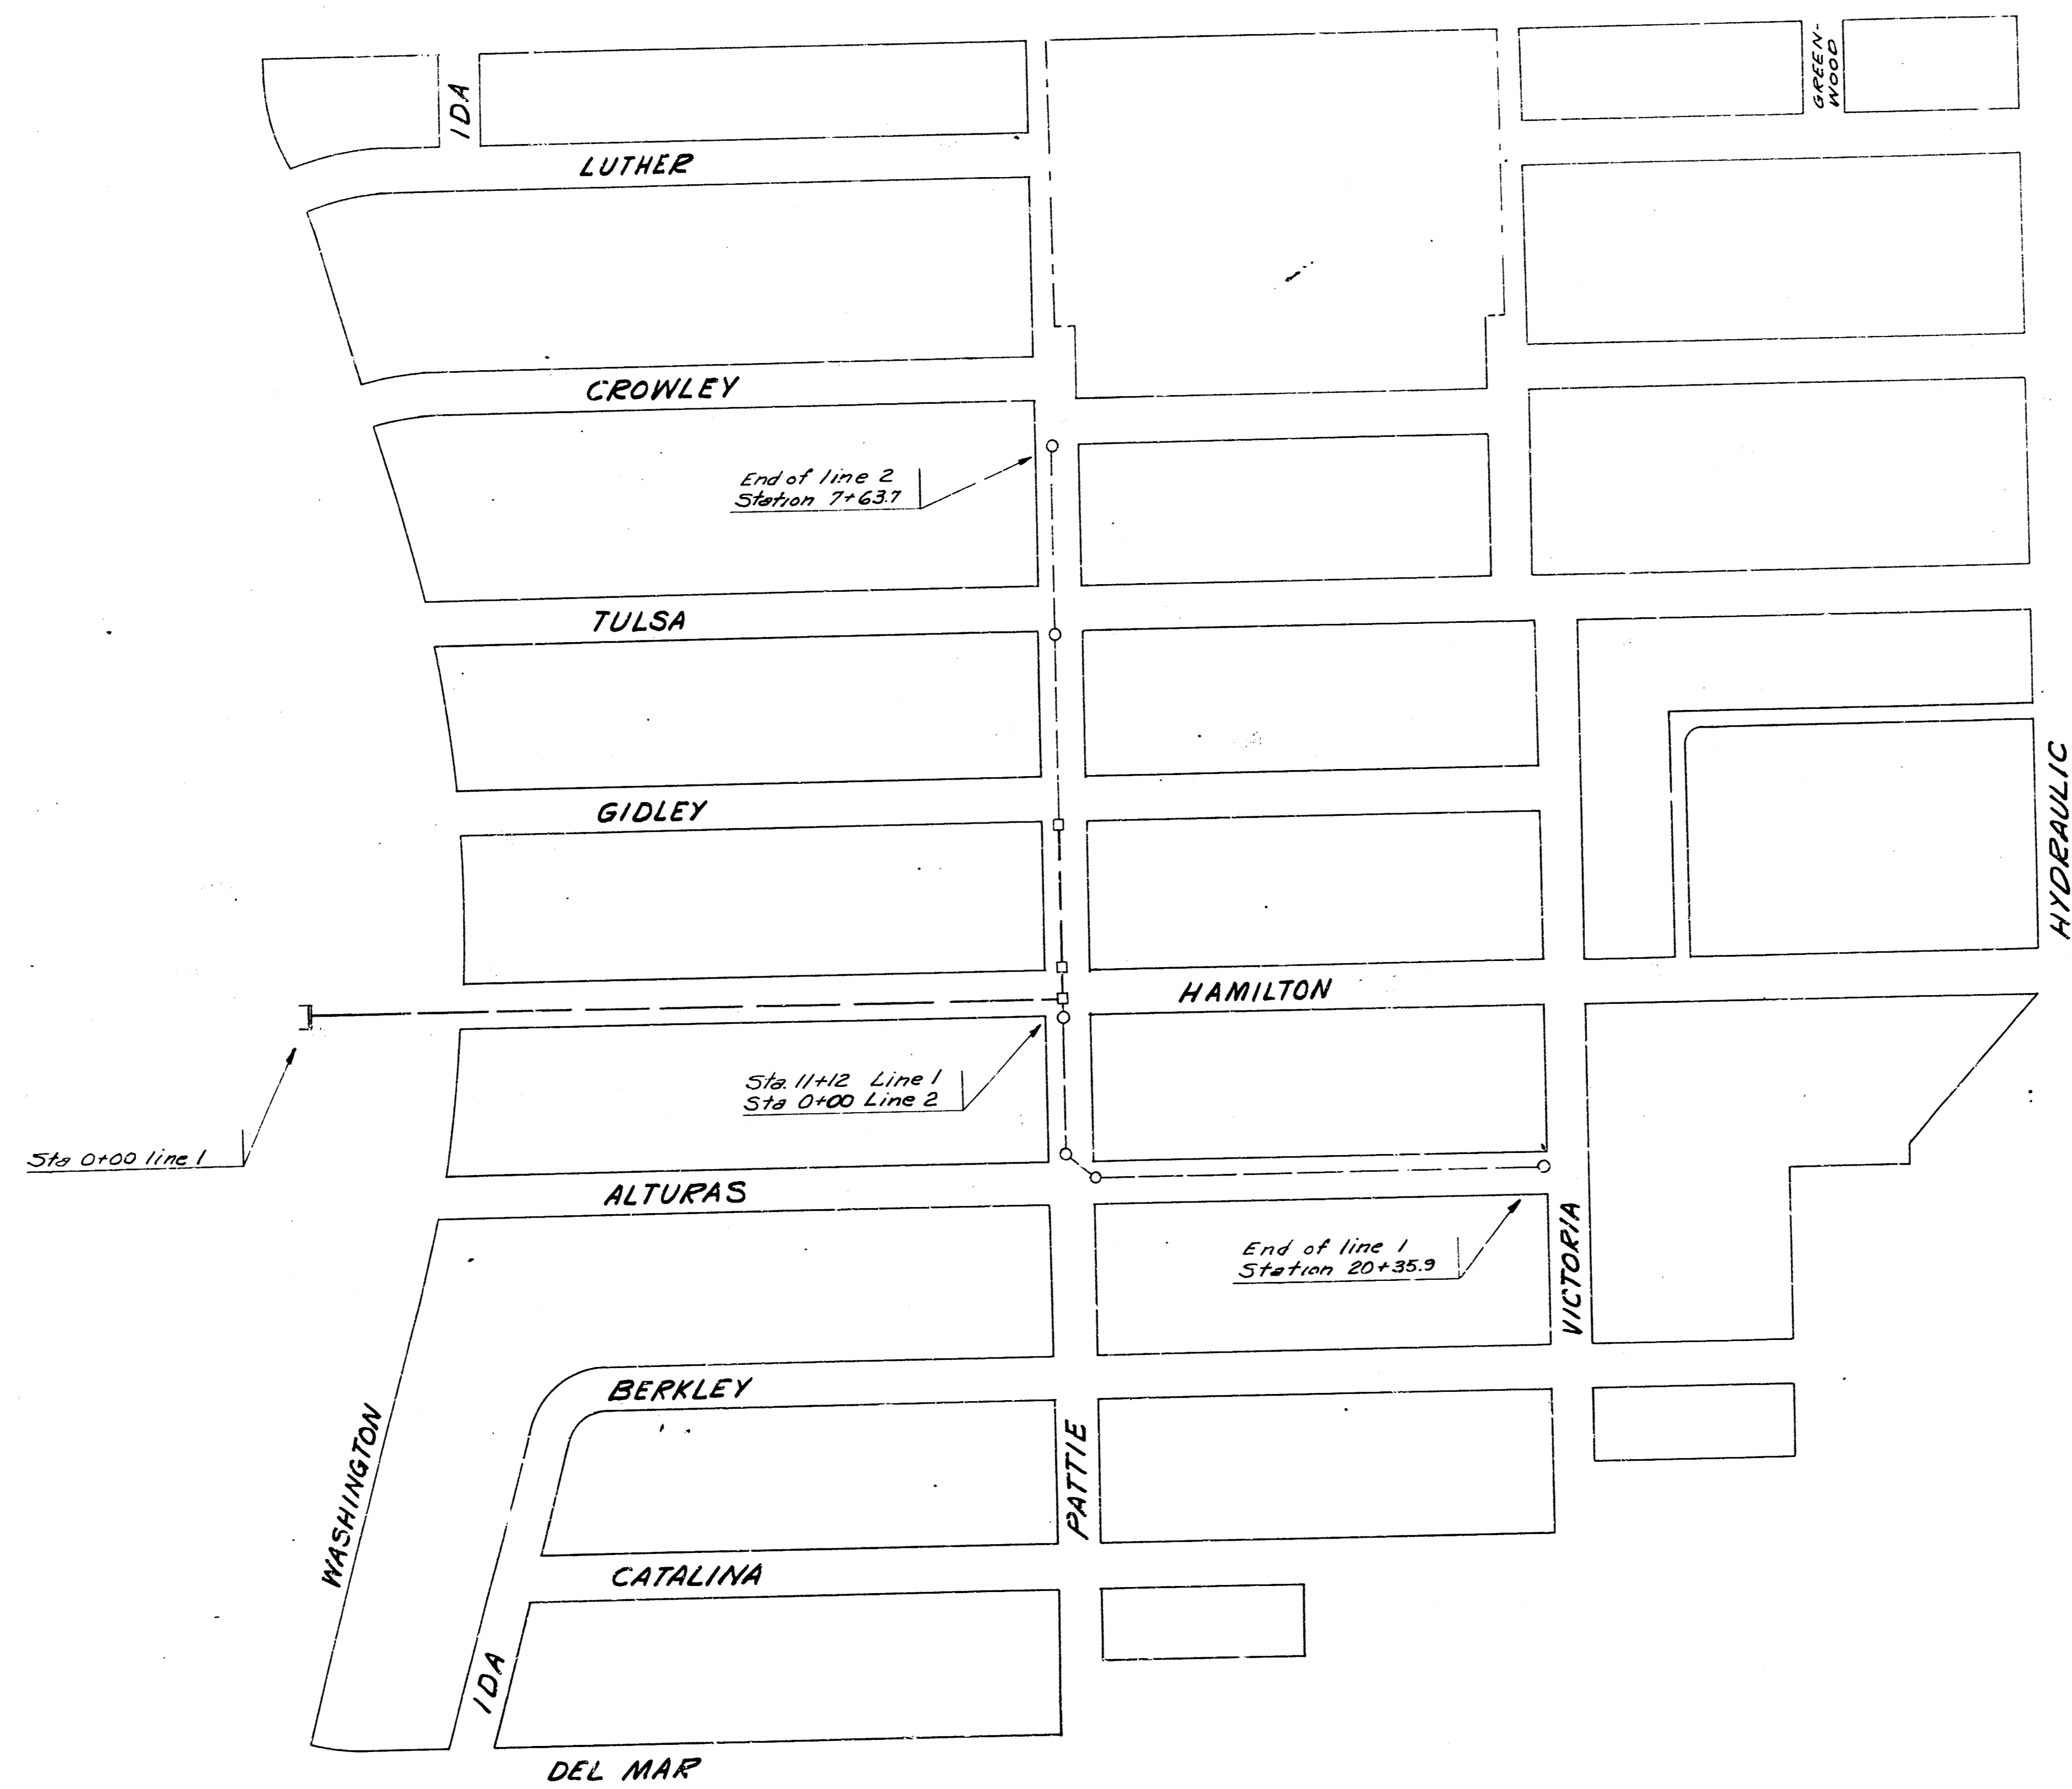

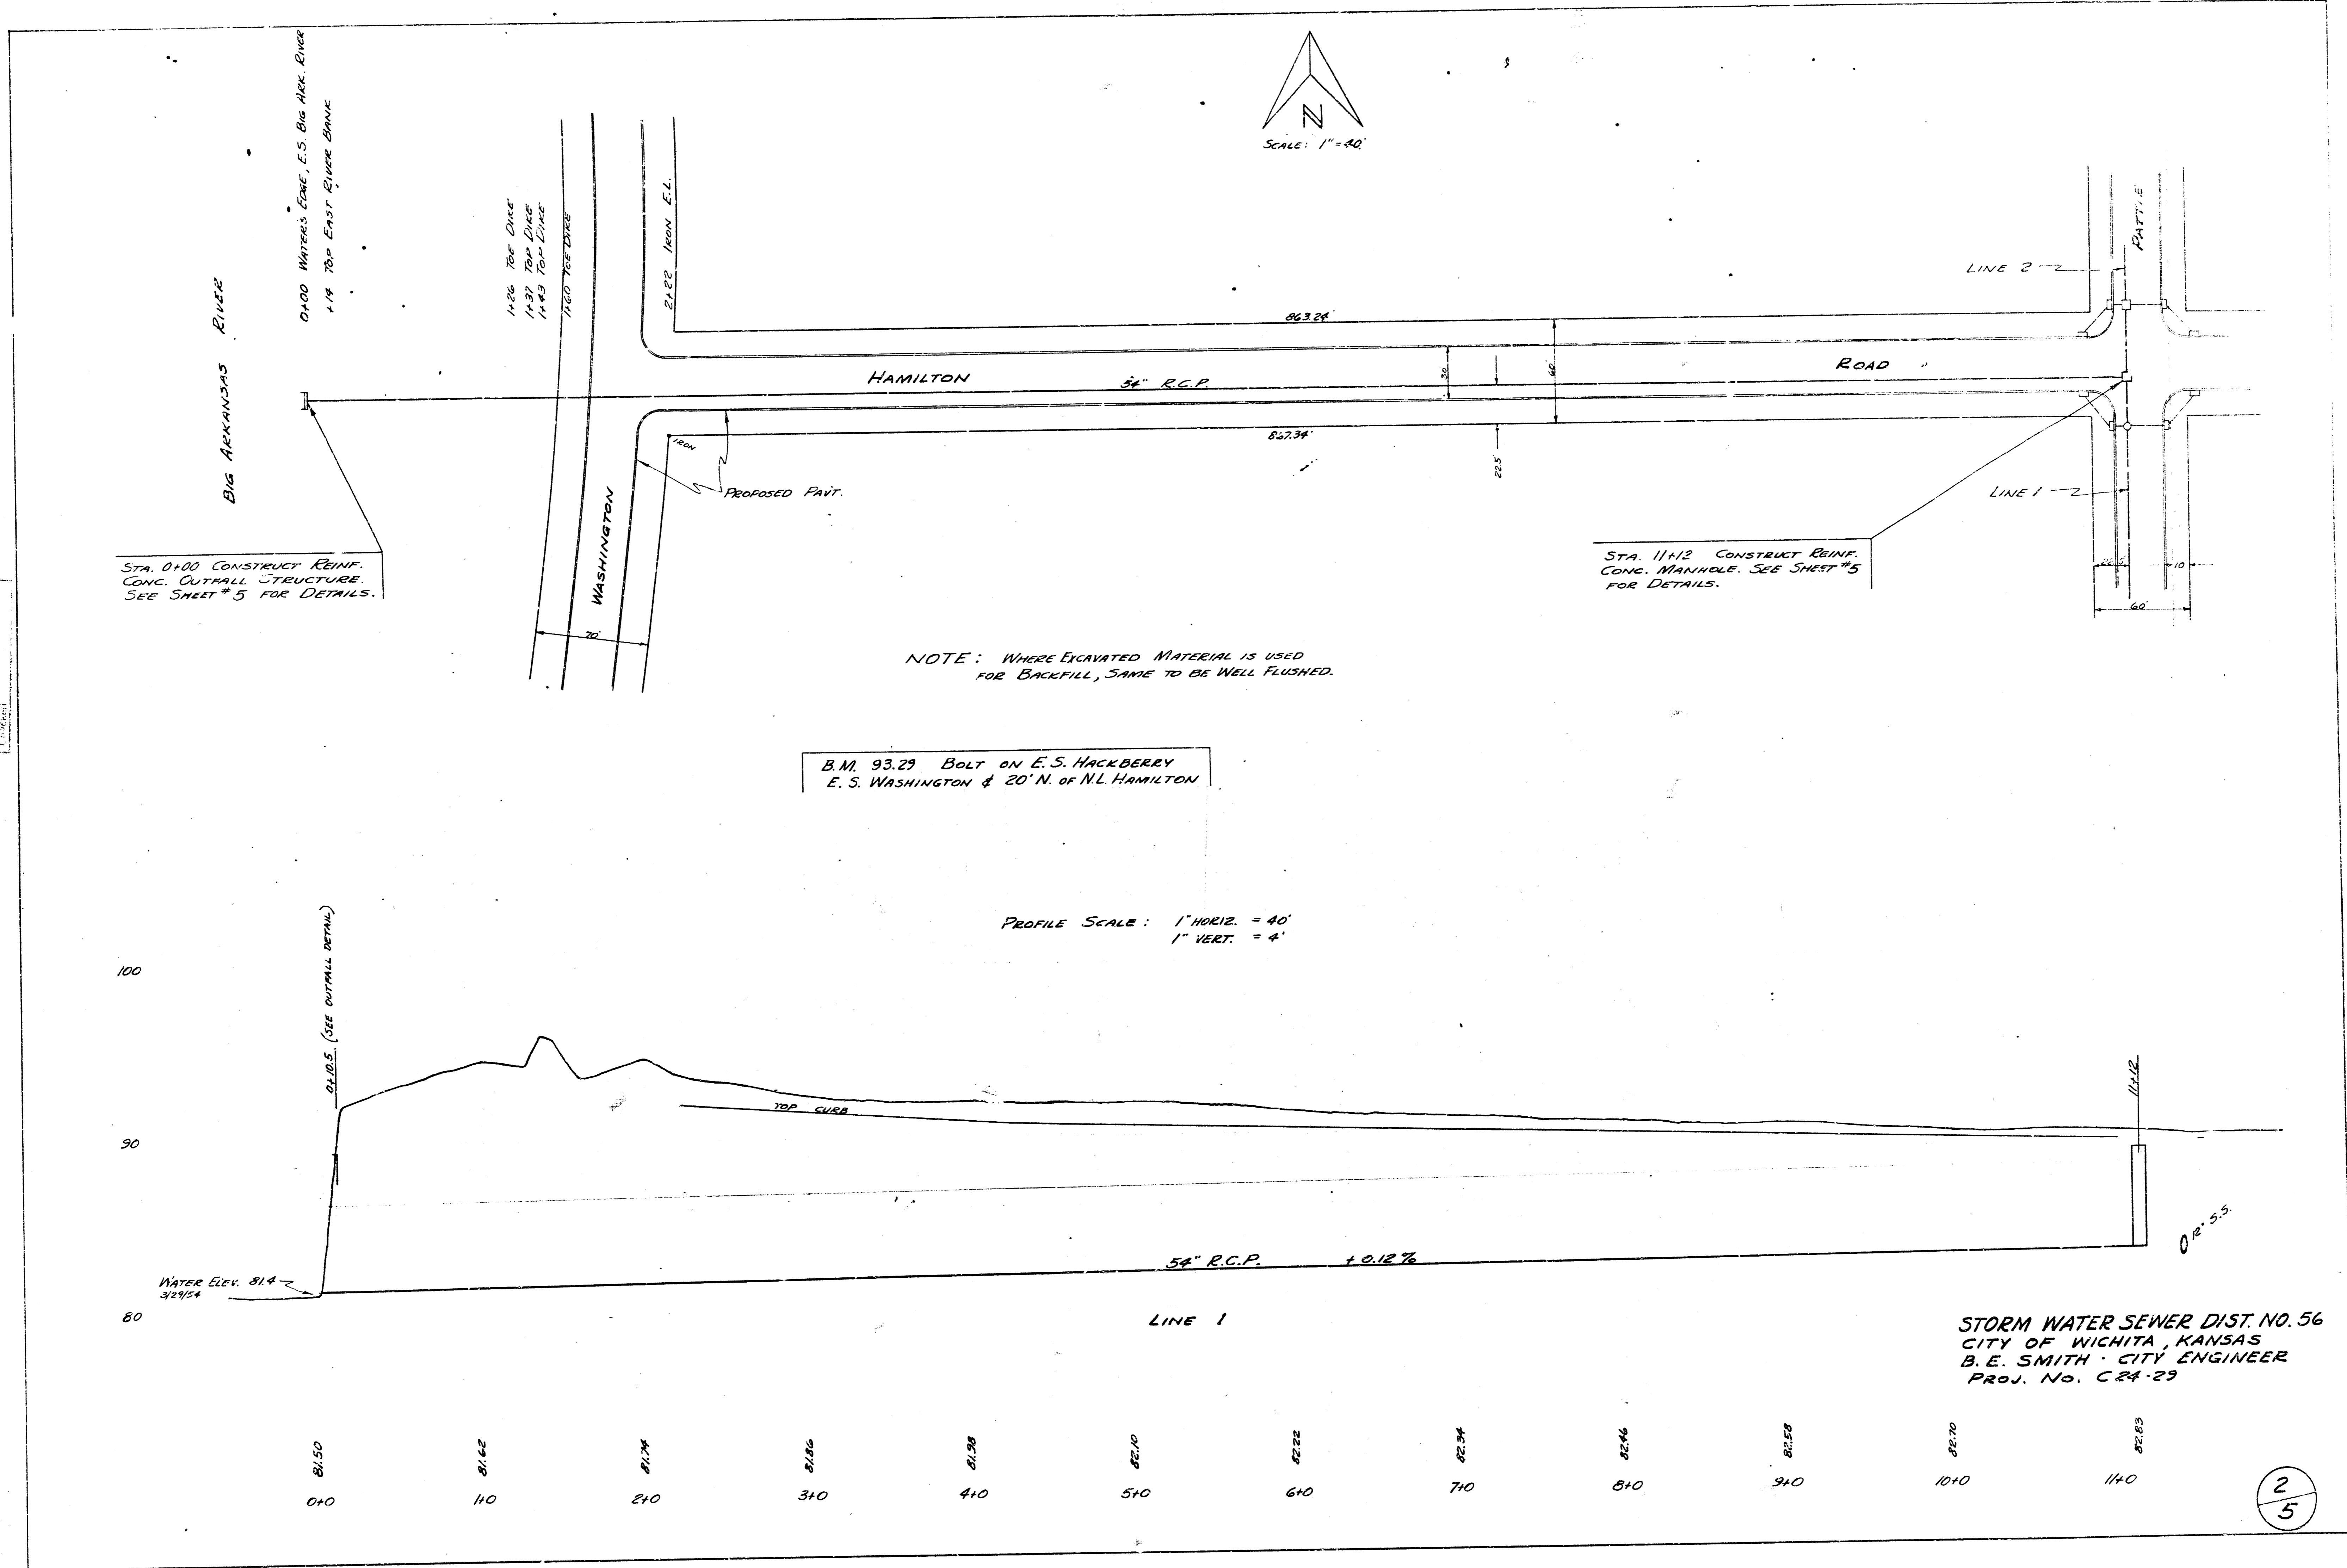

STA. 0+00 CONSTRUCT REINF. CONC. OUTFALL STRUCTURE. SEE SHEET # 5 FOR DETAILS.

STA. 1+12 CONSTRUCT REINF. CONC. MANHOLE. SEE SHEET # 5 FOR DETAILS.



NOTE: WHERE EXCAVATED MATERIAL IS USED FOR BACKFILL, SAME TO BE WELL FLUSHED.

B.M. 93.29 BOLT ON E.S. HACKBERRY
E. S. WASHINGTON & 20' N. OF N.L. HAMILTON

PROFILE SCALE: 1" HORIZ. = 40'
1" VERT. = 4'




STORM WATER SEWER DIST. NO. 56
CITY OF WICHITA, KANSAS
B.E. SMITH - CITY ENGINEER
Proj. No. C 24-29

Surveyed by J.H.P. 10/21/70
 Drawn by D.L.L.
 Checked by

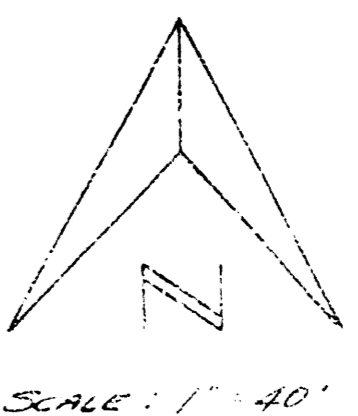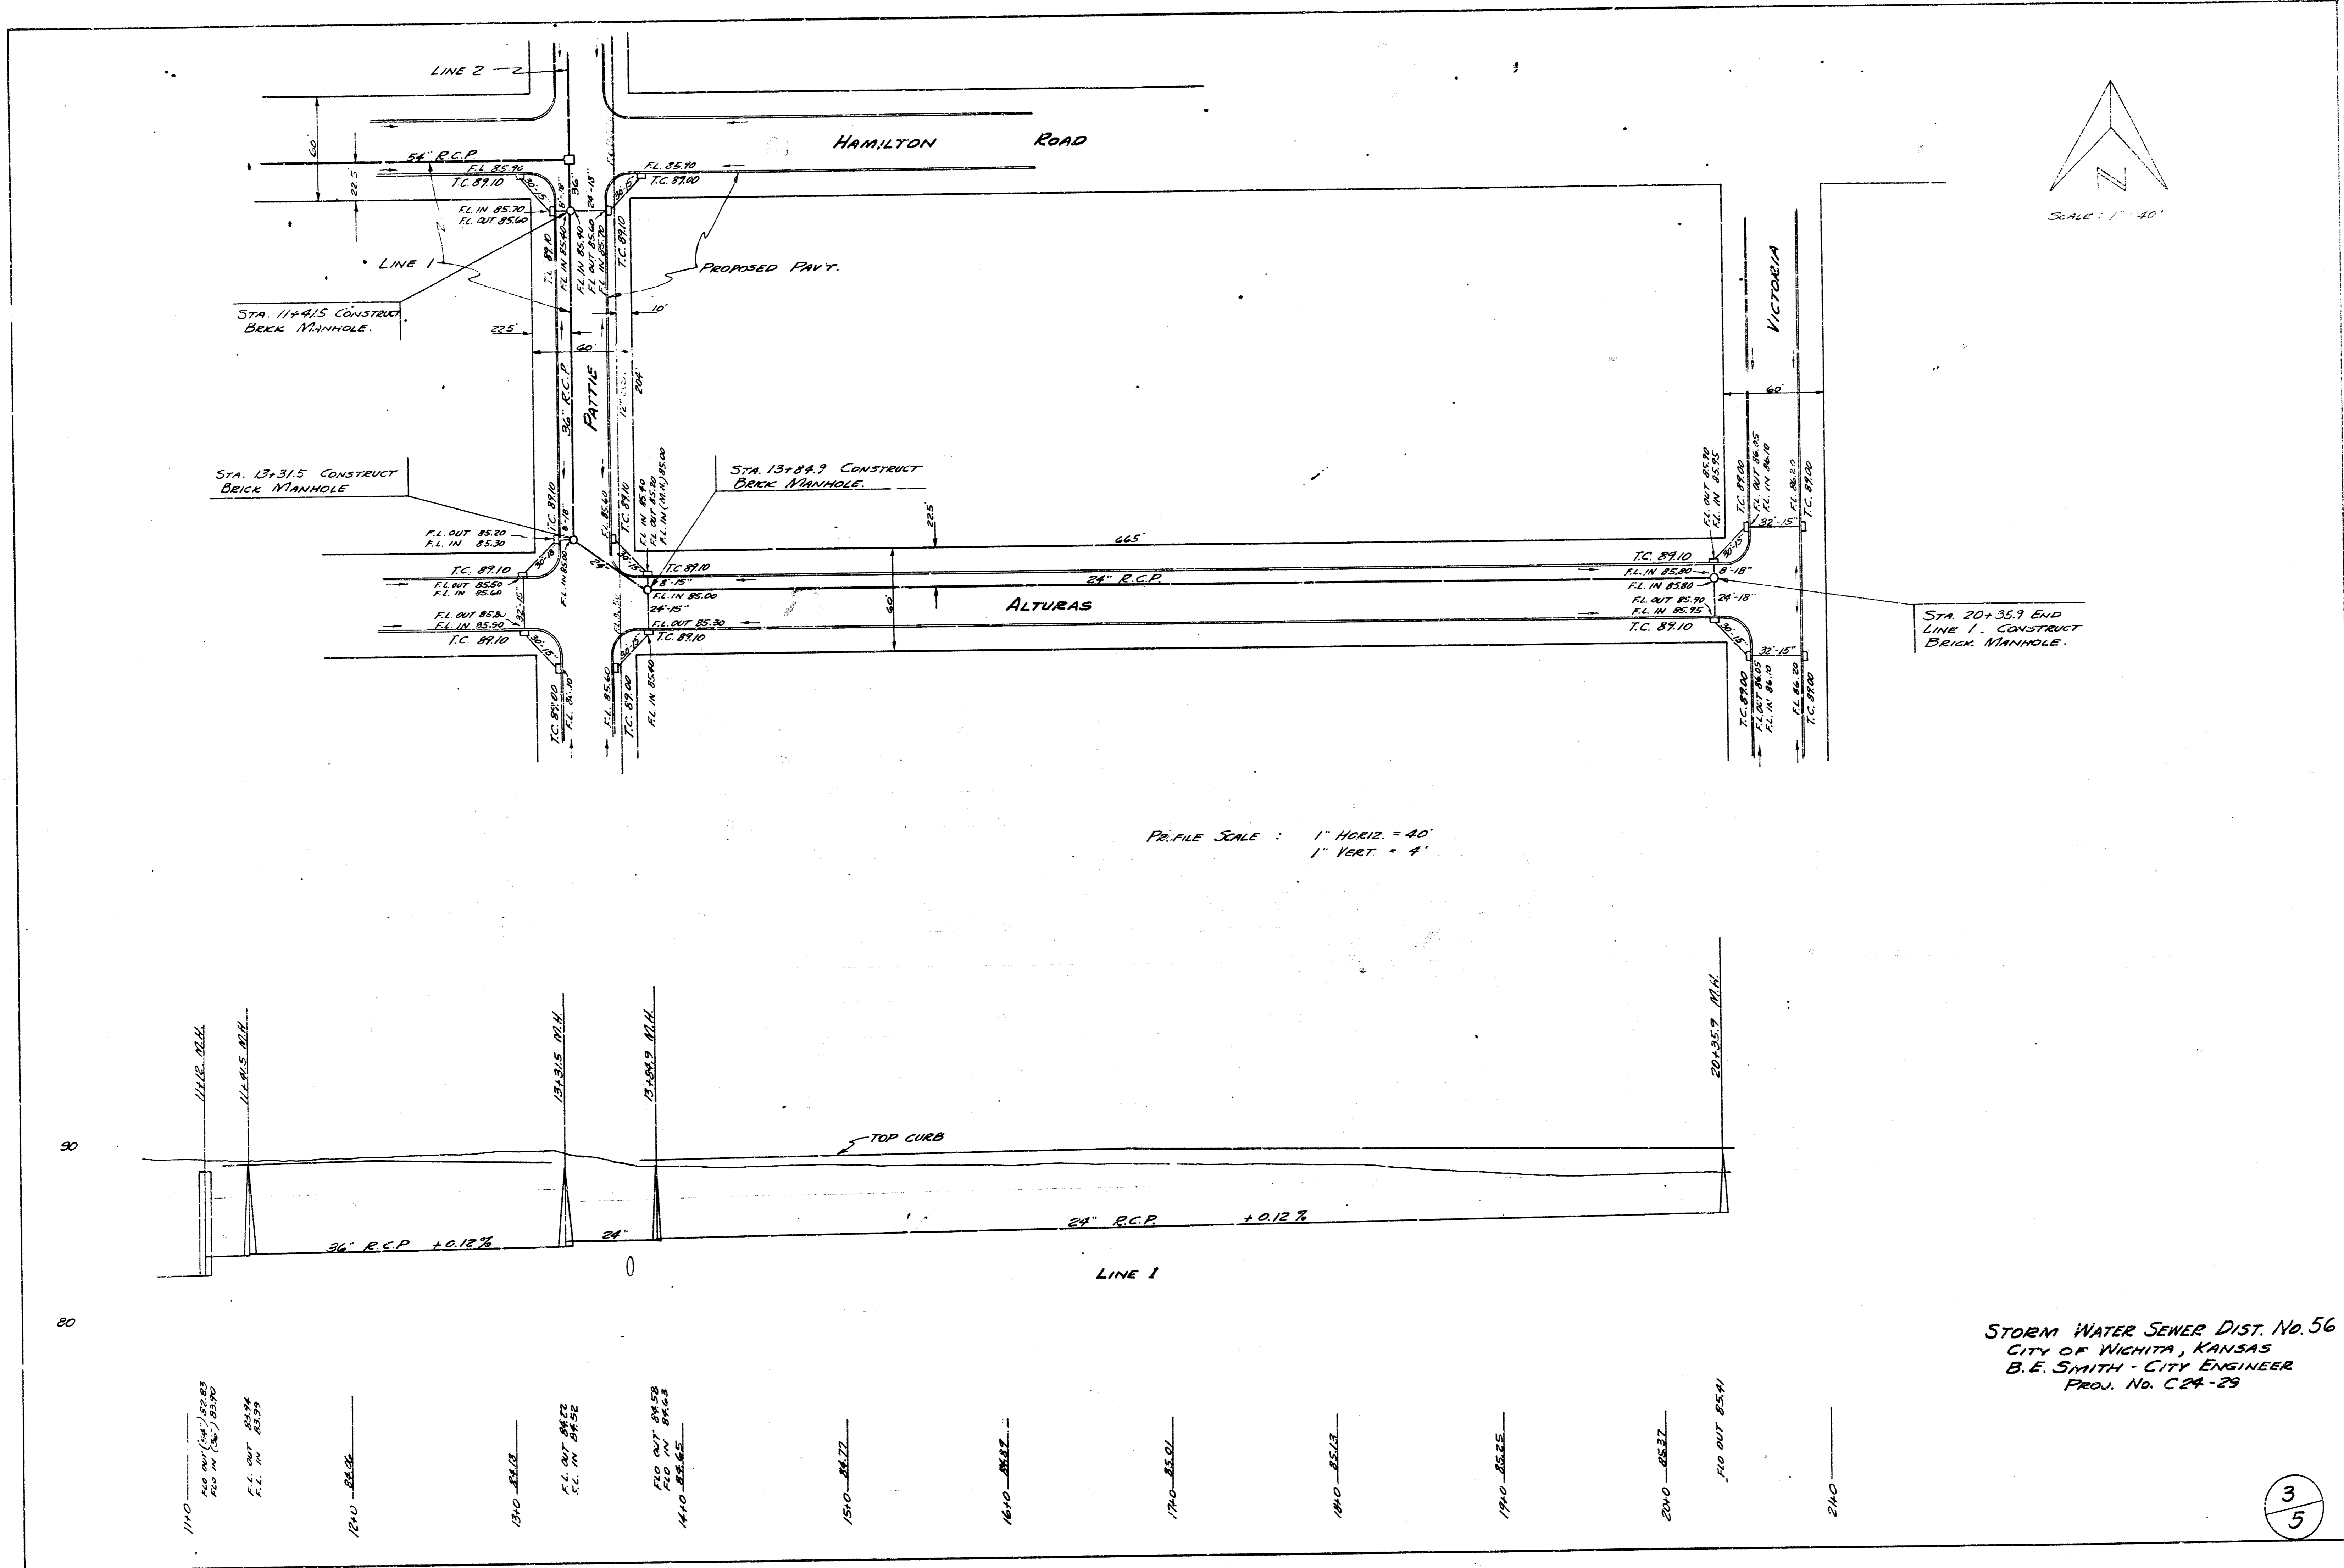


PROFILE SCALE : 1" HORIZ. = 40'
1" VERT. = 4'


STORM WATER SEWER DIST. No. 56
CITY OF WICHITA, KANSAS
B. E. SMITH - CITY ENGINEER
PROJ. No. C24-29

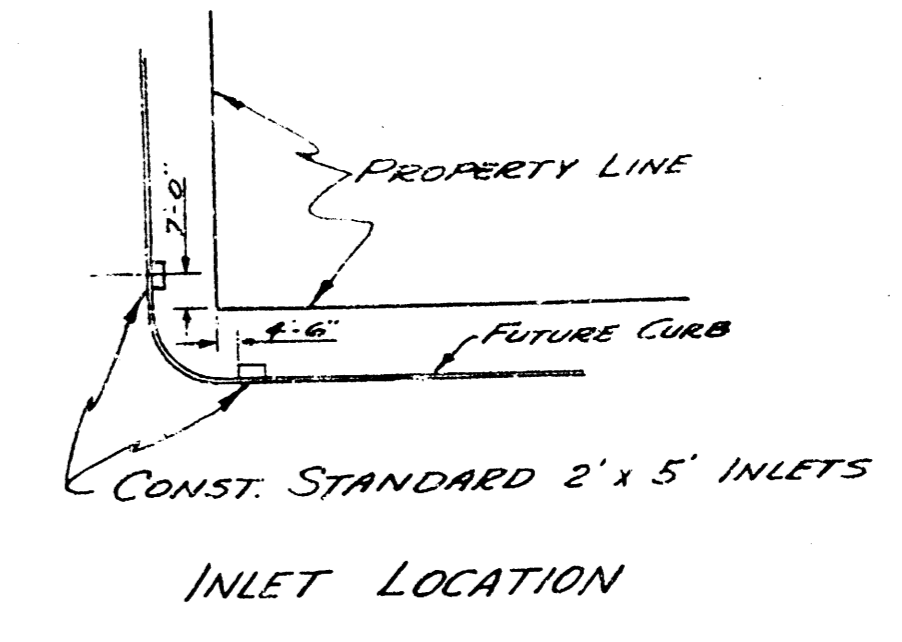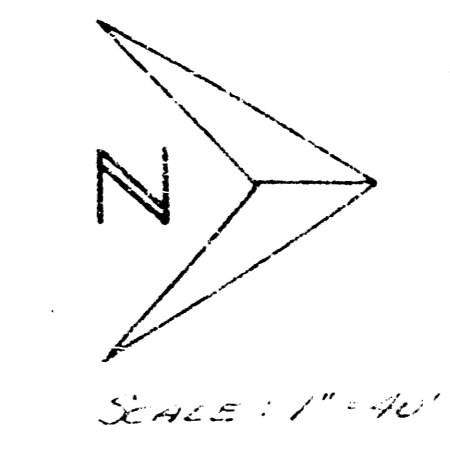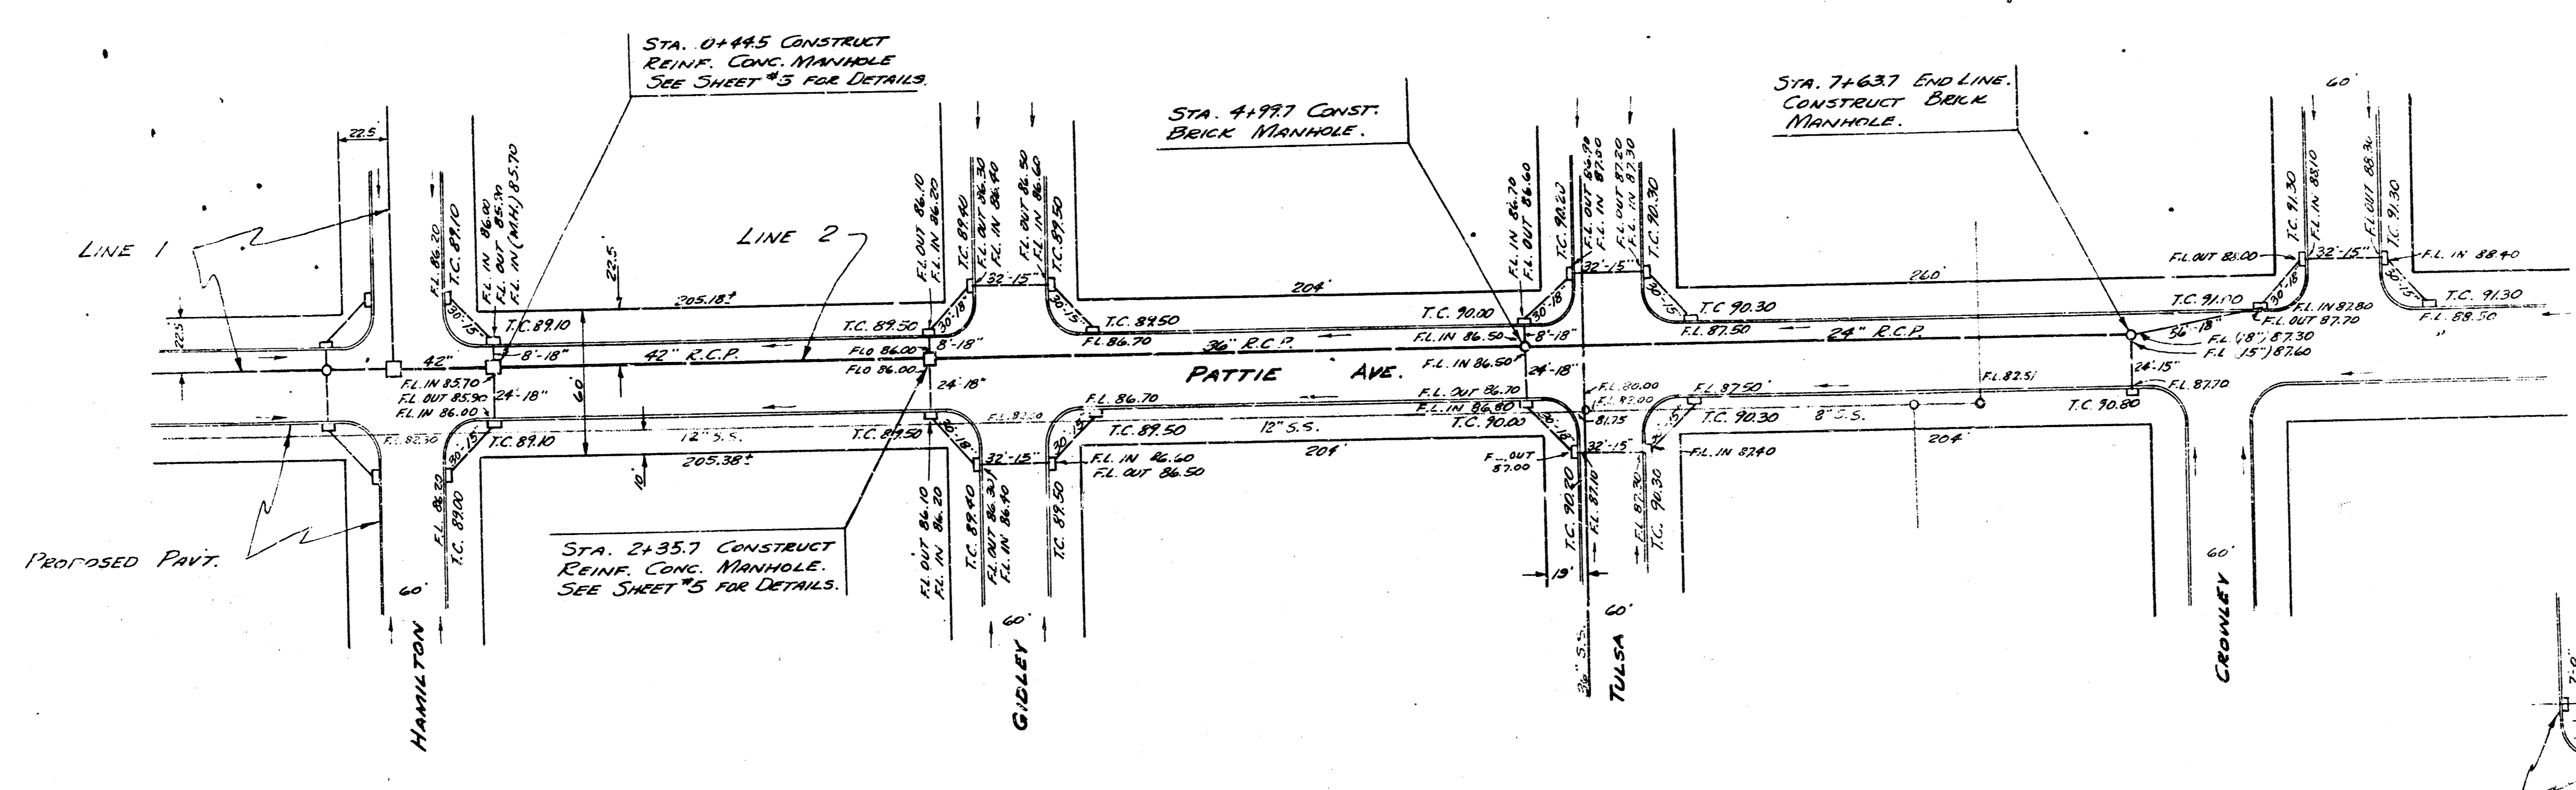

SCALE: 1" HORIZ. = 40'
1" VERT. = 4'

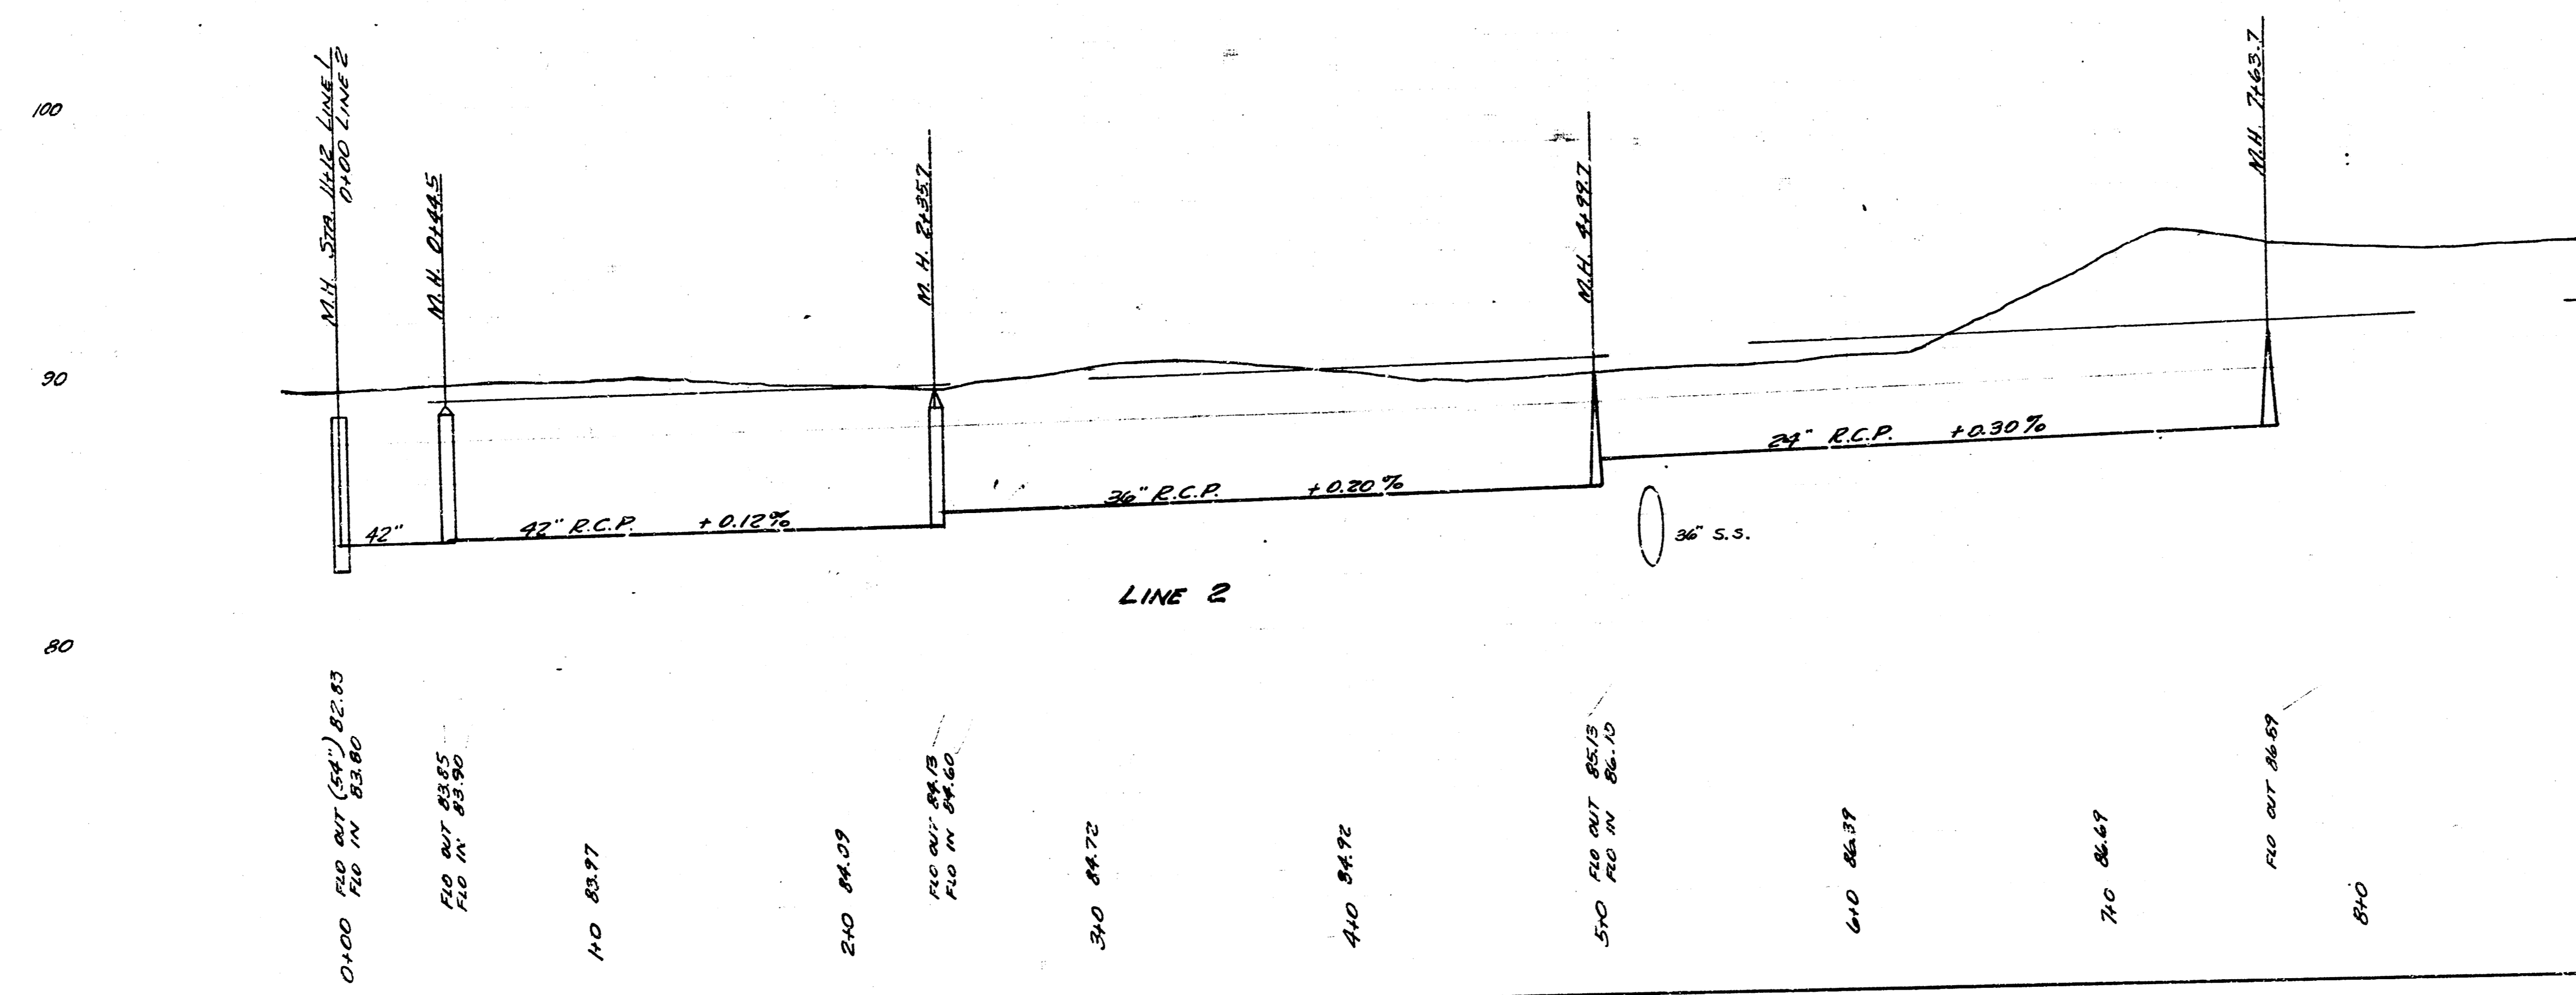


STORM WATER SEWER DIST. No. 56
 CITY OF WICHITA, KANSAS
 B. E. SMITH - CITY ENGINEER
 PROJ. No. C24-29

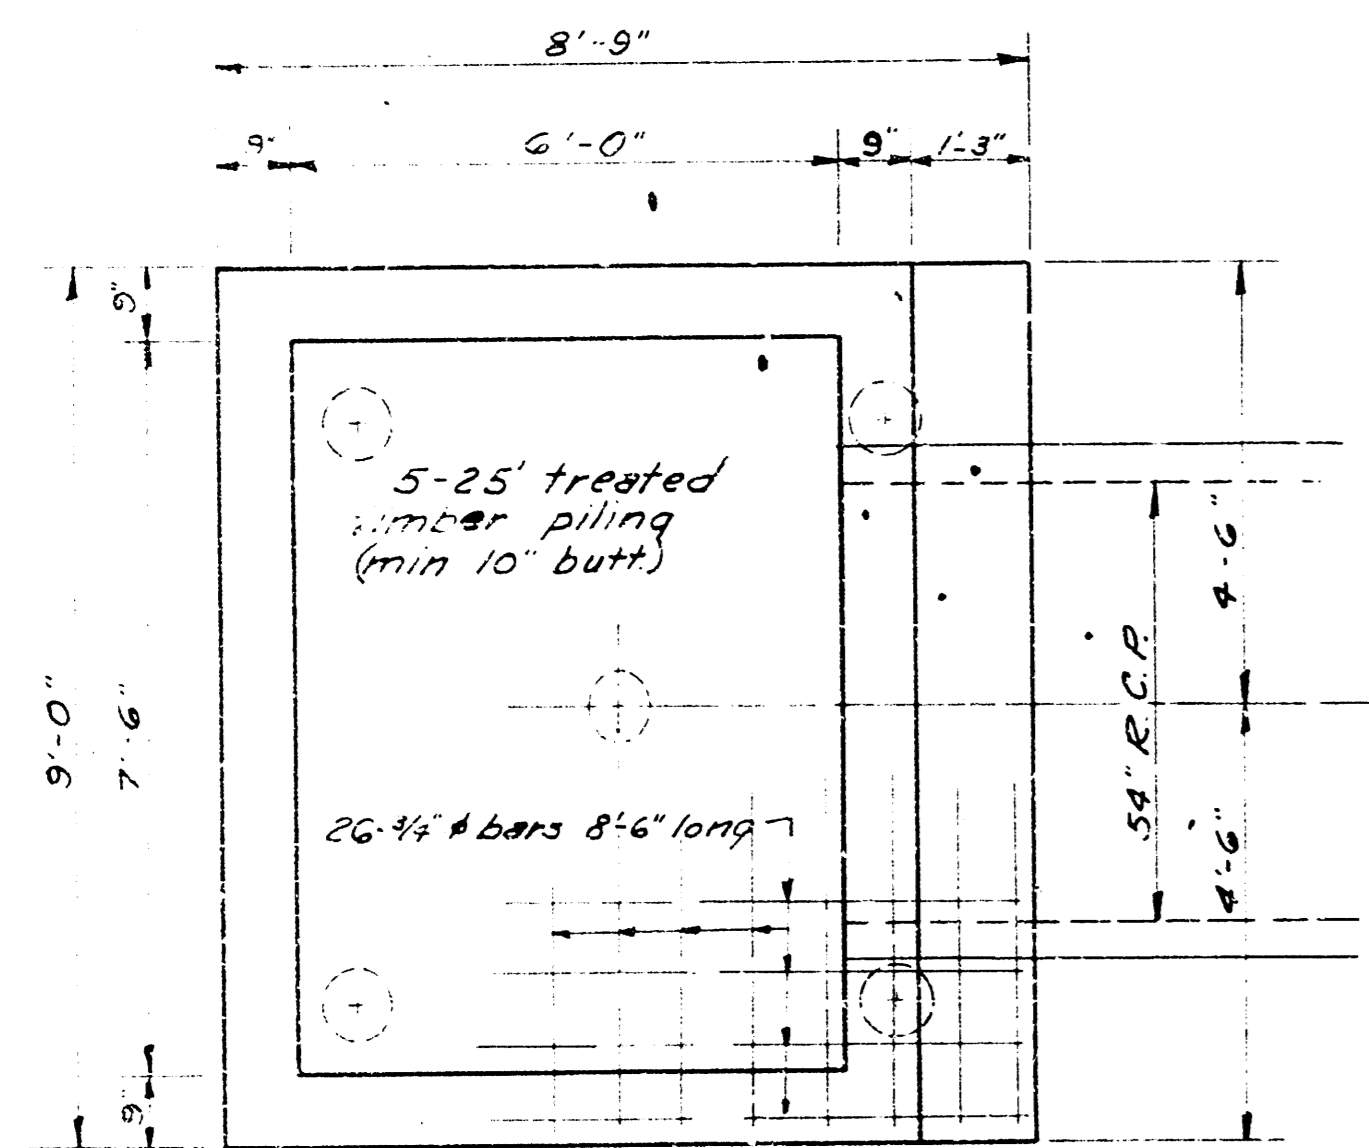


Concrete for structures shall contain not less than 165 barrels of cement per cubic yard. In no event shall the total water content exceed 6.25 gallons per sack. The mixture of fine and coarse aggregate shall be such as will produce a minimum density of the most workable structure.

In general pipes will enter and leave the manholes at various elevations. Wherever possible bond reinforcing bars around pipes (14" Diameter or less). Where pipes are large use diagonal bars as shown.



The floor of the manhole is to be shaped for flow and drainage. No deduction in concrete quantities shall be made for pipe openings. No addition in concrete quantities shall be made for shaping manhole floors. An internal vibrator shall be used for placing concrete.

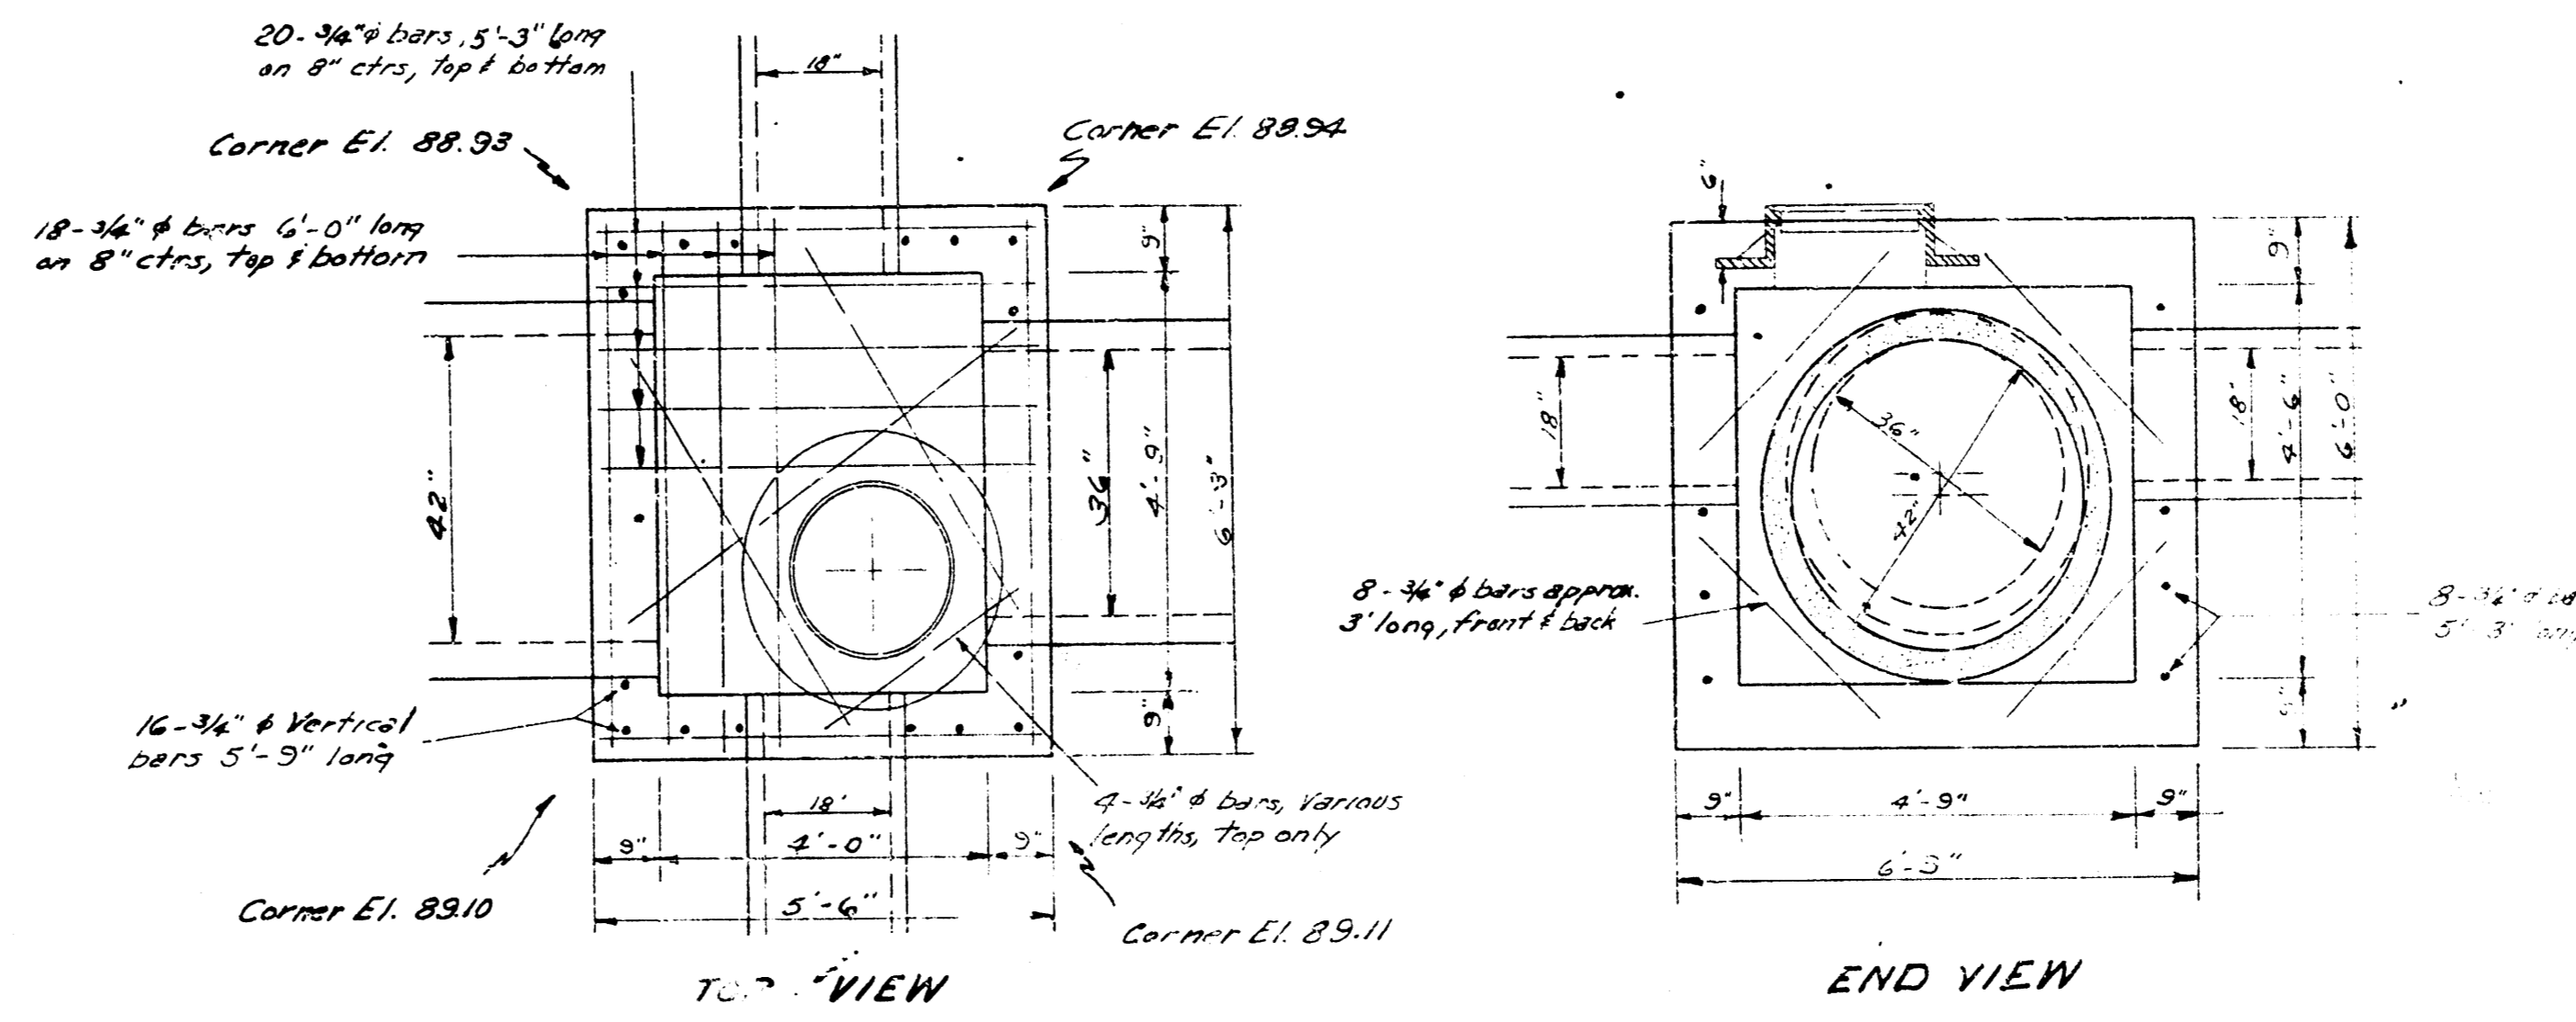


REINFORCED CONCRETE MANHOLE AT STATION 2+35.7

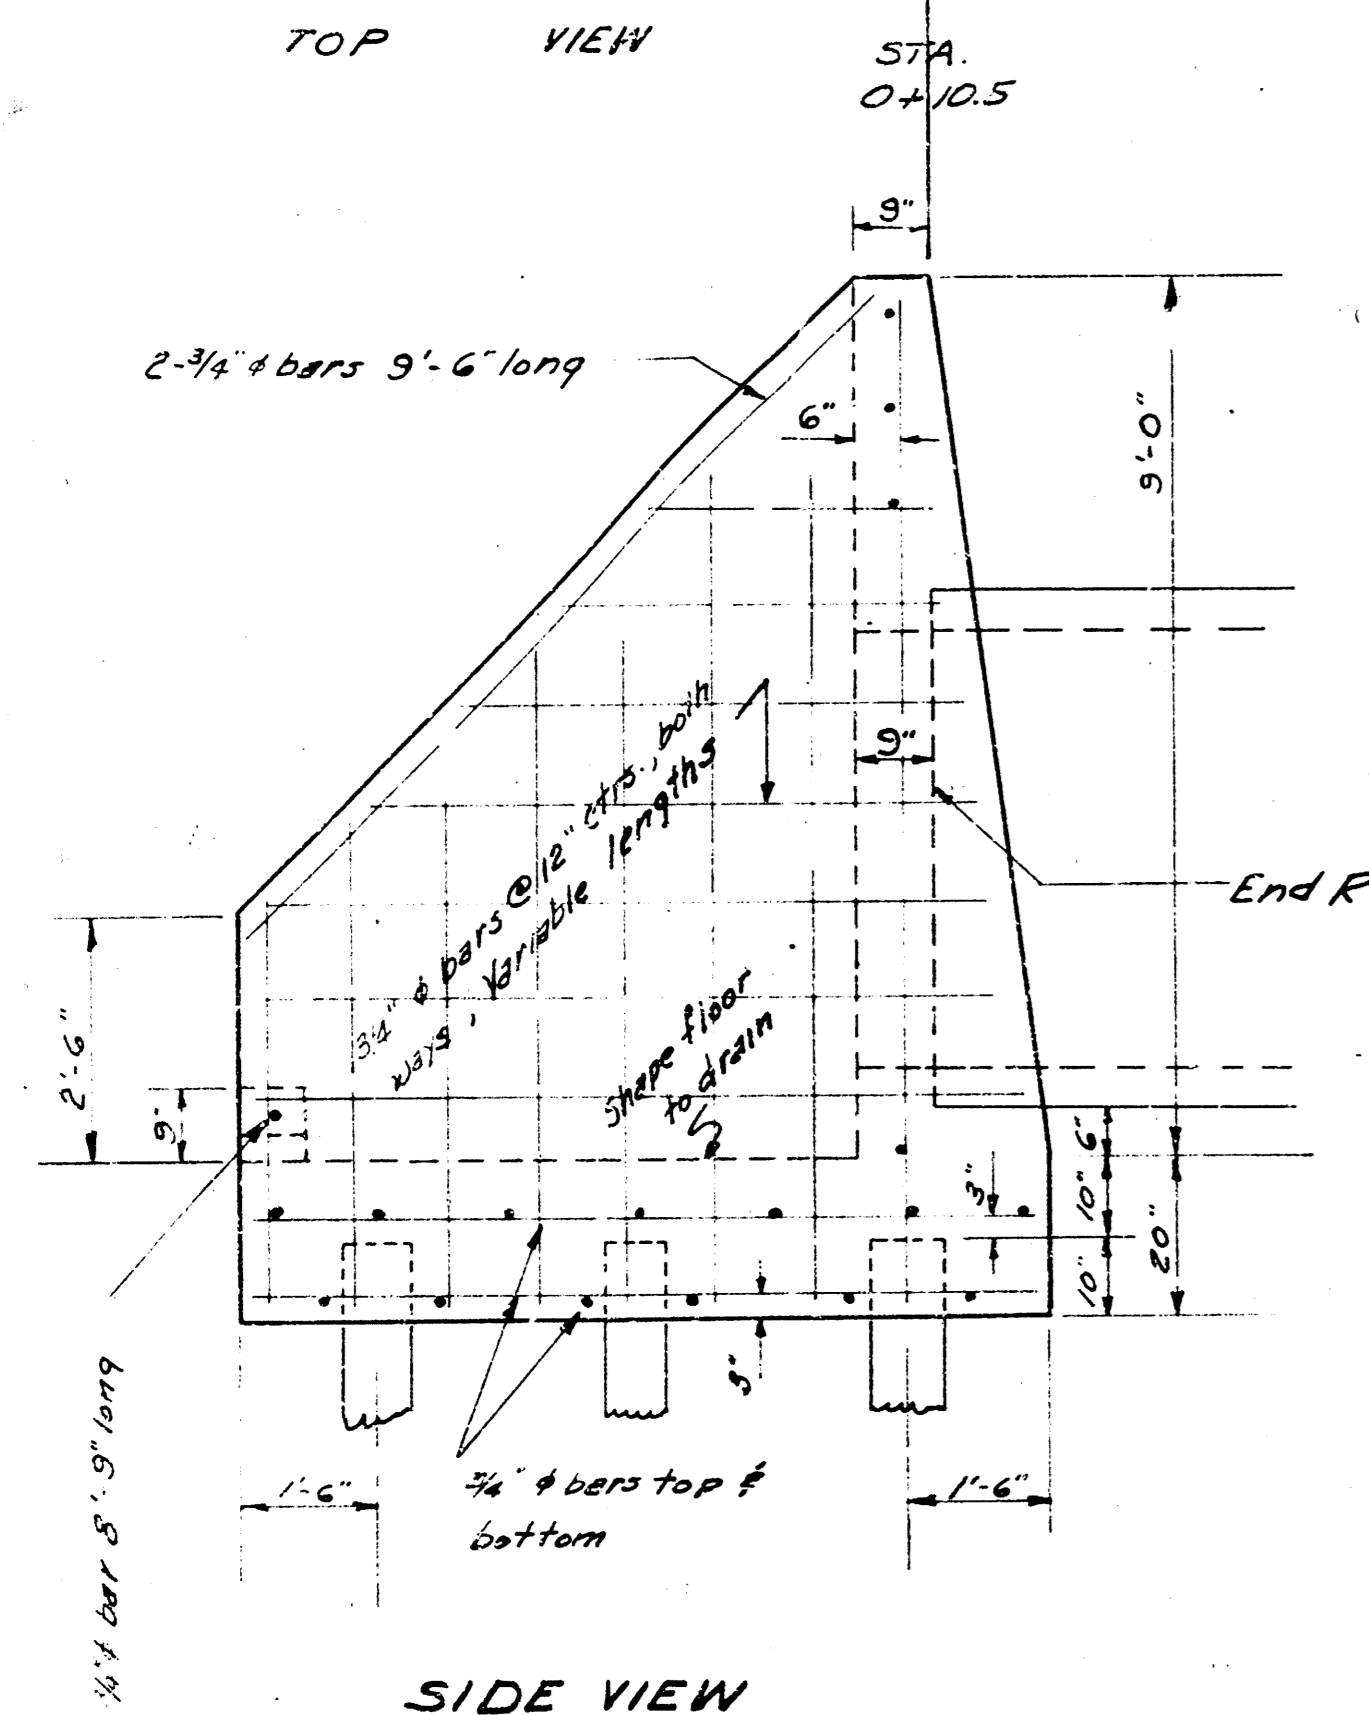


REINFORCED CONCRETE OUTFALL STRUCTURE
Scale 1/2" = 1'-0"

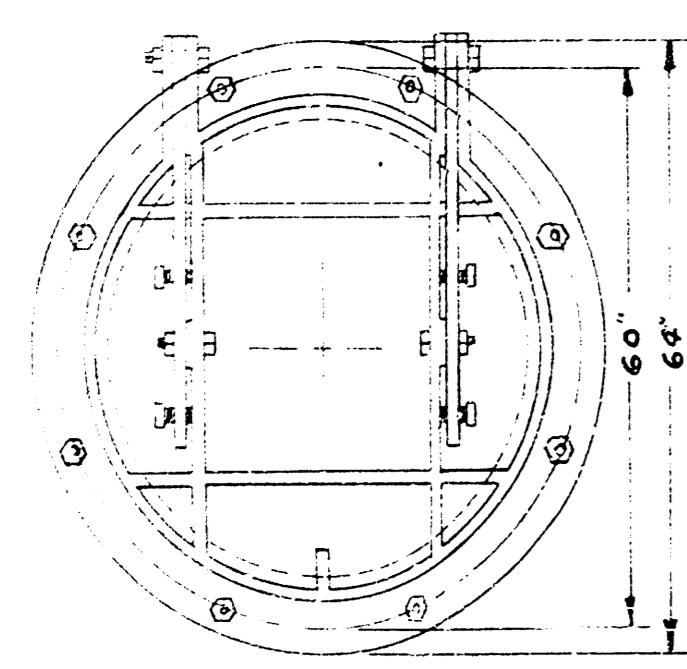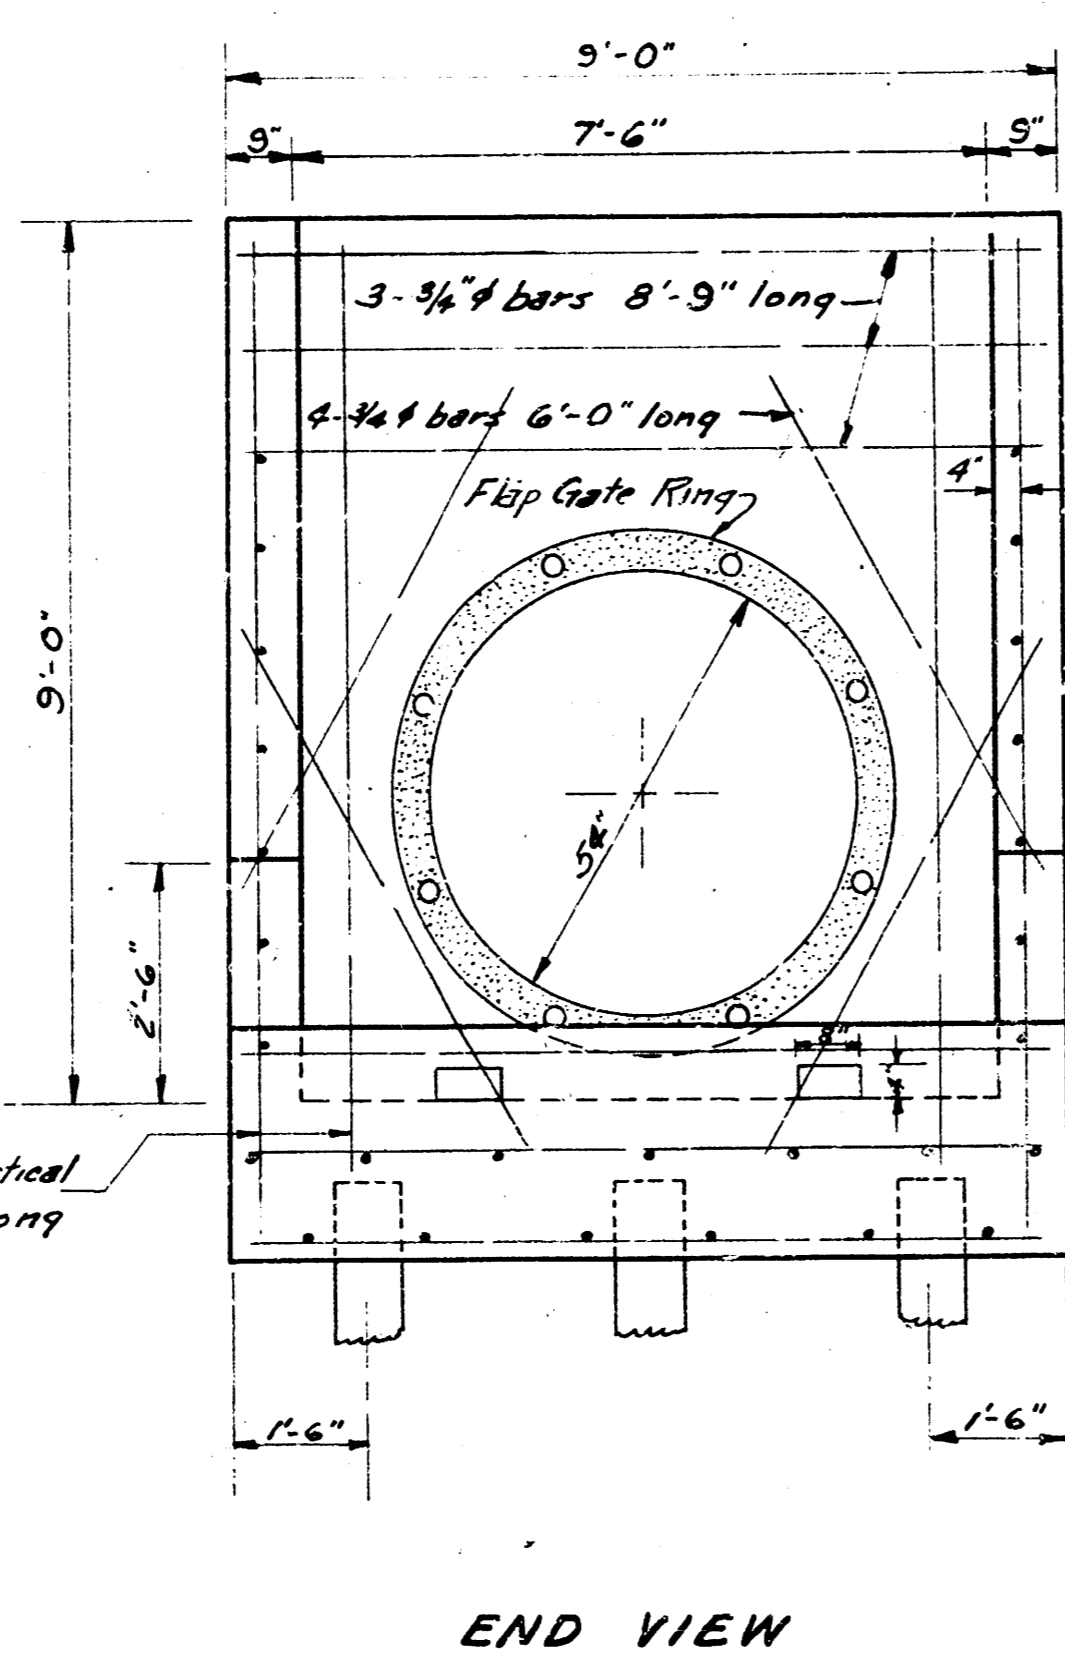


PEKRUl MODEL 16 AUTOMATIC FLAP GATE
No Scale

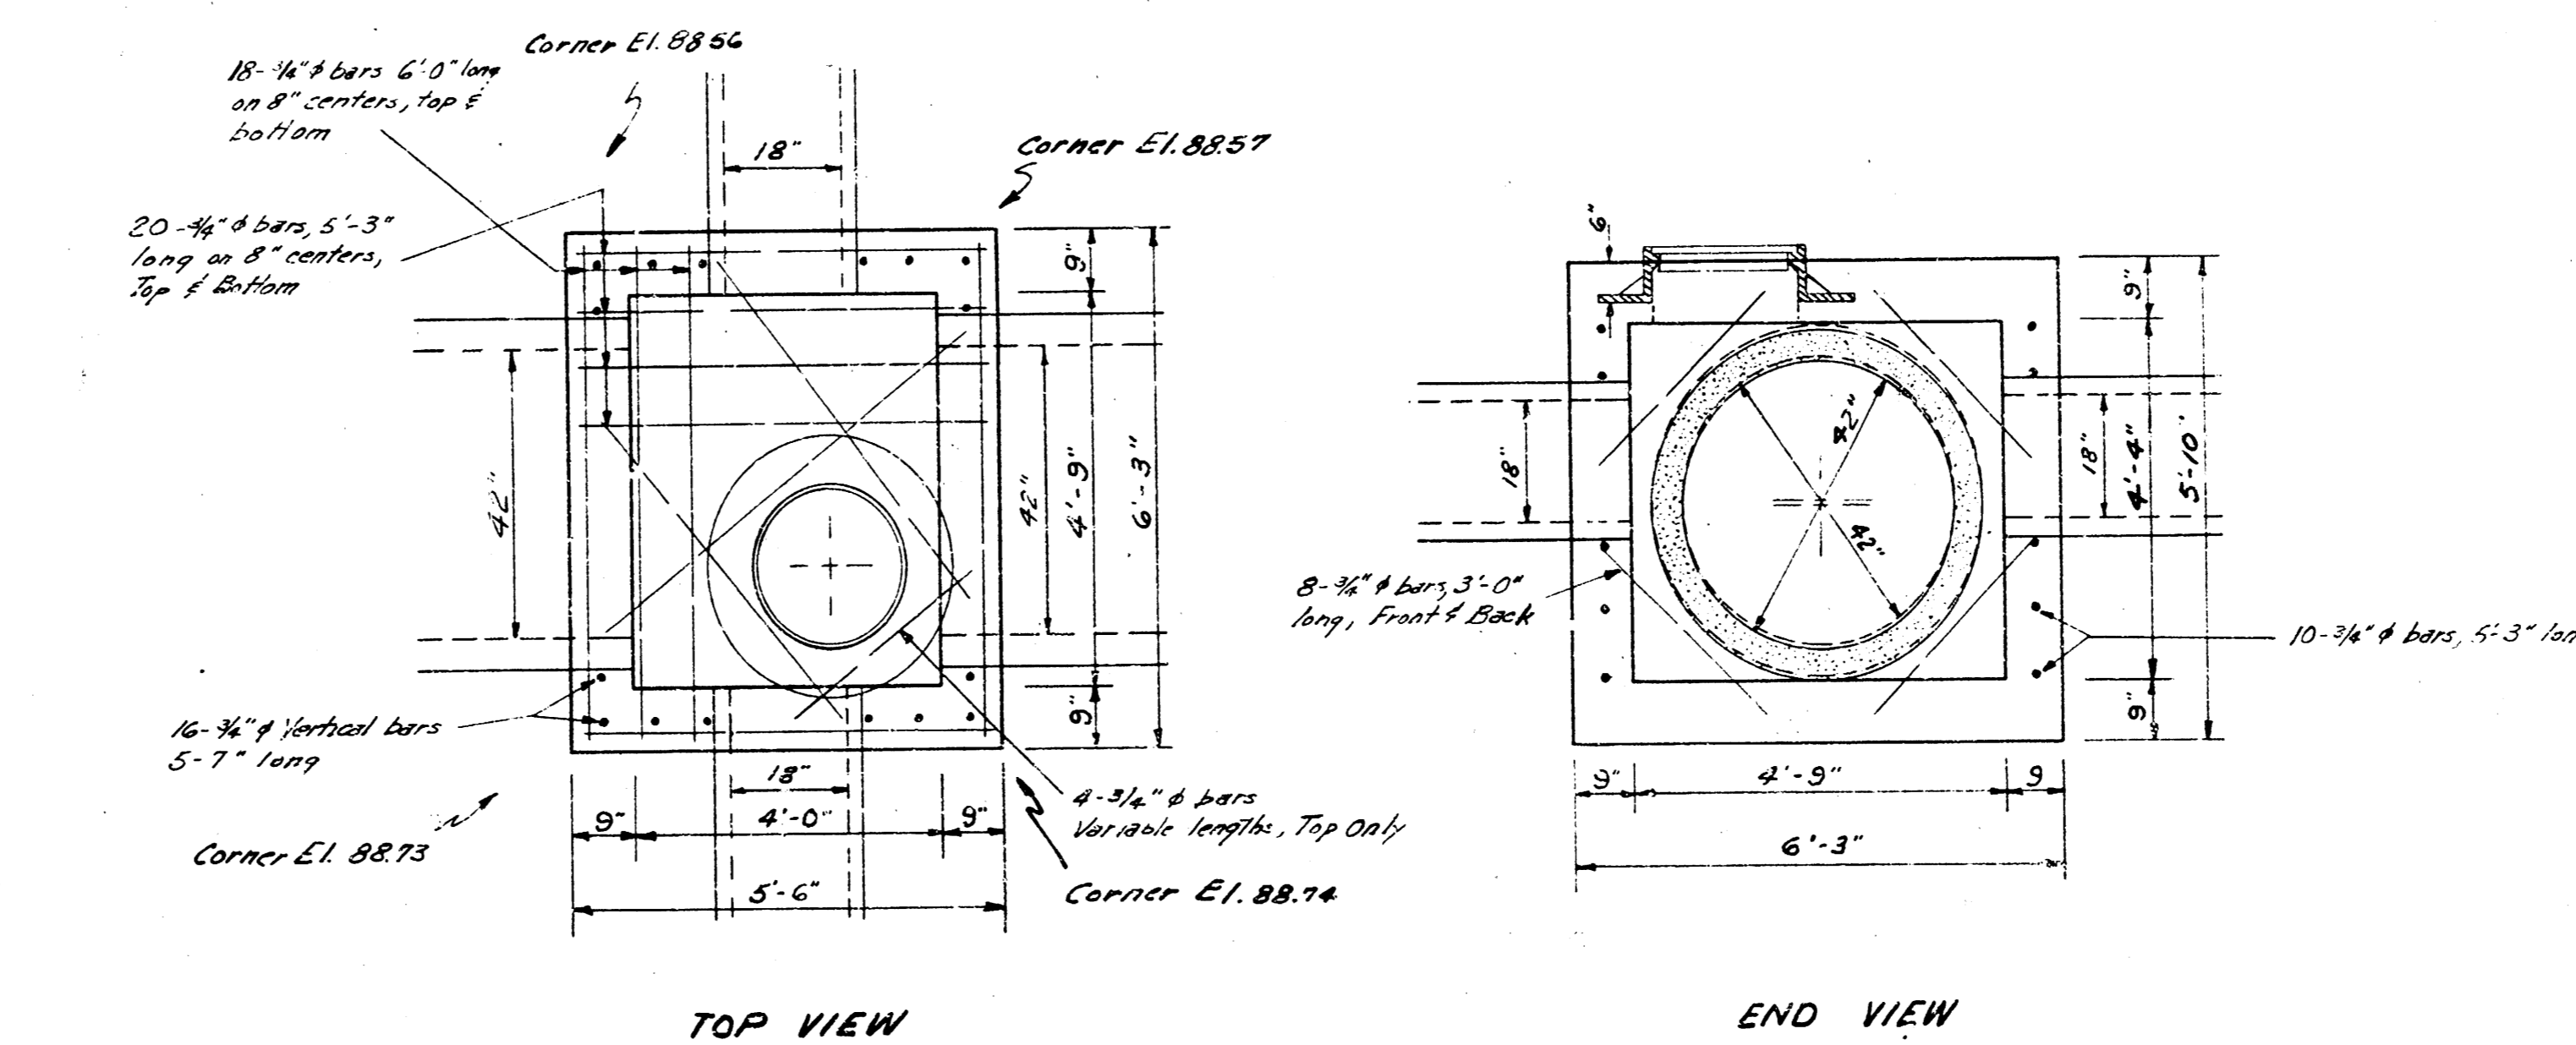

REINFORCED CONCRETE MANHOLE AT STATION 0+44.5

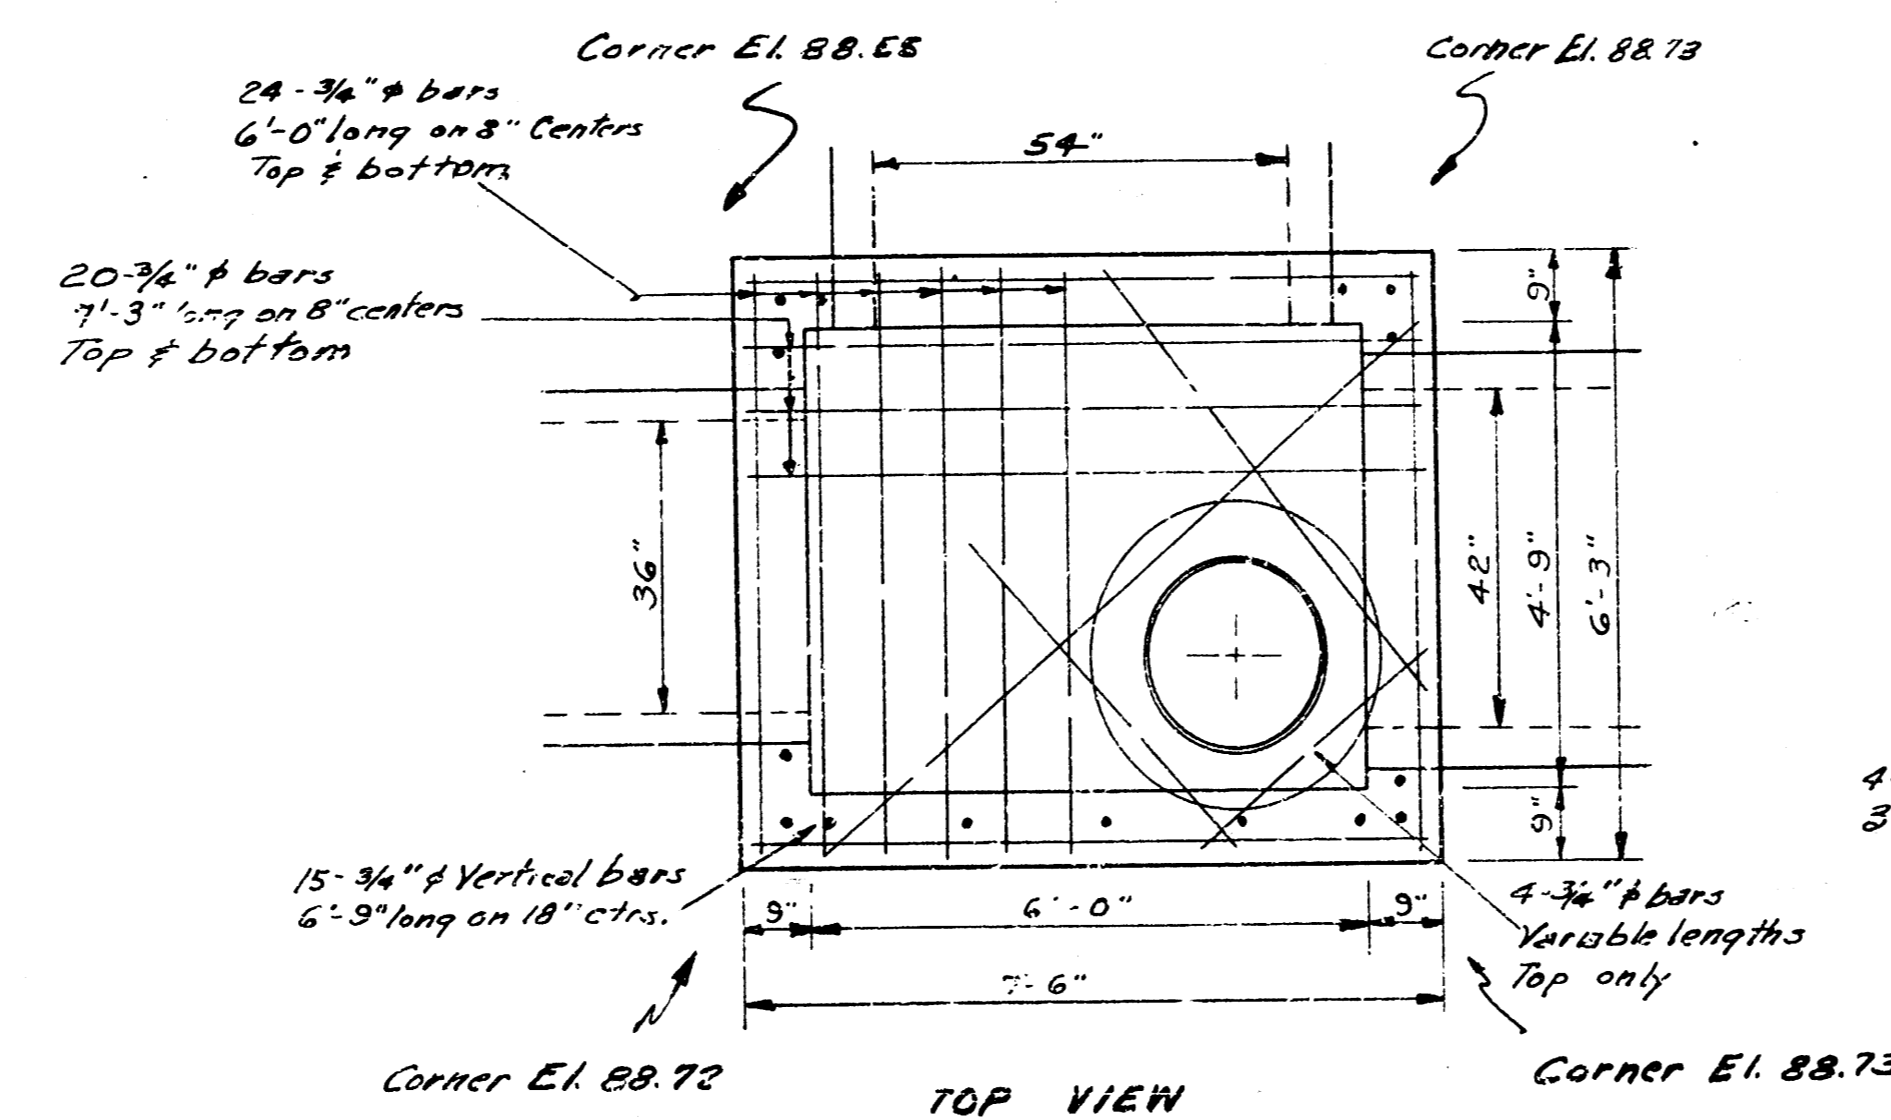

REINFORCED CONCRETE MANHOLE AT STATION 11+12

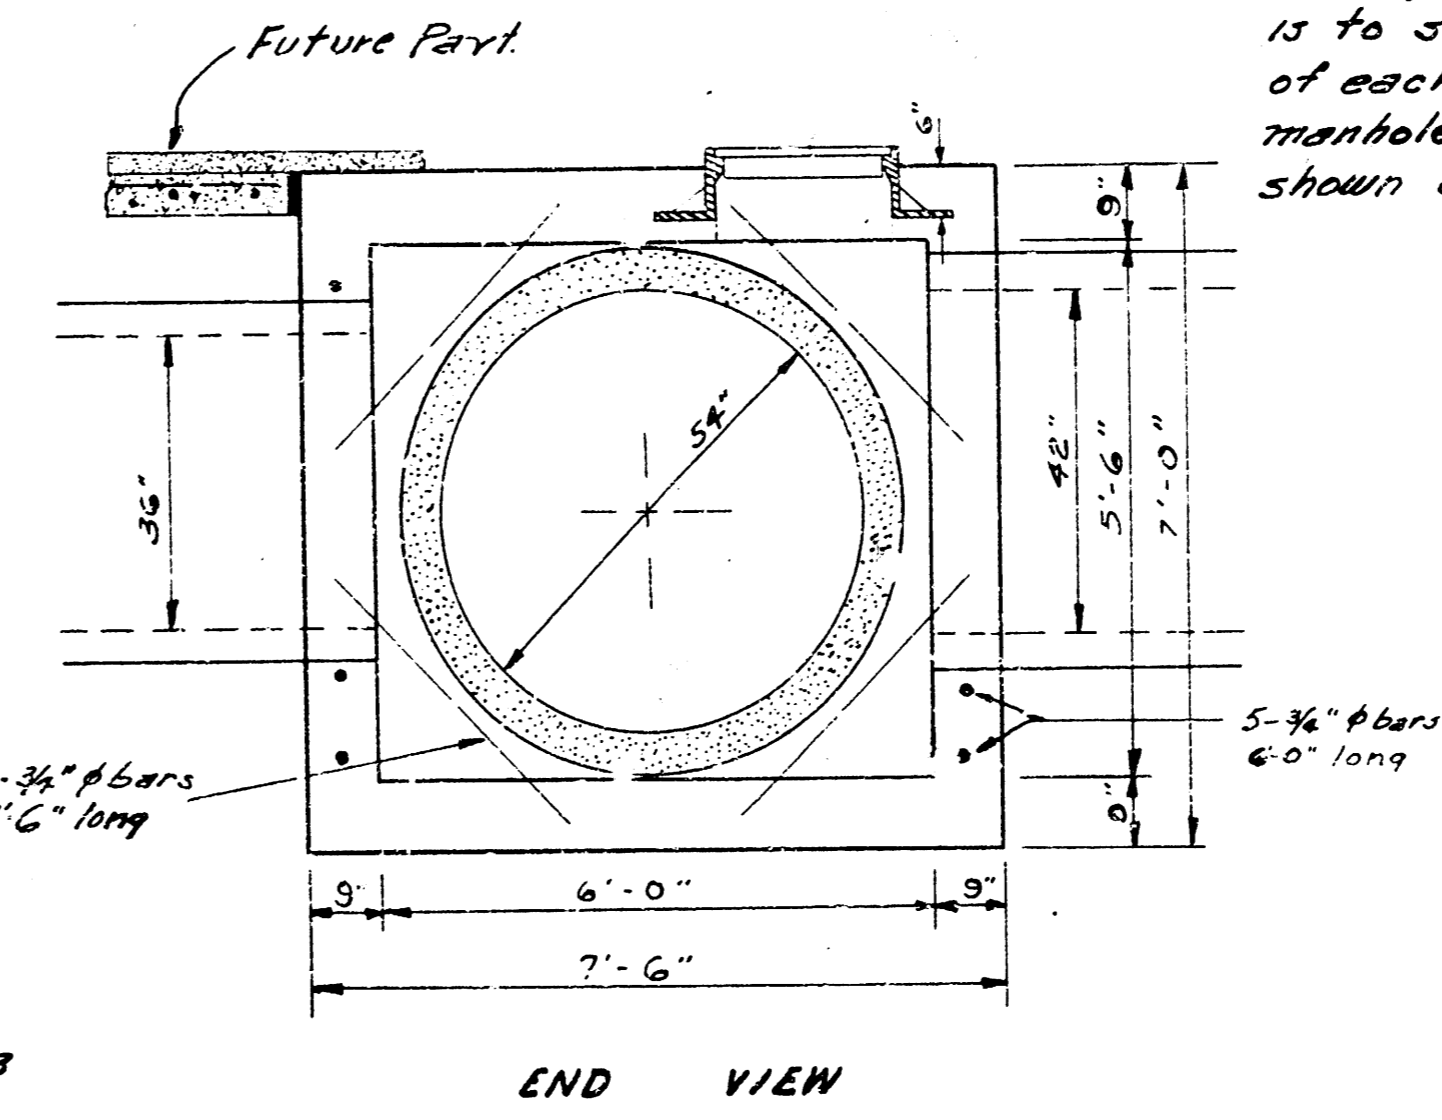

NOTE
The tops of the concrete manholes are to be the top of the base of future Asphaltic Concrete pavement. The excavation around all three concrete boxes is to be completely sand filled, flushed, and vibrated. The top of the box is to slope to fit the pavement crown. Elevations of each corner are given. Height of concrete manholes will vary one to two inches from that shown on detail.

STORM WATER SEWER No. 56
CITY OF WICHITA
B.E. SMITH CITY ENGINEER
Proj. No. C24-29