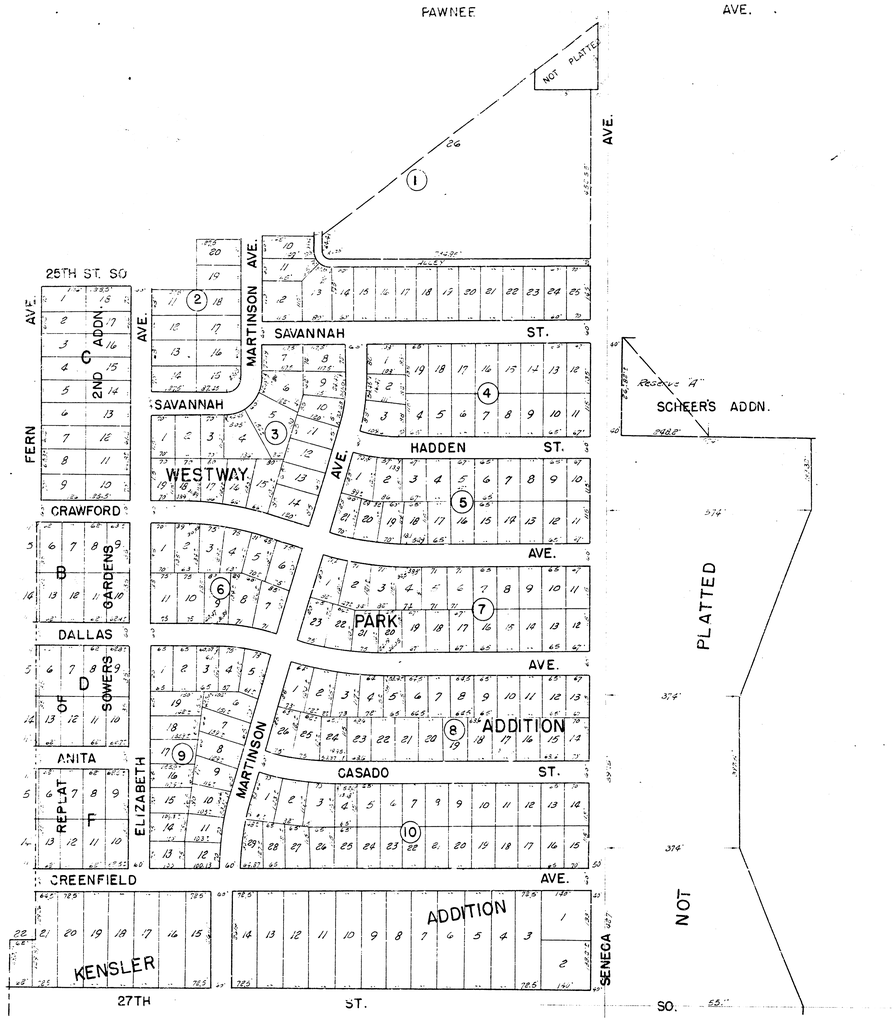

N

1" = 150'

BENEFIT DISTRICT MAP

STORM WATER SEWER NO. 61

CITY OF WICHITA, KANS.

B. E. SMITH — CITY ENGINEER

PROJECT NO. C 25-26

MARCH 1956

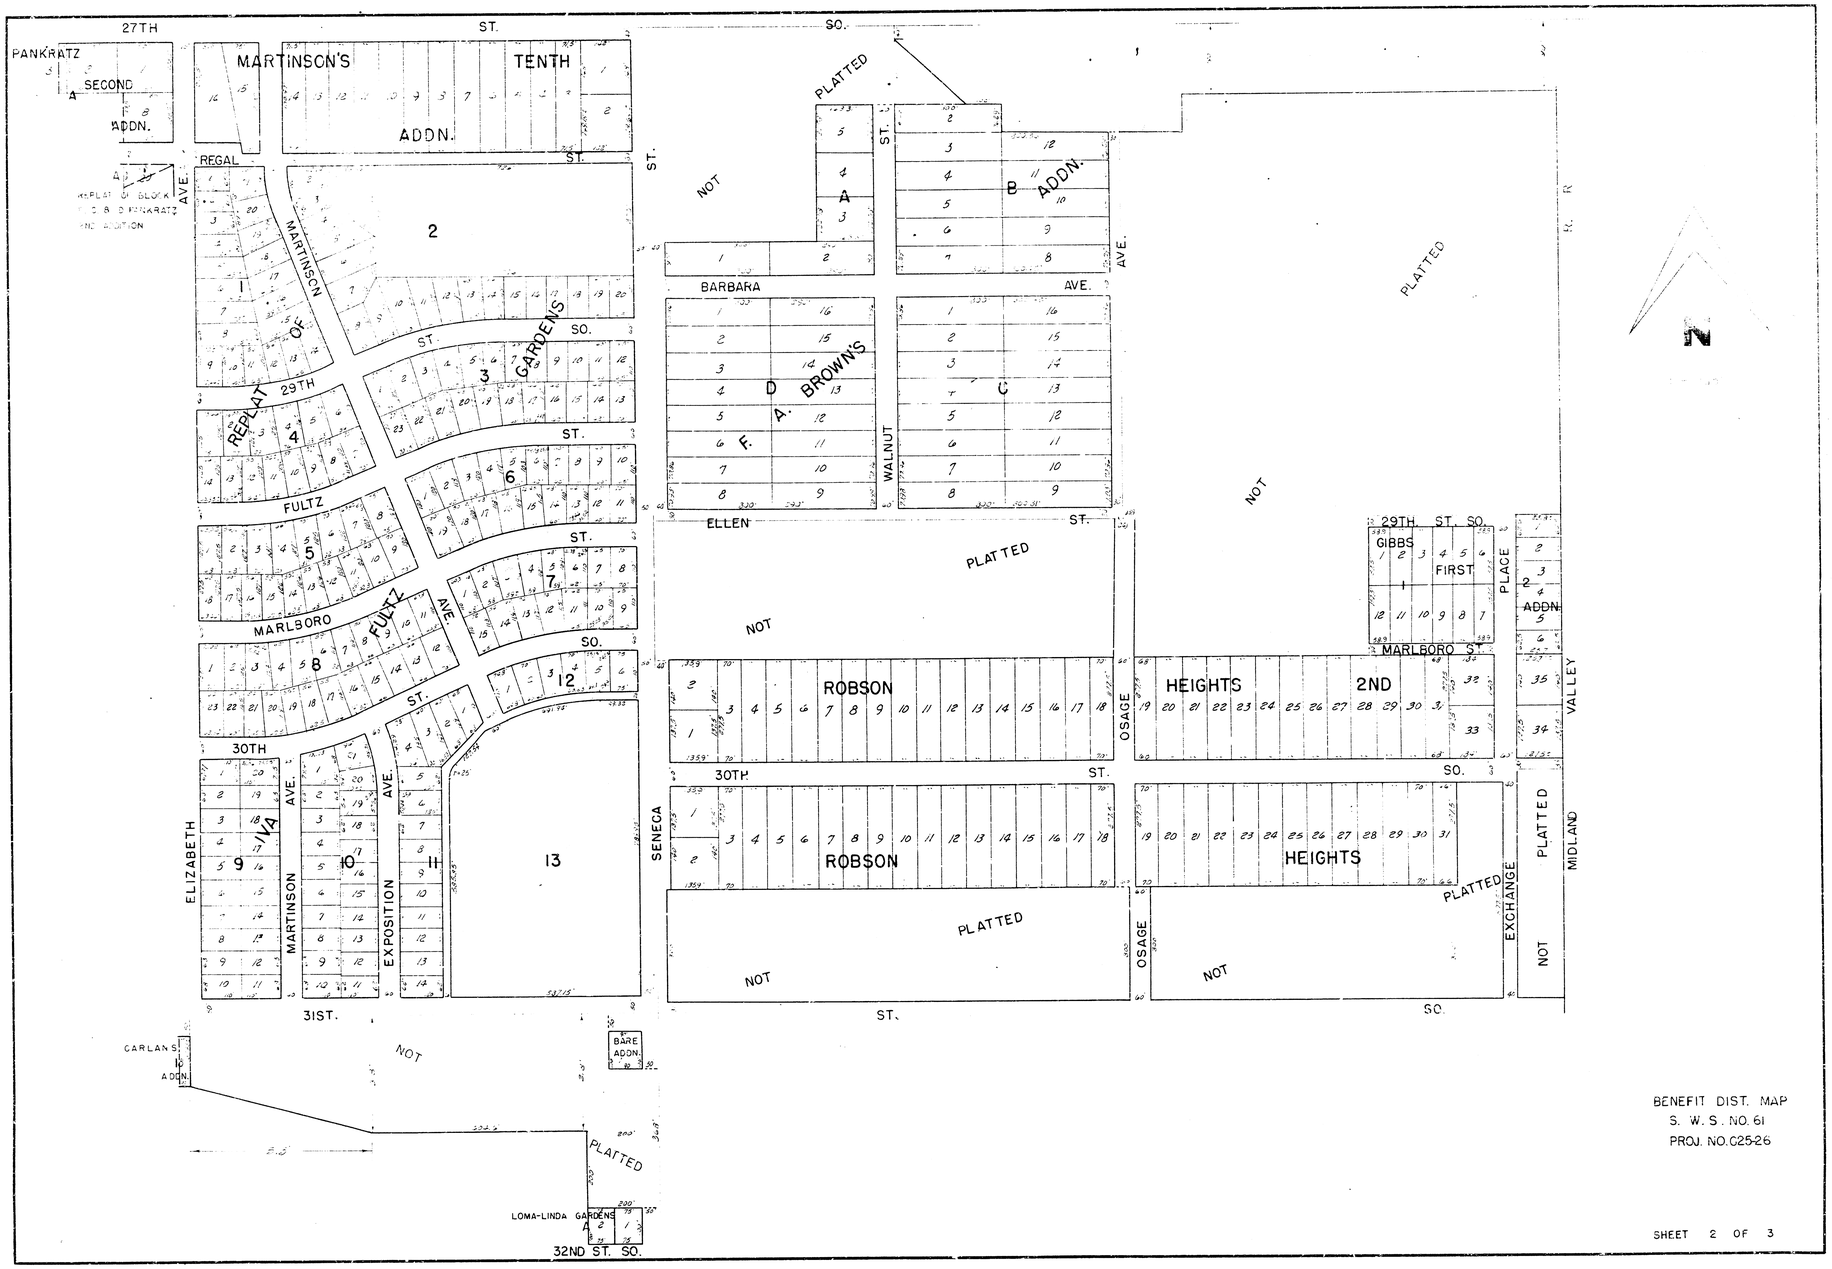

BENEFIT DIST. MAP
S. W. S. NO. 61
PROJ. NO. C25-26

31IST. ST. SO. ST. SO.

RESERVE "A" ADDN. CUMLEY'S ADDN. SLEASE 2ND ADDN. W. O. O. D. ADDN. BURNS ADDN. OAK ST. WRIGHTS ADDN. NOT PLATTED SILVER ST. SYCAMORE AVE. A. G. JONES ADDN. BENTON ST. PATTERSON ST. LOUIS ST. PALISADE AVE. PLATTED AVE. WACO ST. PATTERSON AVE. ROE ADDITION

32ND ST. SO. 32ND ST. 32ND ST. SO.

NOT PLATTED

33RD. 33RD ST. SO. 33RD ST. SO.

NOT PLATTED

ENTERPRISE 2ND ADDN.

ENTERPRISE ADDN.

RICHARDSON-DOWEN ADDN. PINKERTON ADDN.

RECTORS ACRES

SENECA ST. WALNUT DR. SOUTHWOOD CT. SOUTHWOOD DR. HANDLEY ST. OSAGE ST. PLATTED NOT PLATTED

34TH ST. SO. 34TH ST. SO.

35TH ST. SO. 35TH ST. SO. 35TH ST. SO.

DENWAY ST. 6TH. CARLYLE ST.

VALLEY ST. MIDLAND ST. GOLD ST. WICHITA ST.

1" = 150'

BENEFIT DIST MAP
S. W. S. NO. 61
PROJ. NO. C25-26

SHEET 3 OF 3

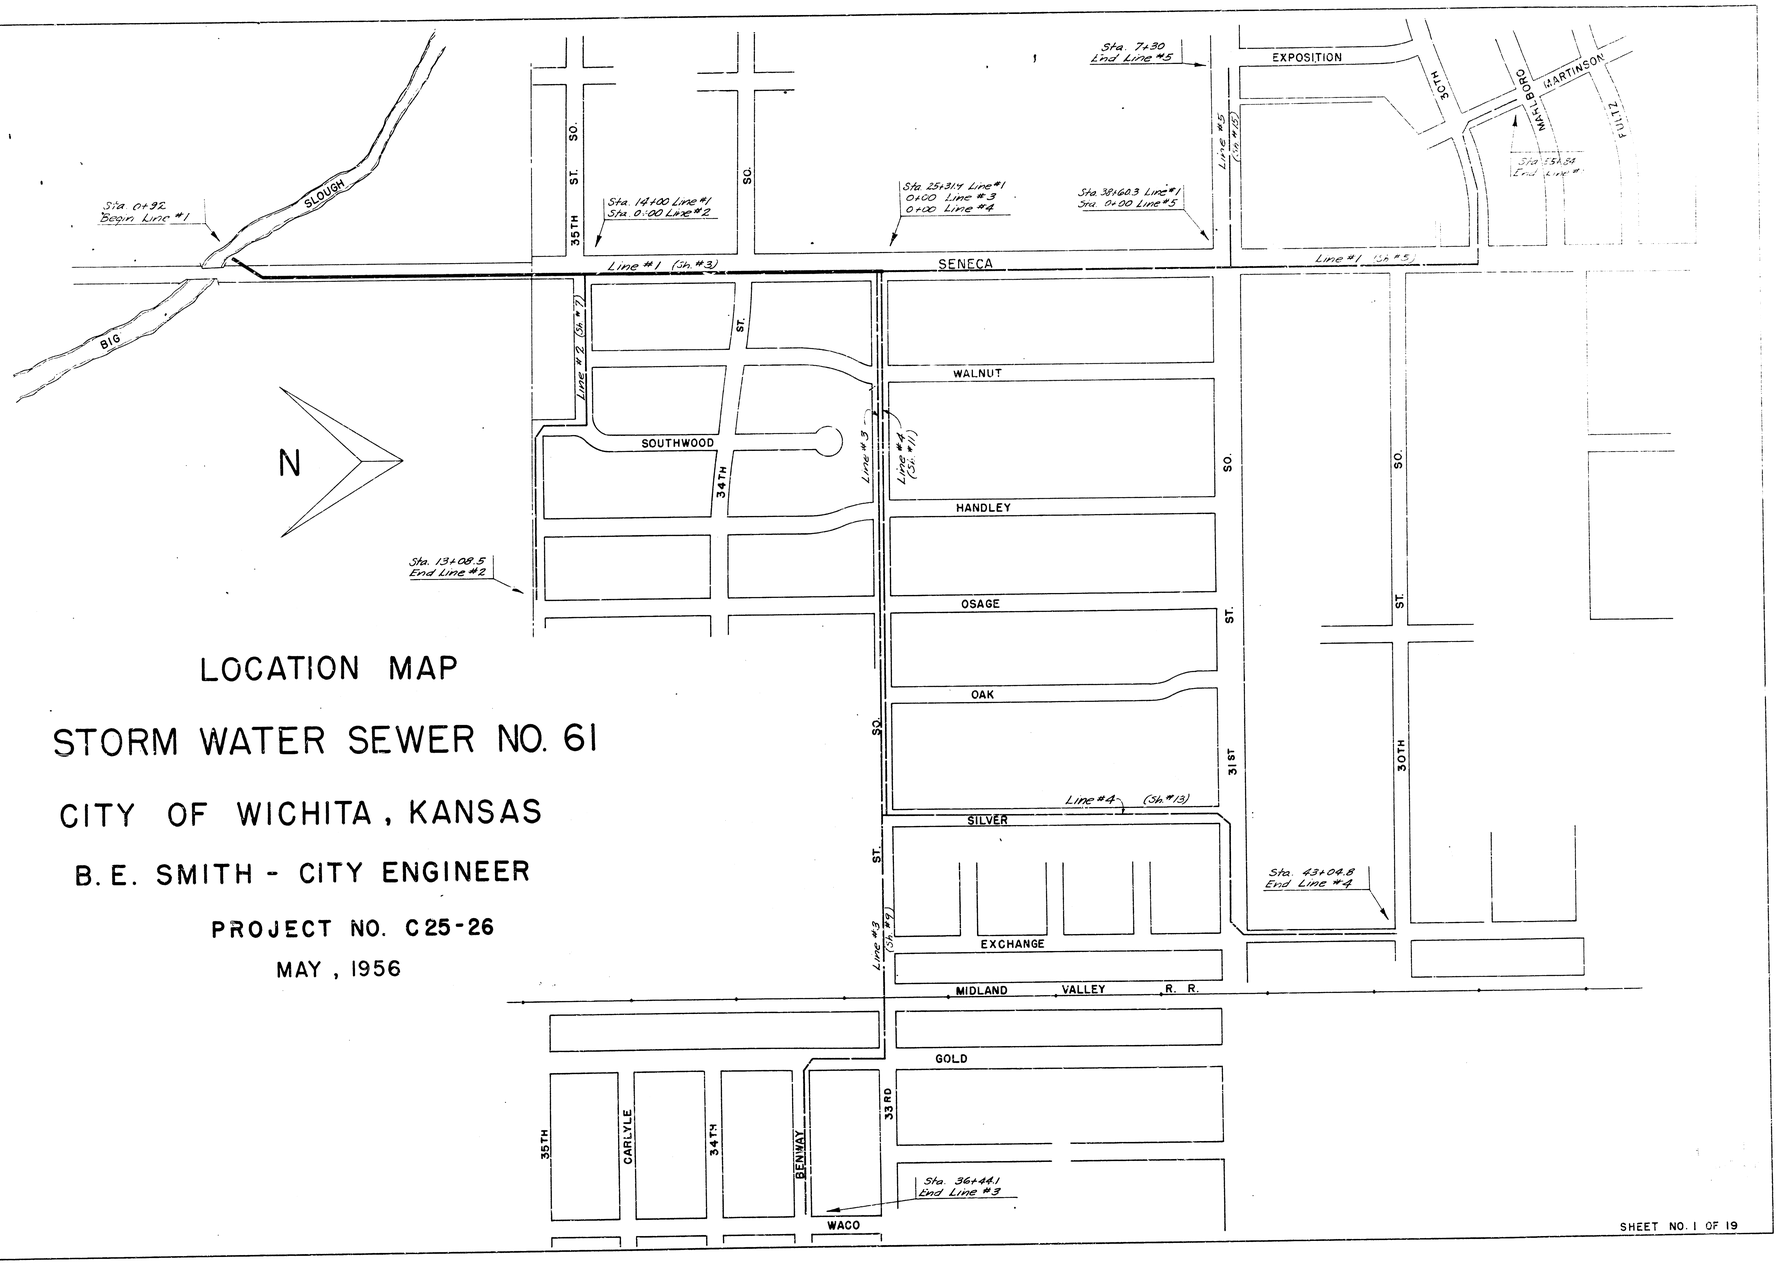

LOCATION MAP

STORM WATER SEWER NO. 61

CITY OF WICHITA, KANSAS

B. E. SMITH - CITY ENGINEER

PROJECT NO. C25-26

MAY, 1956

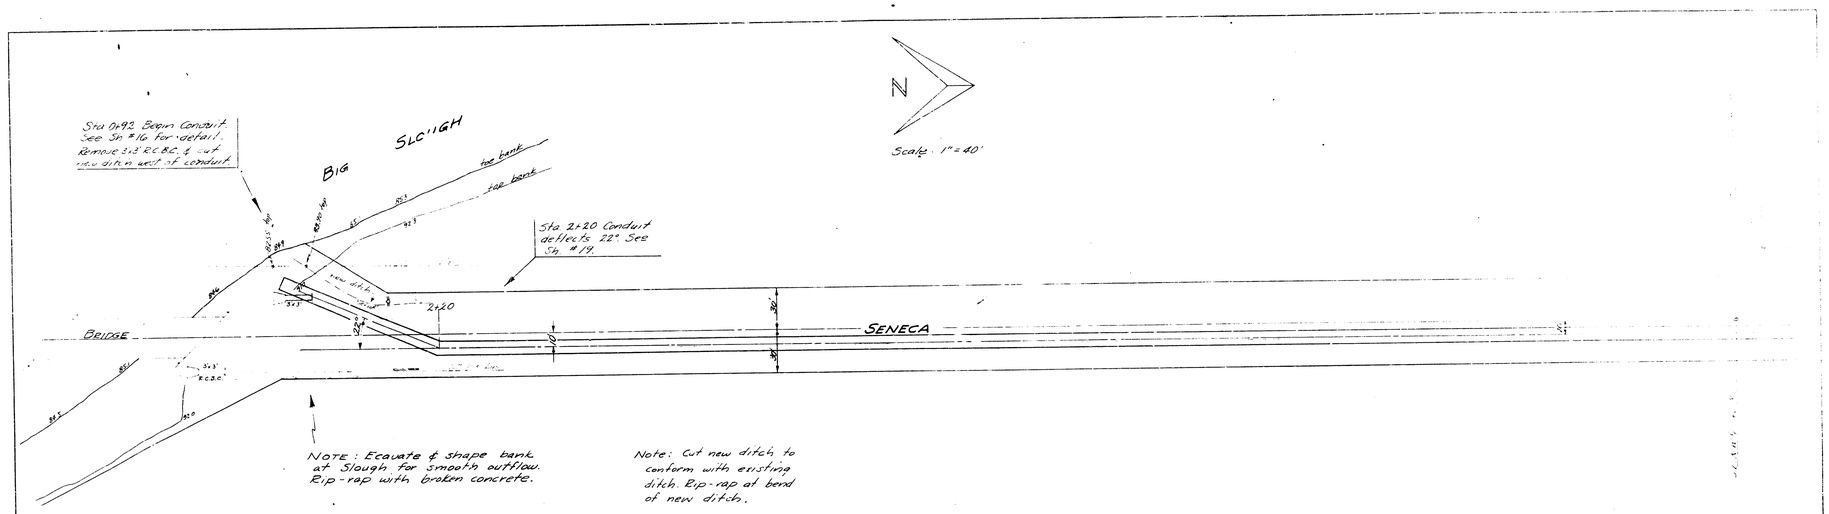

NOTE: Sand fill is to be used where excavated material is unsuitable for backfill. Bid price of sand fill is to include cost of flushing ditch where sand fill is used. Lin ft. of flushing will be paid where excavated material is used & flushed.

Note to Field Engr:
Measure and record all removal on job.
Take ties to all monuments and irons which may be disturbed and replace same.

B.M. 92.669 'x' on S. Headwall Conc. Culvt N.E. Cor. Bridge & Slough & Seneca

B.M. 91.647 Step bench L.S. M.L.P. 1st N. of 35th So. W.S. Seneca

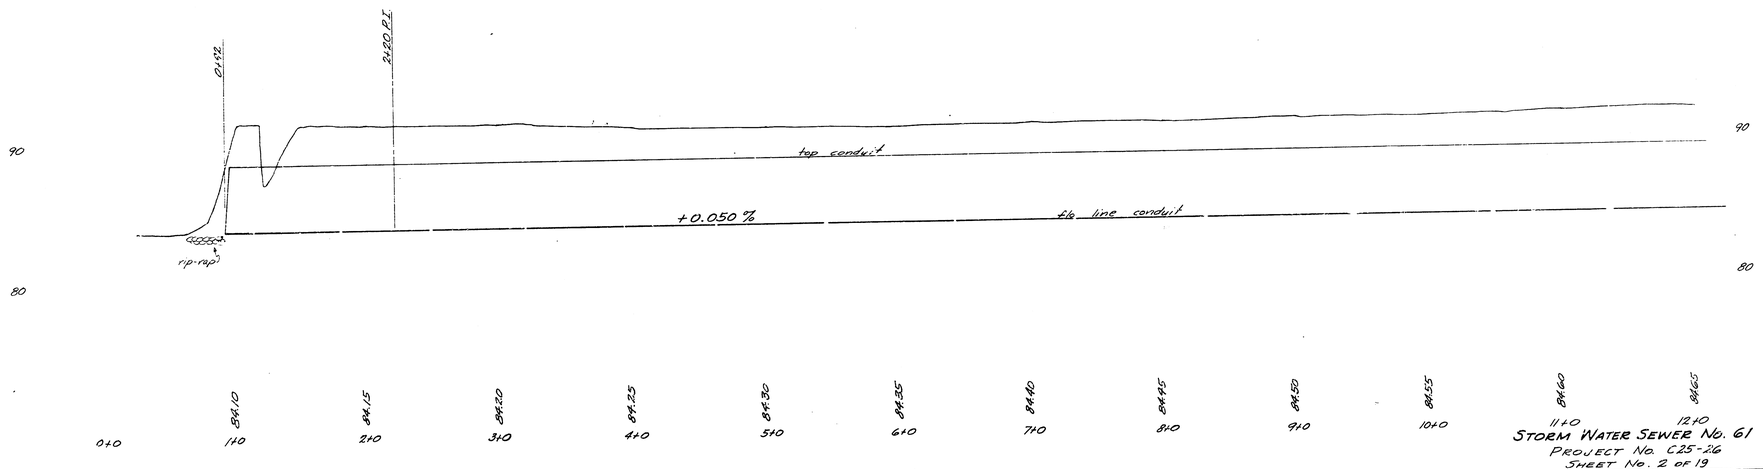

STORM WATER SEWER No. 61
PROJECT No. C25-26
SHEET No. 2 OF 19

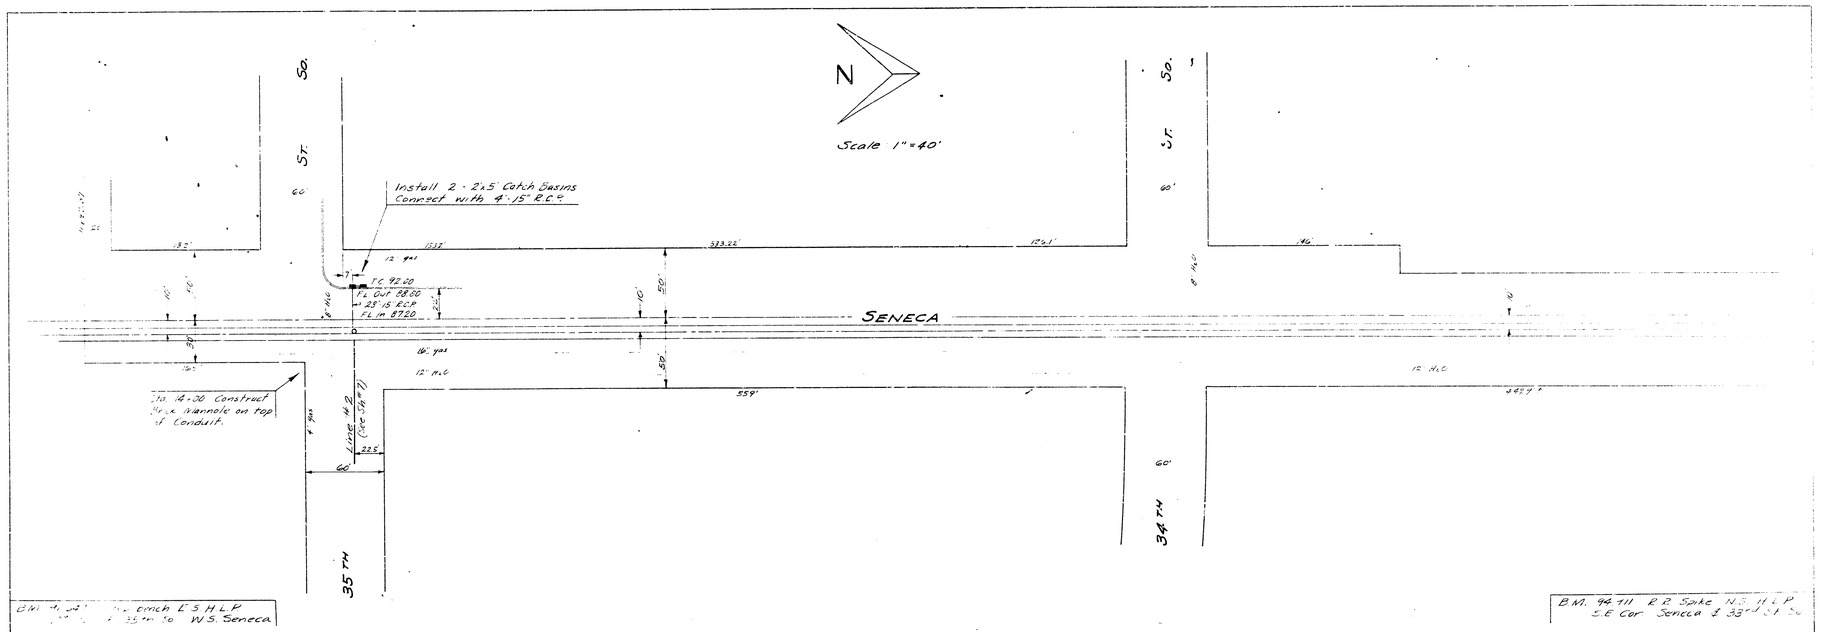

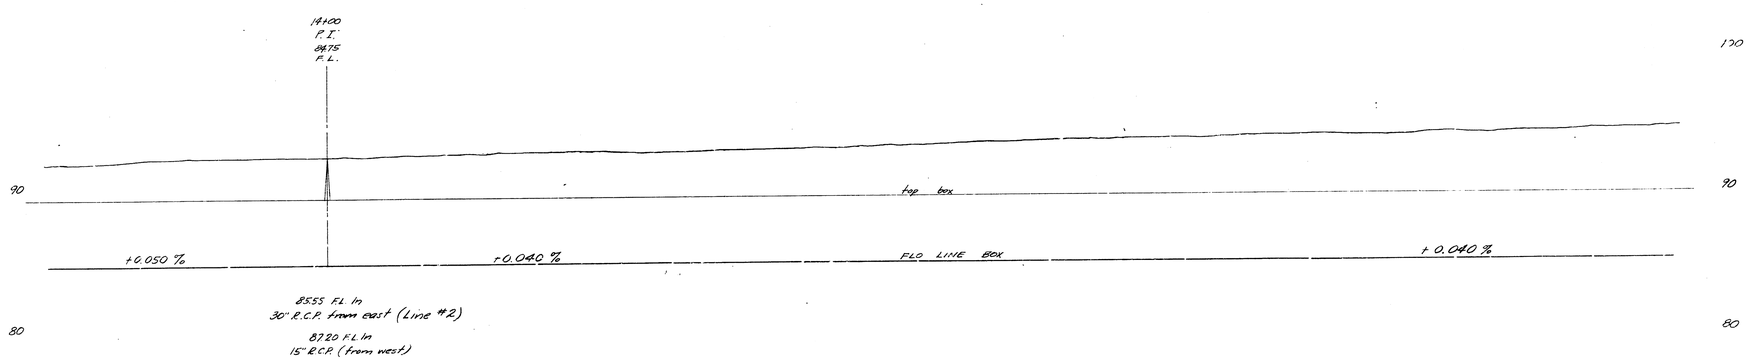

STORM WATER SEWER NO. 61
PROJECT NO. C25-26
SHEET NO. 3 OF 19

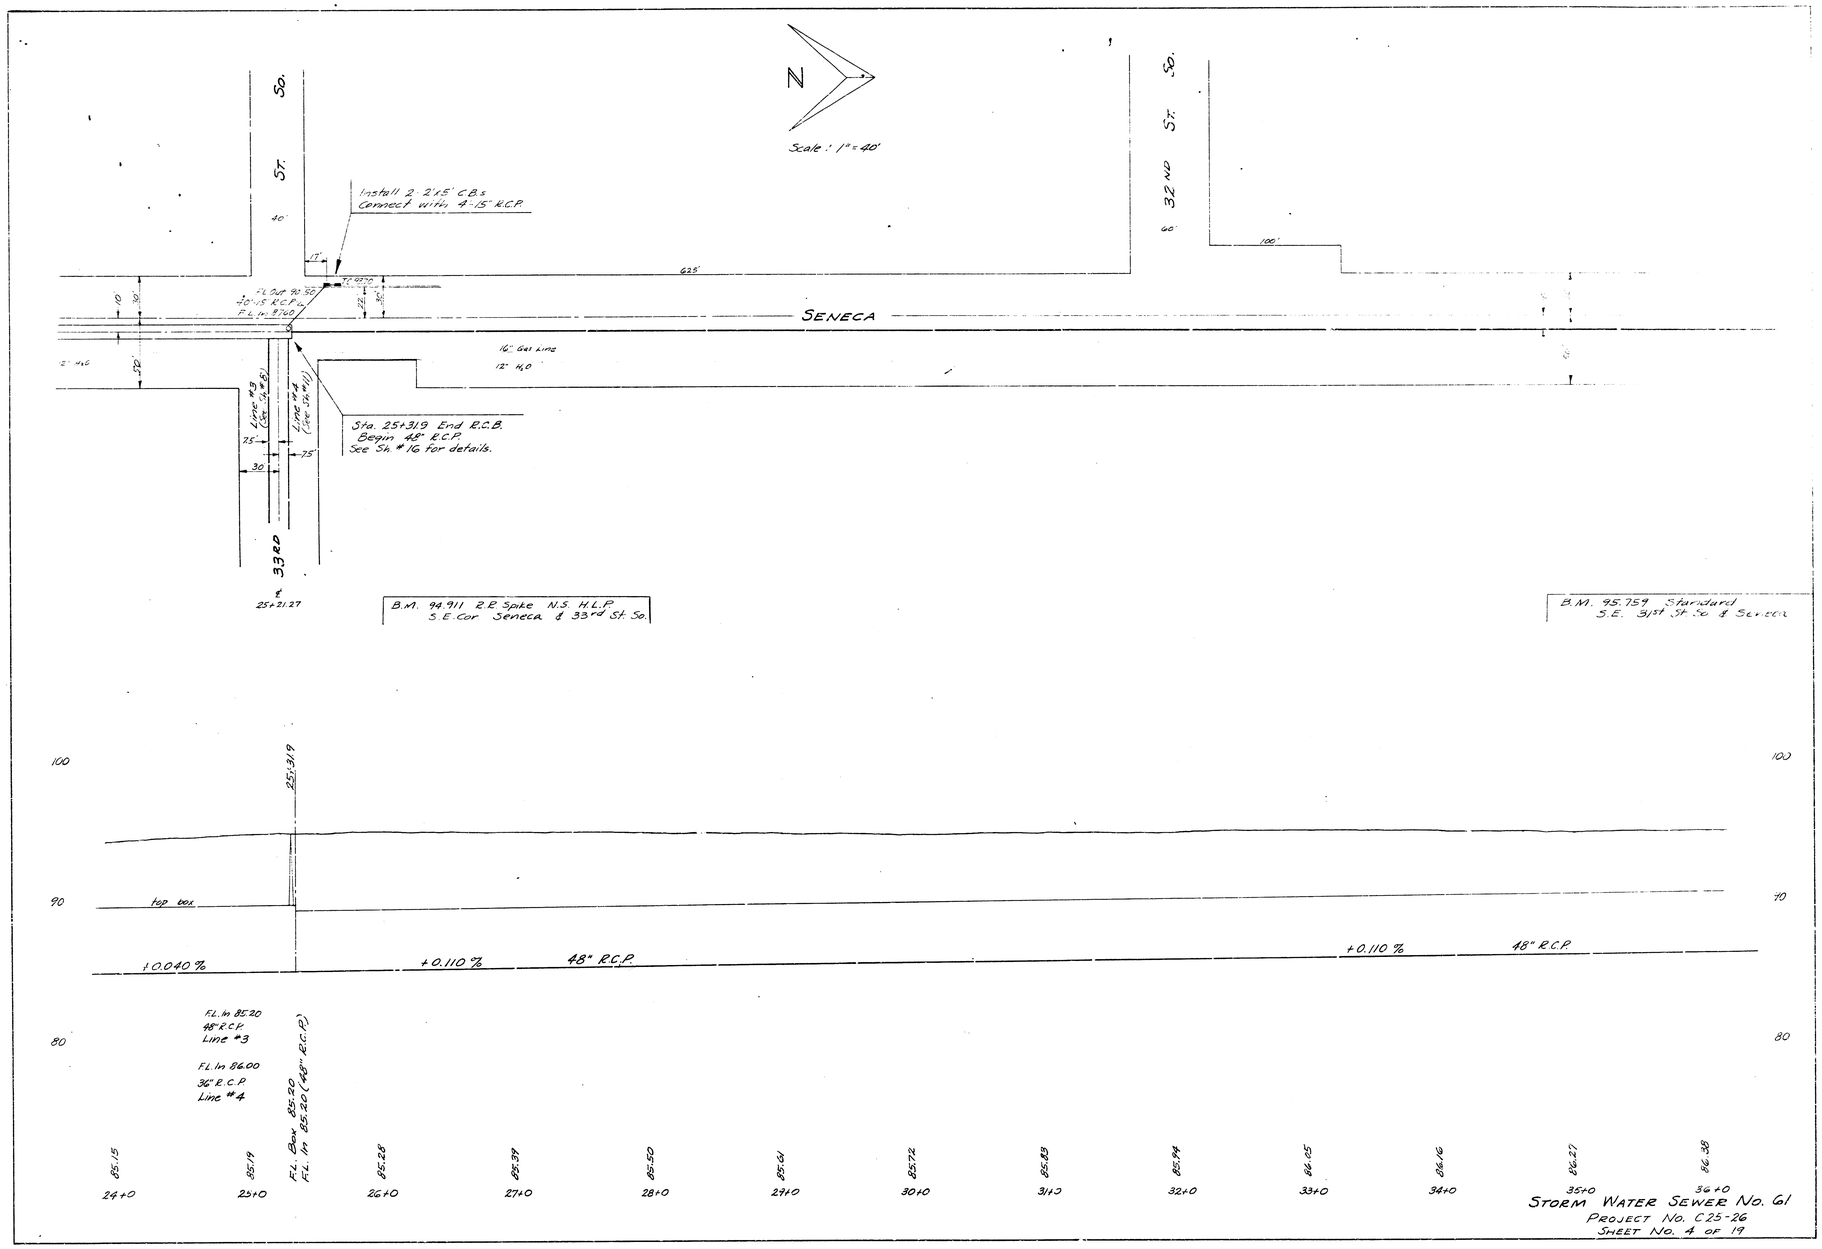

STORM WATER SEWER No. 61

PROJECT No. C25-26

SHEET No. 4 OF 19

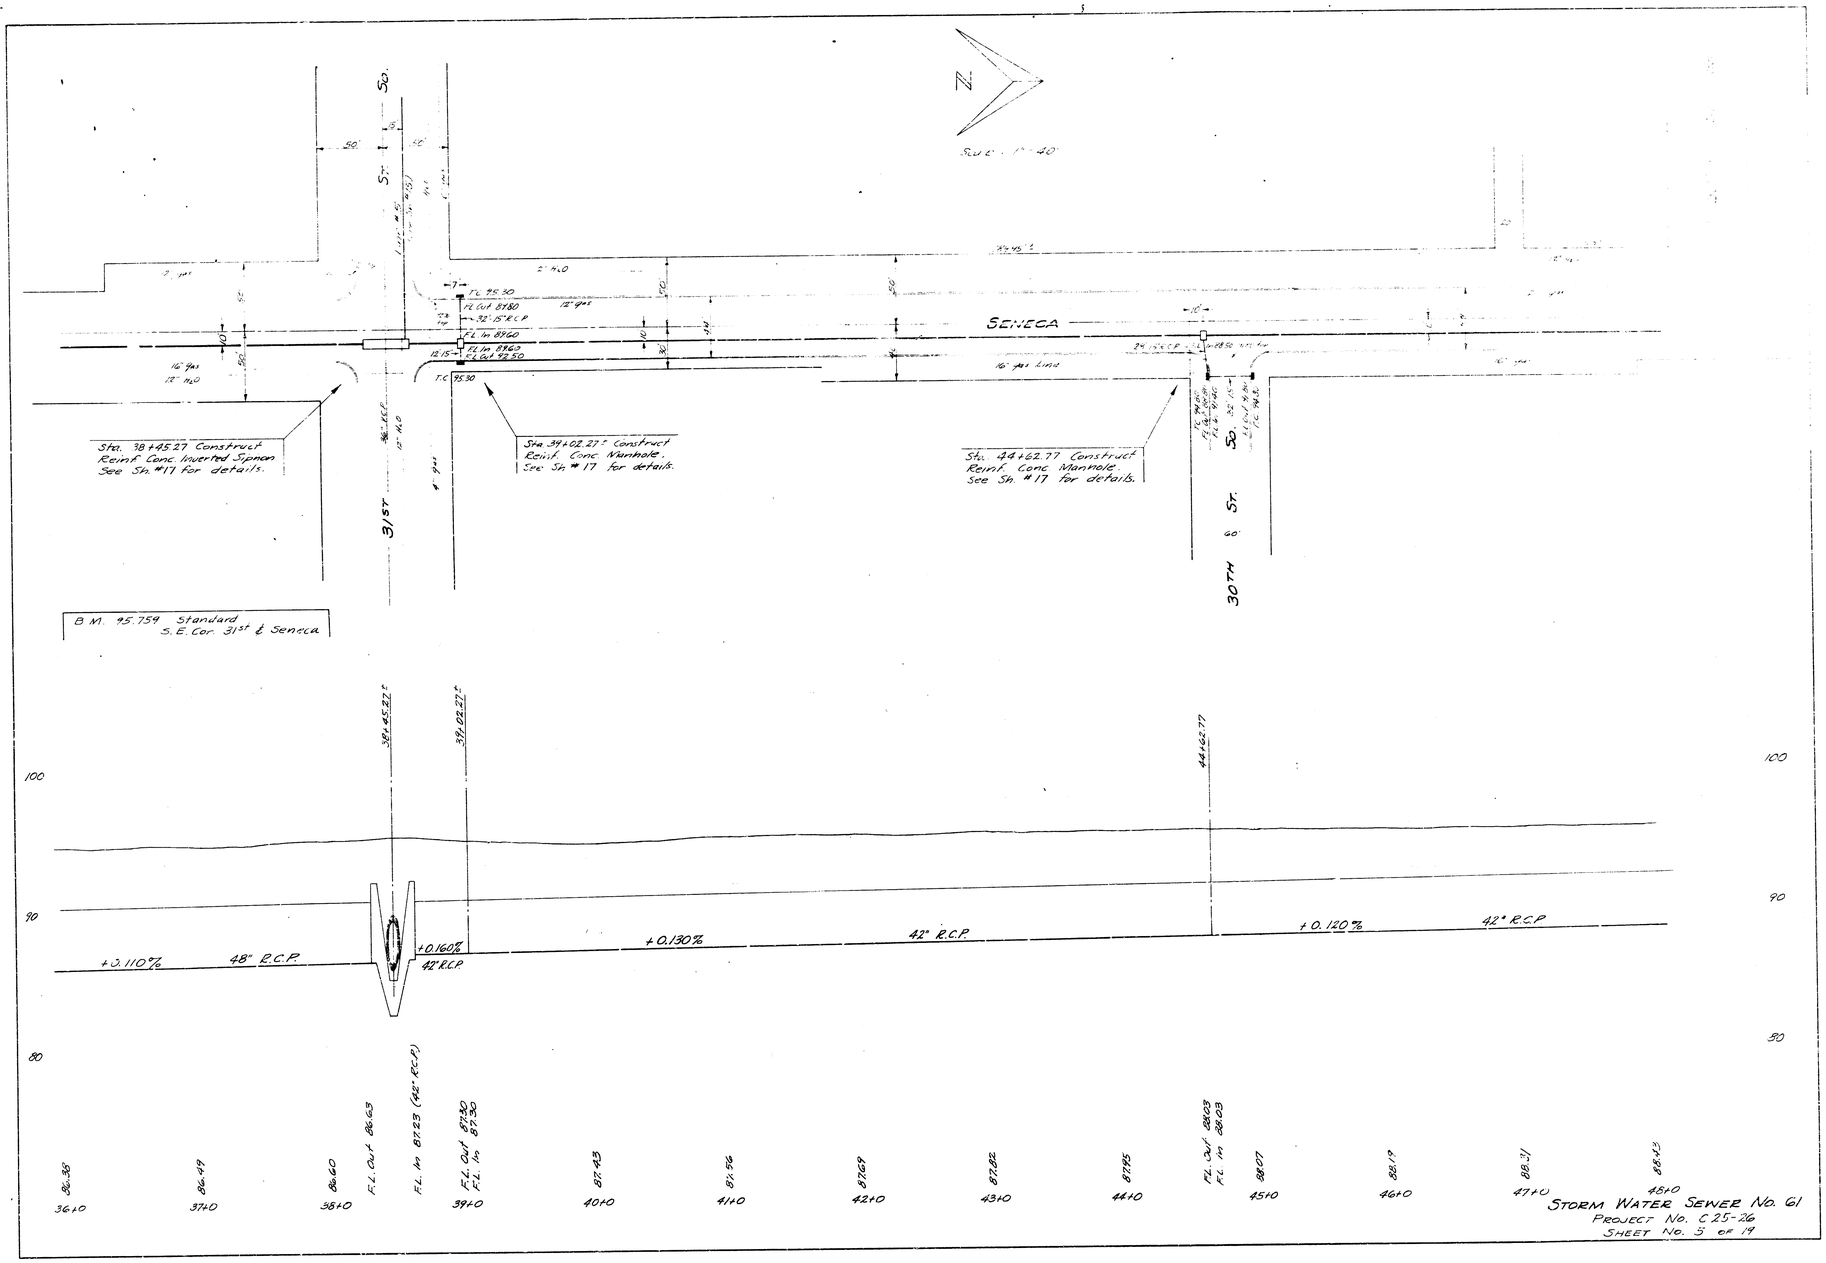

STORM WATER SEWER No. 61

PROJECT No. C.25-26

SHEET No. 3 OF 19

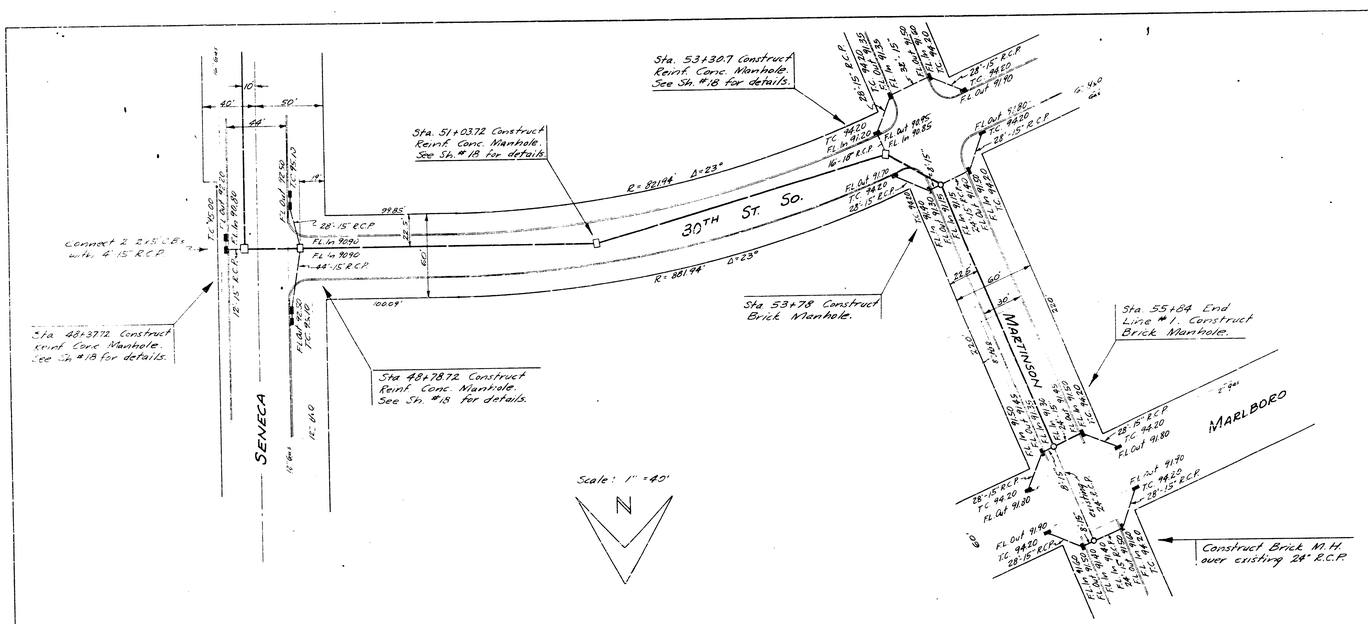

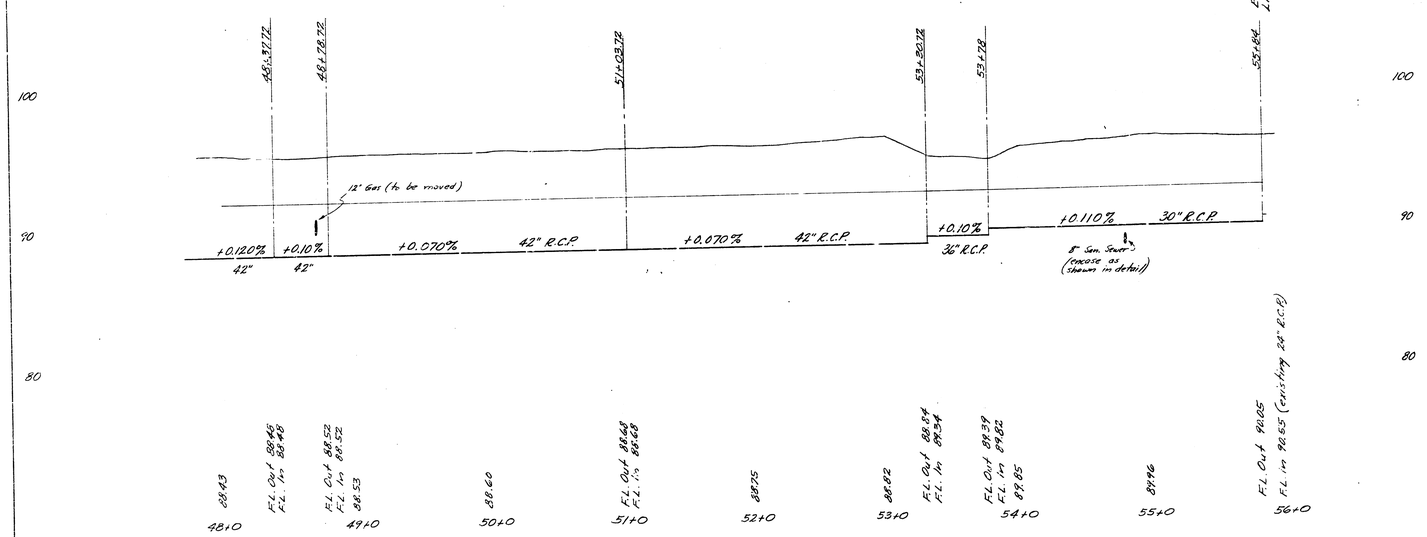

STORM WATER SEWER NO. 61
PROJECT NO. C 25-26
SHEET NO. 6 OF 19

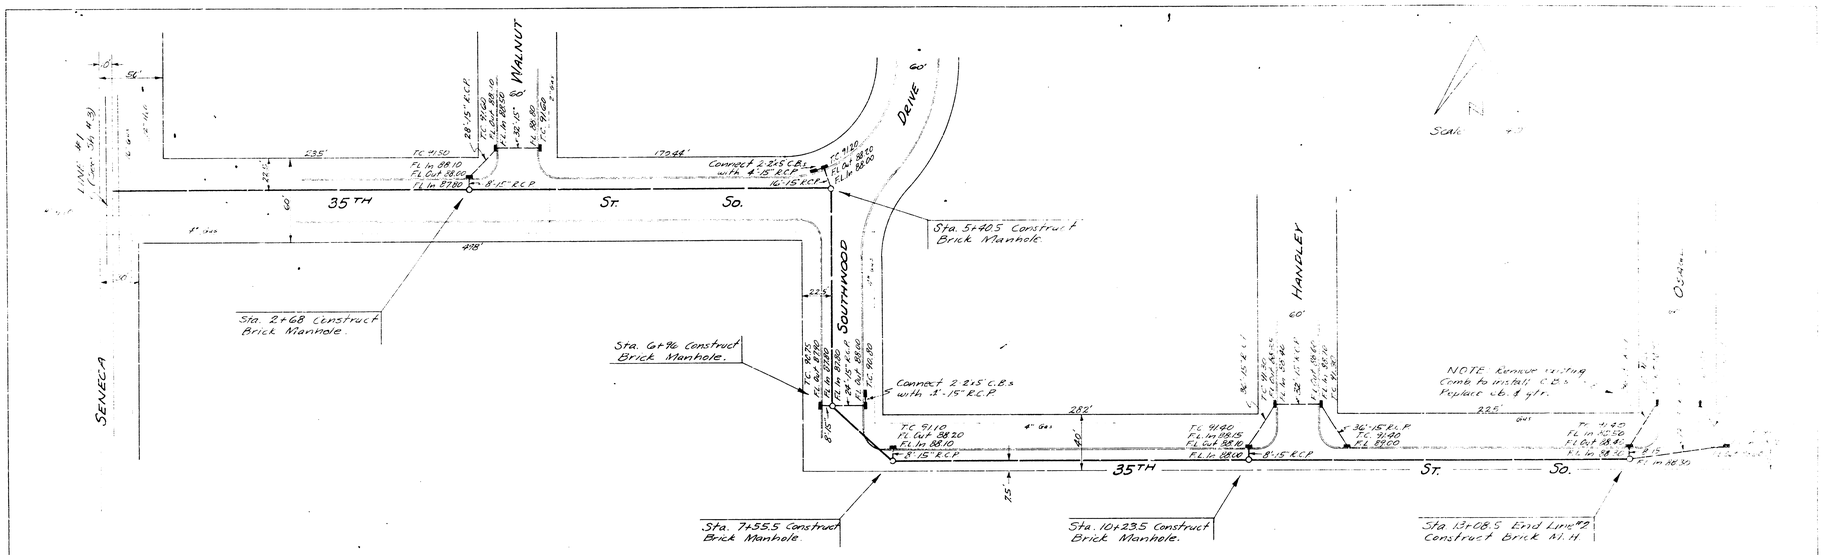

B.M. 91.647 Step bench E.S. H.L.P. 1st N. of 35th W.S. Seneca

LINE No. 2

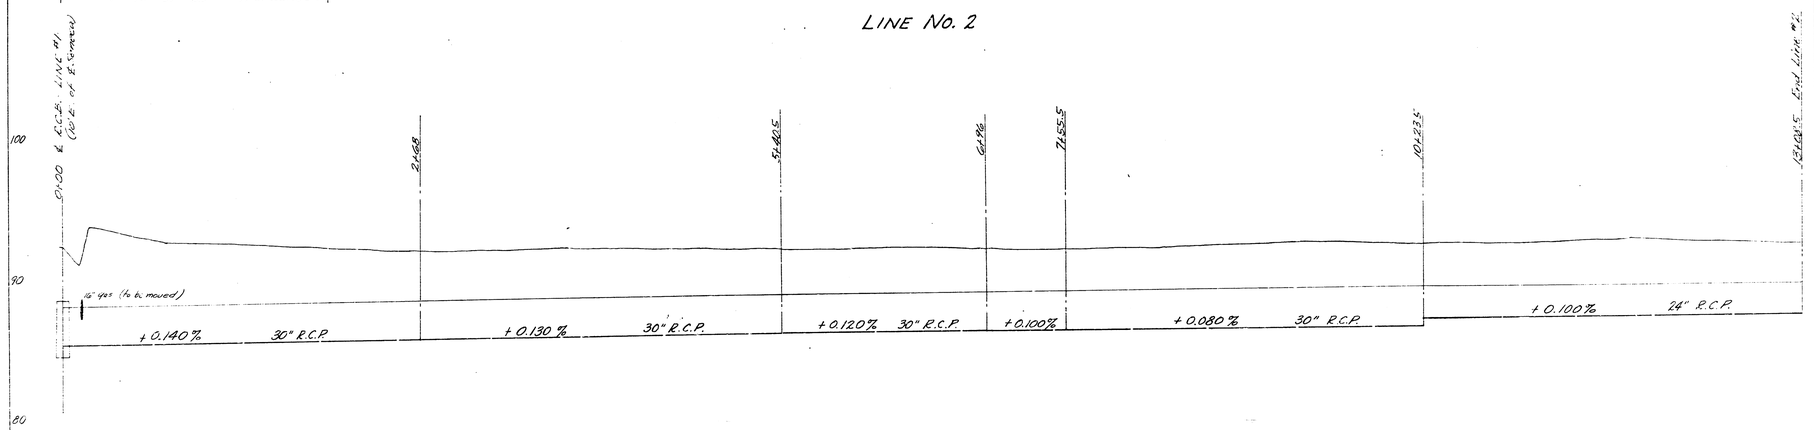

Storm Water Sewer No. 61

Project No. C25-26

Sheet No. 7 of 19

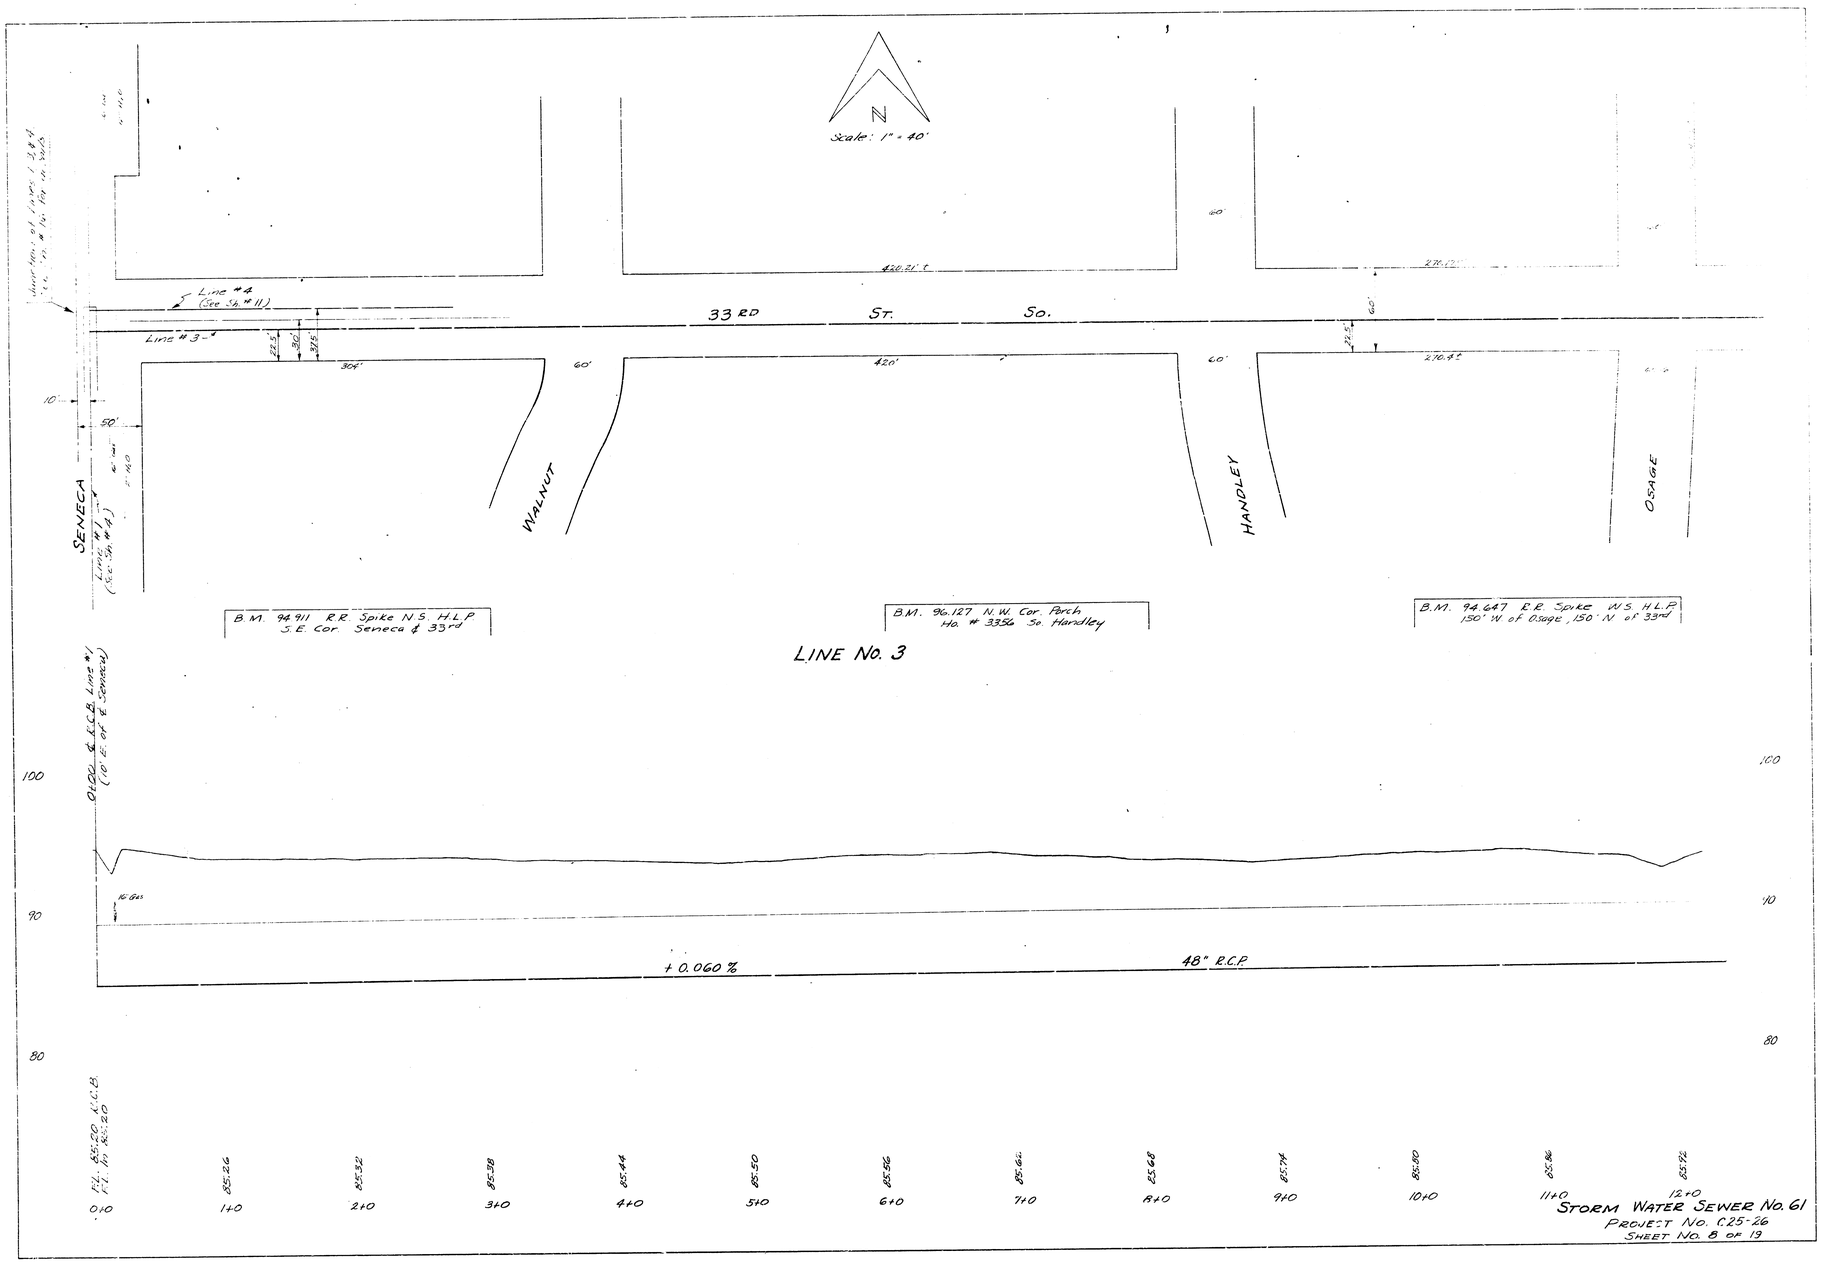

STORM WATER SEWER No. 61
PROJECT No. C25-26
SHEET No. 8 OF 19

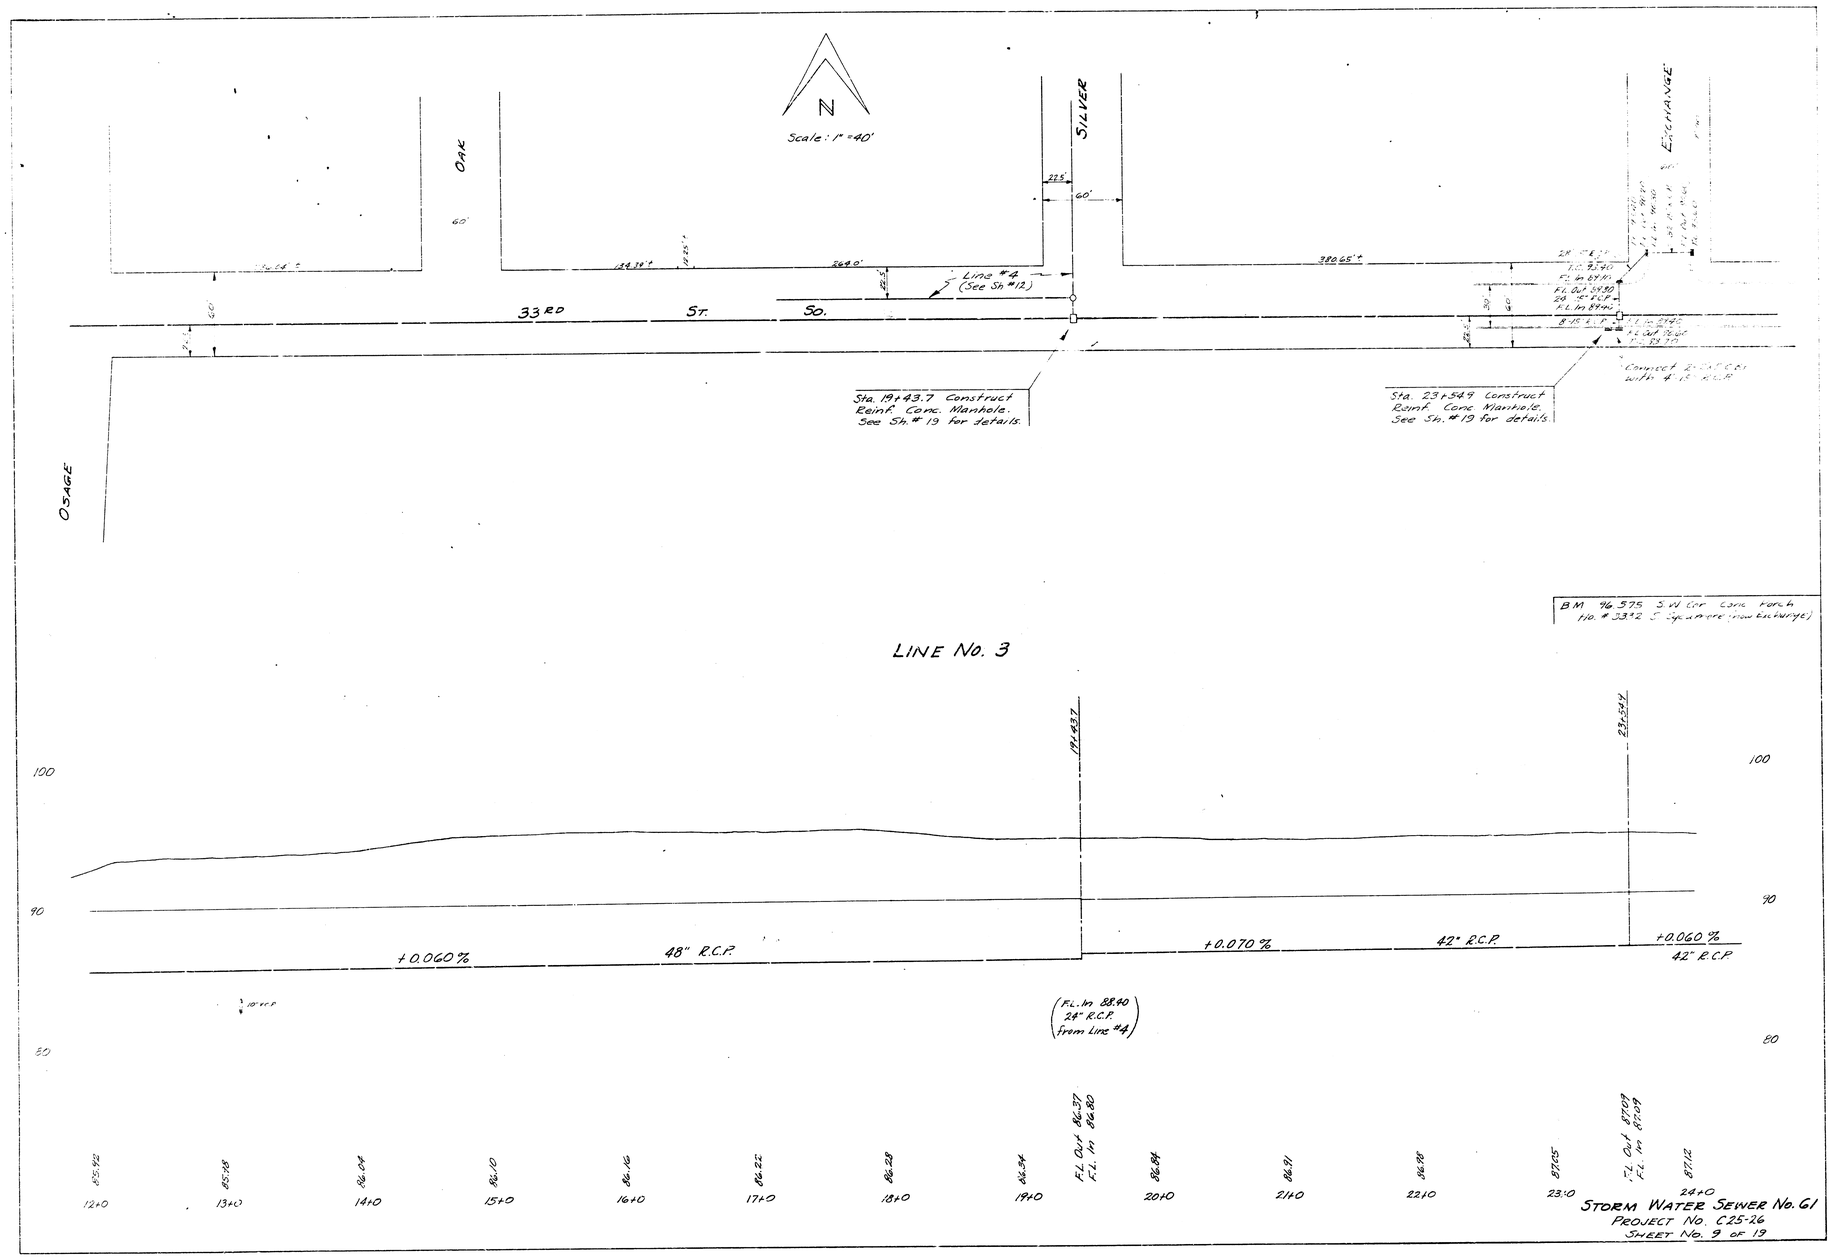

STORM WATER SEWER No. G1

PROJECT No. C25-26

SHEET No. 9 OF 19

Scale : 1" = 40'

EXCHANGE

33 RD ST.

50. 60'

1378.7'

132.0'

Encase 26 Lin Ft of Pipe under R R. See Str. # 9 for details.

Sta. 28+05.6 Construct Reinf. Conc. Manhole. See Str. #19 for details.

MIDLAND VALLEY R. R.

GOLD

WACO

60'

BENWAY

Sta. 30+91.1 Construct Brick Manhole.

Sta. 31+53.1 Construct Brick Manhole.

Sta. 34+00 Construct Brick Manhole.

Sta. 36+44.1 End Line #3 Construct Brick M. H.

Connect 2-2.15 C.Bs with 4'-15" R.C.P.

505'

B.M. 95.797 S.W. Cor. conc. porch No. # 3955 So. Gold

B.M. 96.893 N.W. Cor. conc. porch No. # 301 W. 33rd So.

LINE NO. 3

28+05.6 30+91.1 31+53.1 34+00 36+44.1 End Line #3

+0.060 % 42" R.C.P. Encasement

+0.060 % 36" R.C.P.

+0.100 % 30" R.C.P.

+0.060 % 24" R.C.P.

24" R.C.P. +0.060 %

100 90 80

87.12 87.18 87.24 87.30 F.L. Out 87.36 F.L. In 87.26 87.92 87.98 F.L. Out 88.23 F.L. In 88.53 F.L. Out 88.59 F.L. In 89.09 89.12 89.18 F.L. 89.24 89.30 89.36 F.L. Out 89.39

24+0 25+0 26+0 27+0 28+0 29+0 30+0 31+0 32+0 33+0 34+0 35+0 36+0

STORM WATER SEWER No. 6!

PROJECT No. C 25-26

SHEET No. 10 OF 19

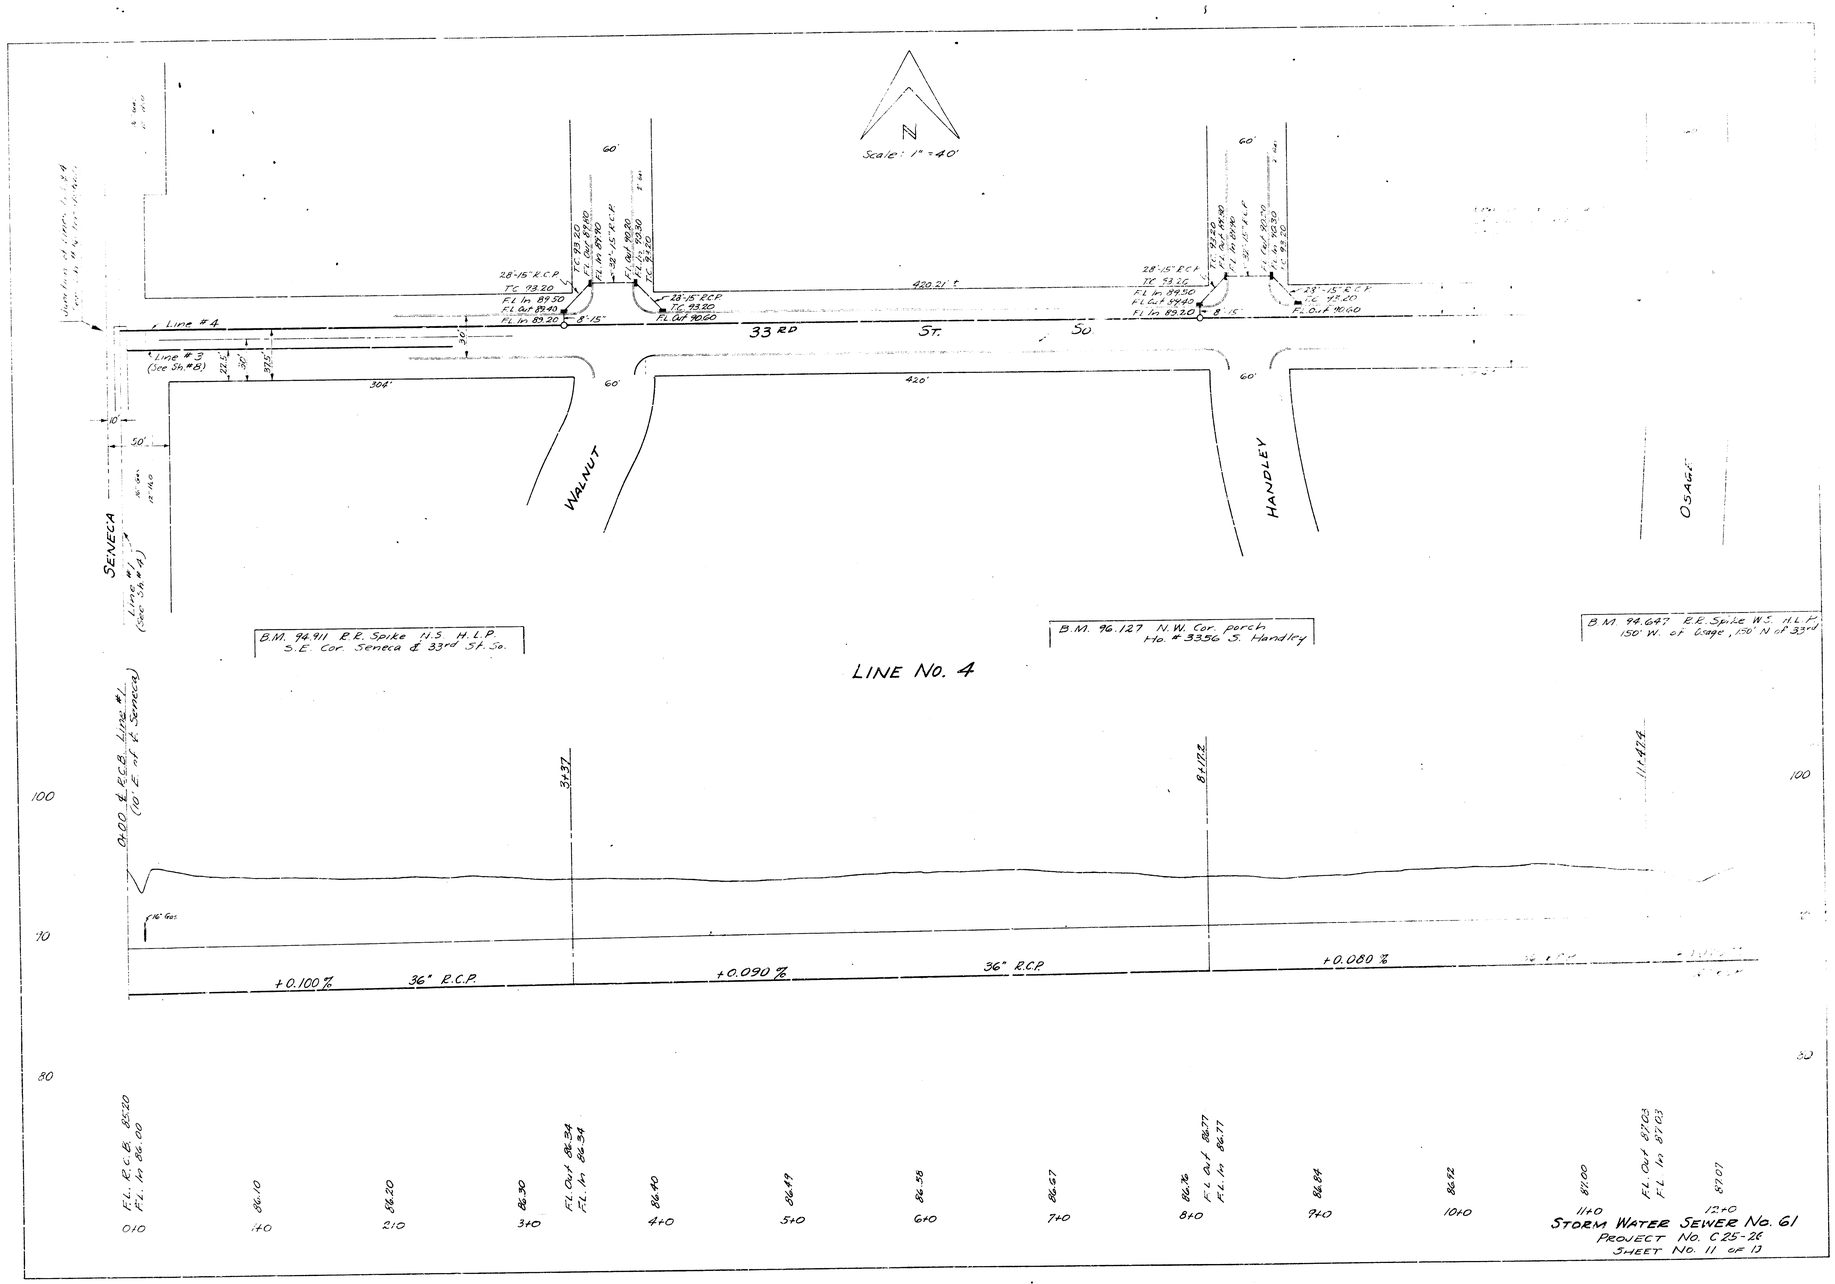

STORM WATER SEWER No. 61
PROJECT No. C25-26
SHEET No. 11 OF 13

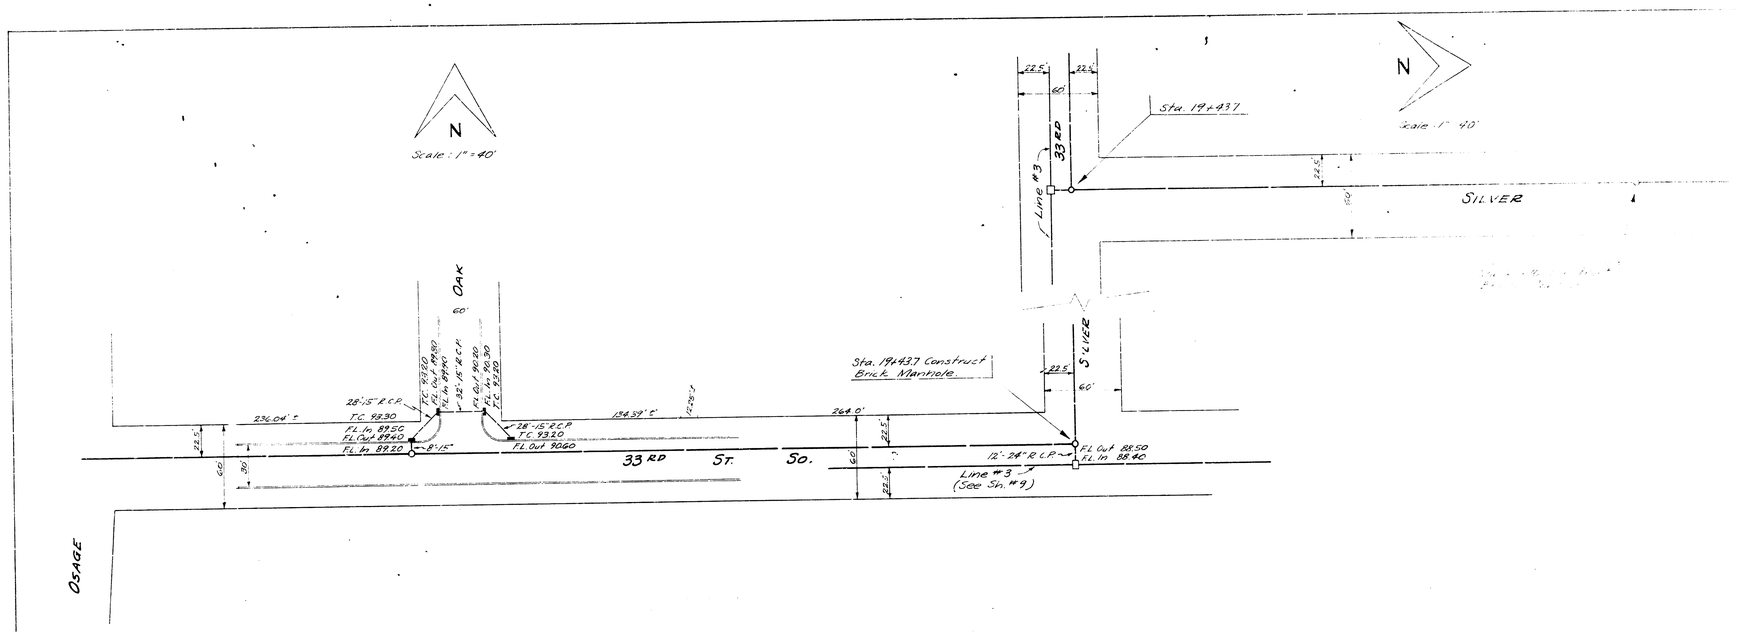

Storm Water Sewer No. 61

Project No. C25-26

Sheet No. 12 of 17

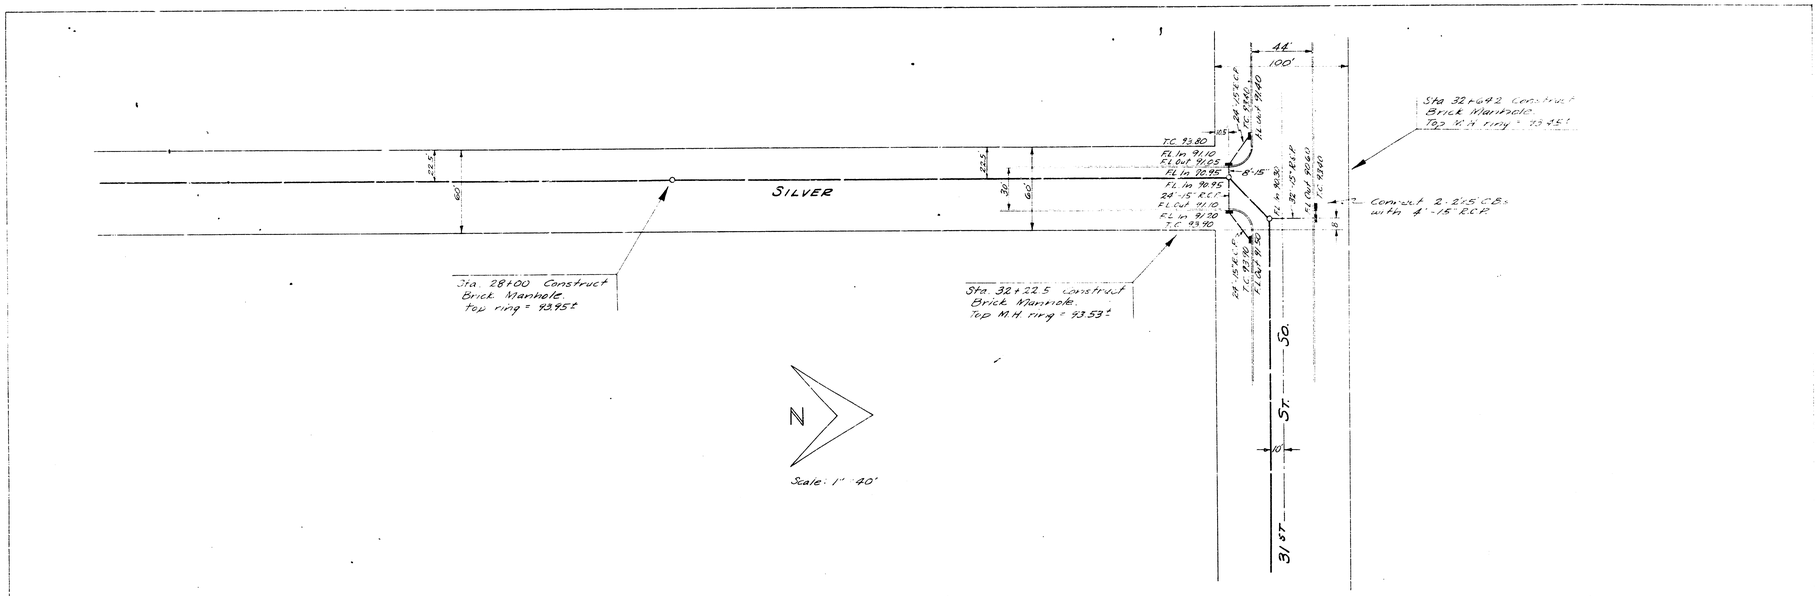

LINE No. 4

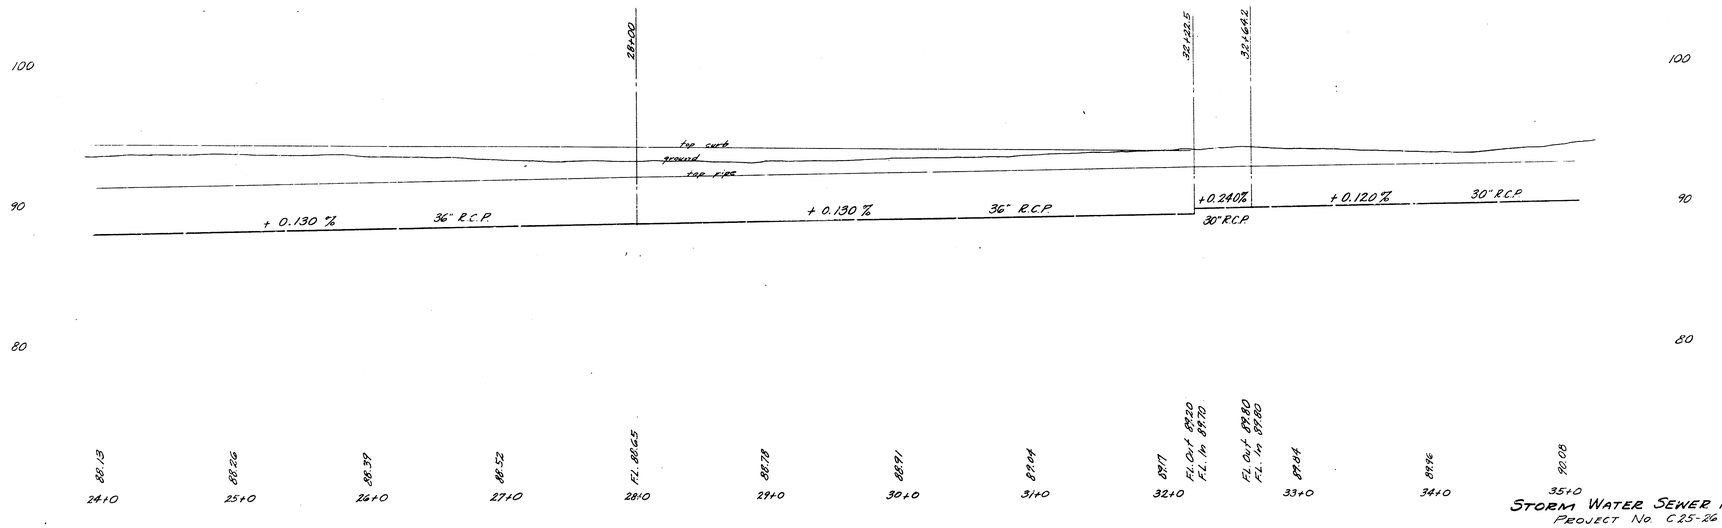

STORM WATER SEWER No. 61
PROJECT No. C25-26
SHEET No. 13 OF 19

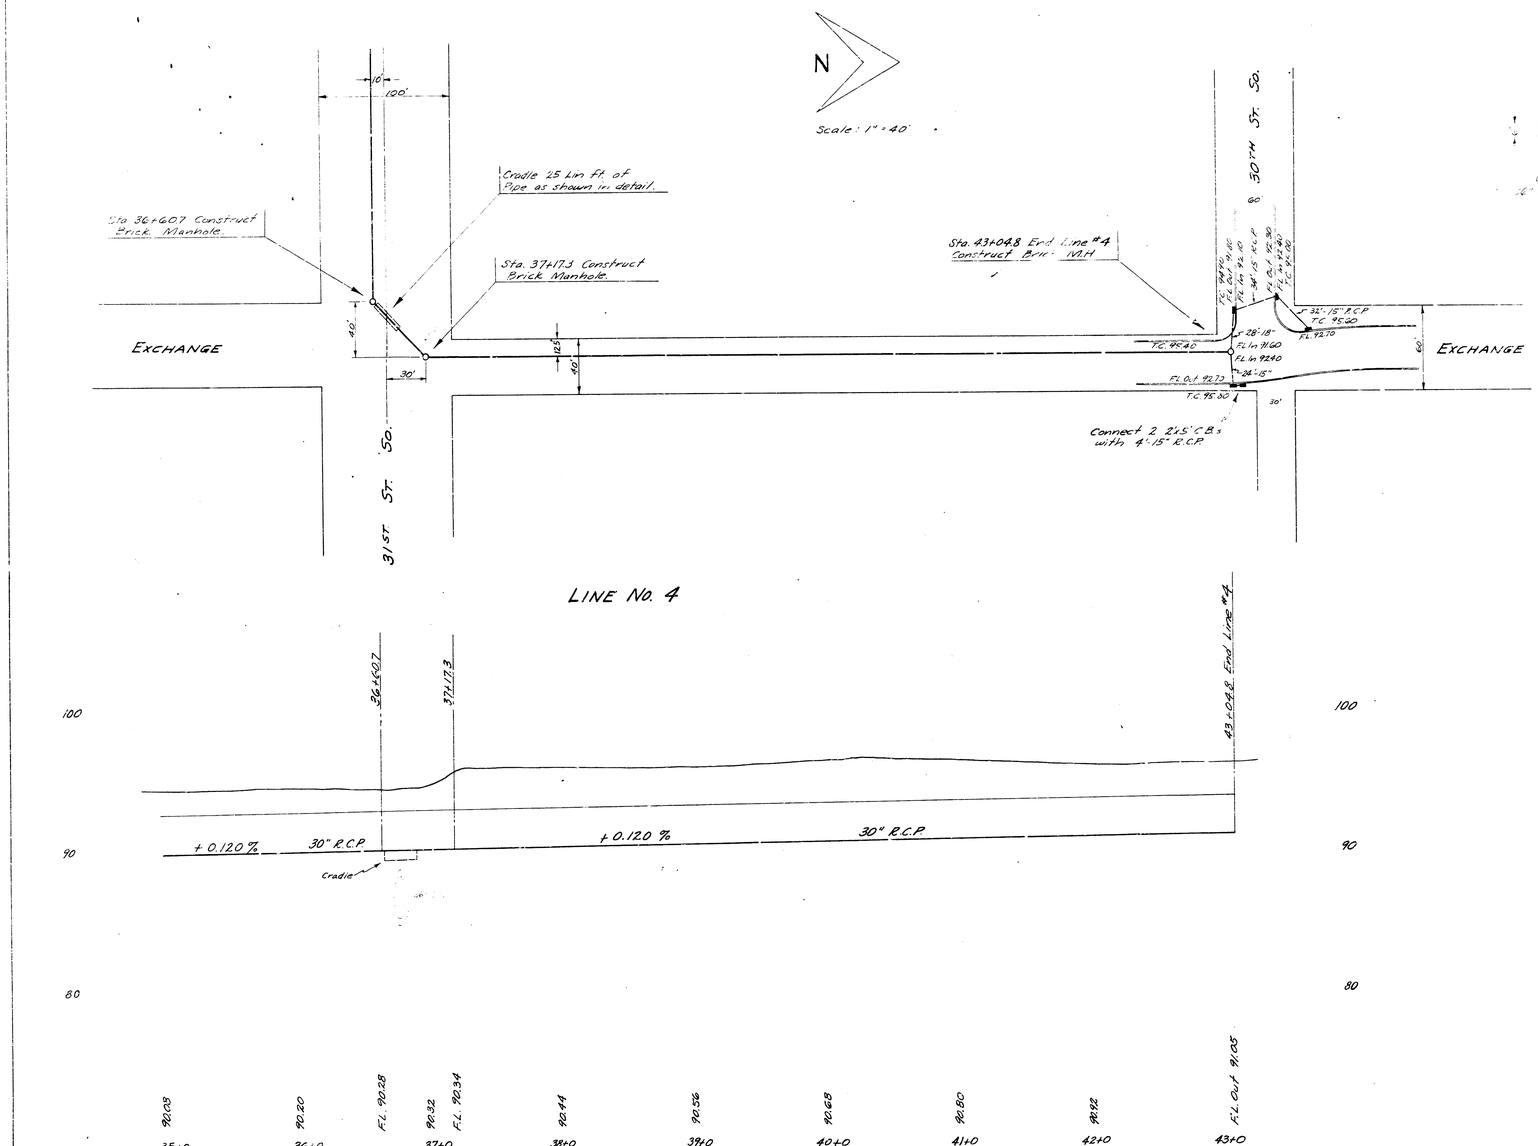

STORM WATER SEWER No. 61
PROJECT No. C25-26
SHEET No. 14 OF 19

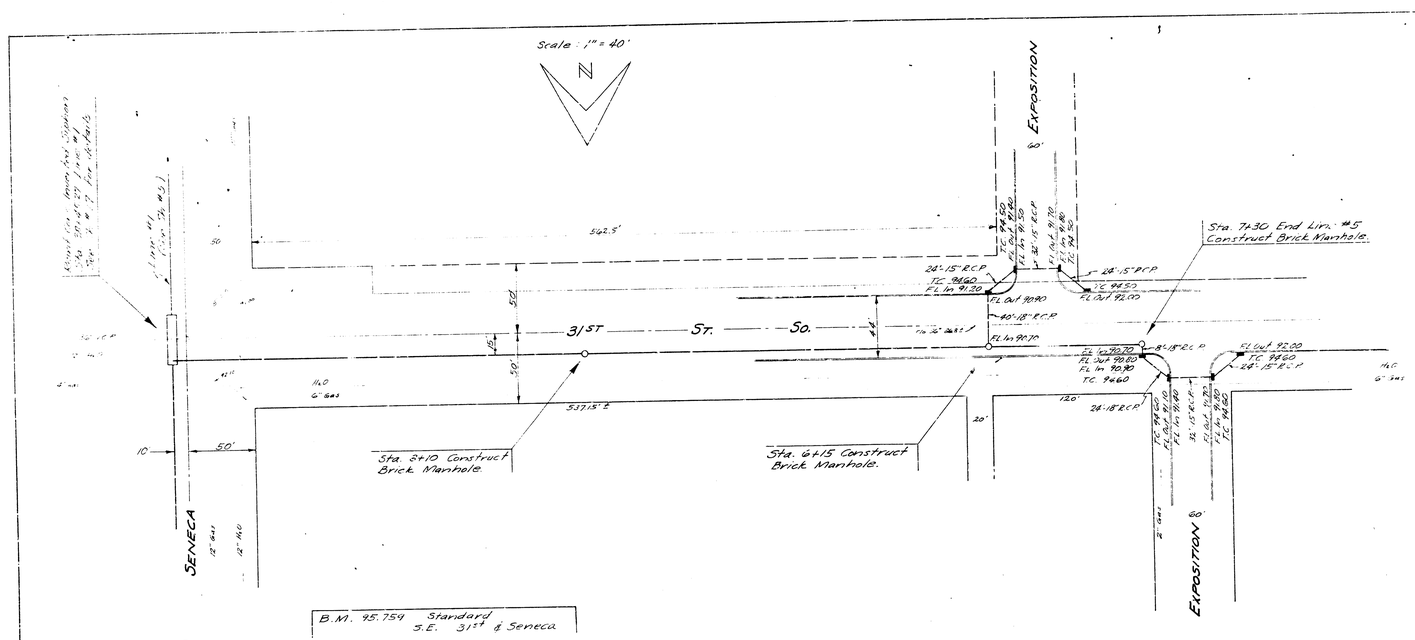

STORM WATER SEWER No. G1
PROJECT No. C25-26
SHEET No. 15 OF 19

TYPICAL SECTION
REINF. CONC. CONDUIT
Scale: 1"=1'-0"

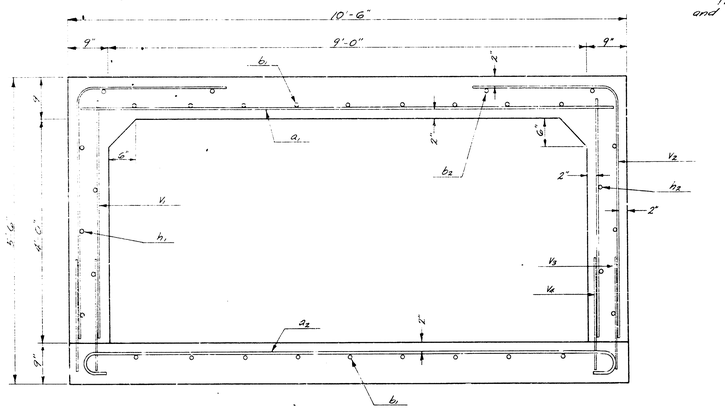

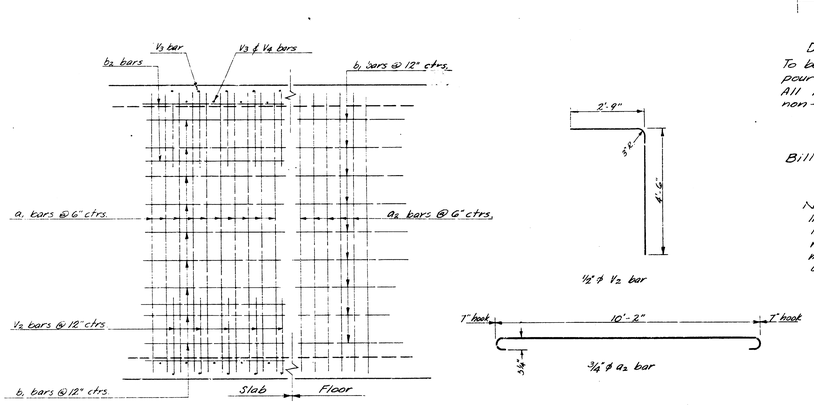

PLAN VIEW
Scale: 1/2"=1'-0"

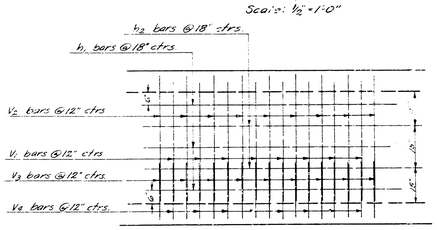

ELEVATION
Scale: 1/2"=1'-0"

Concrete for structures shall contain not less than 1.65 bbls. of cement per cu. yd. of concrete. In no event shall the total water content exceed 6.25 gals. per sack of cement. The mixture of fine and coarse aggregate shall be such to produce a maximum density of a most workable mixture. An internal vibrator shall be used for placing concrete. The floor of manholes are to be sloped for flow and drainage.



OPTIONAL FILLET
Shape of fillet & method of forming to be approved by City Engineer.



DETAIL OF KEYED JOINT
To be used at the end of each pour in the slab, floor, & walls. All longitudinal steel to be non-continuous at joints.

Bill of Material per lin. ft. of Conduit:
0.815 cu. yds. concrete
106.6 lbs. reinf. steel

Note: Conduit is to be bid as lin. ft. reinf. conc. conduit, complete in place, including excavation, concrete, reinf. steel, toe wall at outlet, brick manholes on top of conduit, and end wall at 33rd St. So.

½" ϕ V2 bar

¾" ϕ a2 bar

Steel Schedule				
bar	Size	Spacing	length	shape
a1	#6	6" ctrs.	10'-2"	
a2	#6	6" ctrs.	see detail	
b1	#4	12" ctrs.	continuous	
b2	#4	2'-0" ctrs.	continuous	
V1	#4	12" ctrs.	1'-3"	
V2	#4	12" ctrs.	see detail	
V3	#4	12" ctrs.	2'-0"	
V4	#4	12" ctrs.	2'-0"	
h1	#4	18" ctrs.	continuous	
h2	#4	18" ctrs.	continuous	

V3 & V4 bars to alternate as shown.
V1 bar ties to V4 bar.
V2 bar ties to V3 bar.
Splices on longitudinal bars - 15" minimum.

DETAIL - BEGINNING OF CONDUIT AT STA. 0+92
Extra steel required as shown
Scale: 3/8"=1'-0"



PLAN VIEW

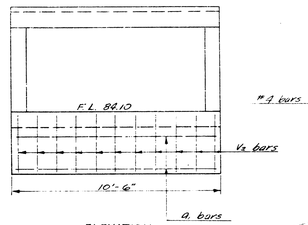

ELEVATION

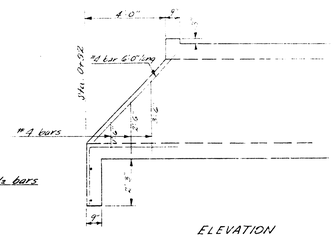

ELEVATION

DETAIL - END OF CONDUIT AT 33RD ST. SO.
Scale: 3/16"=1'-0"

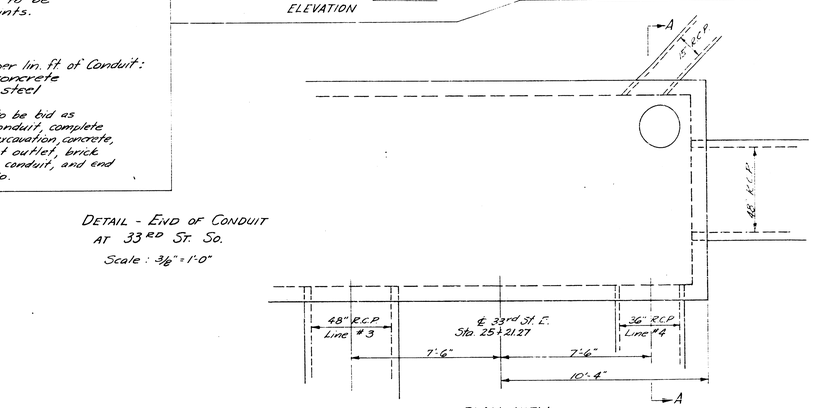

PLAN VIEW

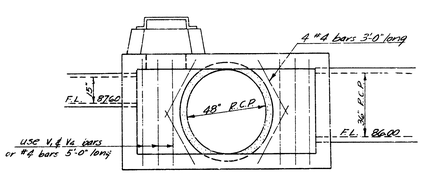

END ELEVATION
SEC. A-A

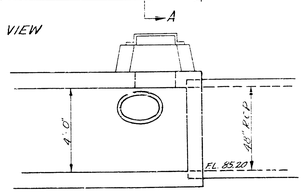

ELEVATION

S.W.S. #61
Sheet No. 16 of 19

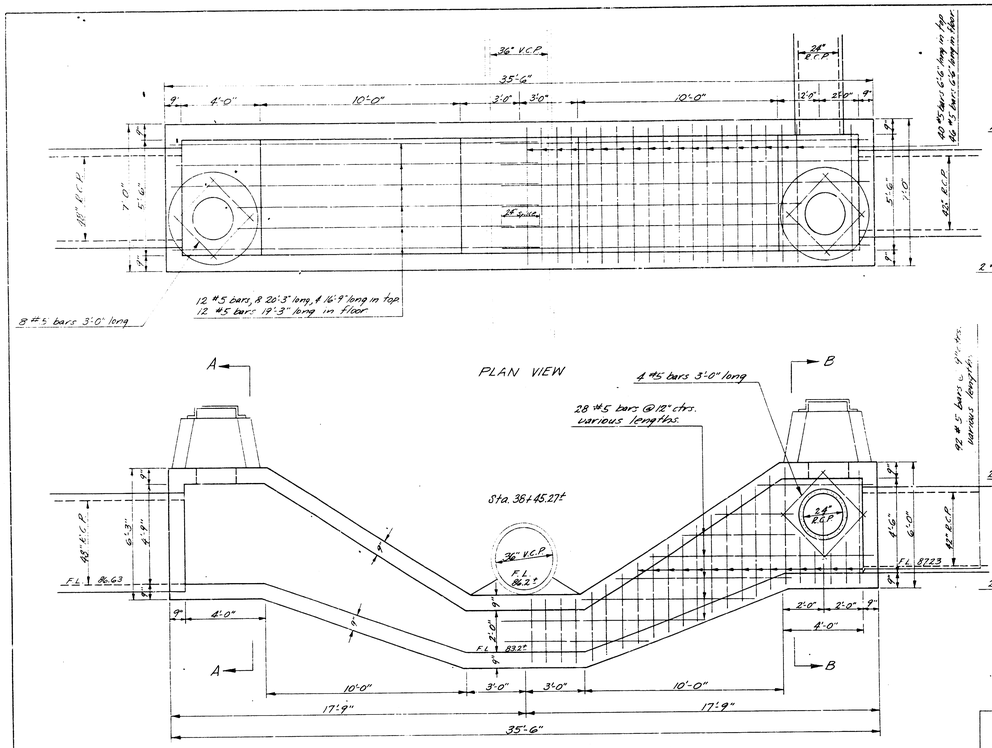

PLAN VIEW

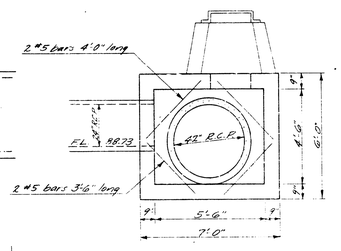

SEC. B-B

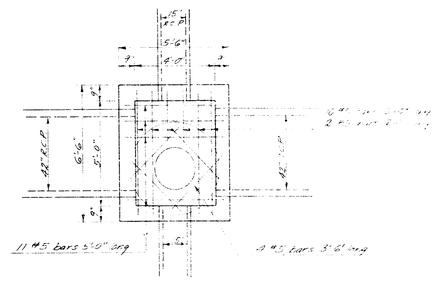

PLAN VIEW

ELEVATION

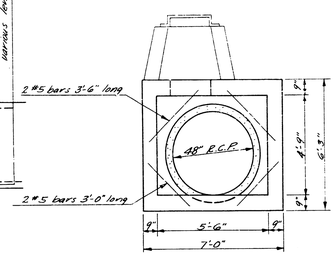

SEC. A-A

Bill of Materials:
23.5 cu. yds. concrete
1800 lbs. reinf. steel

REINF. CONC. INVERTED SIPHON - STA. 38+45.27 - LINE No. 1

Scale : 3/8" = 1'-0"

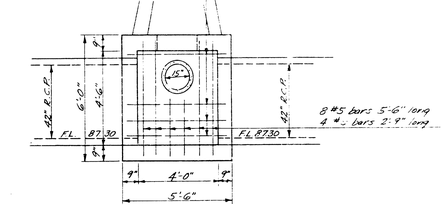

ELEVATION

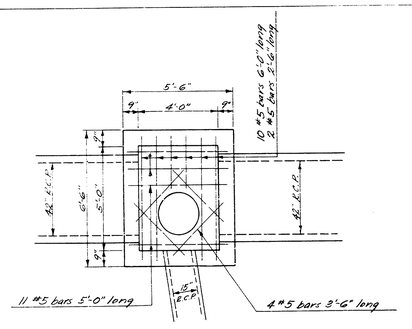

PLAN VIEW

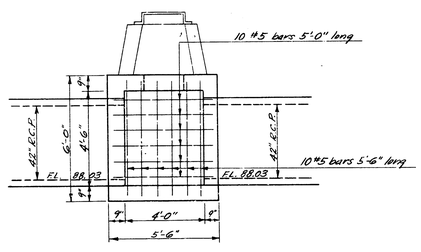

ELEVATION

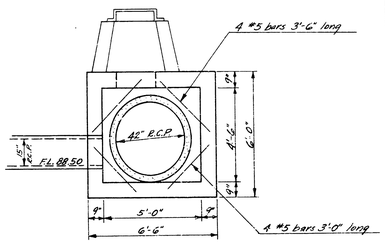

ELEVATION

REINF. CONC. MANHOLE - STA. 44+62.8 - LINE No. 1

Scale : 3/8" = 1'-0"

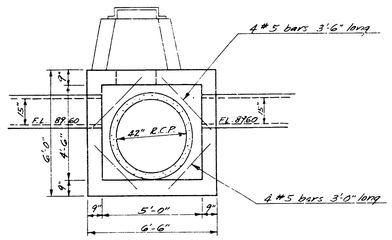

ELEVATION

REINF. CONC. MANHOLE - STA. 39+02.3 - LINE 1

Scale : 3/8" = 1'-0"

STORM WATER SEWER No. 61

PROJECT No. C25-26

SHEET No. 17 OF 19

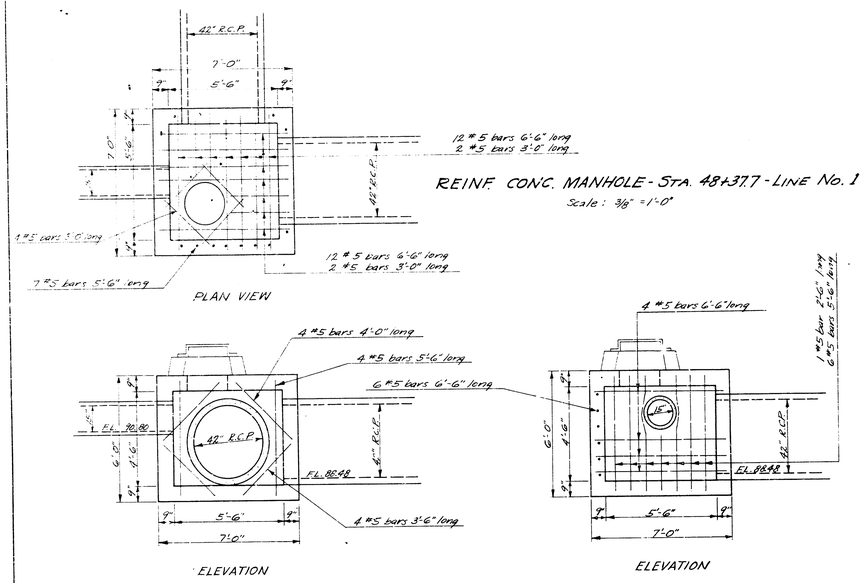

PLAN VIEW

REINF. CONC. MANHOLE - STA. 48+37.7 - LINE No. 1

Scale : 3/8" = 1'-0"

ELEVATION

ELEVATION

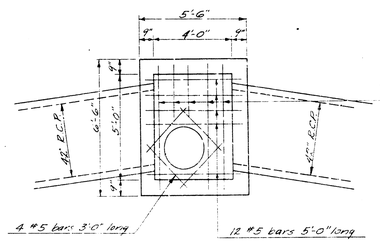

PLAN VIEW

REINF. CONC. MANHOLE - STA 51+03.7 - LINE No. 1

Scale : 3/8" = 1'-0"

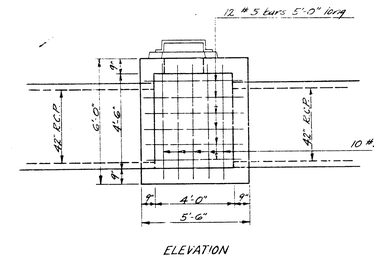

ELEVATION

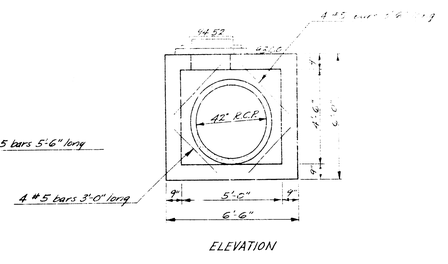

ELEVATION

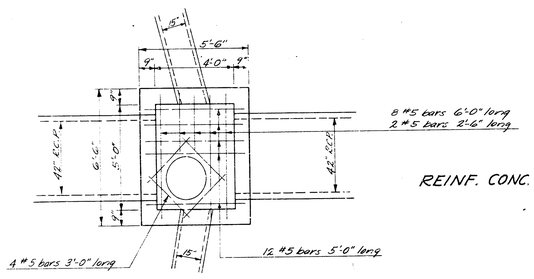

PLAN VIEW

REINF. CONC. MANHOLE - STA. 48+78.7 - LINE No. 1

Scale : 3/8" = 1'-0"

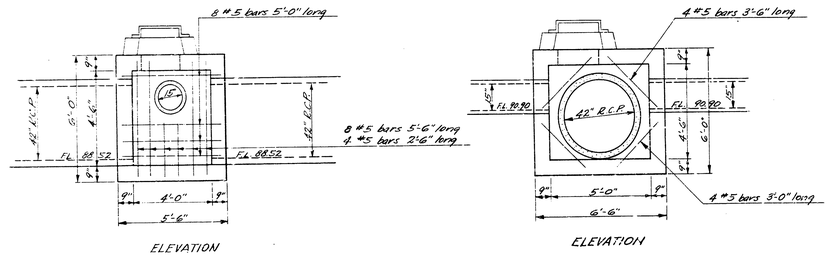

ELEVATION

ELEVATION

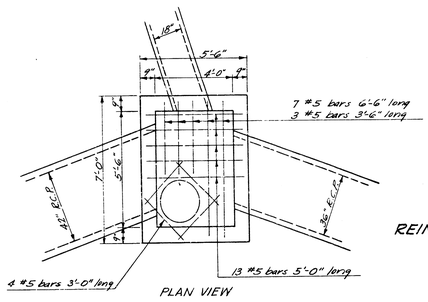

PLAN VIEW

REINF. CONC. MANHOLE - STA. 53+30.7 - LINE No. 1

Scale : 3/8" = 1'-0"

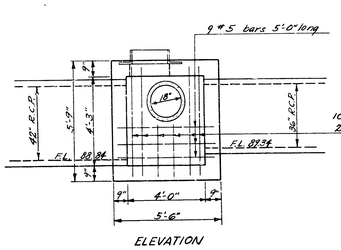

ELEVATION

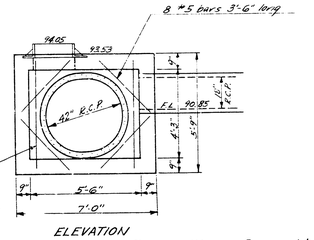

ELEVATION

STORM WATER SEWER No. 61
PROJECT No. C25-26
SHEET No. 18 OF 19

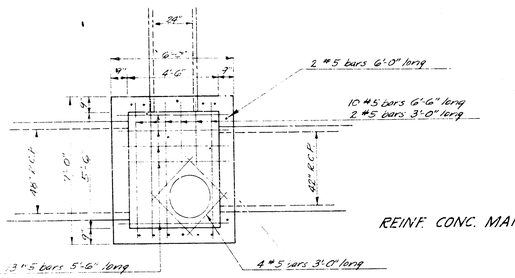

PLAN VIEW

REINF. CONC. MANHOLE - STA. 19+43.7 - LINE No. 3

Scale: 3/8" = 1'-0"

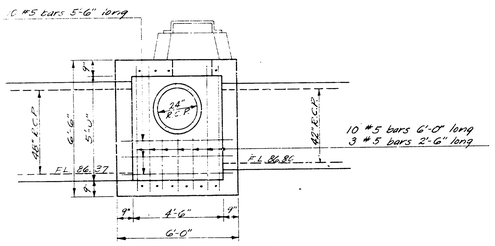

ELEVATION



ELEVATION

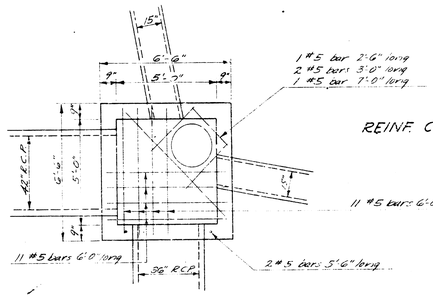

PLAN VIEW

REINF. CONC. MANHOLE - STA. 28+05.6 - LINE NO. 3

Scale: 3/8" = 1'-0"

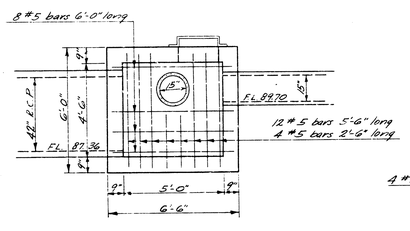

ELEVATION

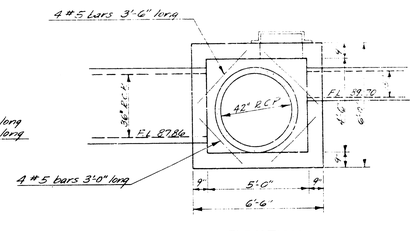

ELEVATION

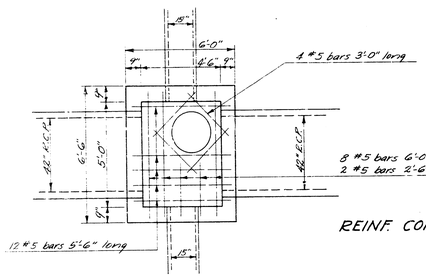

PLAN VIEW

REINF. CONC. MANHOLE - STA. 23+54.9 - LINE No. 3

Scale: 3/8" = 1'-0"

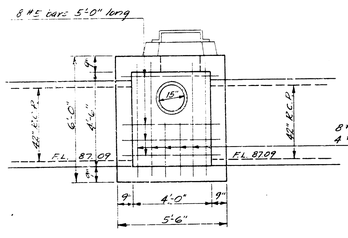

ELEVATION

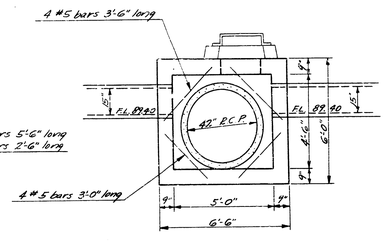

ELEVATION

Pipe is to be installed by open ditch method with tracks removed during hours which will not disrupt train traffic. The contractor shall give proper notice to the R.R. to provide flagmen, etc., while the crossing is being made. The expense of removing and replacing tracks and all other charges made by the R.R. will be paid by the contractor. R.R. charges, cost of encasement and reinf. steel, and all other extra cost of crossing shall be included in the lump sum bid of "reinf. conc. R.R. crossing".

6 sack paving mix is to be used for encasement concrete.

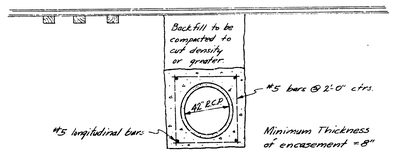

TYPICAL SECTION
REINF. CONC. ENCASEMENT
UNDER MIDLAND VALLEY R.R.
STA. 26+10 - LINE No. 3

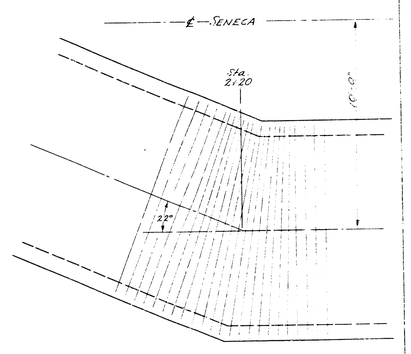

maintain 6" spacing with 4 bars on long side reduce spacing on short side as shown.

PLAN VIEW - REINF. CONC. CONDUIT
STA. 2+20 - LINE 1
Scale: 3/8" = 1'-0"

STORM WATER SEWER No. 61
PROJECT No. C25-26
SHEET No. 19 OF 19