

WATERLINE ENCASUREMENT DETAIL


Note:

1) Steel Encasement pipe shall conform to City of Wichita Specifications for Encasement of water pipe by jacking operations.

2) Casing spacers & casing end seals shall be Advanced Products & System Casing Spacers (Model CI, SI, or SSI), PSI Casing spacers, or pre-approved equal.

STEEL CASING PIPE I.D. (IN.)	WALL THICKNESS (IN.)
24"	0.281

* CTR. CARRIER PIPE IN CASING PIPE

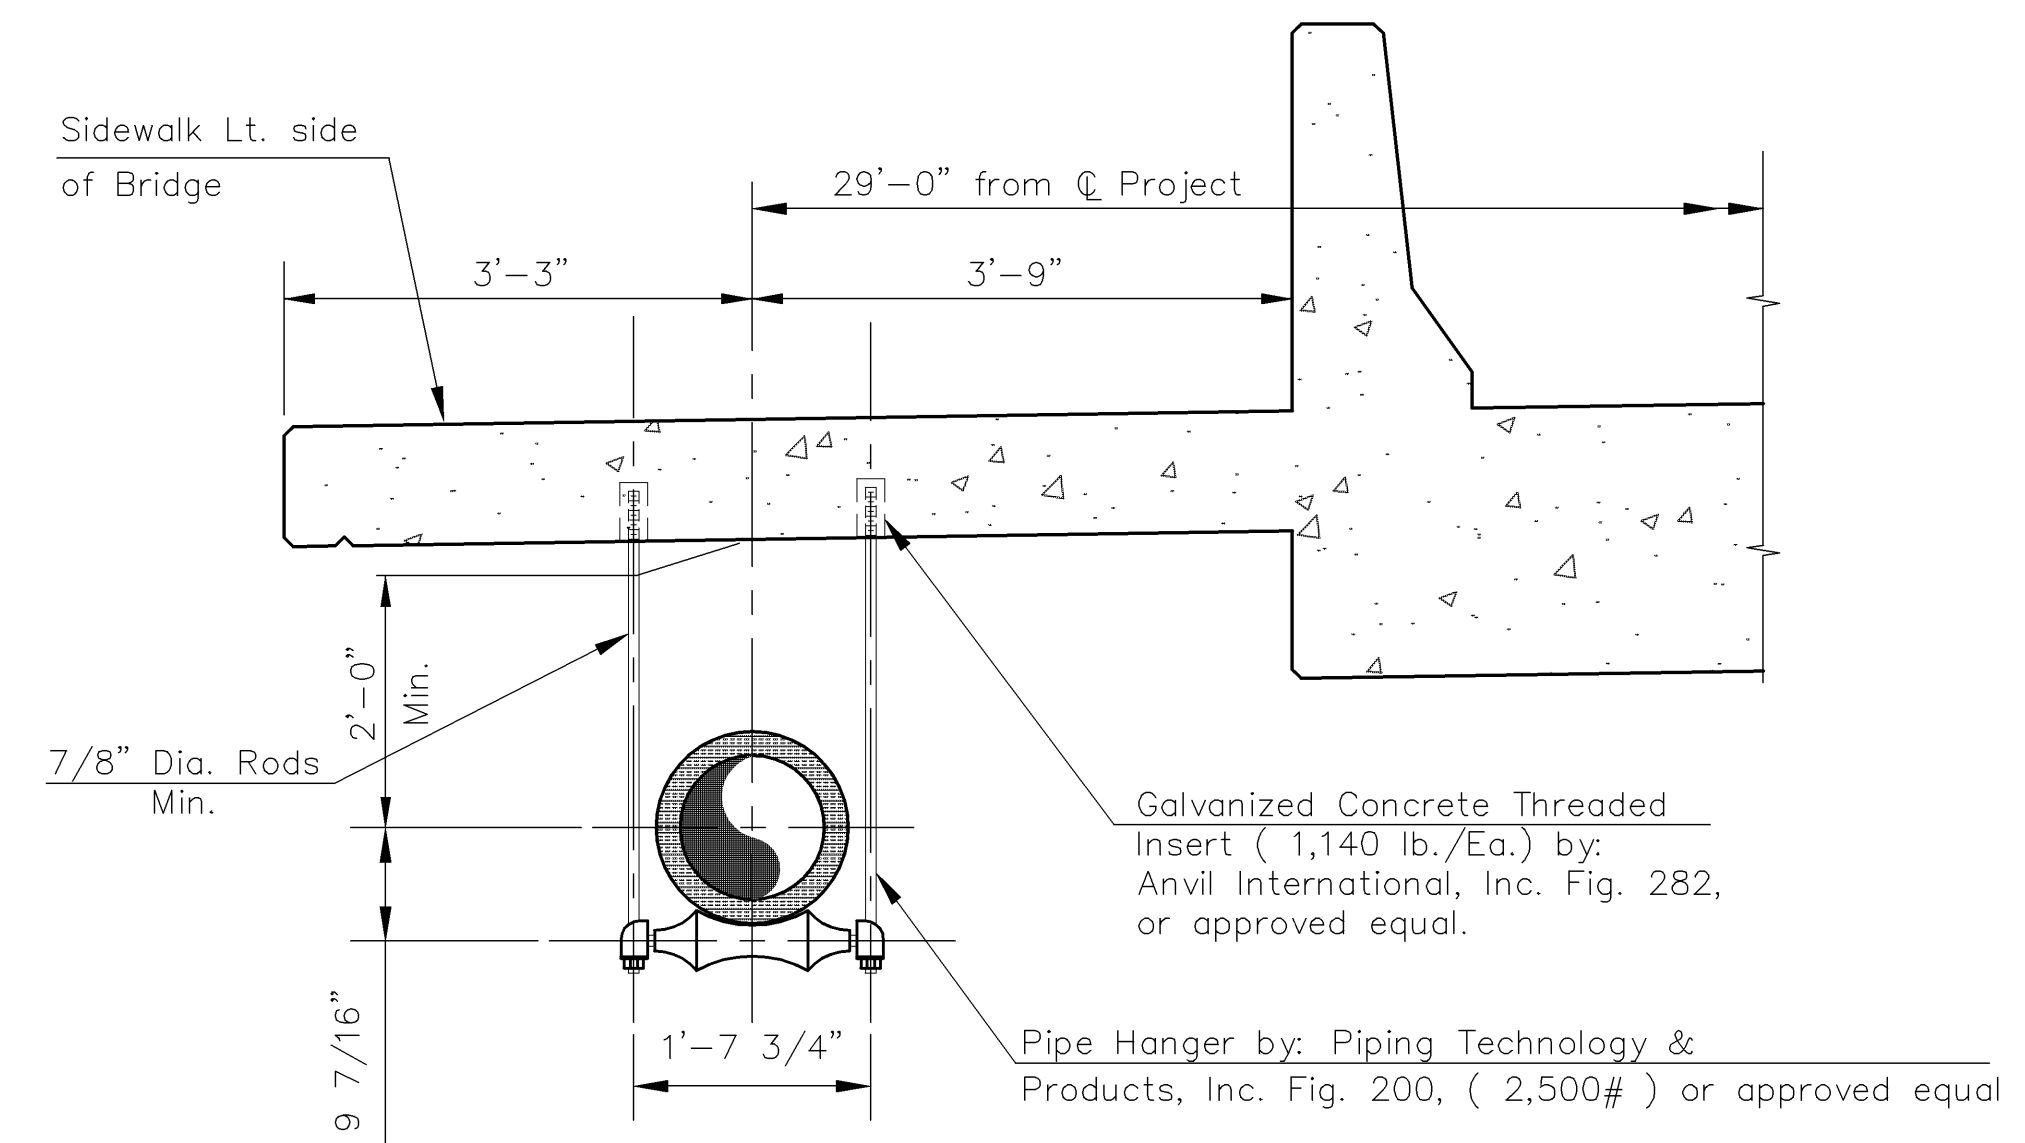

PIPE HANGER DETAIL

Note: Space Hangers at 10'-0" apart (Max.)

KANSAS DEPARTMENT OF TRANSPORTATION			
WATER LINE DETAILS			
HILLSIDE BRIDGE AT RANGE ROAD		DESIGNED	SCALE
CITY OF WICHITA Sedgwick Co. Kansas		DETAILED	DATE
87 N-0359-01		QUANTITIES	SHEET 14a OF 14