



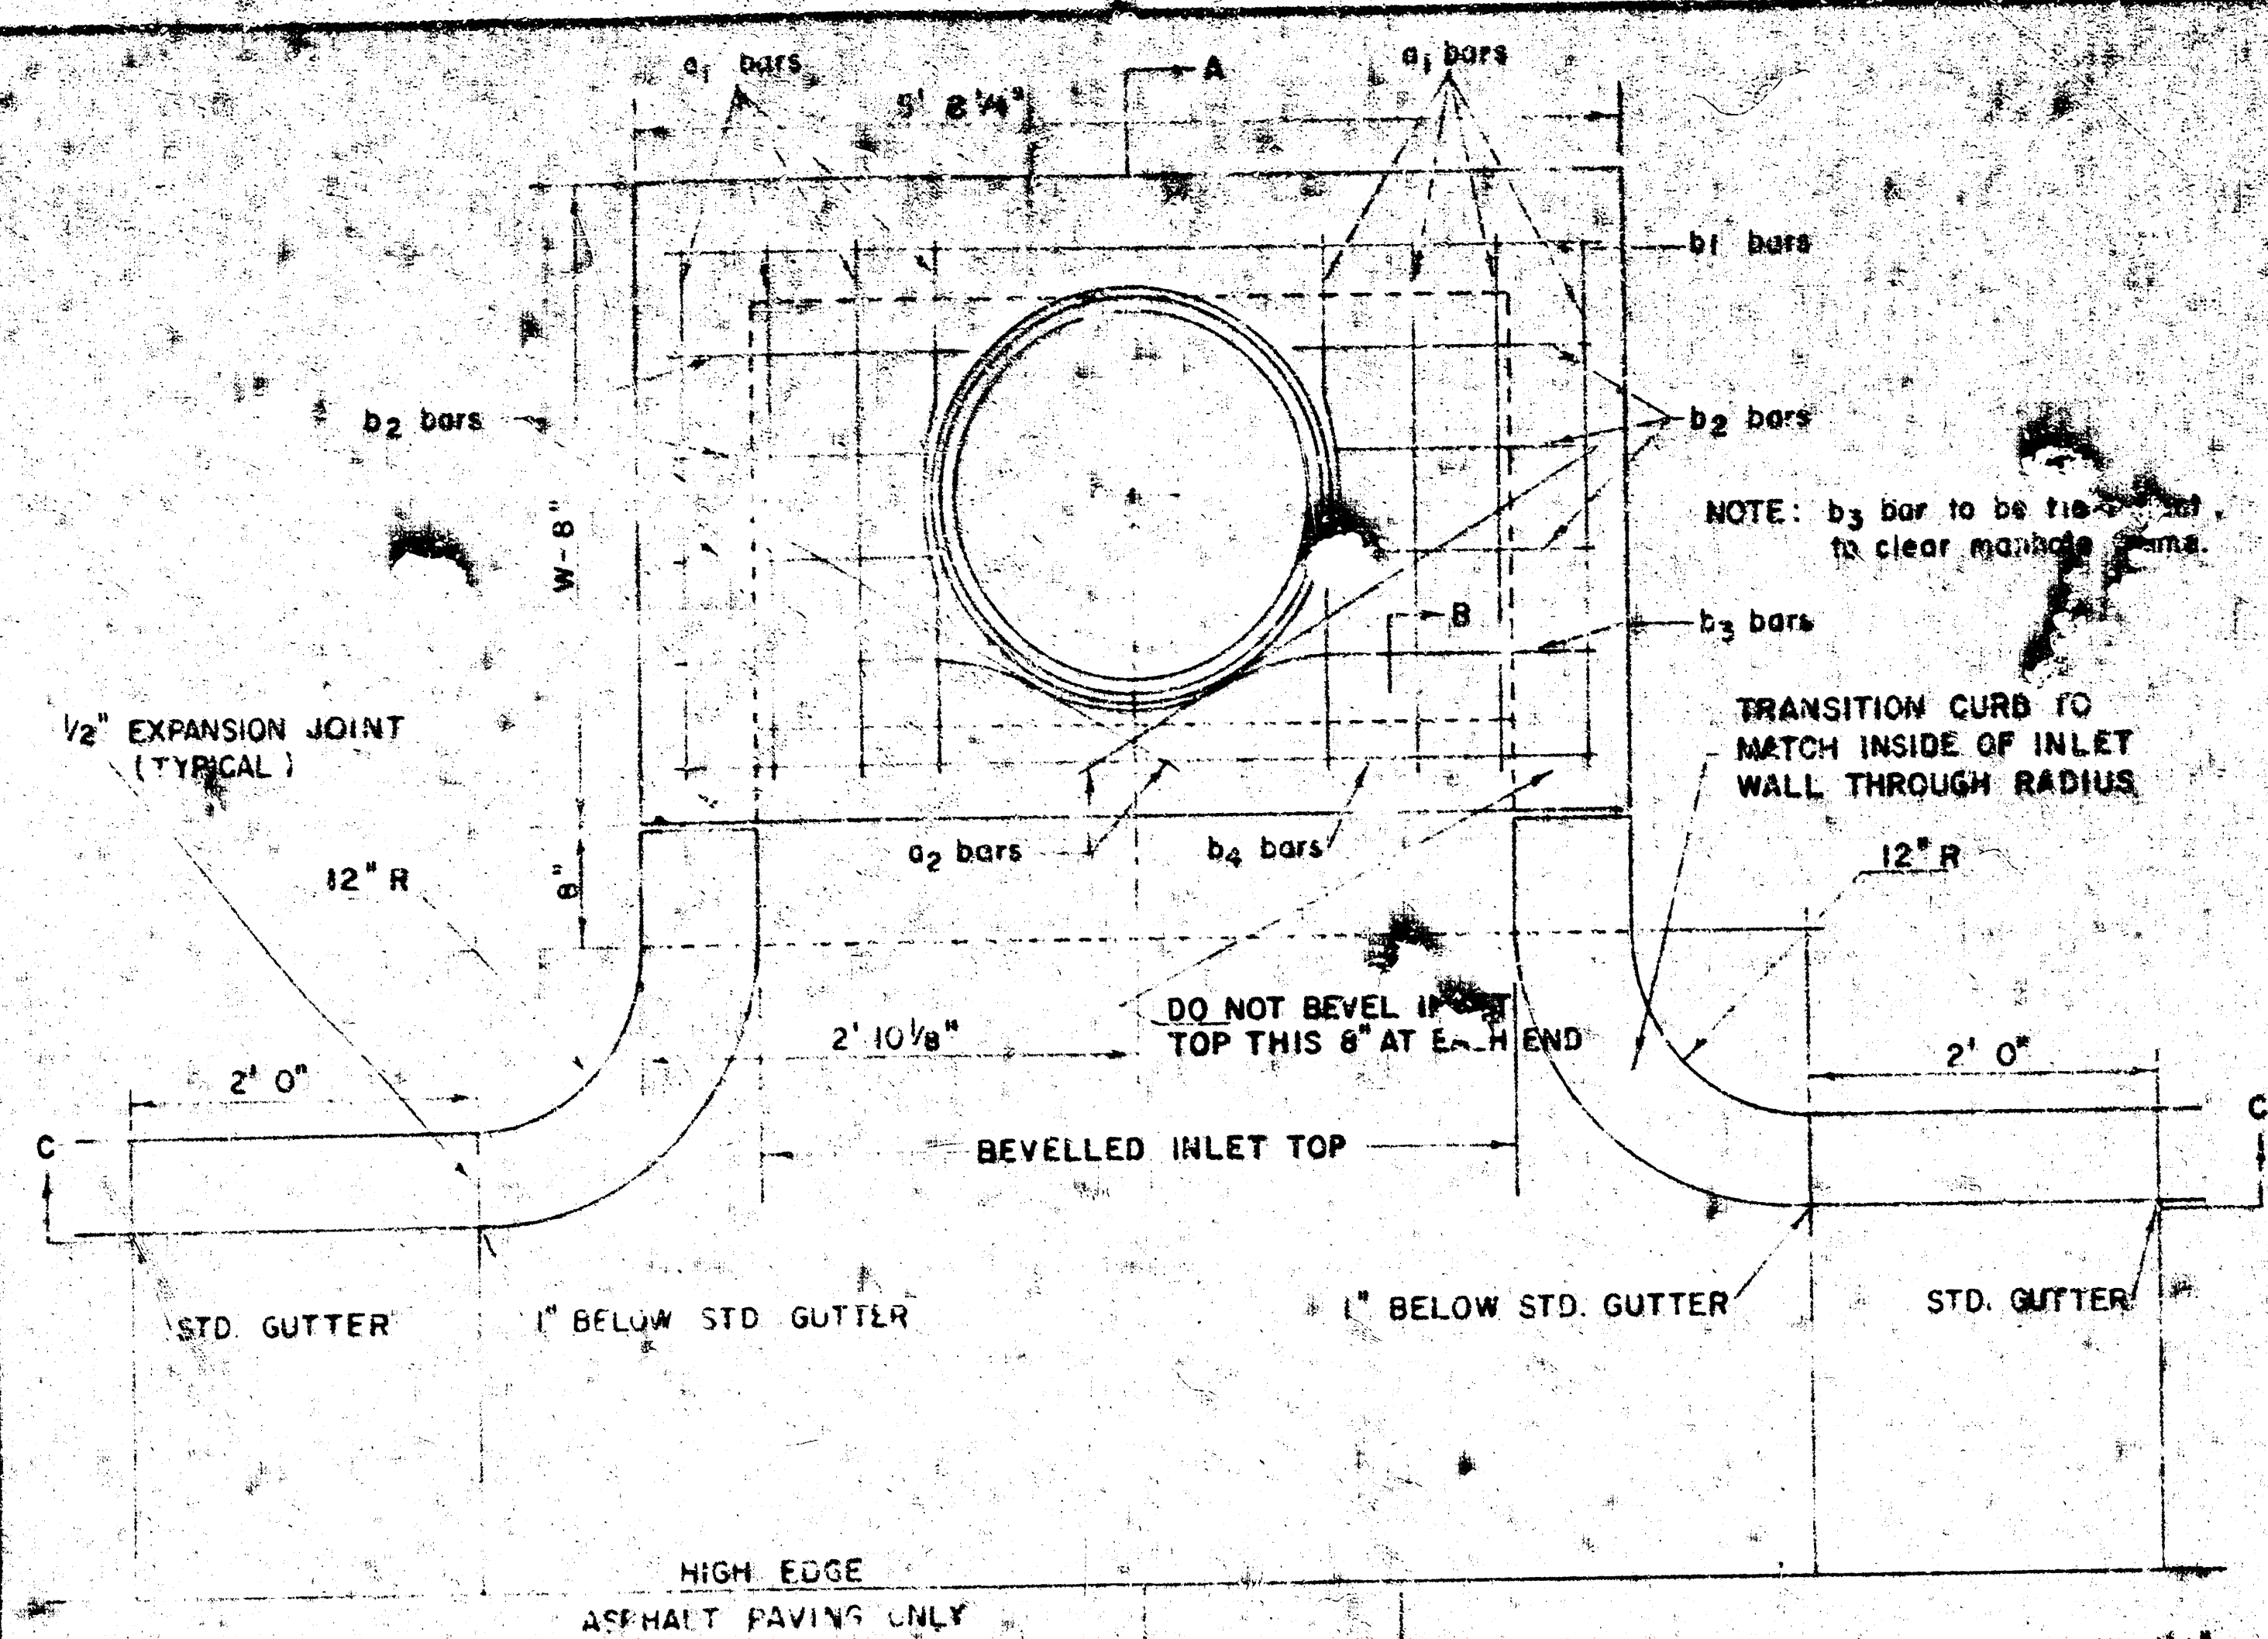

STEEL SCHEDULE

BAR	a1	a2	b1	b2	b3	b4	b5	WT. LBS.
NUMBER	8	2	1	5	7	9	1	1
SIZE	4	4	4	4	4	4	4	6
W	4' 2"	6' 5"	3' 4"	5' 5"	-	-	1' 5"	5' 6"
D	8"	1"	4' 4"	-	5' 5"	-	1' 5"	5' 6"
WT.	60#	77#	97#	11#	16#	124#		






NOTE: a2 BARS TO BE PLACED APPROX. 2" BELOW TOP OF INLET COVER

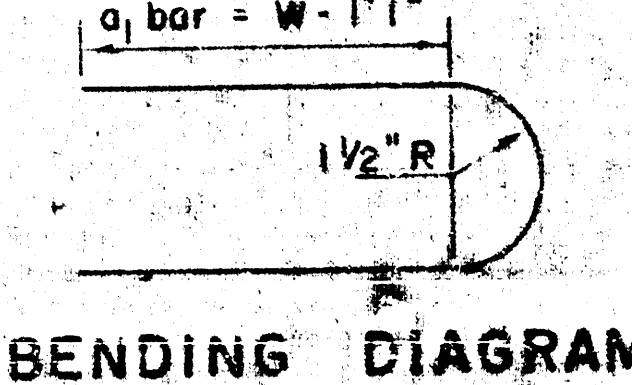


STANDARD CURB INLET PRECAST TOPS

W	PRECAST TOP SIZE	PIPE SIZE	CU. YD. CONC.
4' 2"	36" x 5' 8 1/4" x 7 1/2"	21" & SMALLER	0.56
5' 0"	44" x 5' 8 1/4" x 7 1/2"	24" & 30"	0.57
6' 0"	54" x 5' 8 1/4" x 7 1/2"	36" & 42"	0.71
7' 0"	64" x 5' 8 1/4" x 7 1/2"	48" & 54"	0.84
8' 0"	74" x 5' 8 1/4" x 7 1/2"	60" & 66"	0.97

GROSS VOLUME

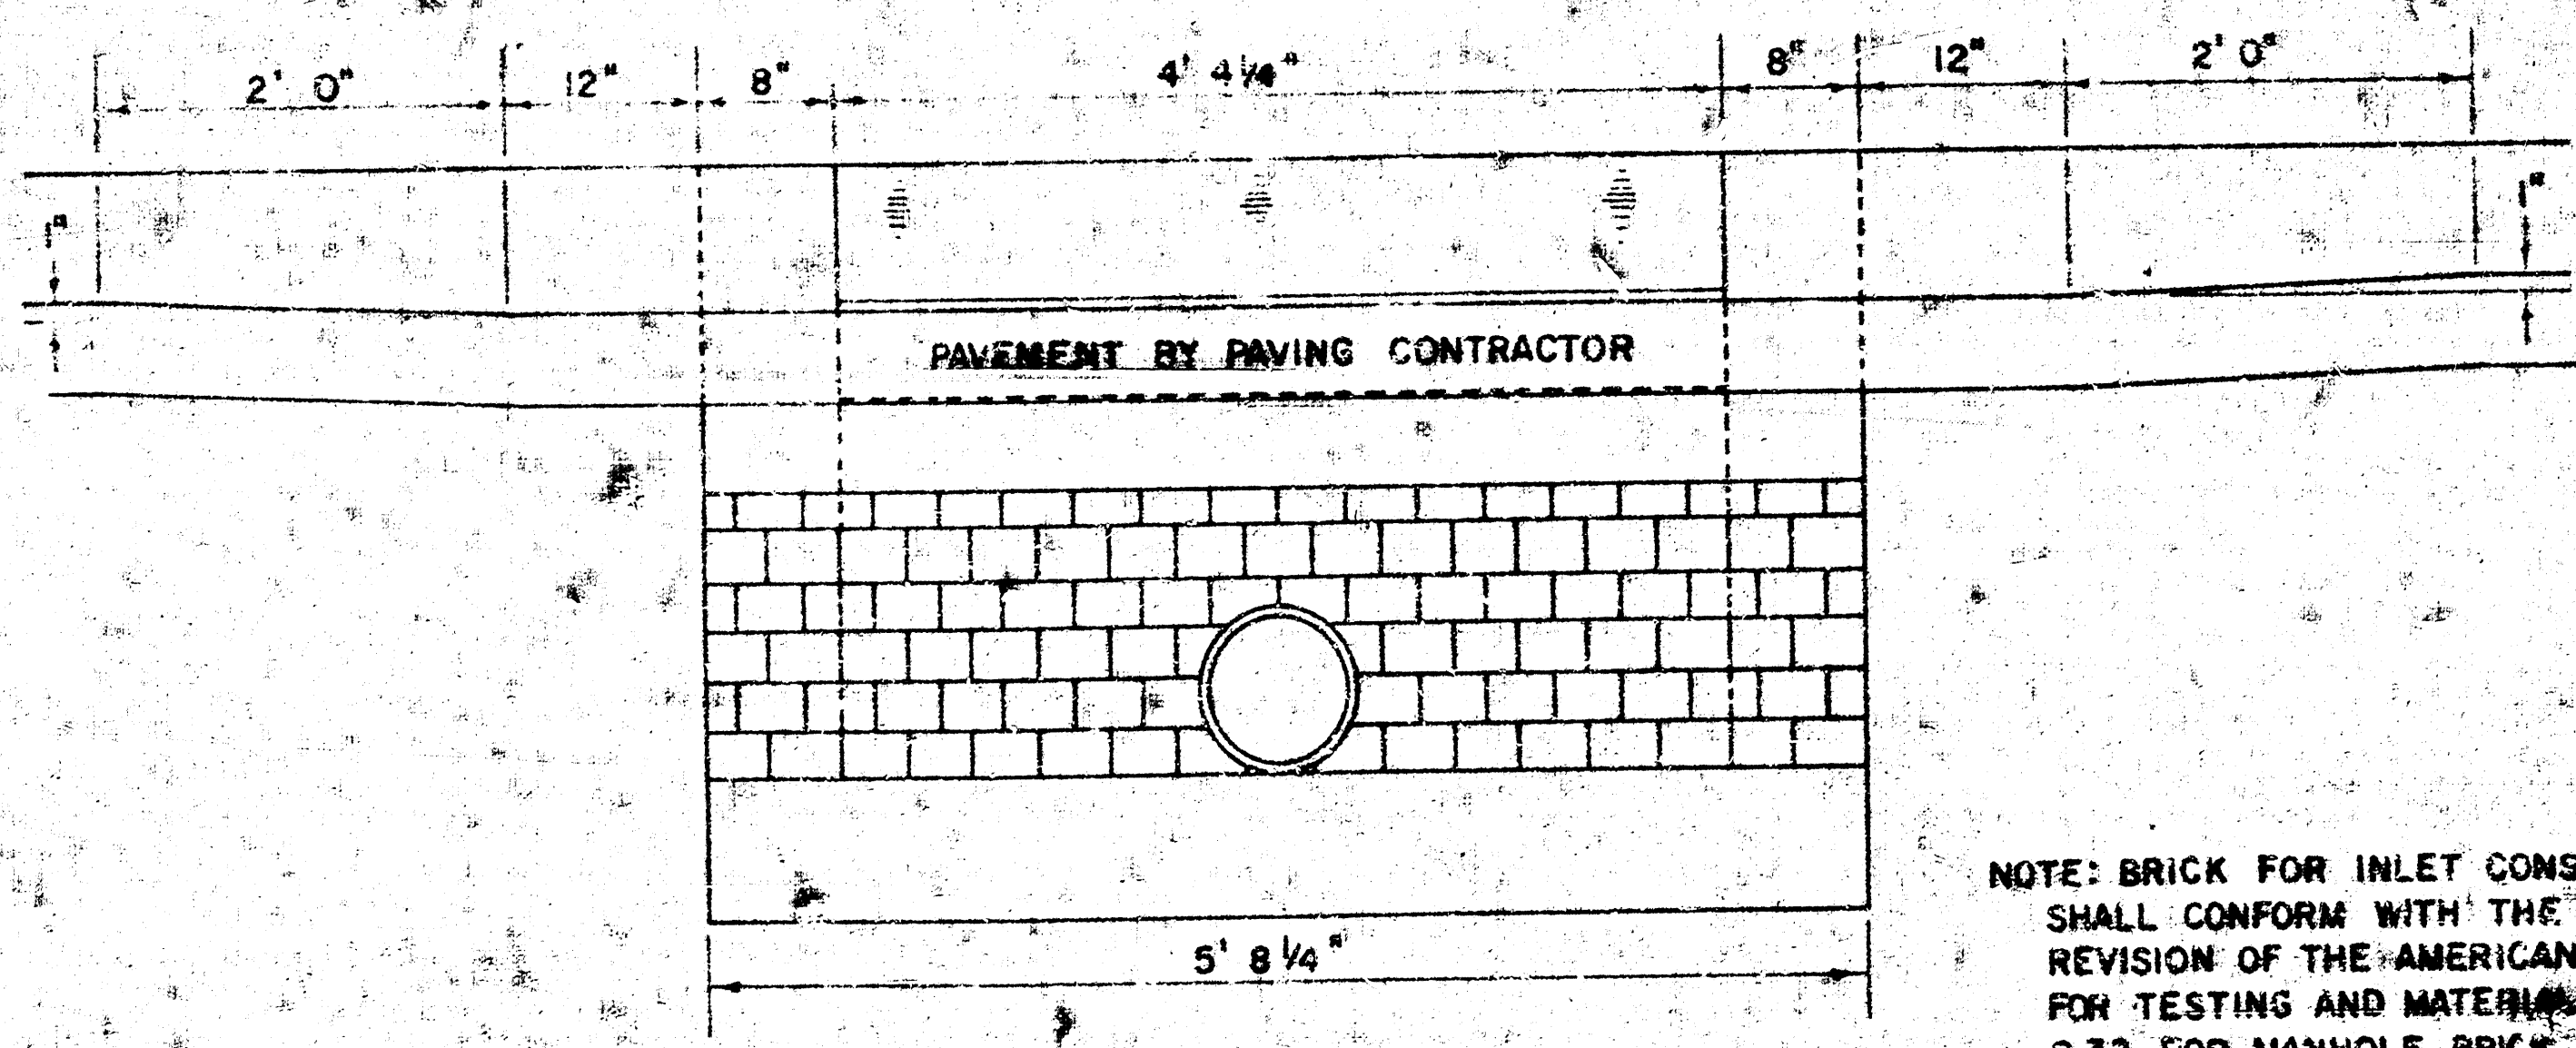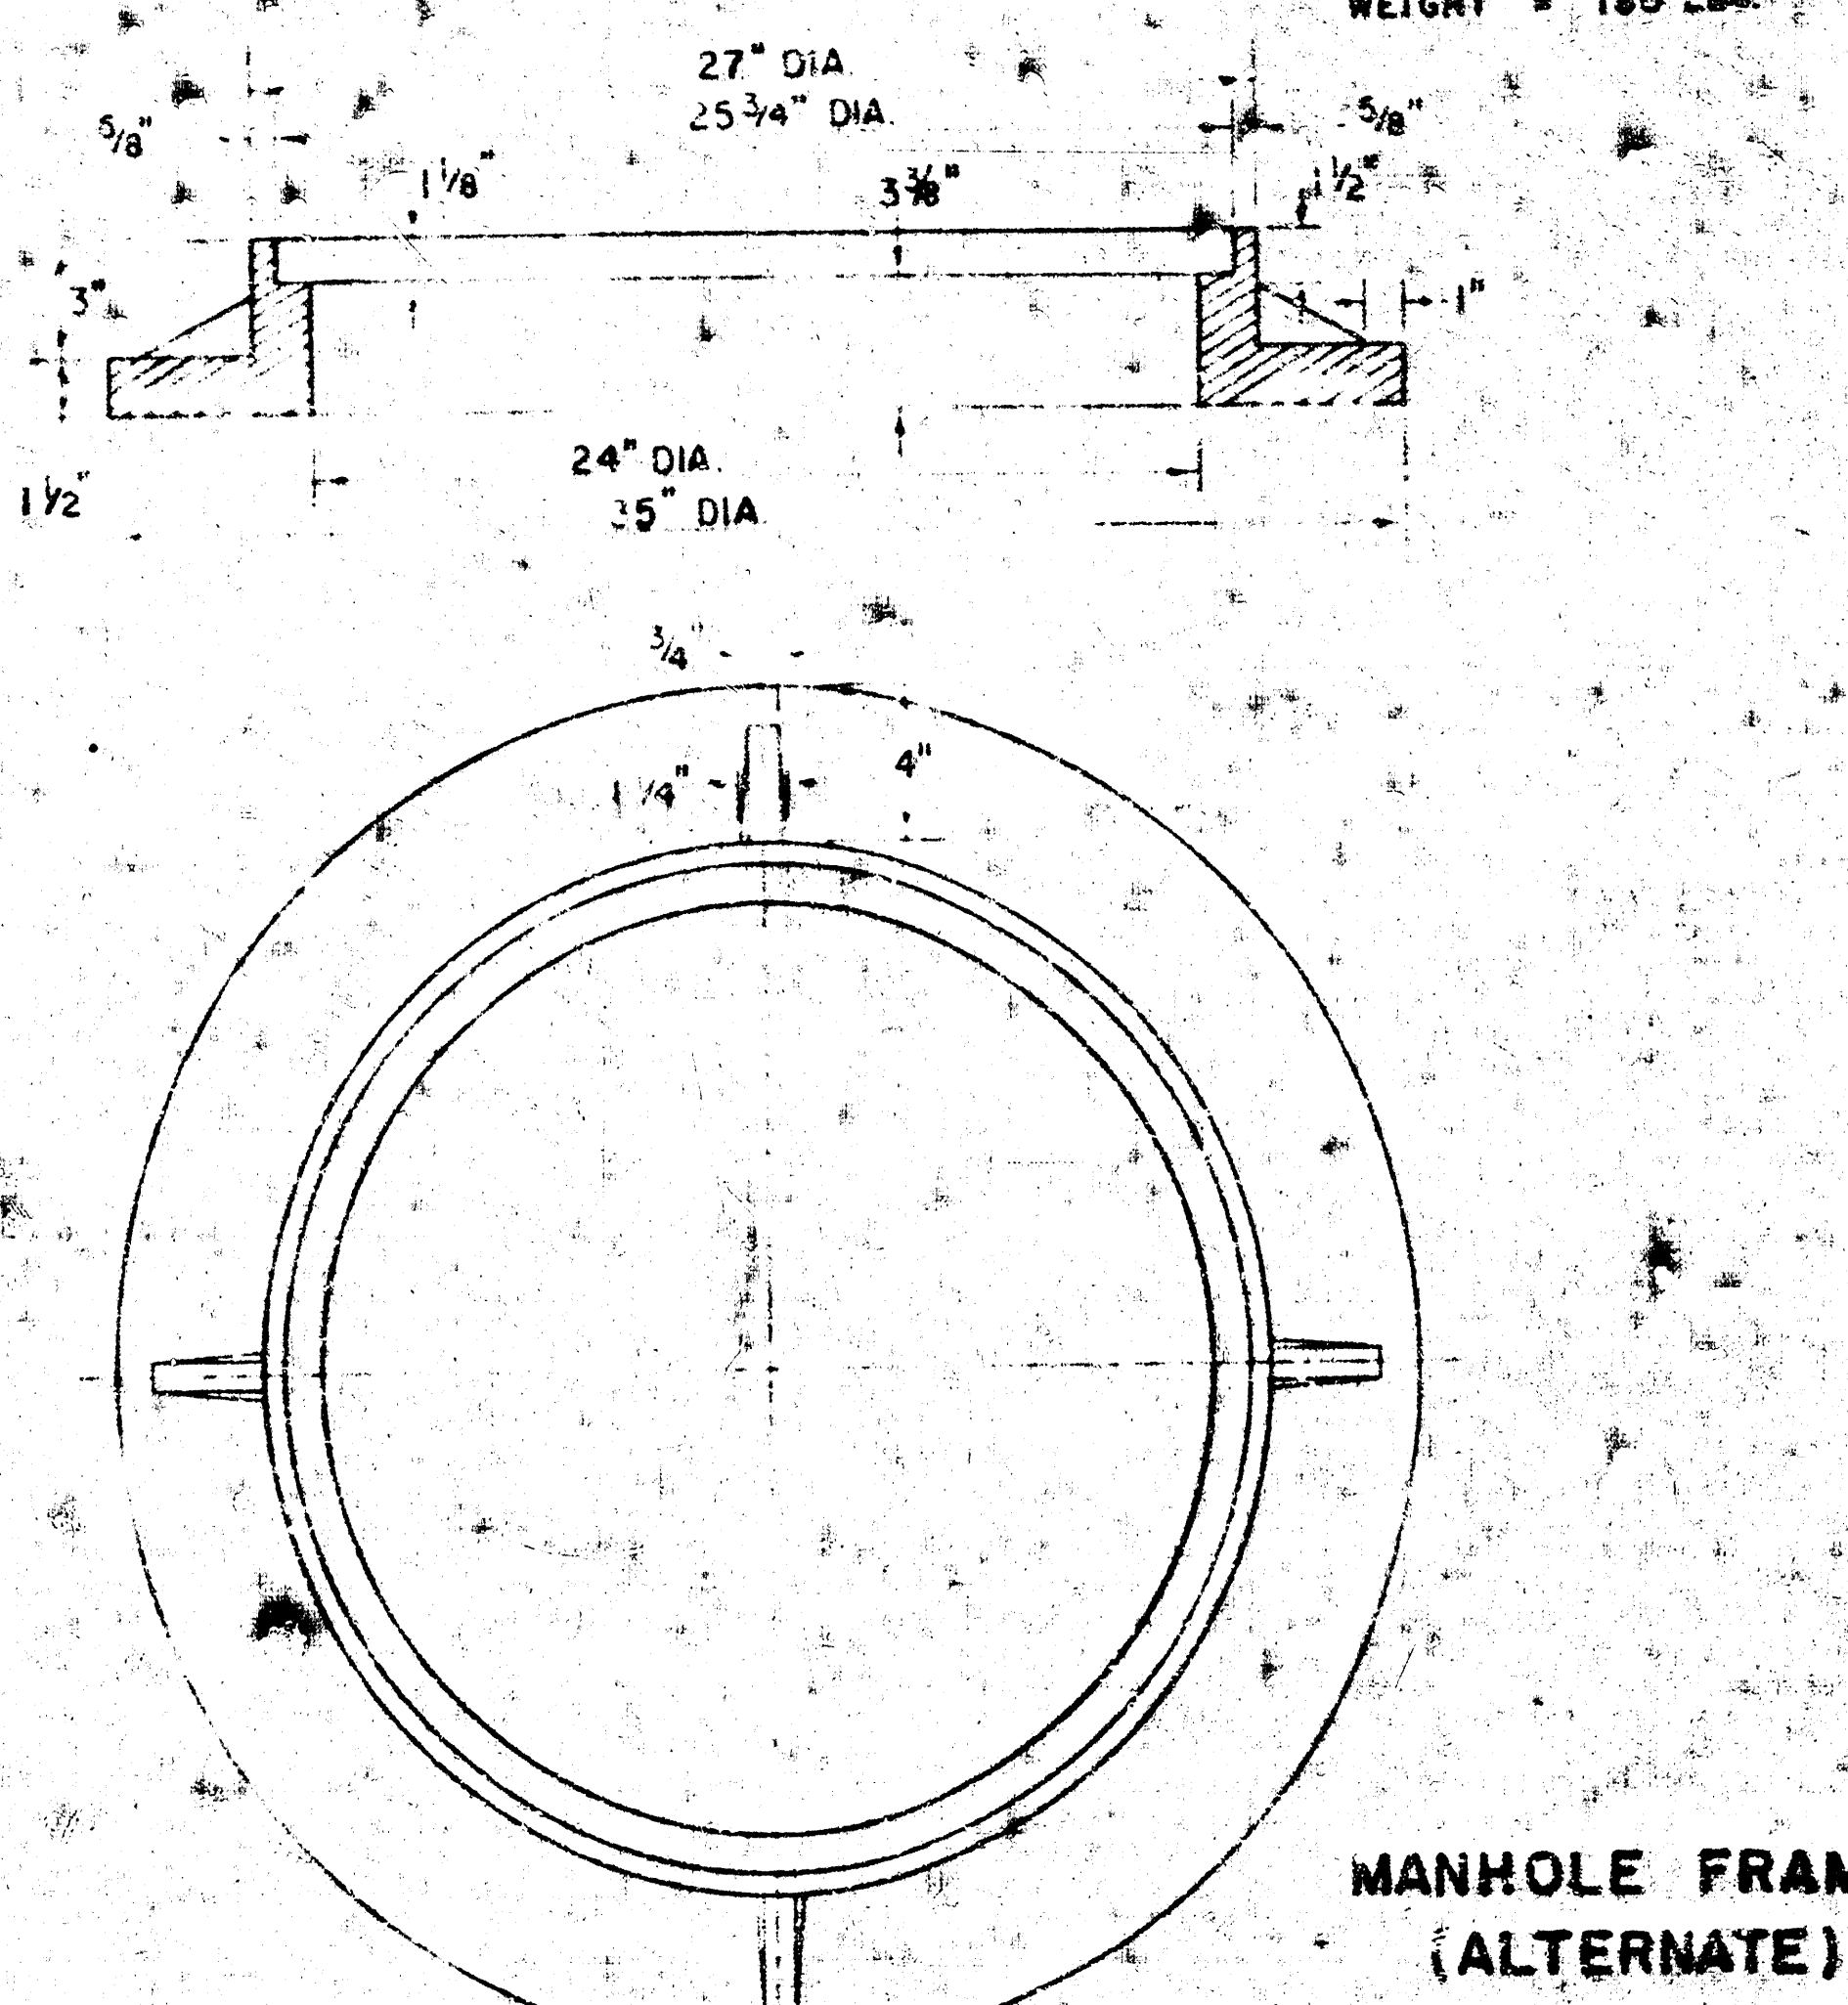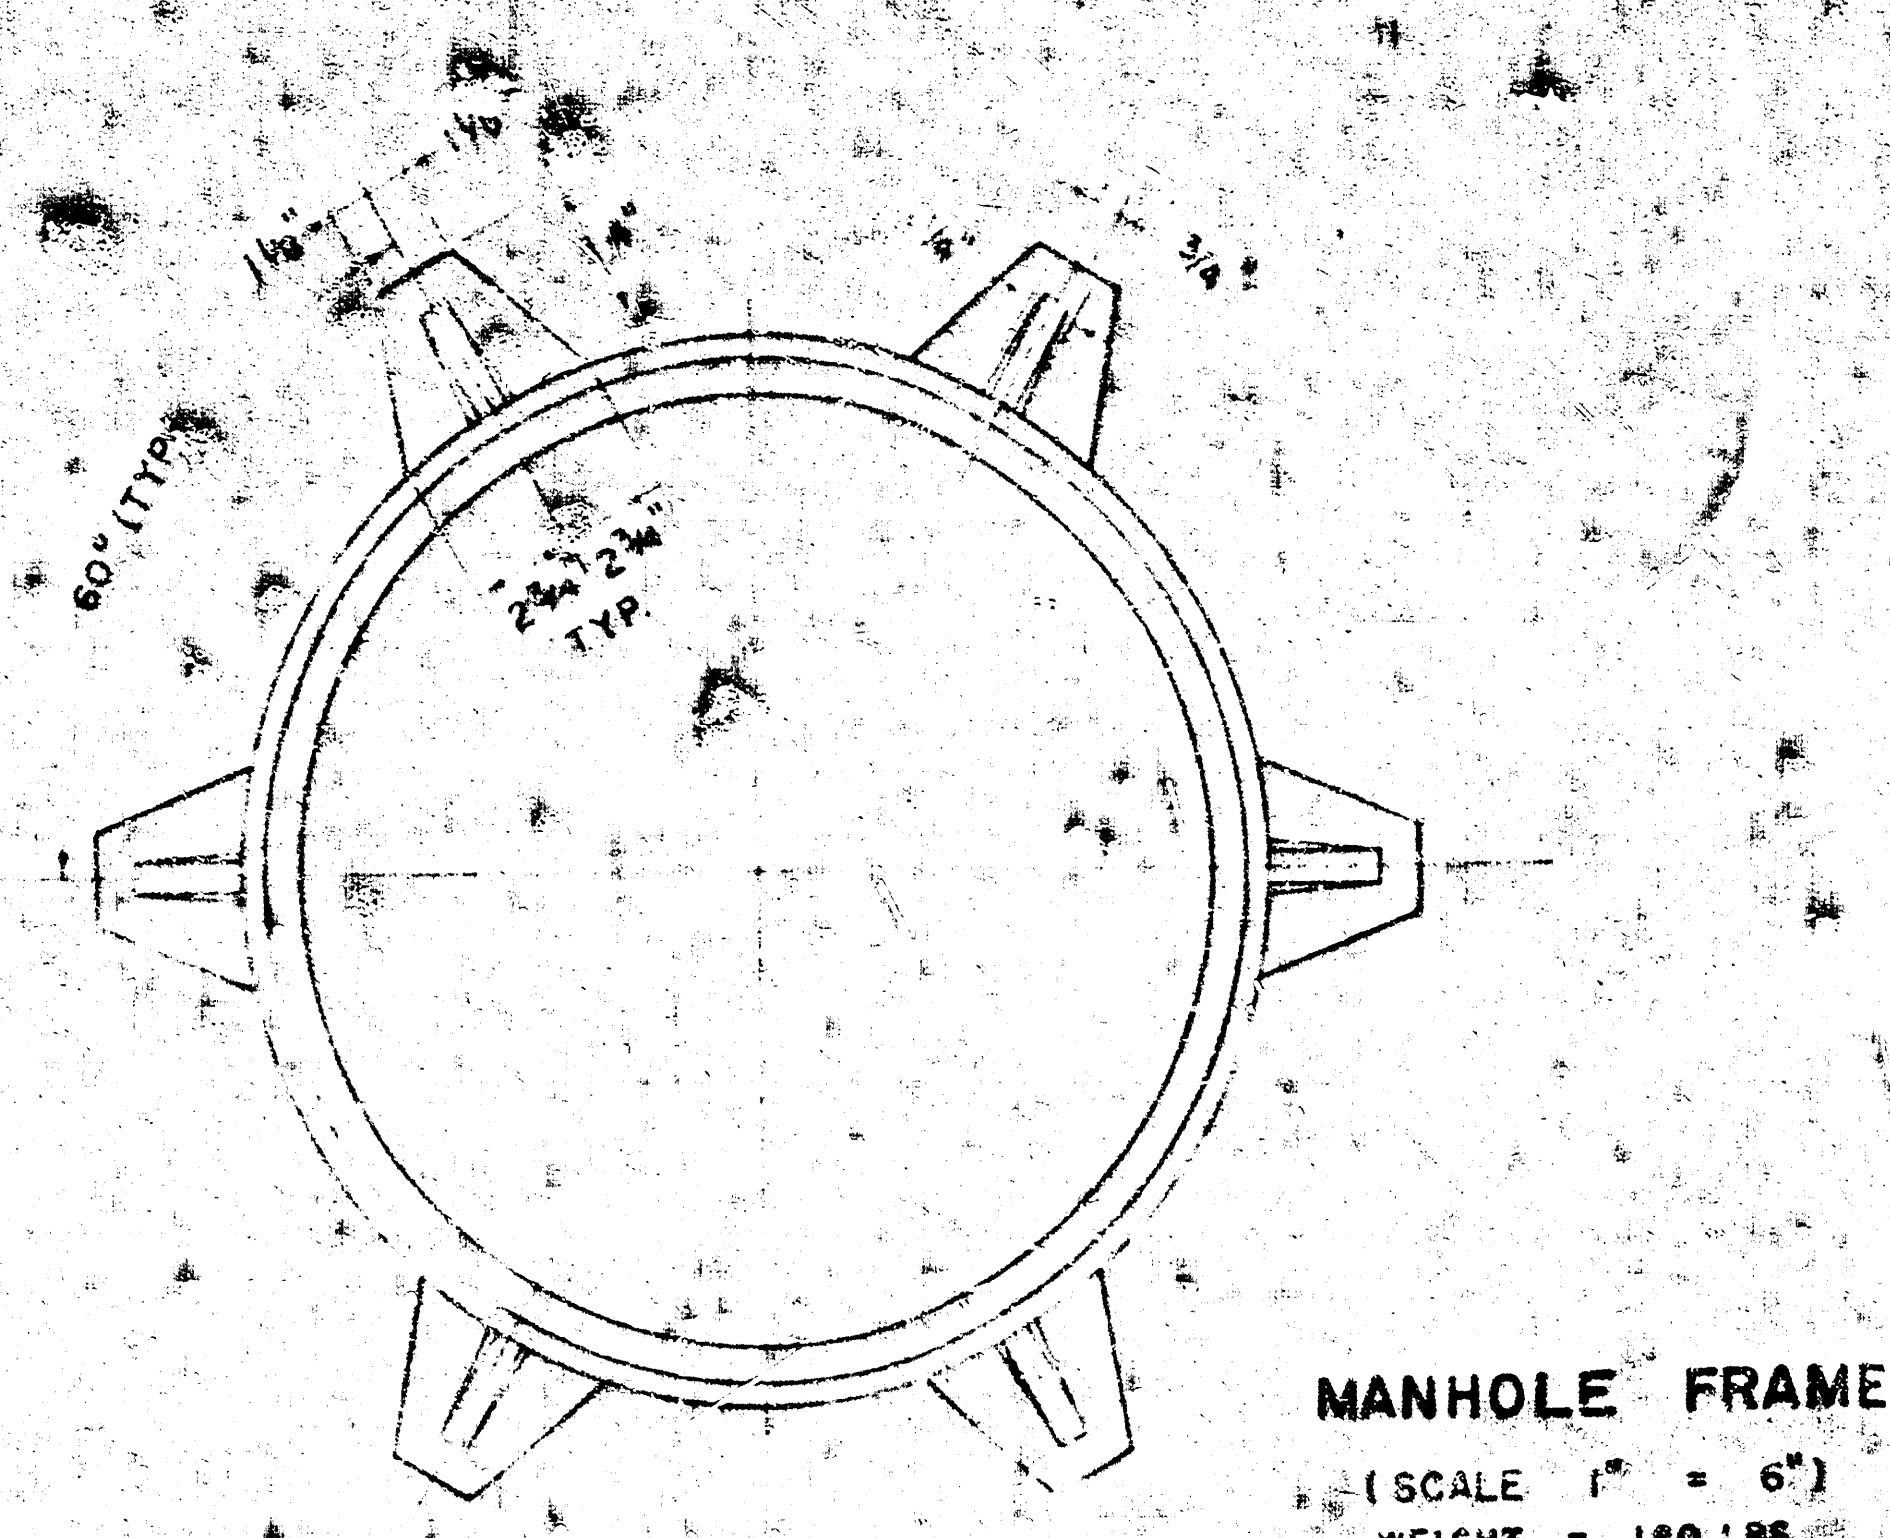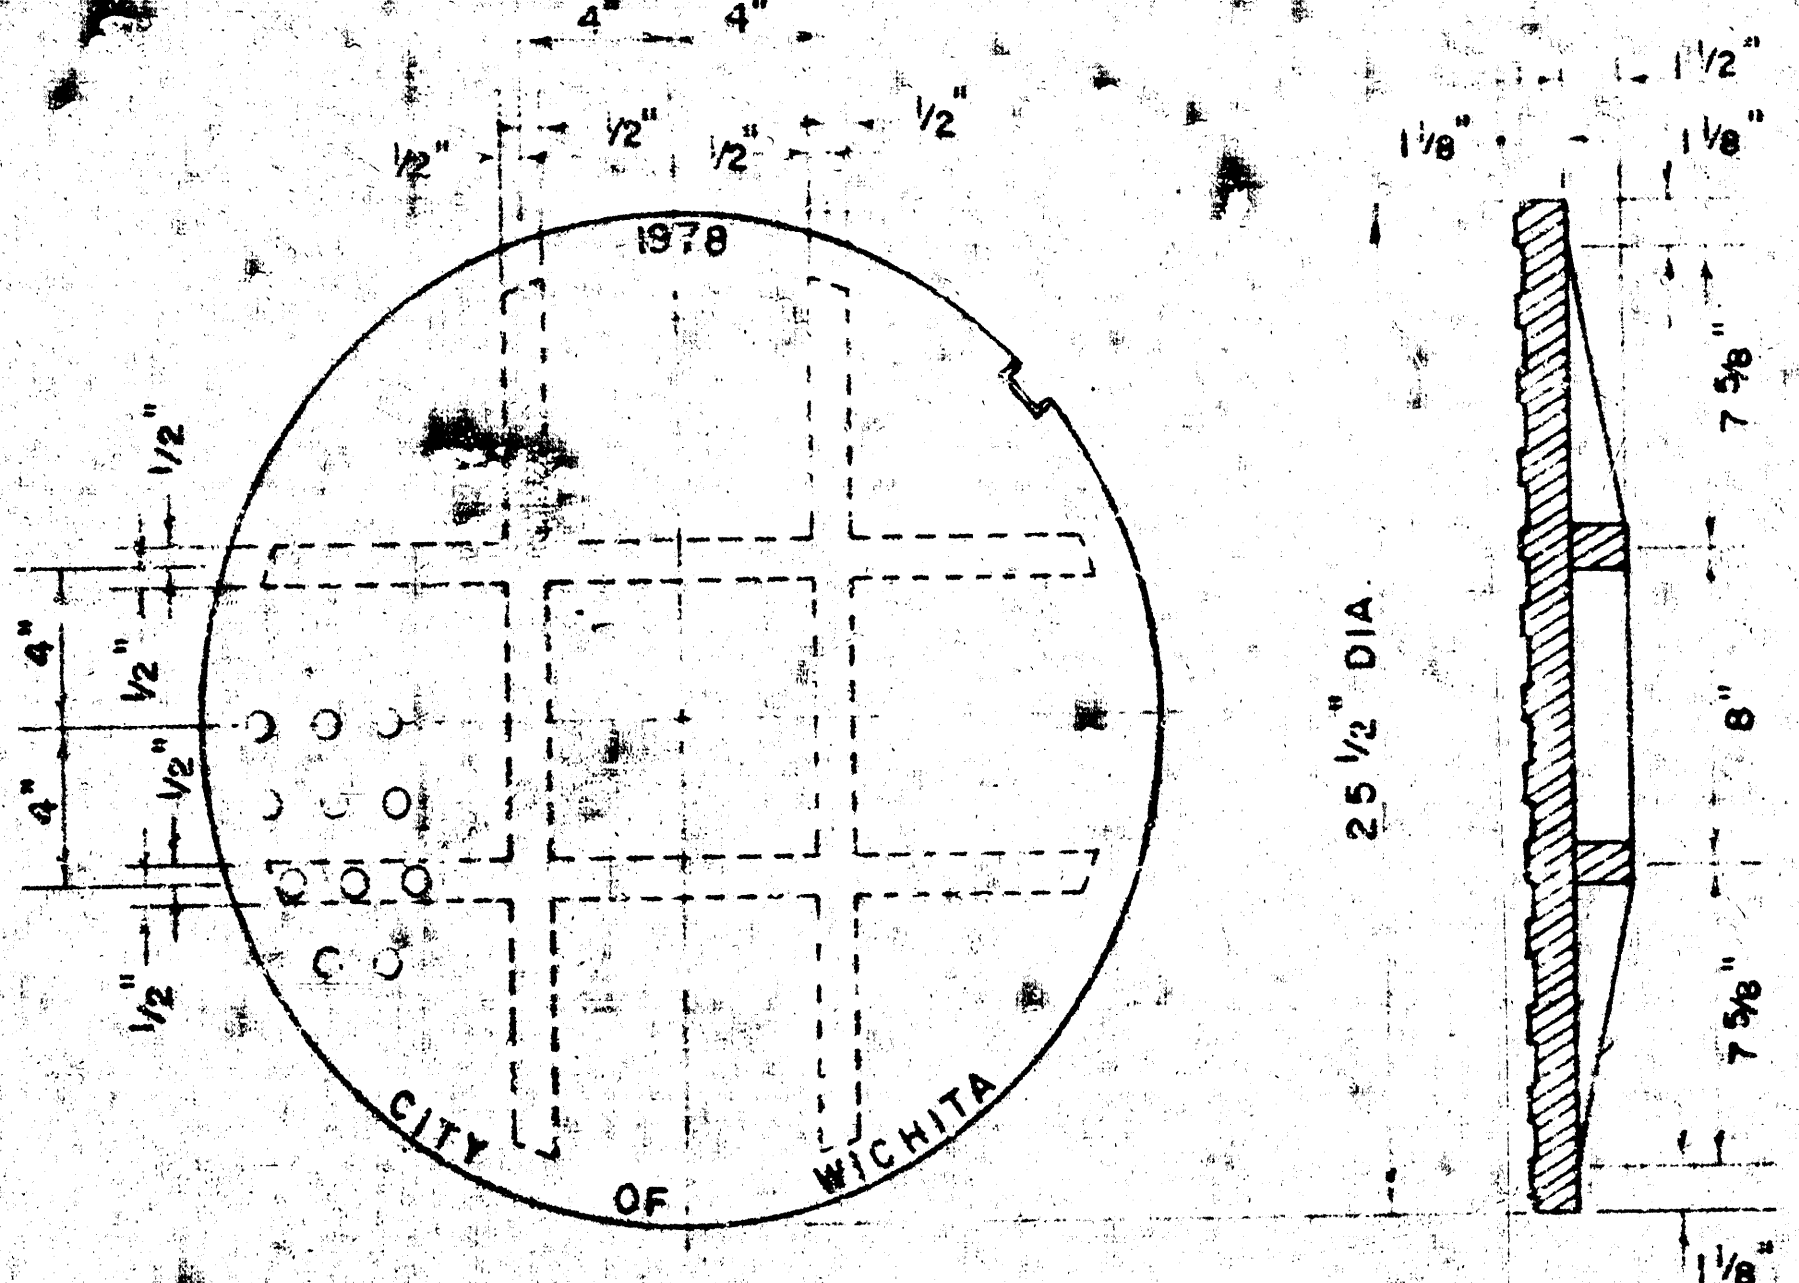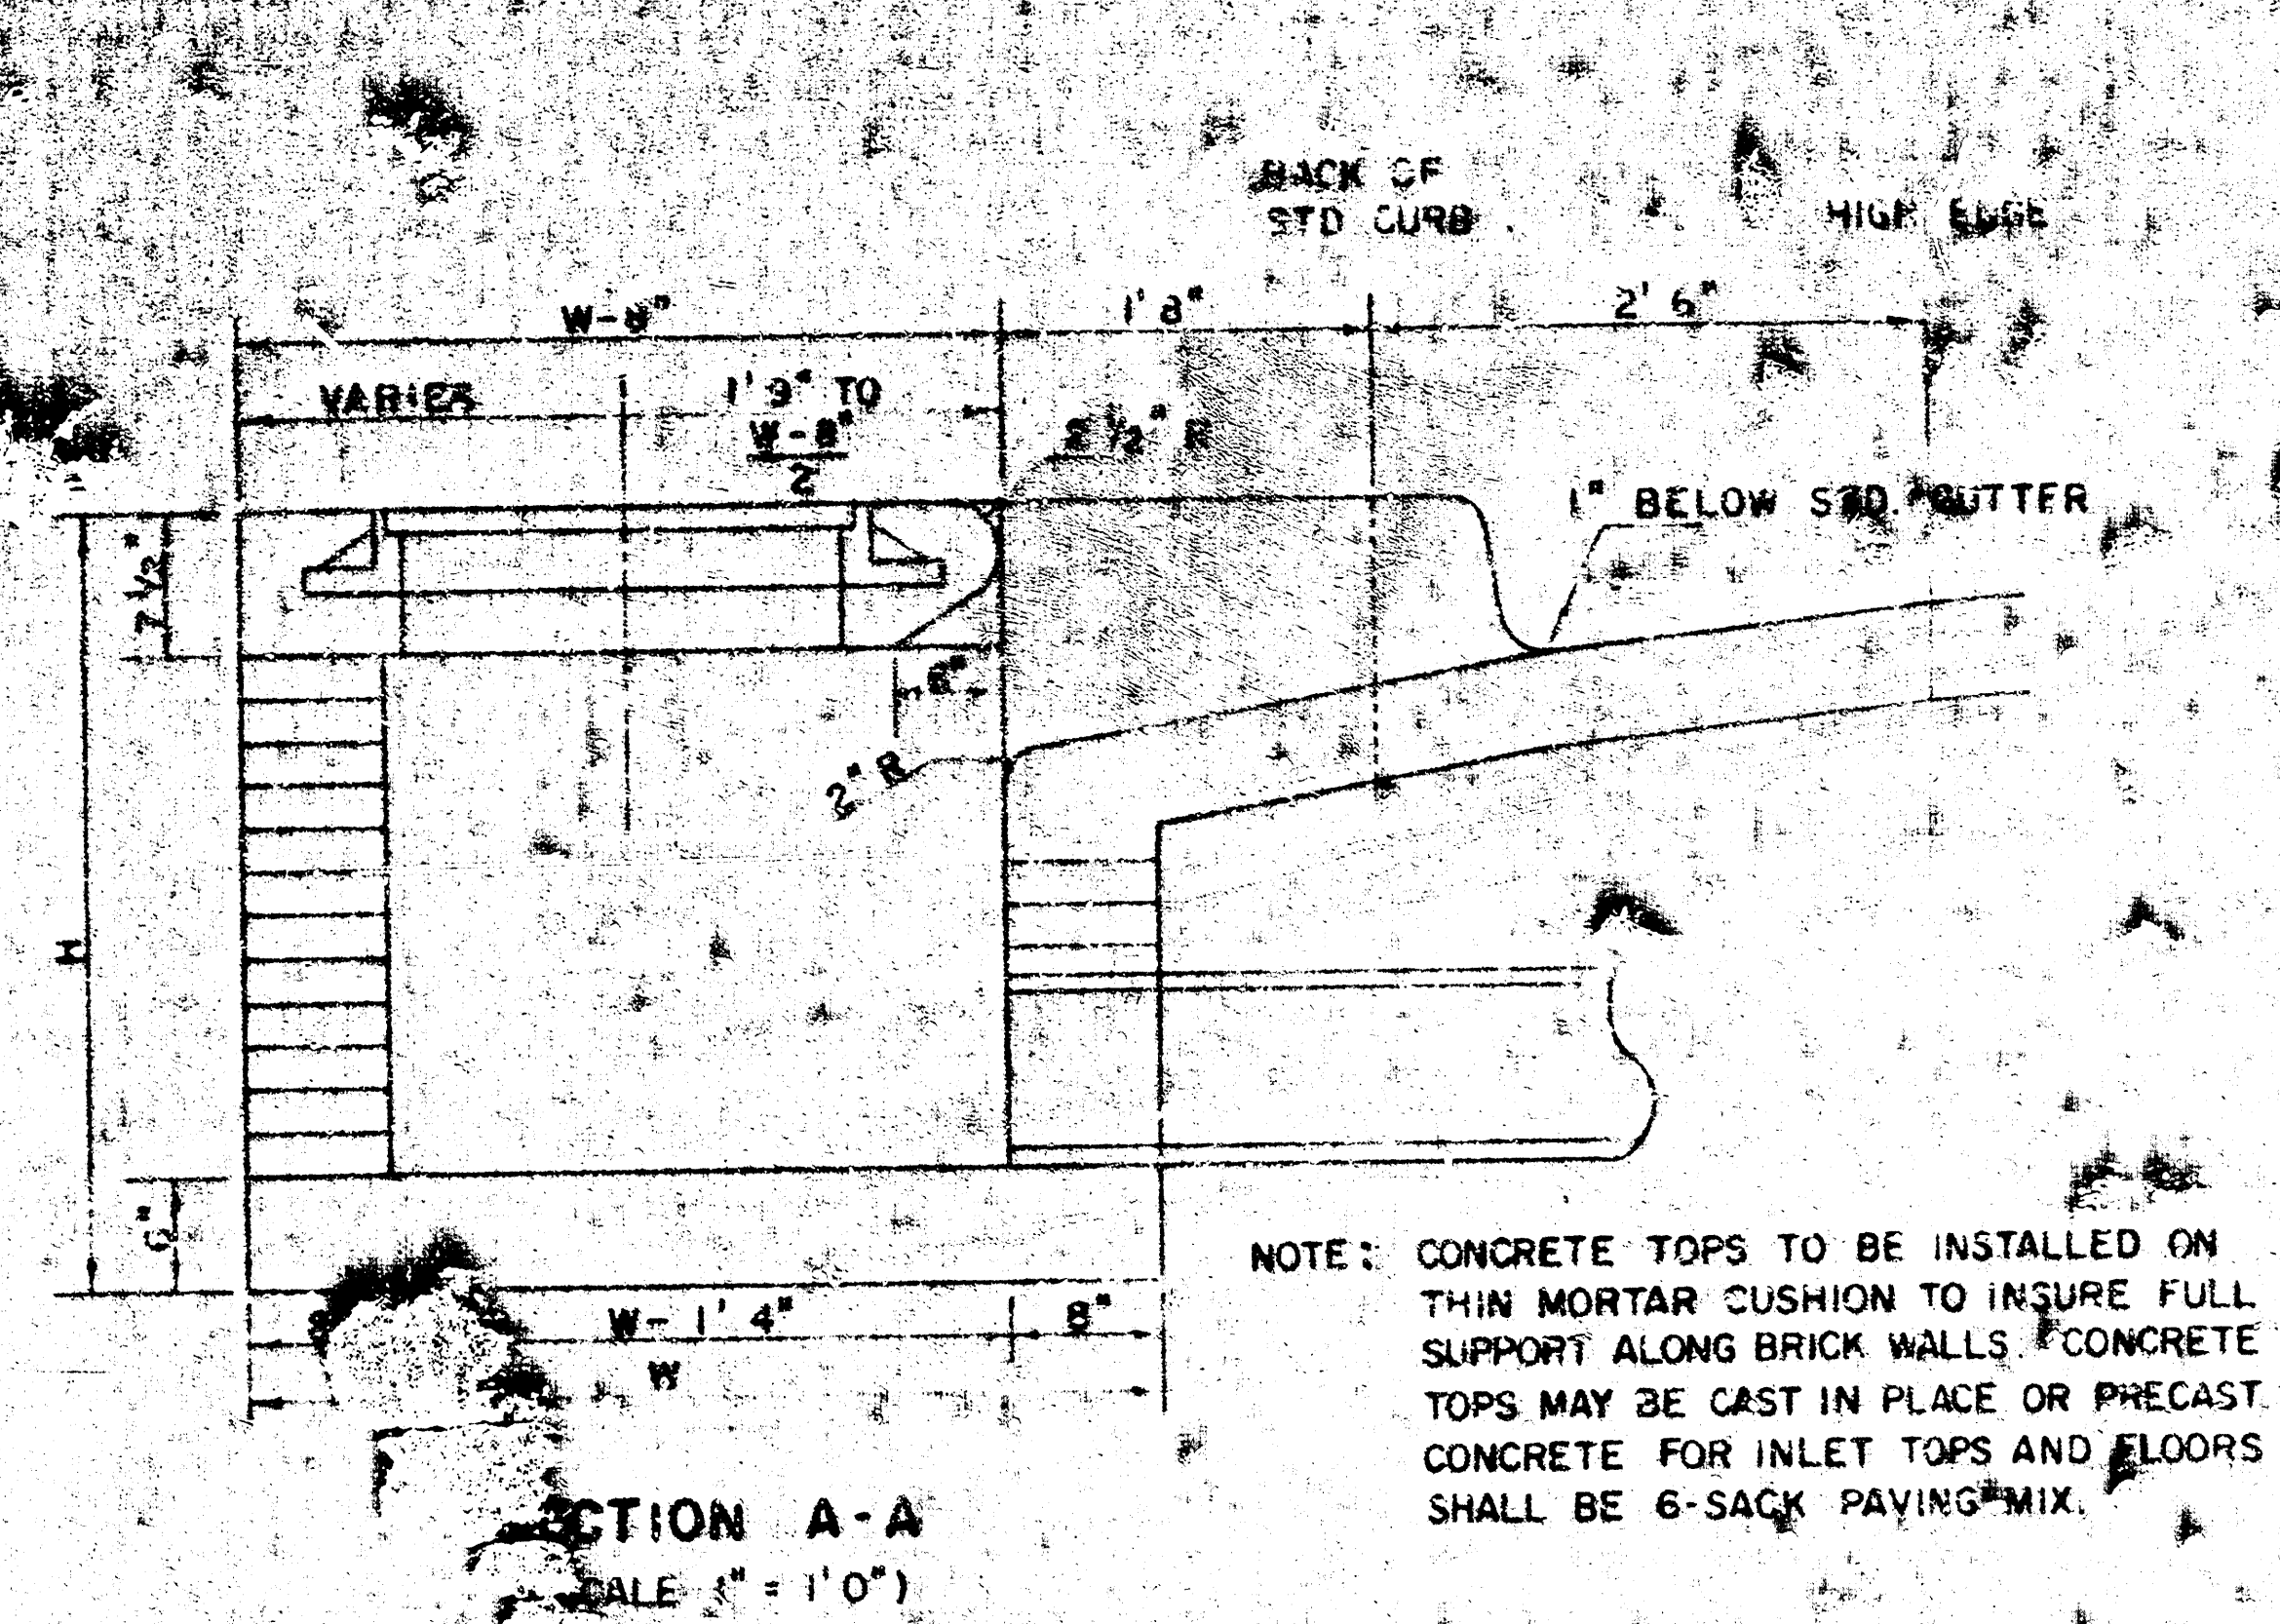

NOTE: BRICK FOR INLET CONSTRUCTION SHALL CONFORM WITH THE LATEST REVISION OF THE AMERICAN SOCIETY FOR TESTING AND MATERIALS DESIGNATION C-32 FOR MANHOLE BRICK GRADE MS.

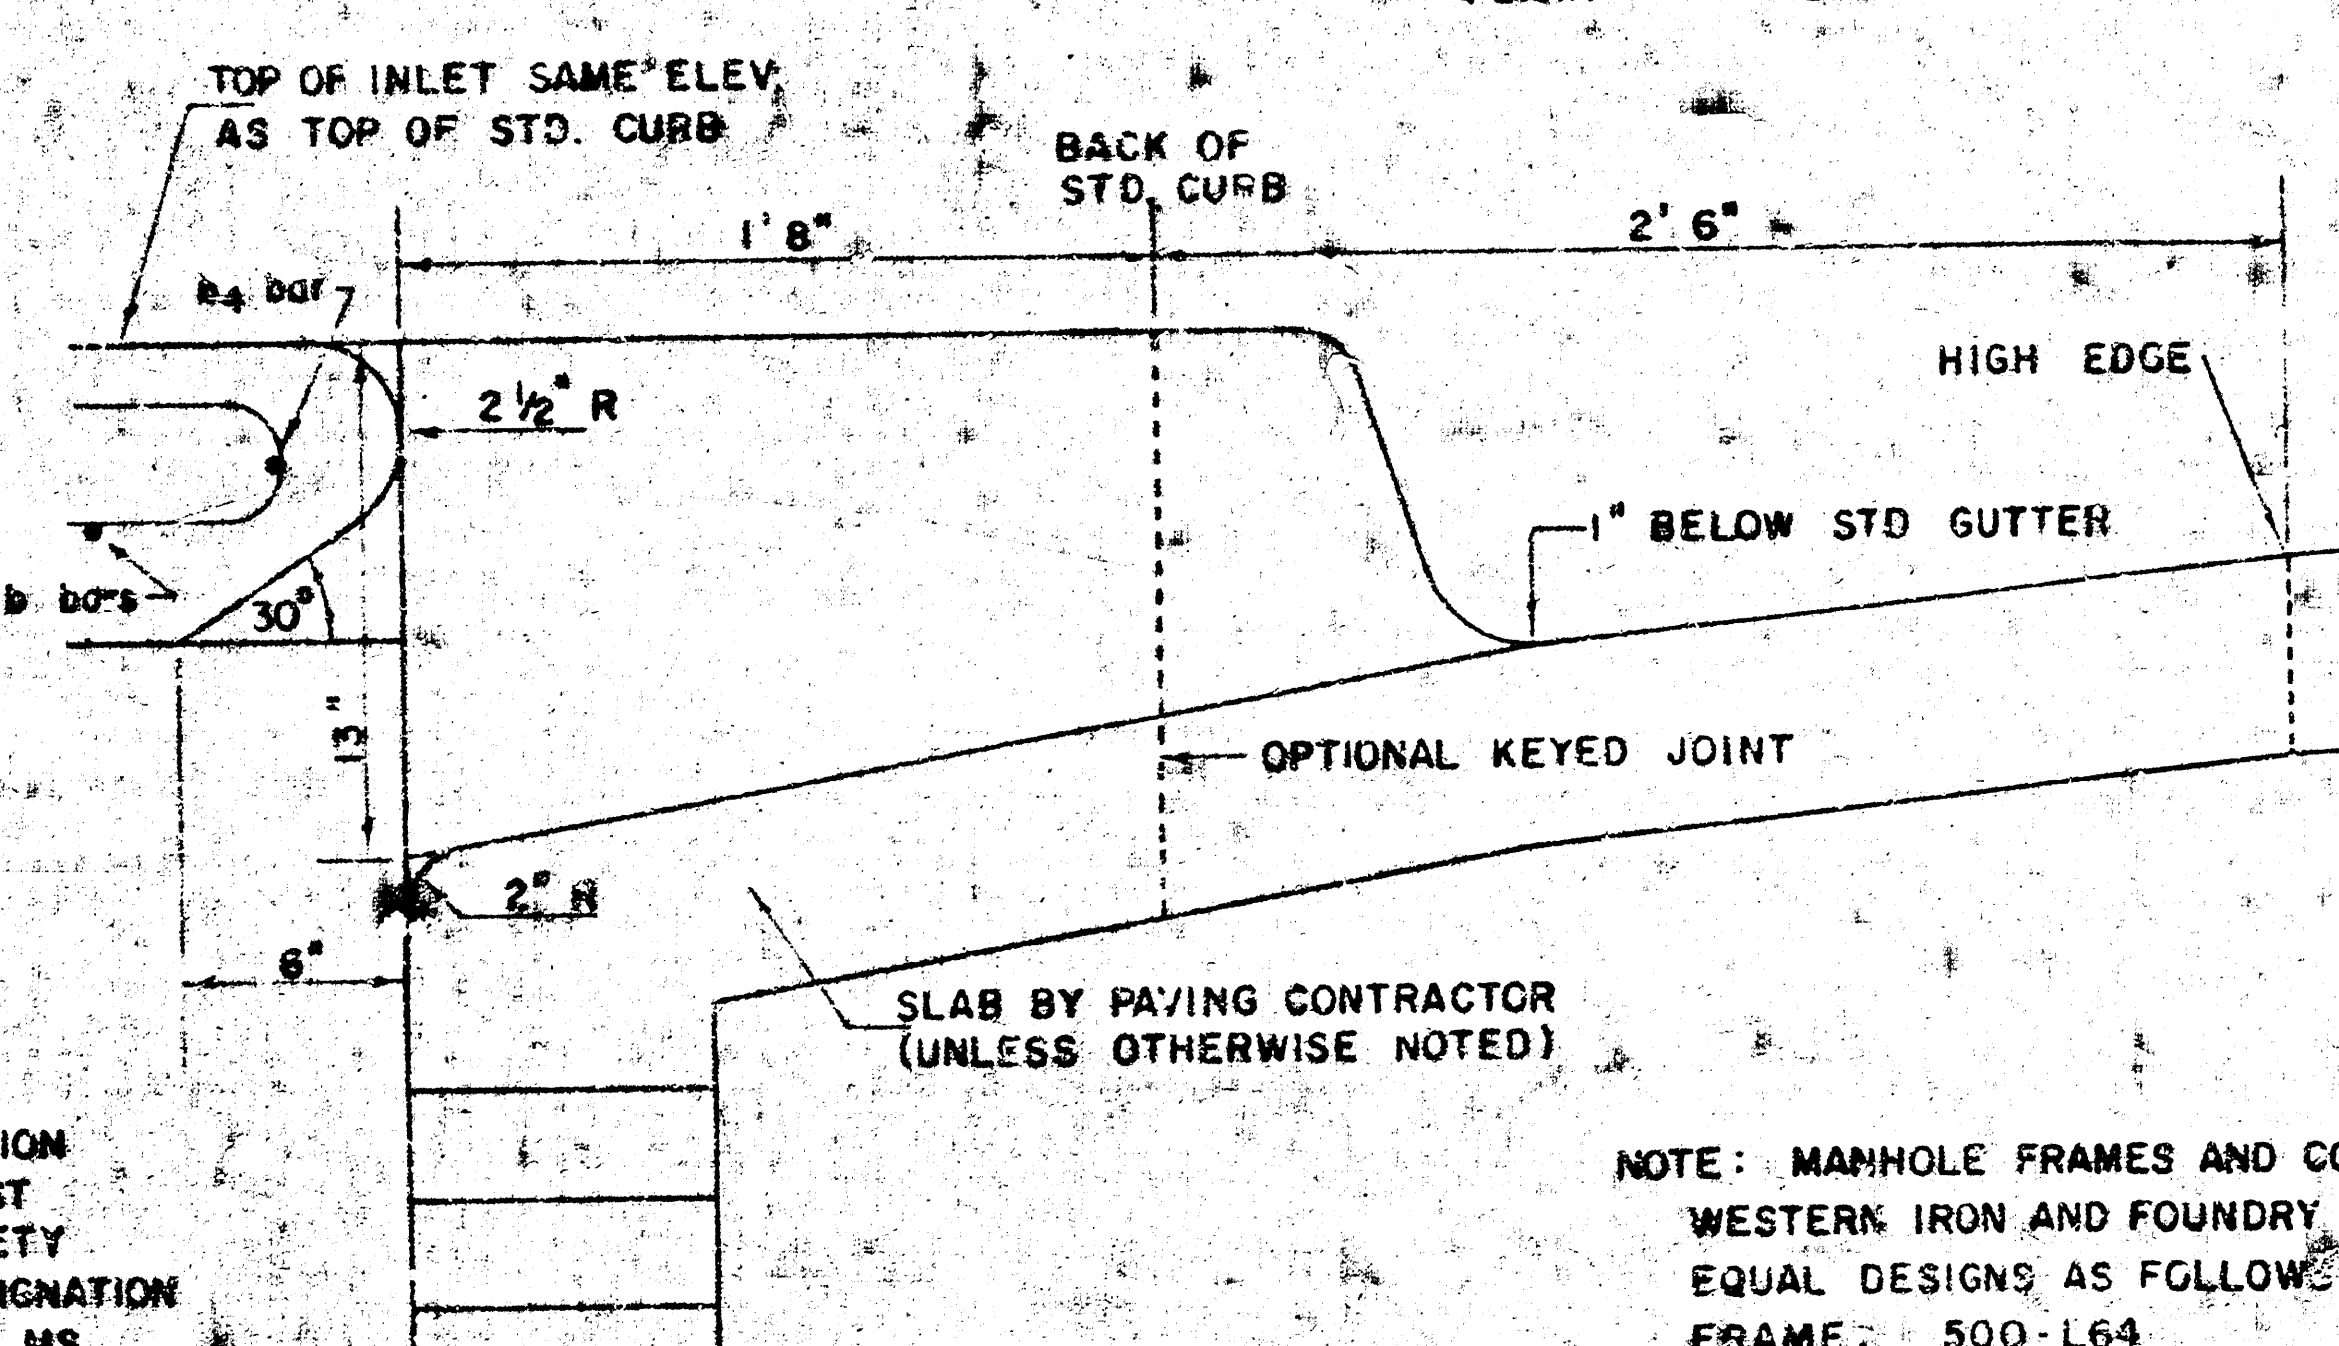

NOTE: MANHOLE FRAMES AND COVER ARE WESTERN IRON AND FOUNDRY CO. INC. OR EQUAL DESIGNS AS FOLLOWS:
FRAME: 500-L64
FRAME (ALTERNATE): 500-A4
COVER: 222-S4 "MOBBY"

DETAIL STANDARD TYPE 1A CURB INLET
CITY OF WICHITA, KANSAS
R. W. LINN — CITY ENGINEER
OCTOBER 1978

FILMED FROM THE BEST AVAILABLE COPY