

CONTINENTAL VILLAGE MARINA

LITTLE ARKANSAS RIVER
WICHITA, KANSAS


INDEX OF SHEETS
SHEET
1. TITLE SHEET
2. MARINA SITE PLAN
3. EROSION
4. DETAILS

FOR

JACK P. DE BOER ASSOCIATES, INC.
240 NORTH ROCK ROAD
P.O. BOX 18387
WICHITA, KANSAS 67218


McCALEB ENGINEERING

116 SOUTH BROADWAY
EDMOND, OKLAHOMA

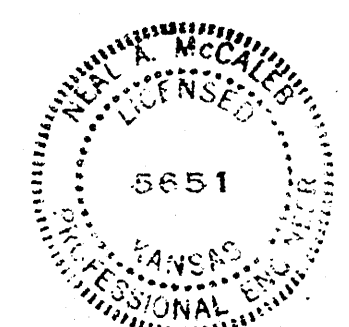
Neal A. McCaleb
NEAL A. McCaleb ENG. REG. NO. 5651


Revised

NOV 12 1970

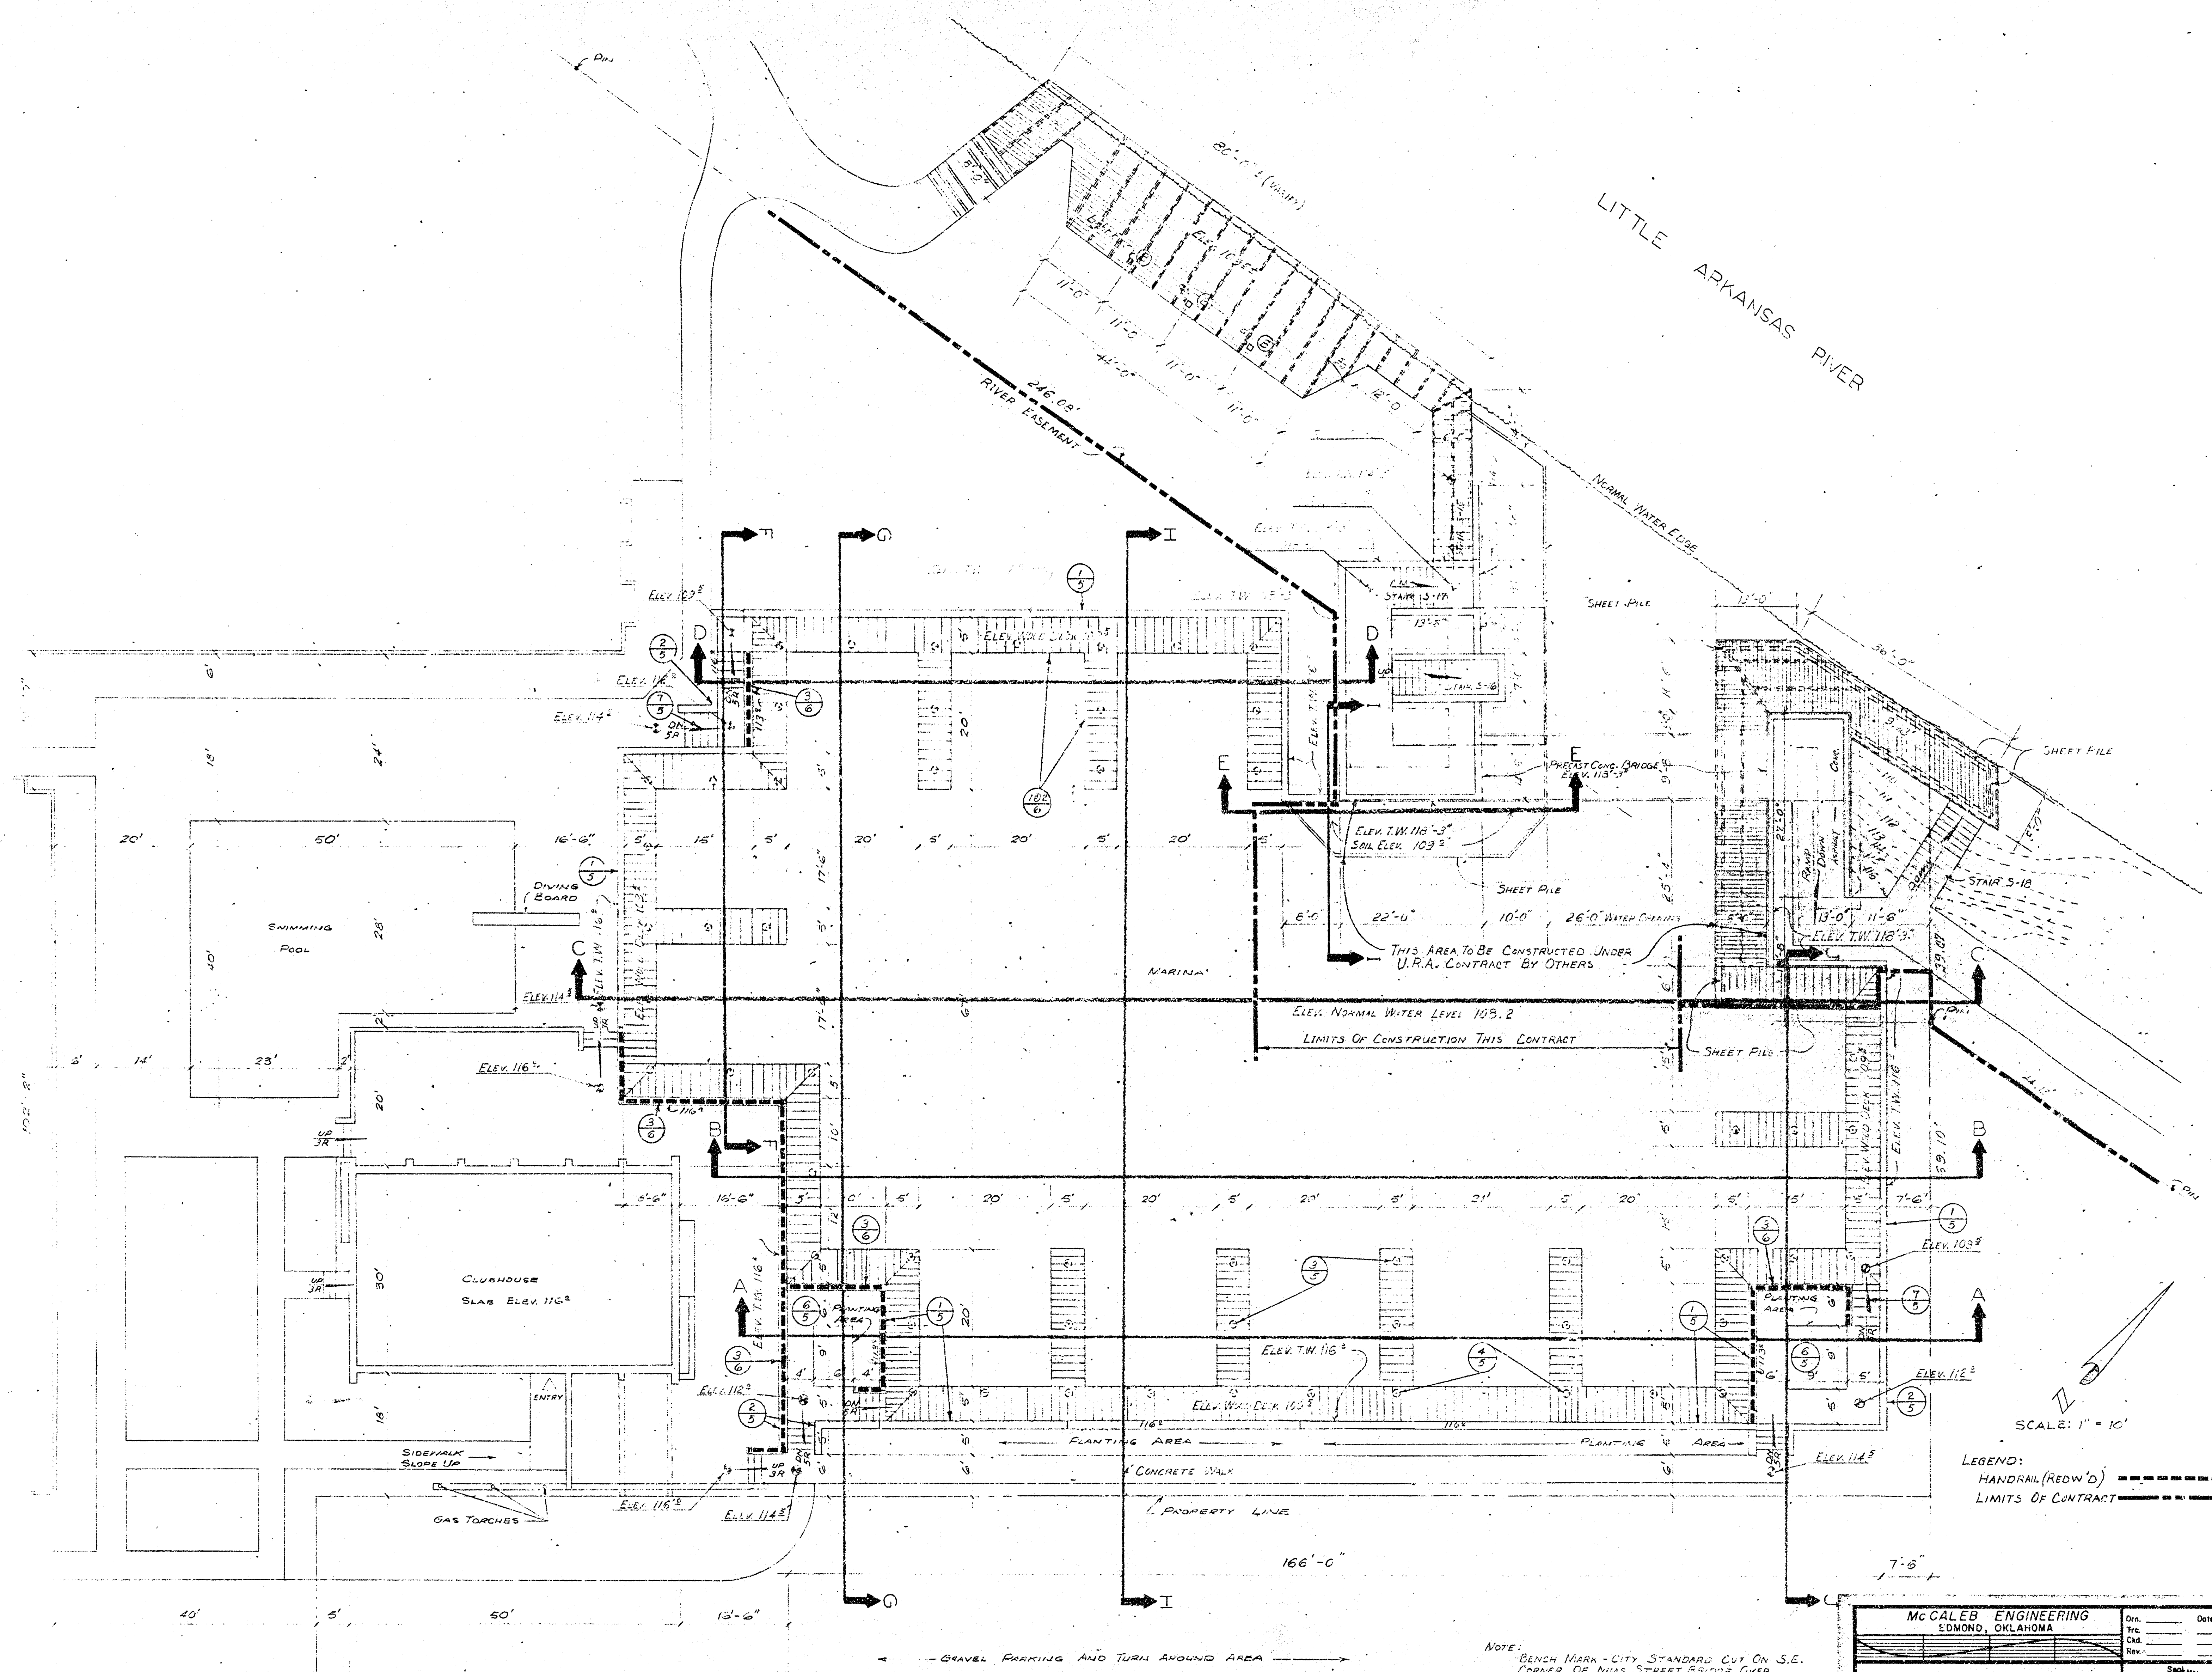


NOTE: BENCH MARK - CITY STANDARD CUT ON S.E. CORNER OF NIMS STREET BRIDGE OVER RIVER ON NIMS STREET. ELEV. 118.415


McCaleb Engineering Edmond, Oklahoma		Dwn. Tye CNA Rev.	Date
CONTINENTAL VILLAGE MARINA SITE PLAN		Sheet No. 2 of 6 NOV 12 1970	

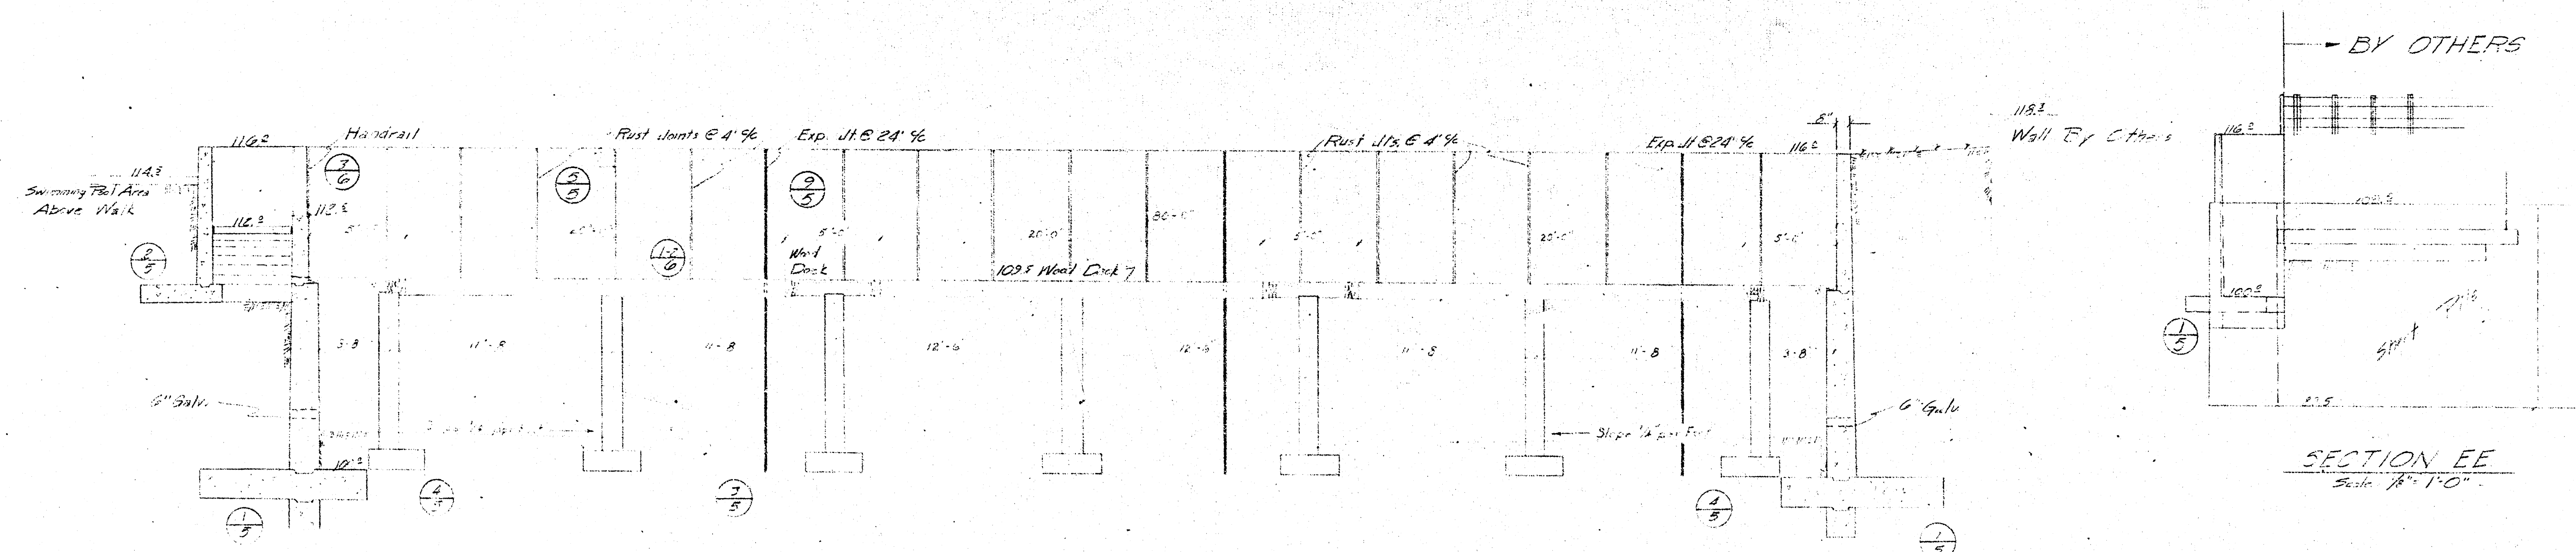

SECTION DD
Scale: 1/4" = 1'-0"

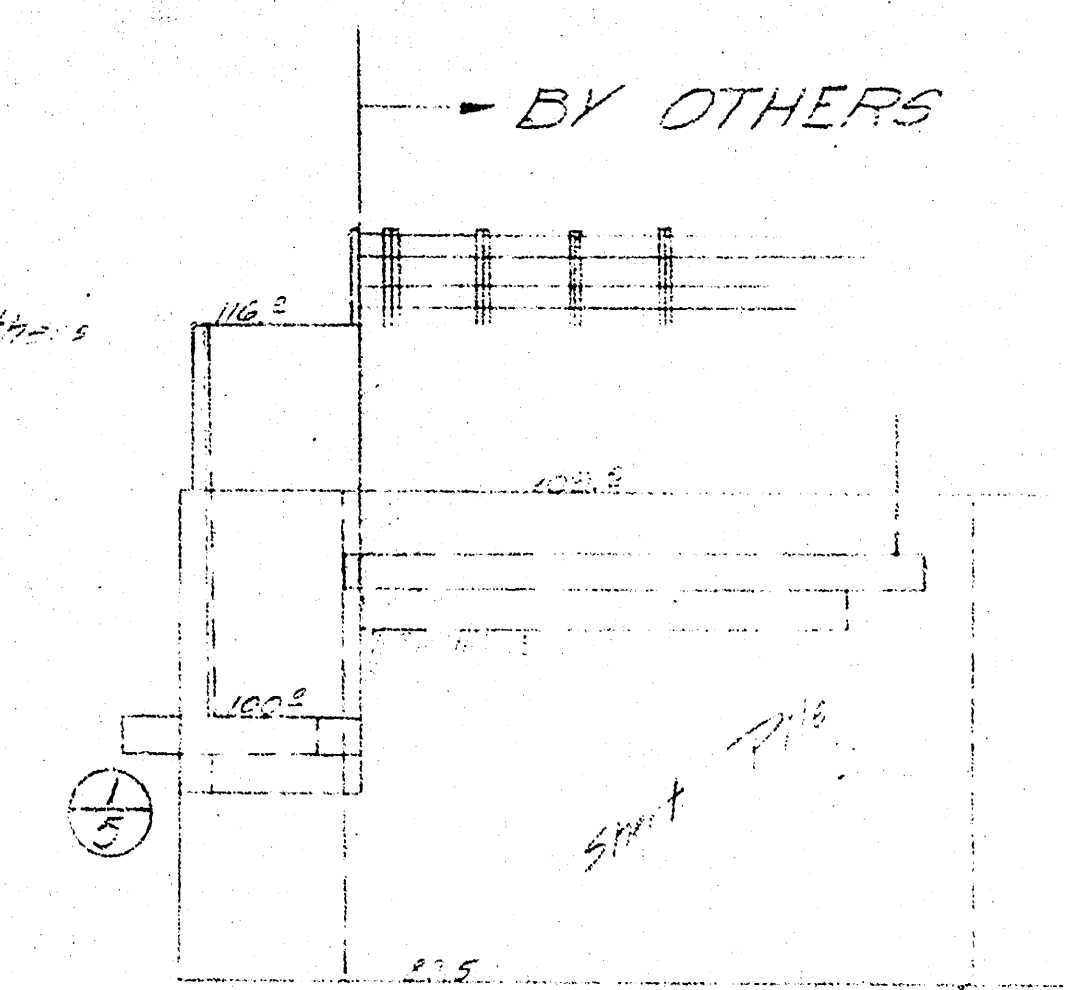


SECTION EE
Scale: 1/4" = 1'-0"

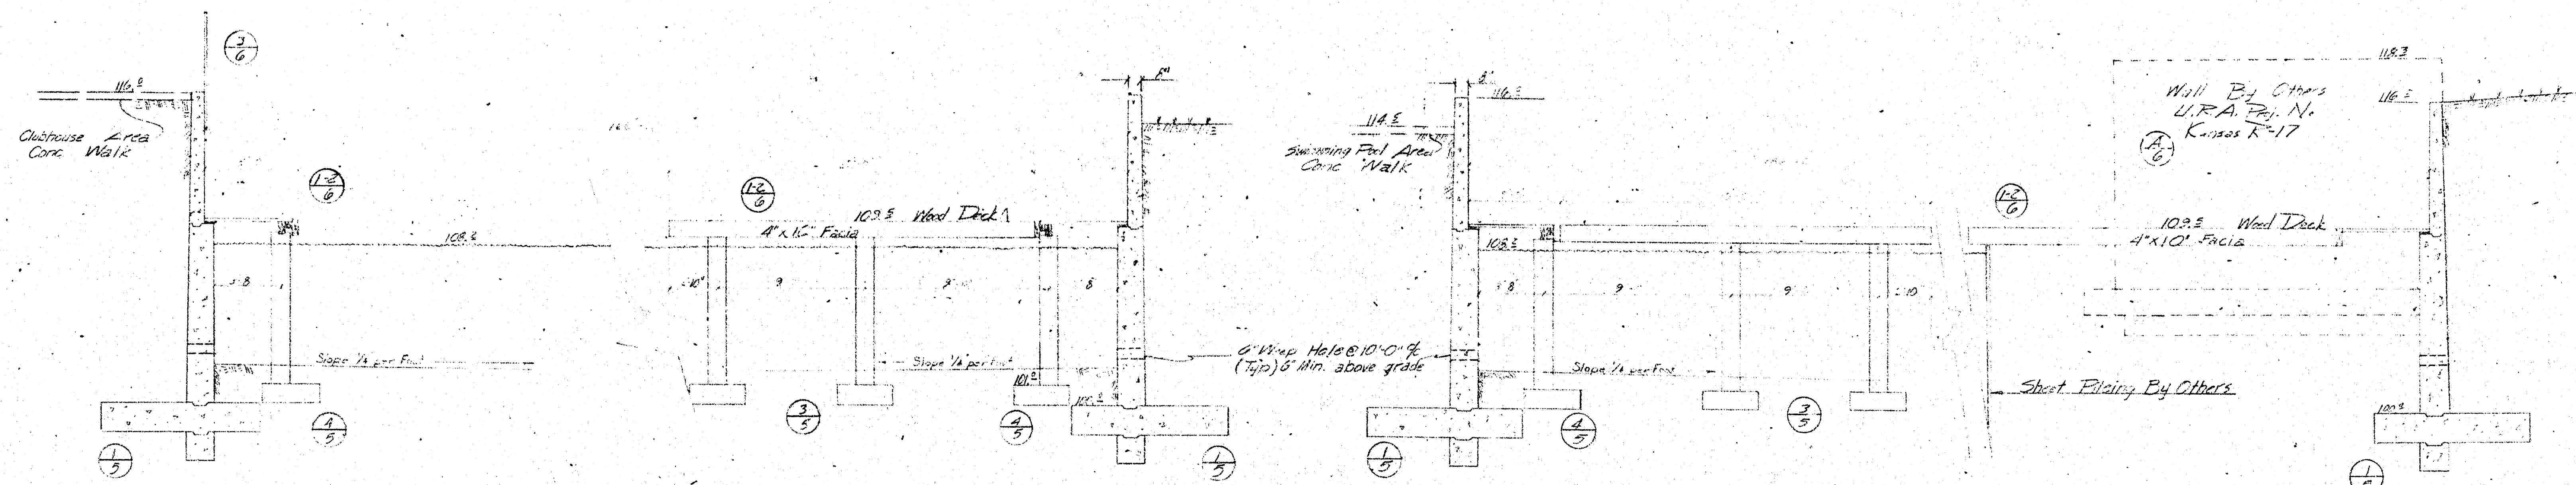


SECTION BB
Scale: 1/4" = 1'-0"










SECTION CC
Scale: 1/4" = 1'-0"

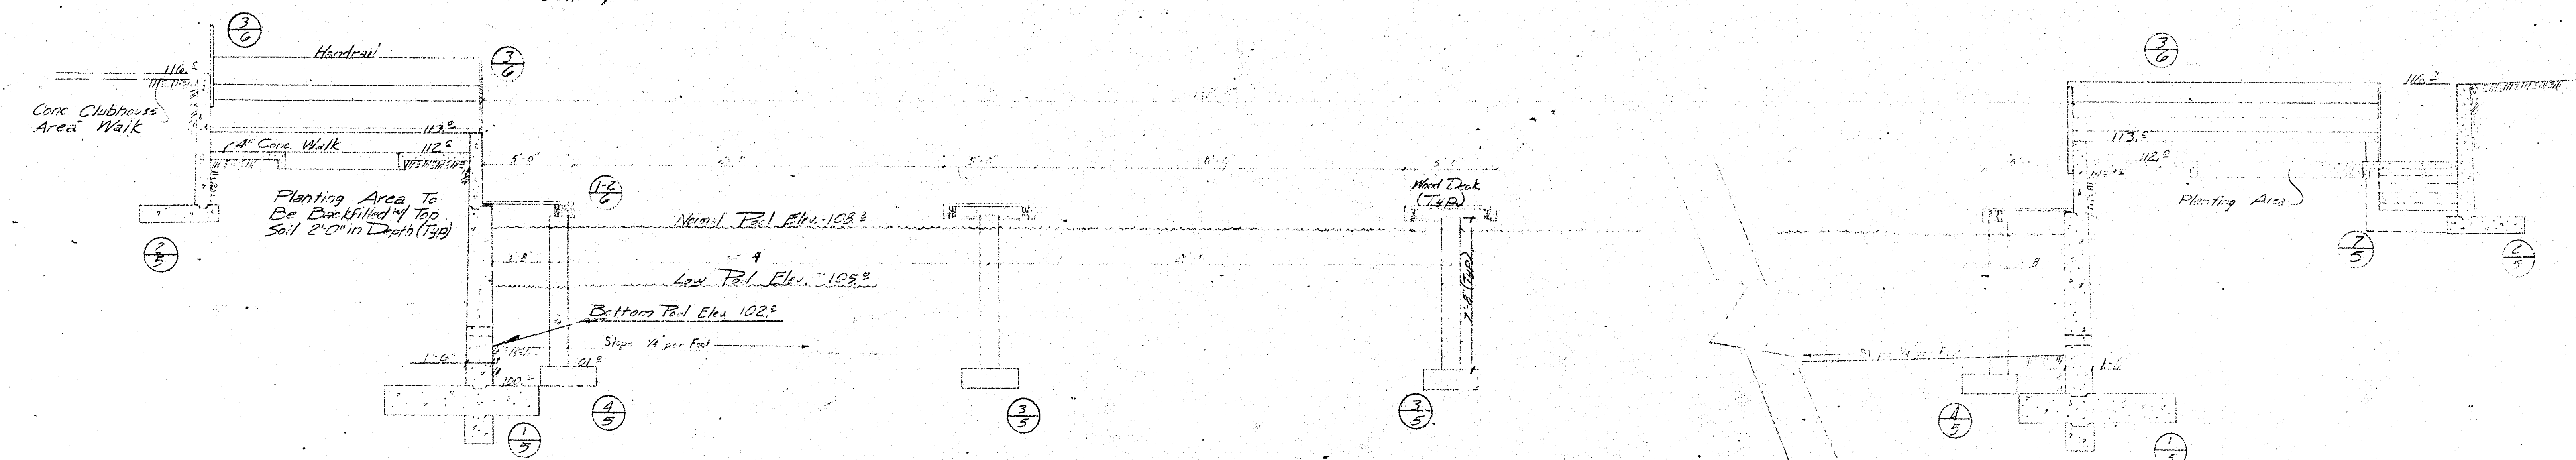

SECTION AA
Scale: 1/4" = 1'-0"

MCALEB ENGINEERING EDMOND, OKLAHOMA		Drn. _____ Date: _____ Tie _____ Ced. _____ Rev. _____
CONTINENTAL VILLAGE MARINA ELEVATIONS		
Sheet No. 3 of 6		NOV 12

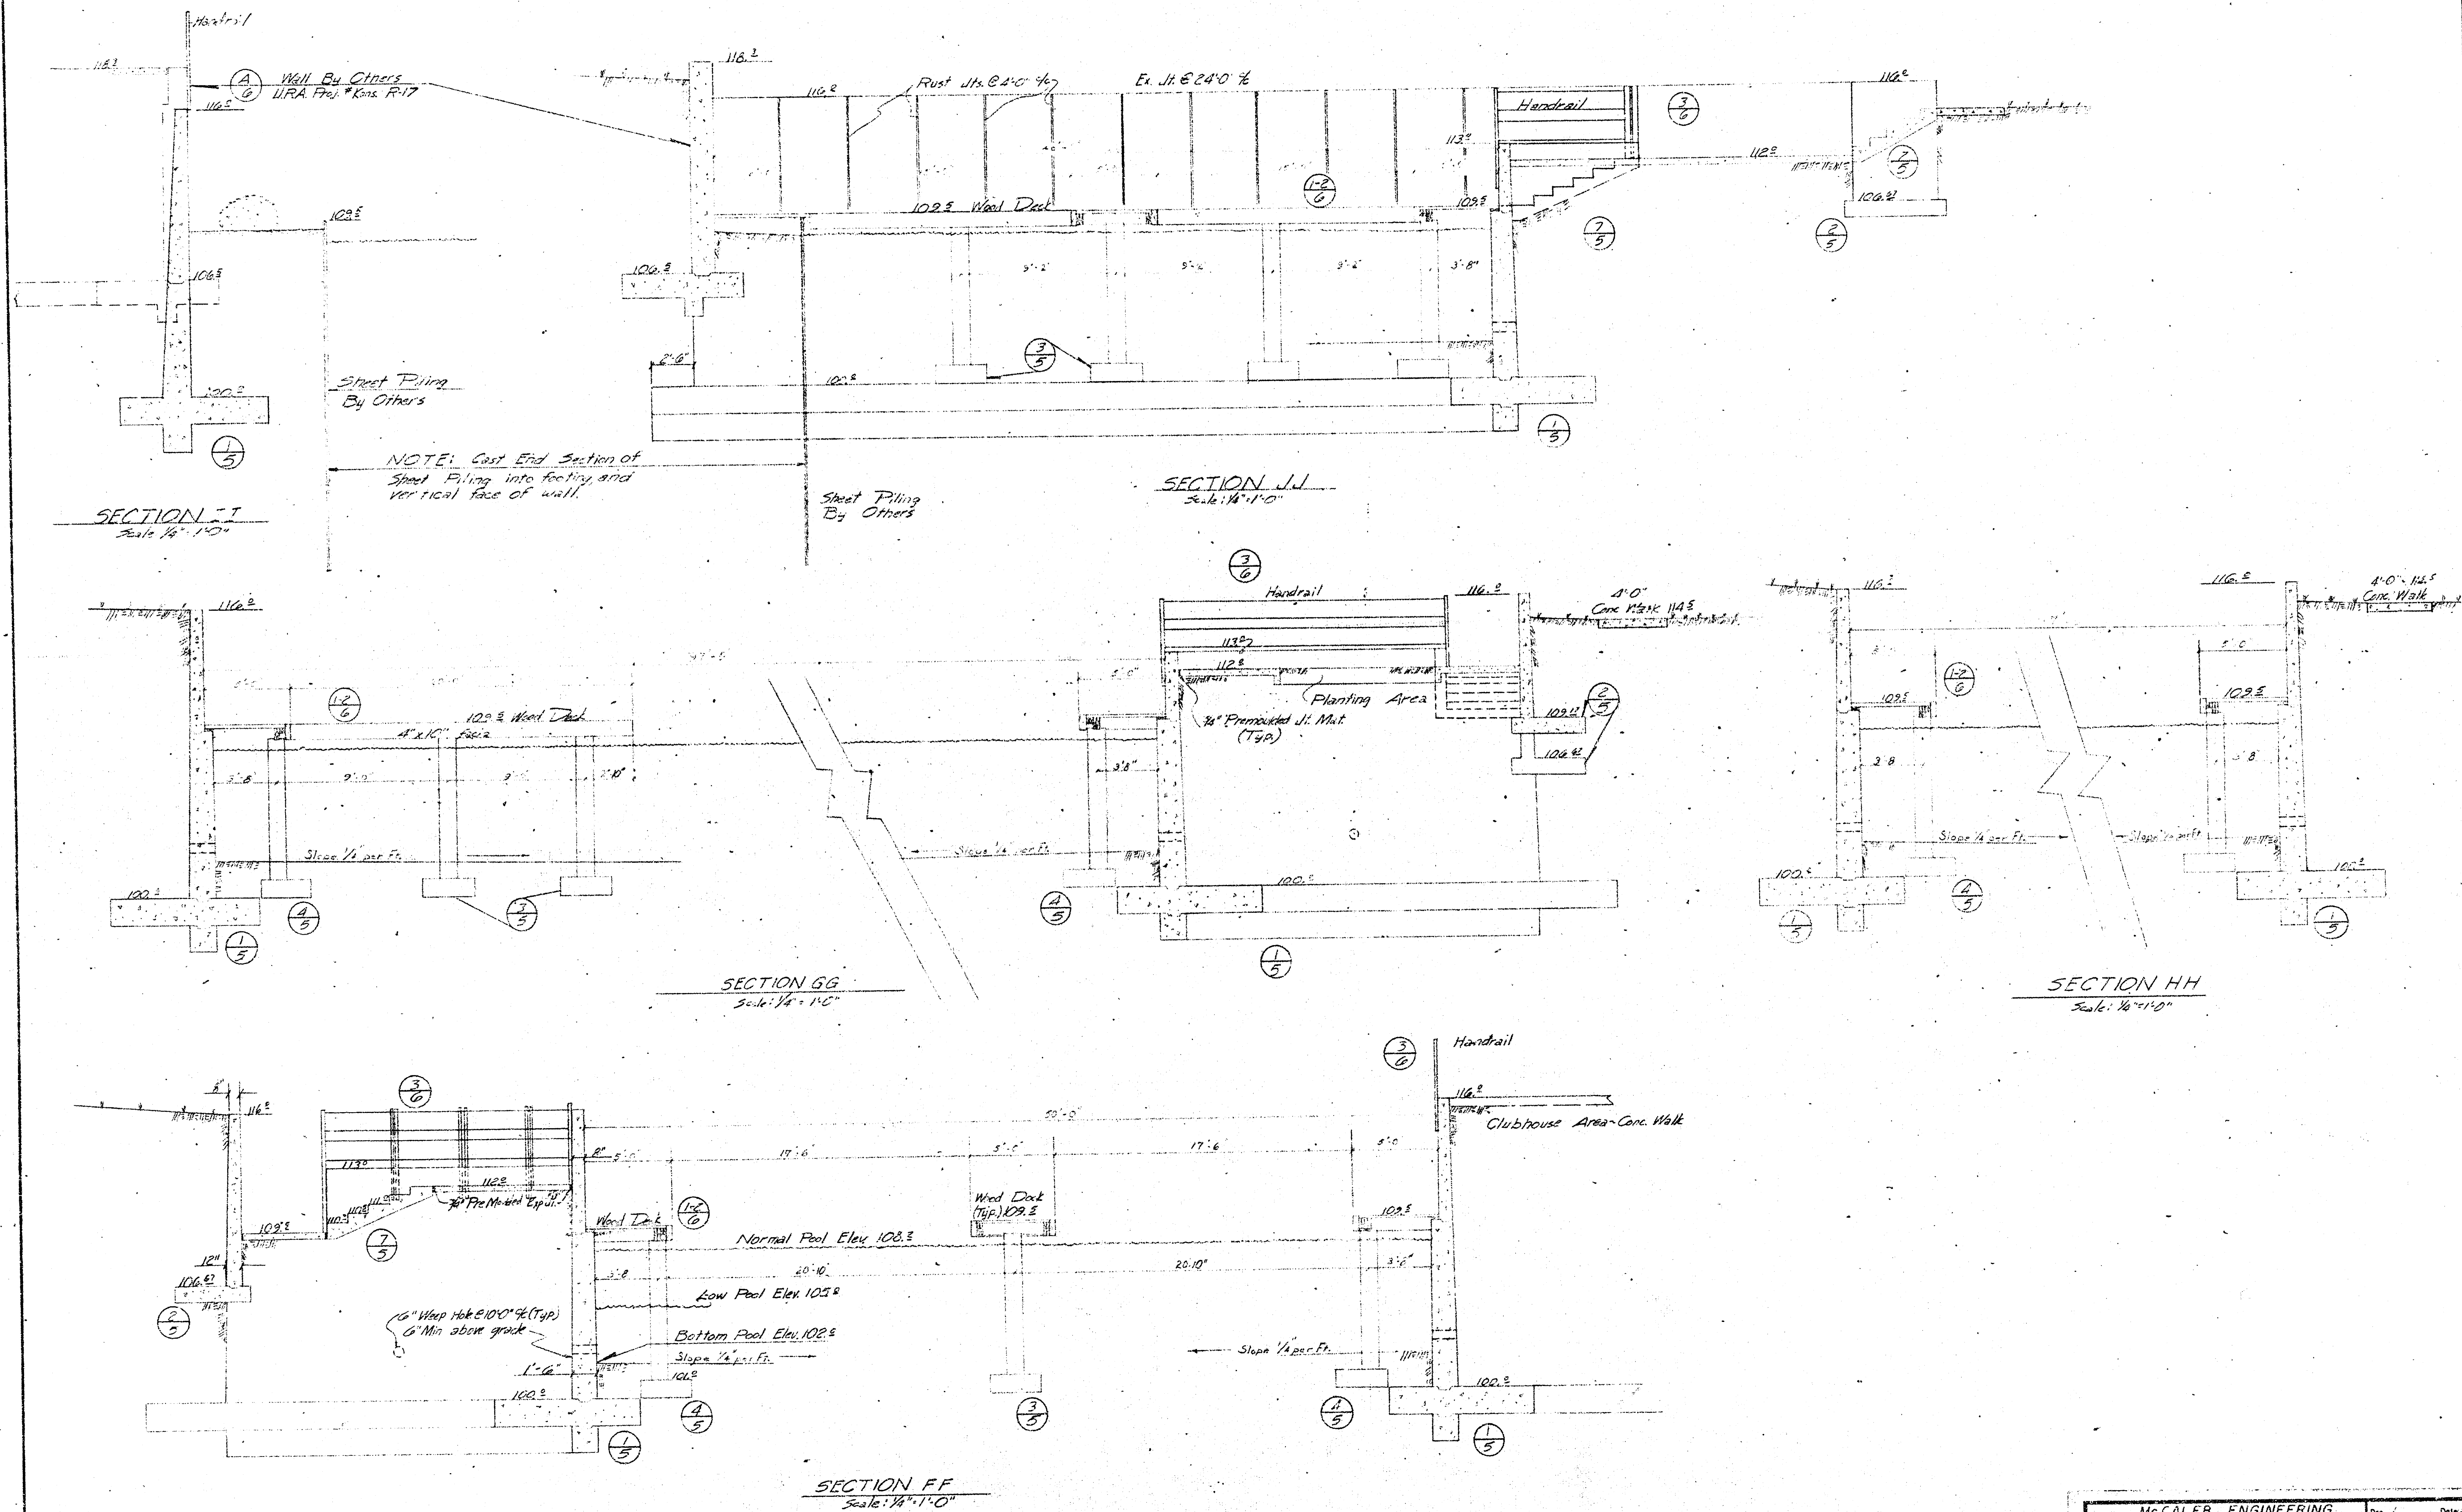

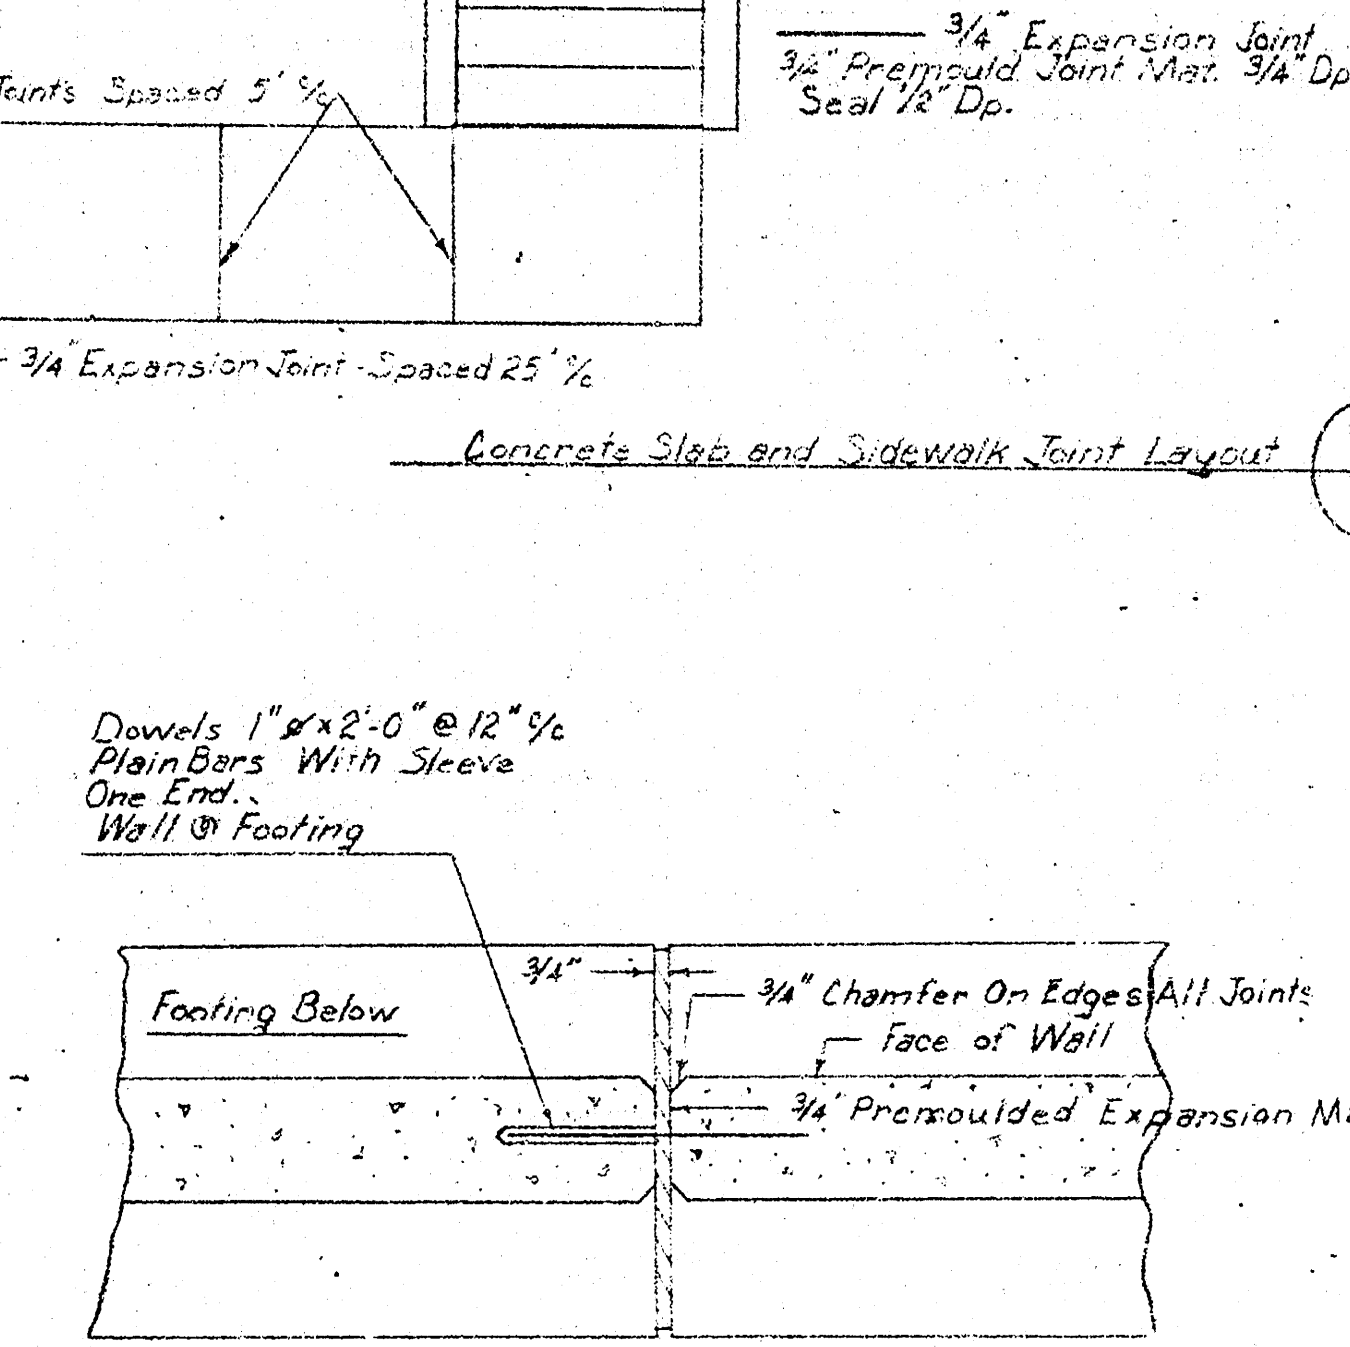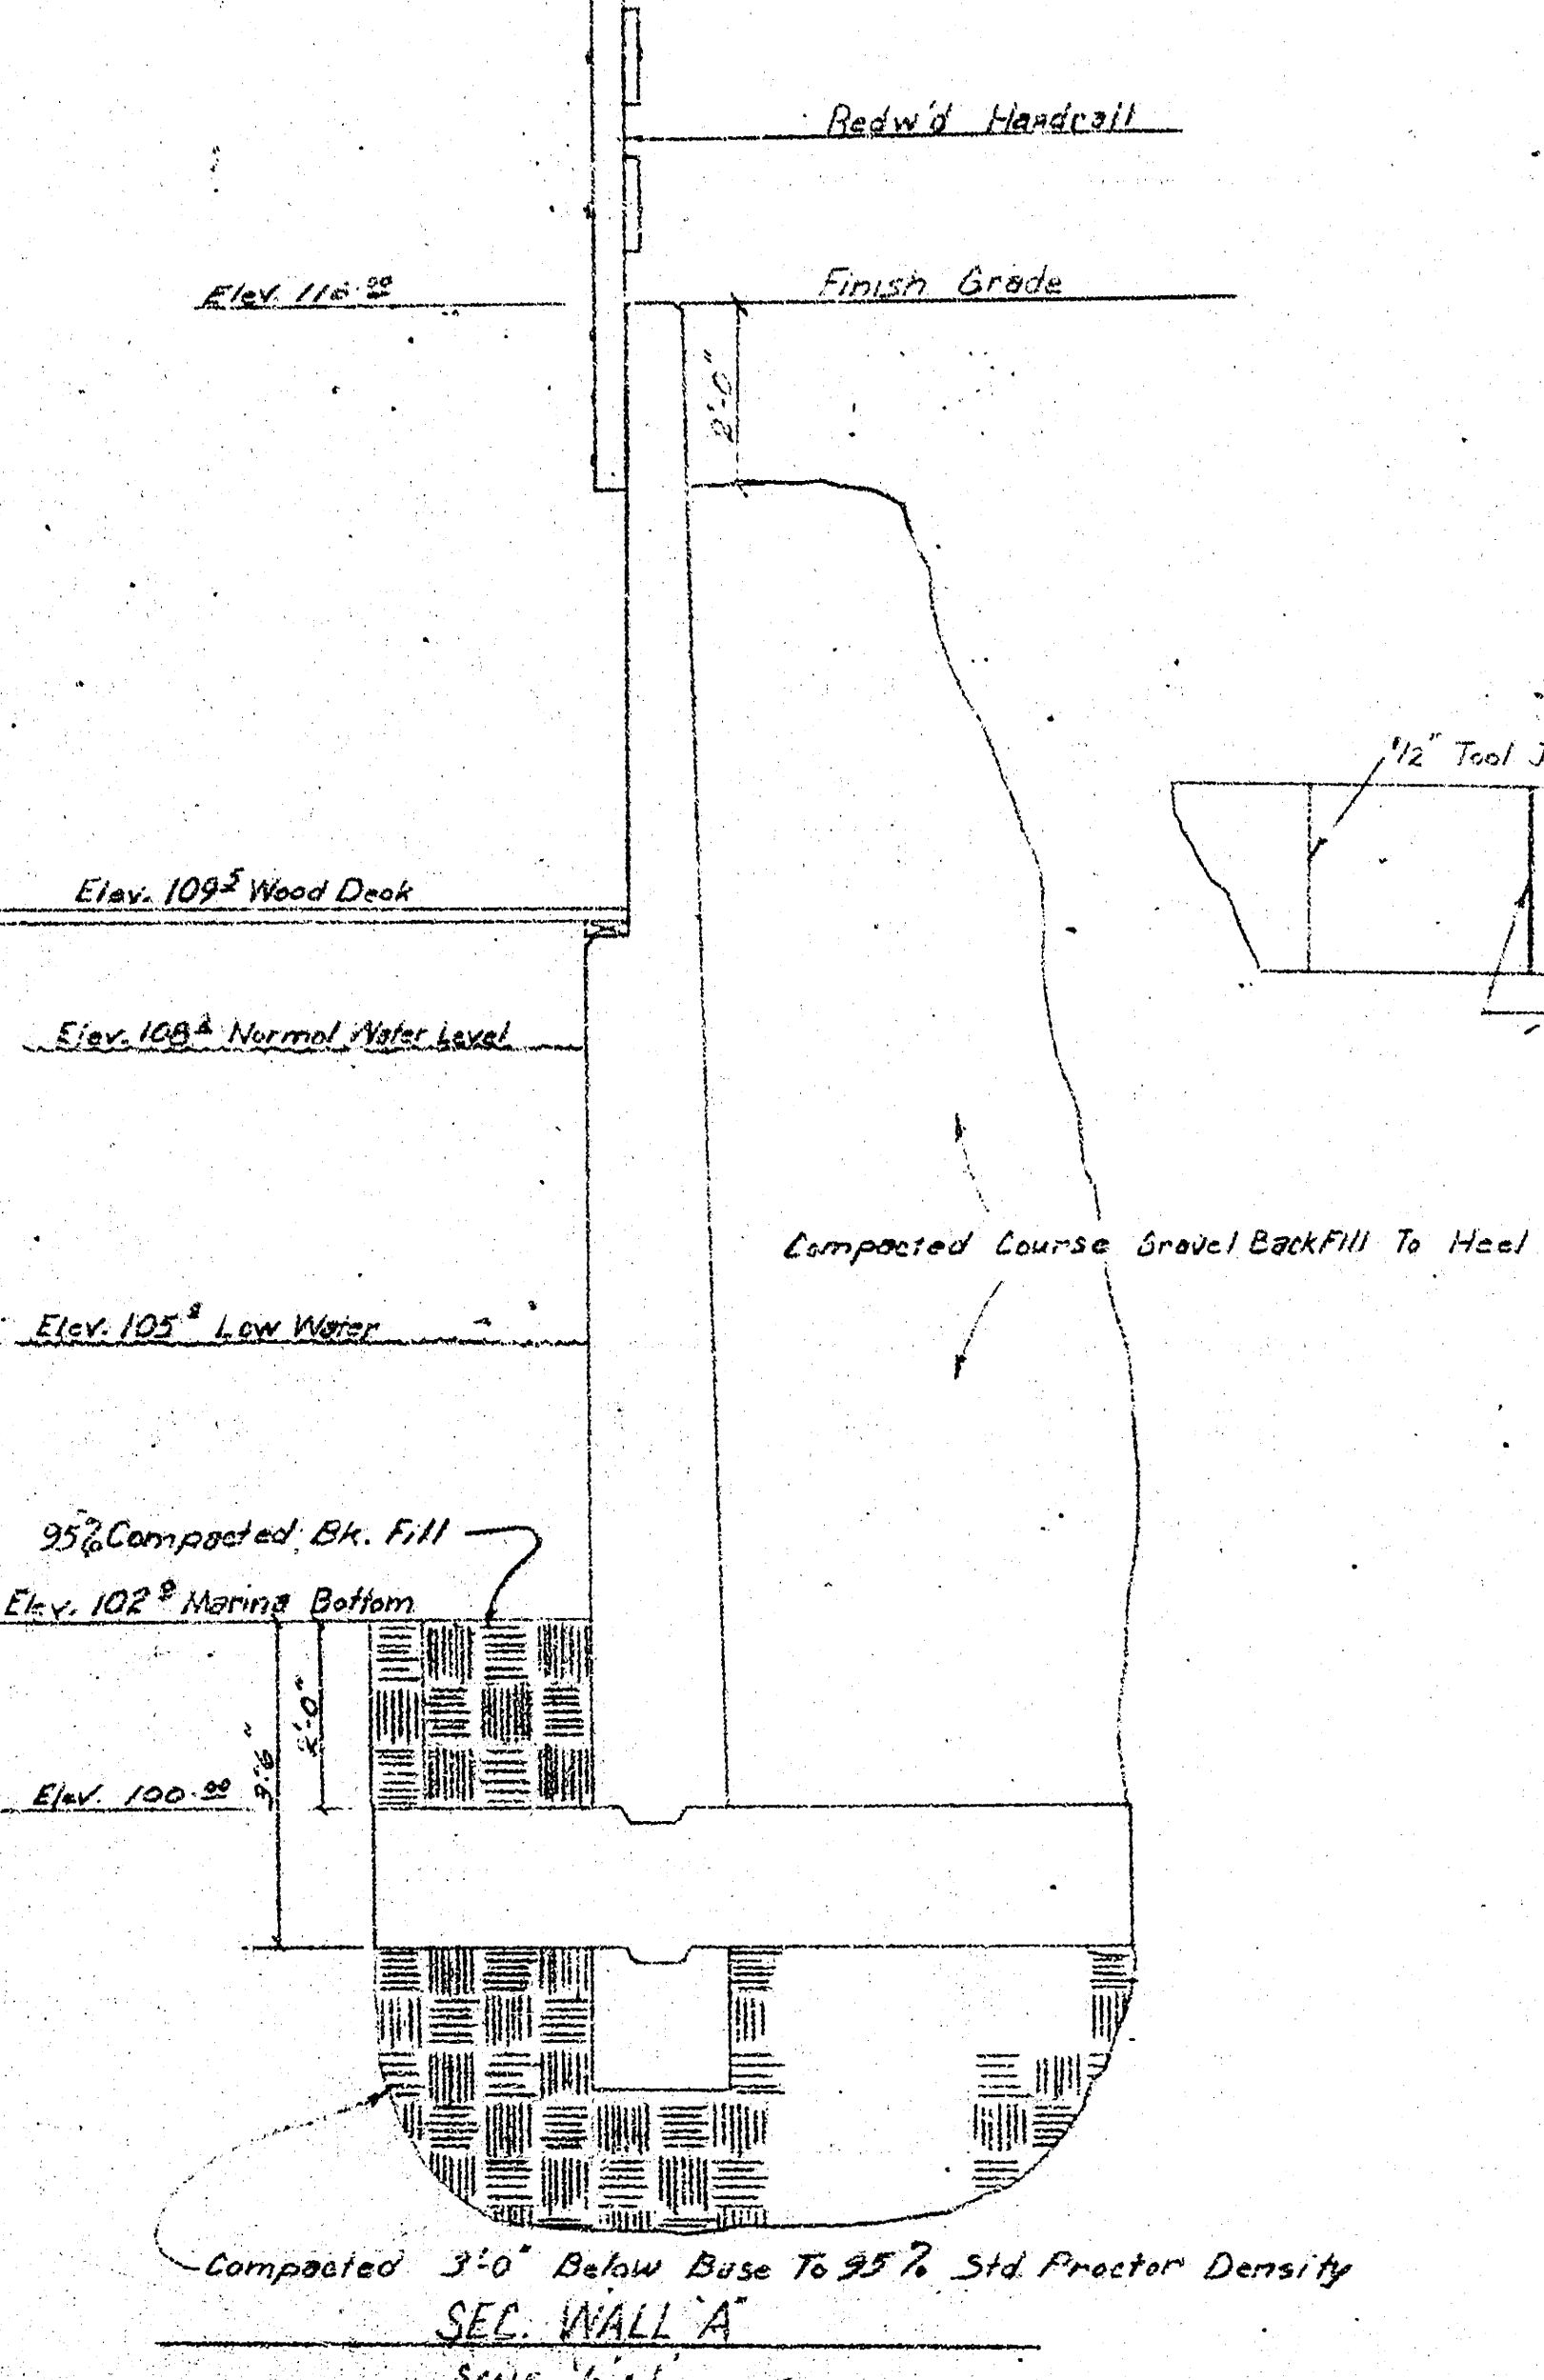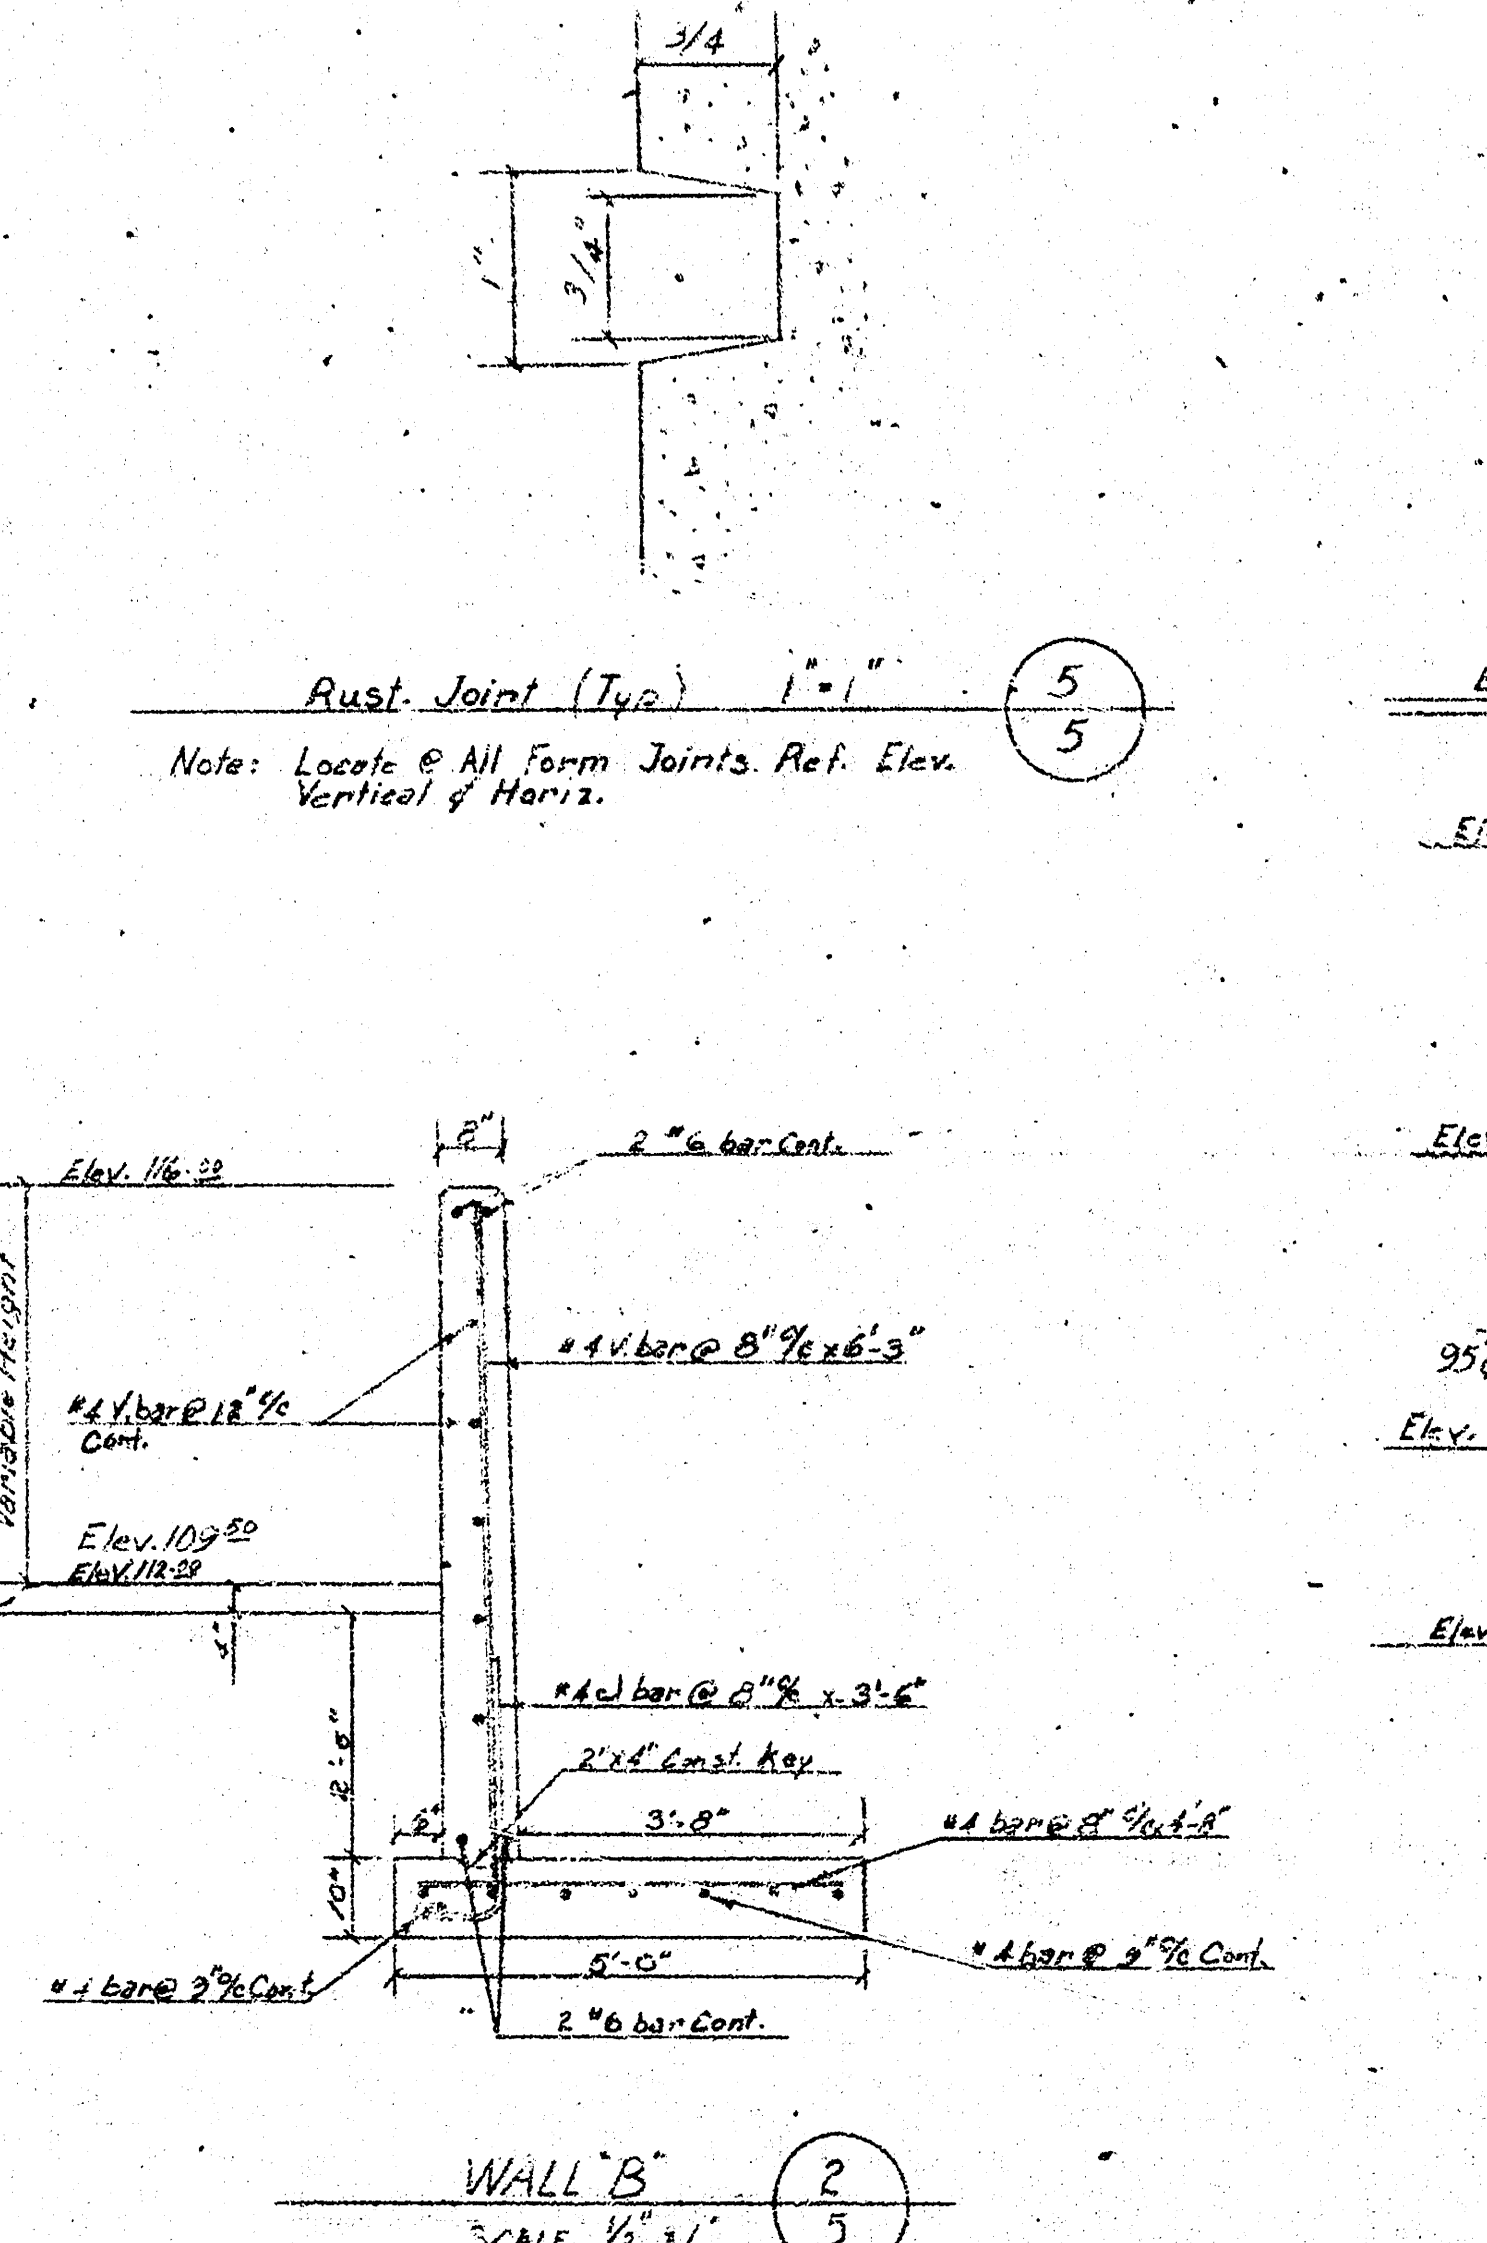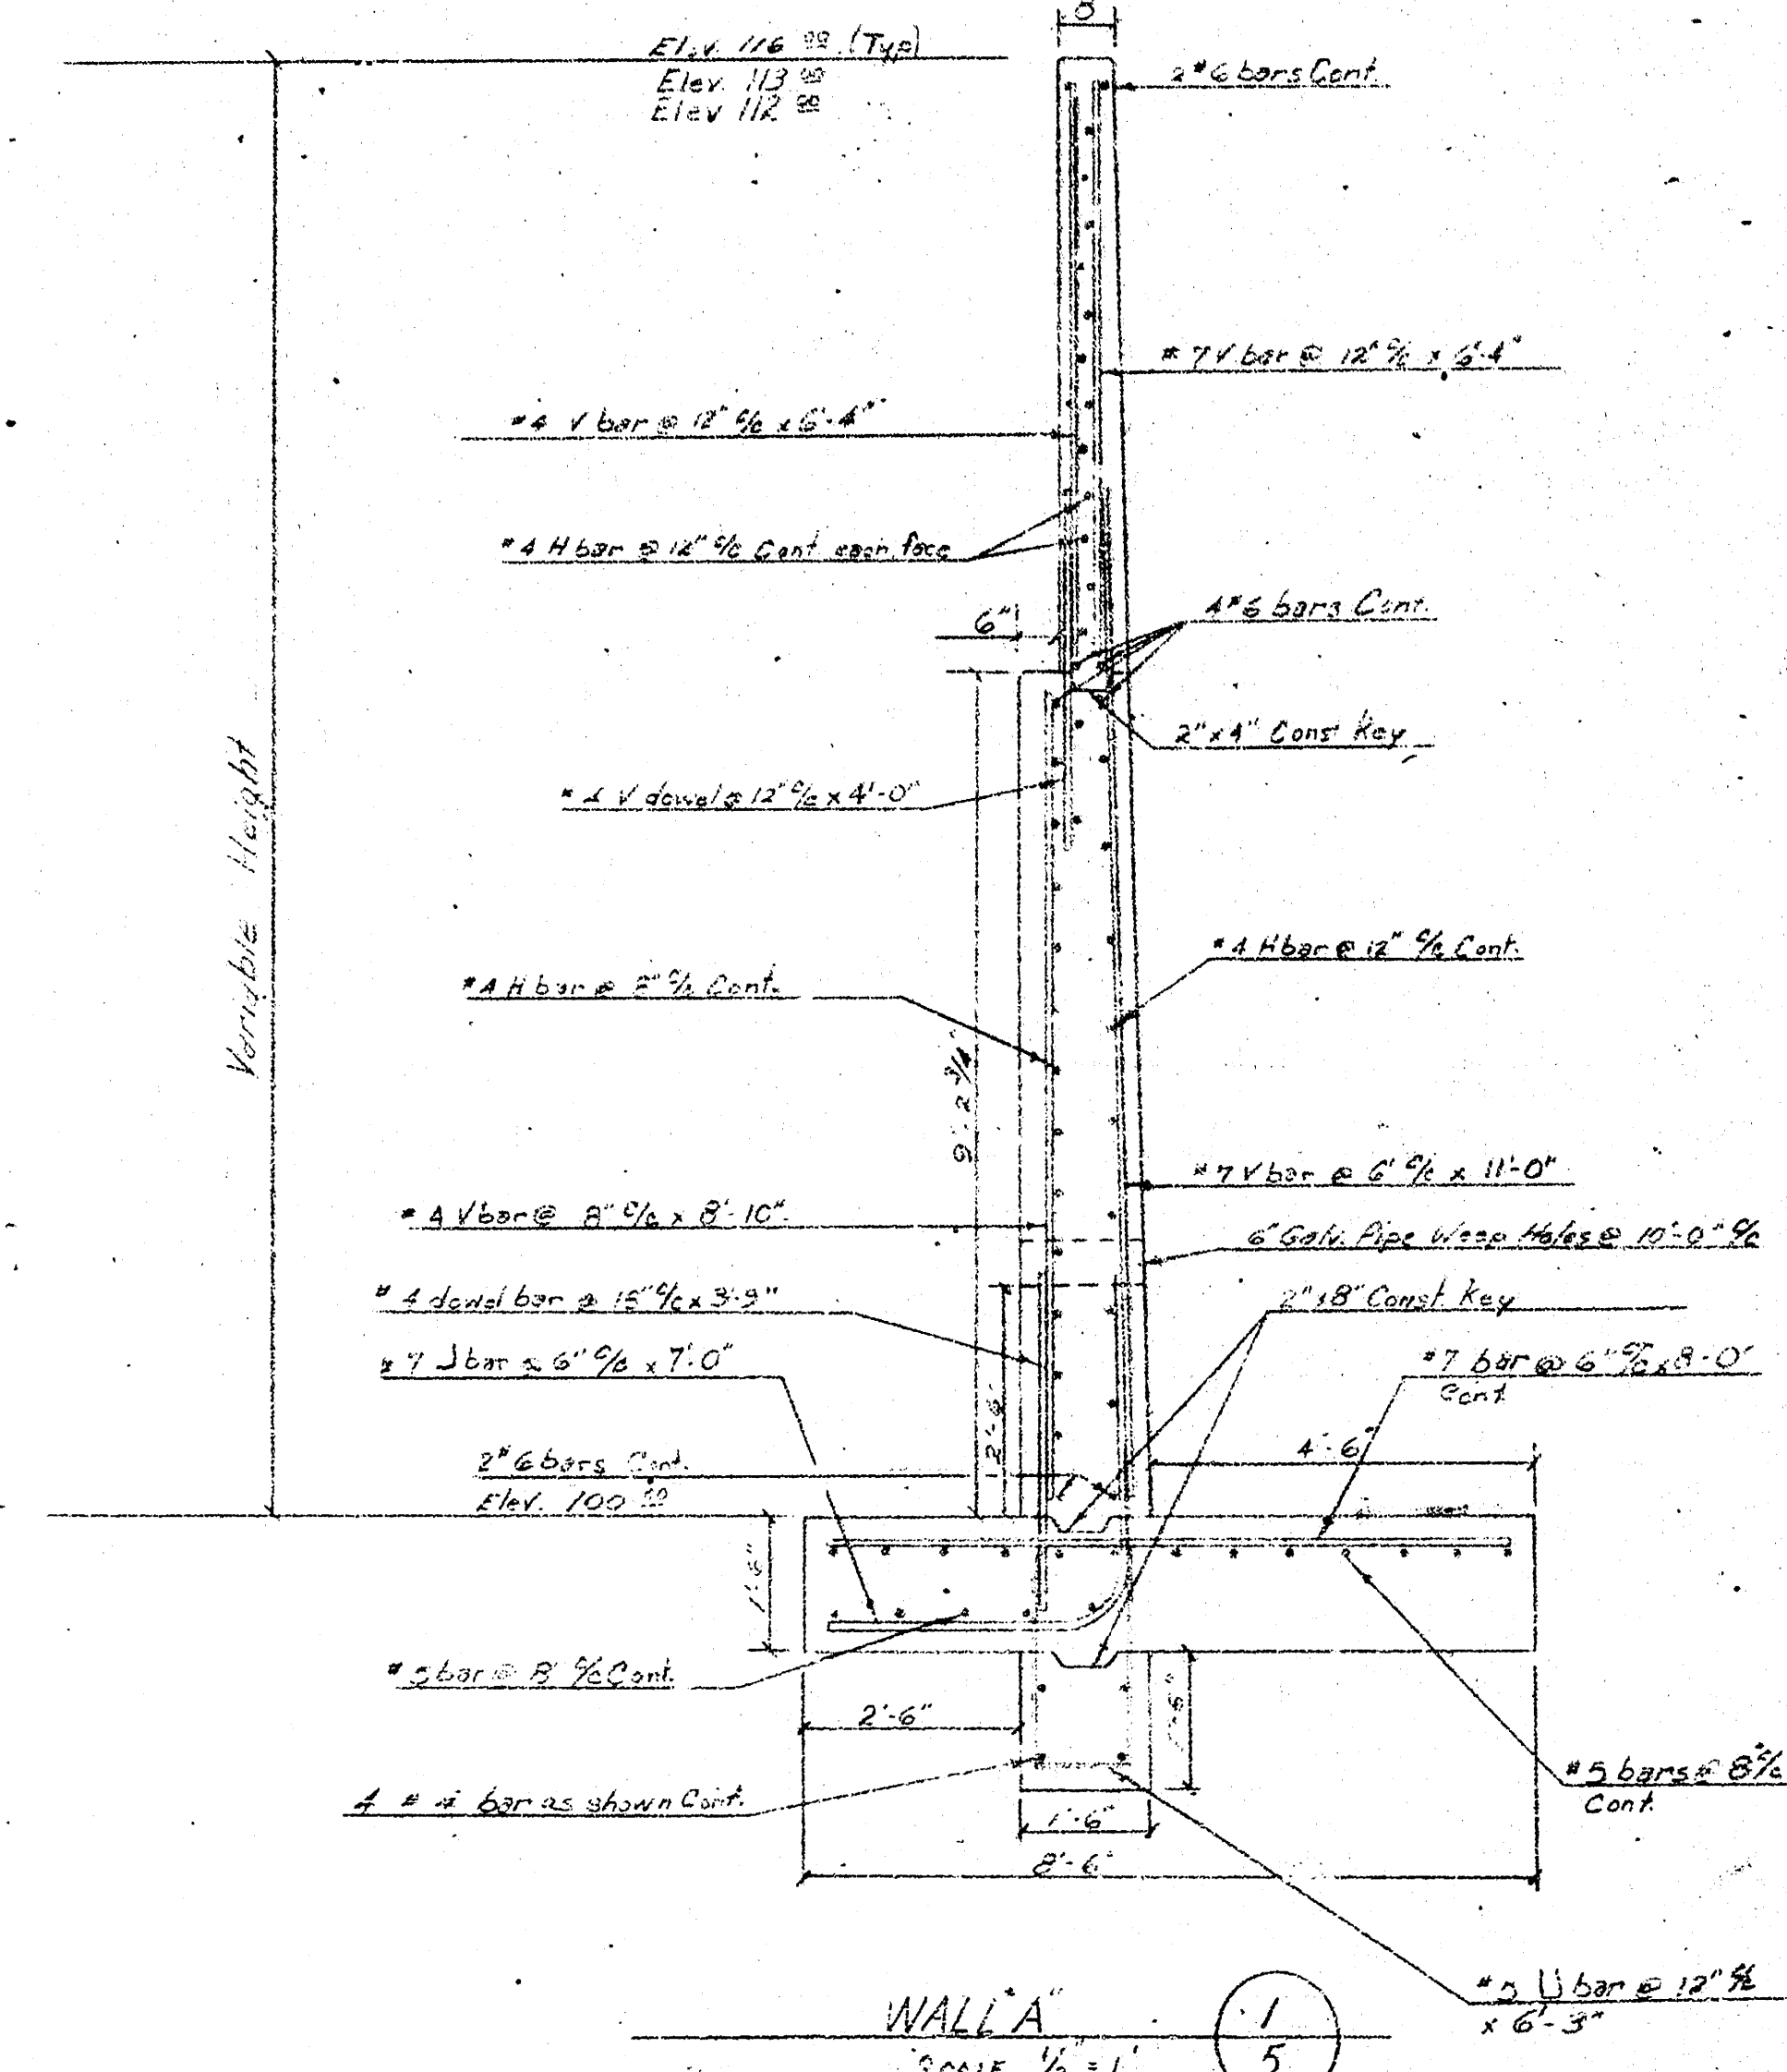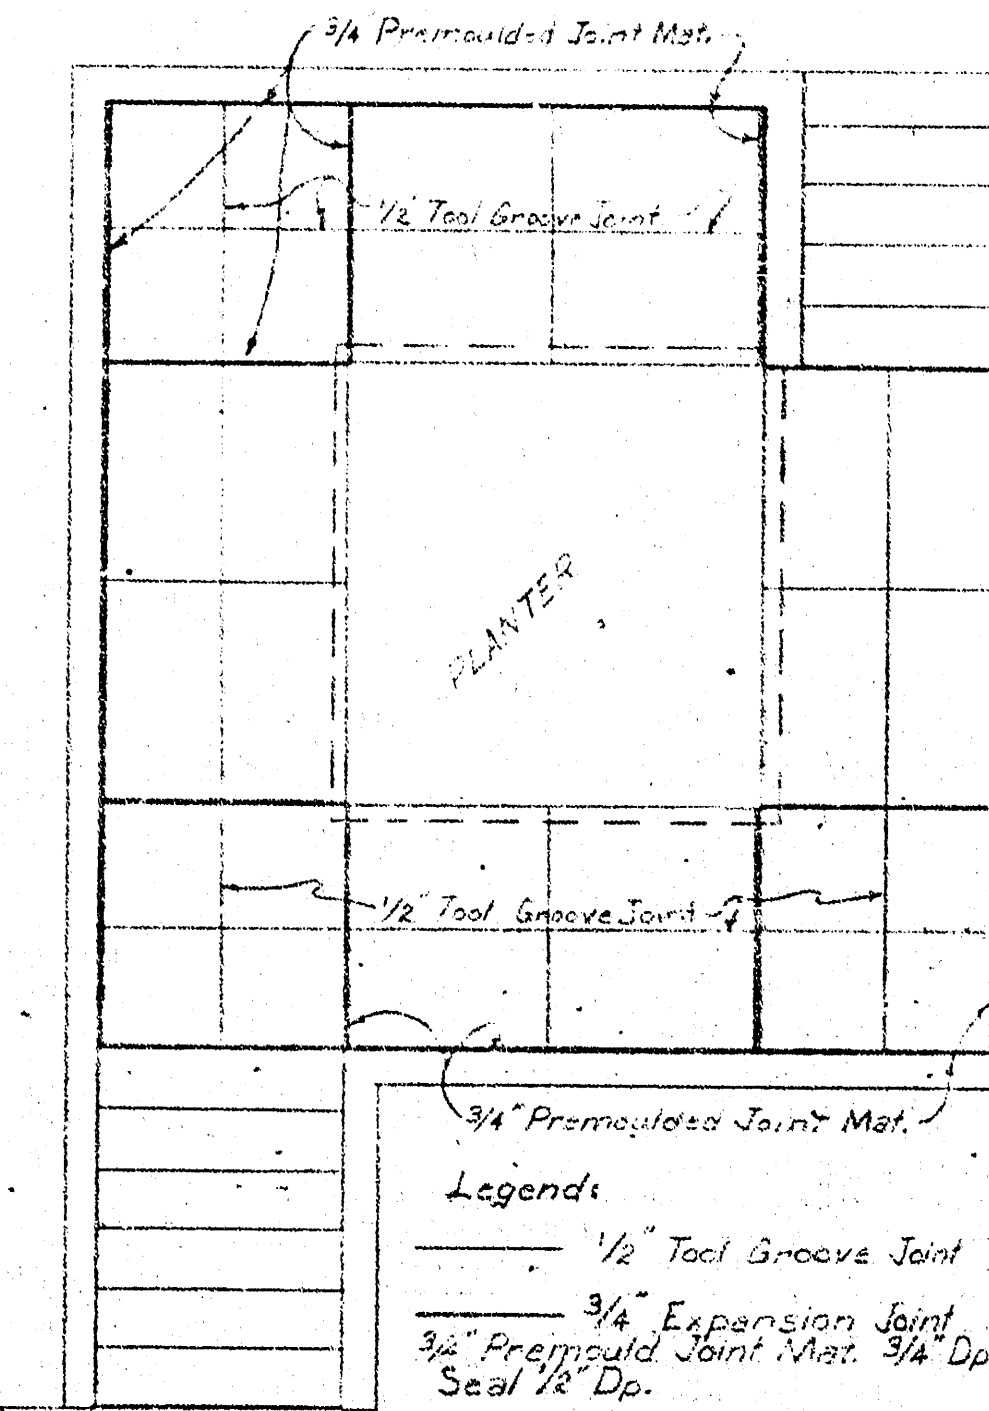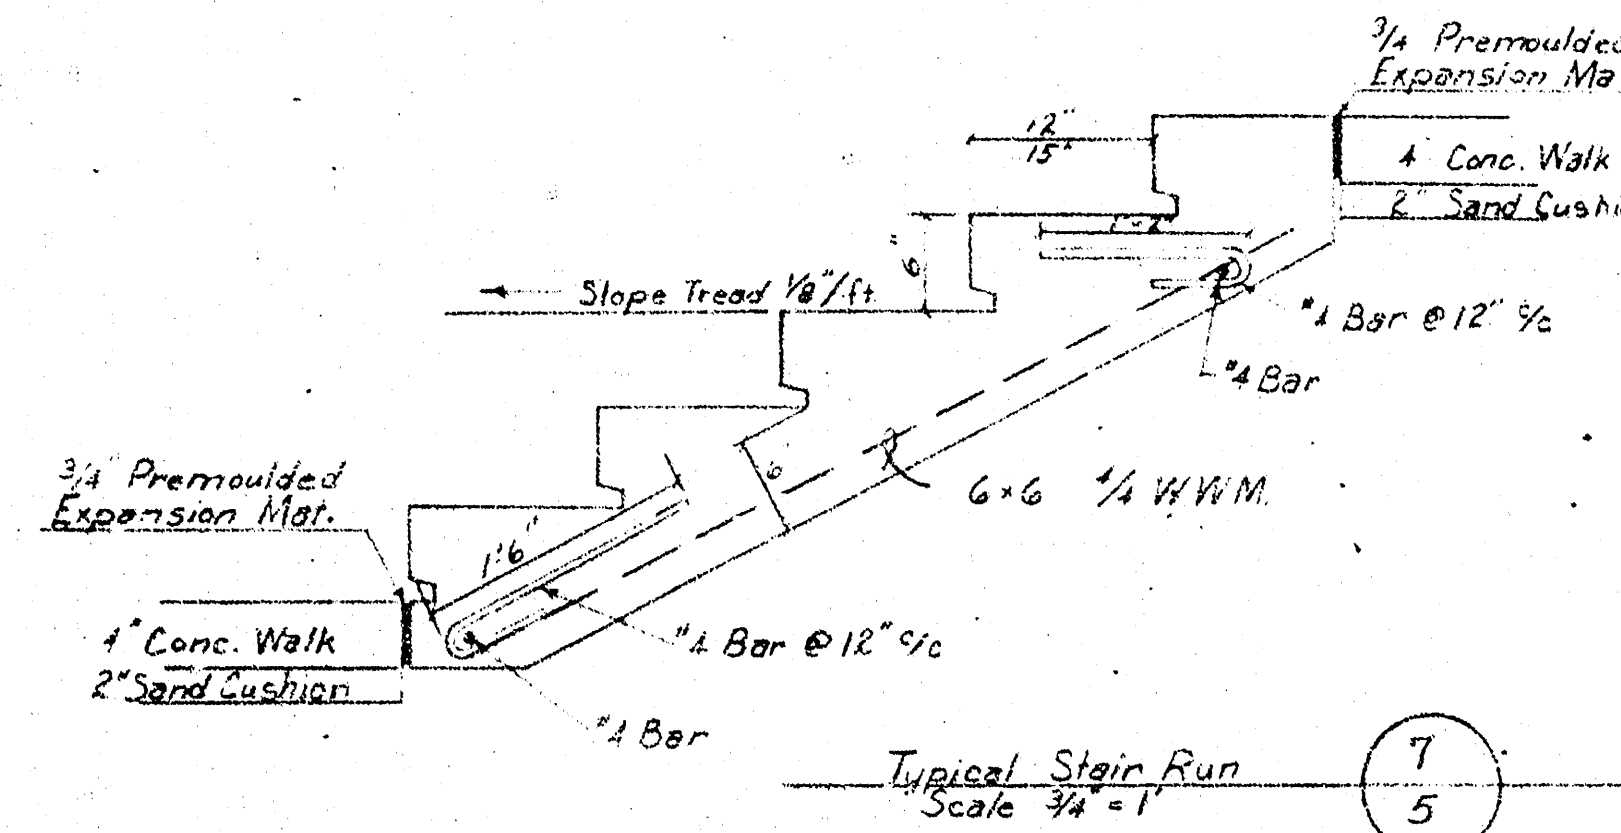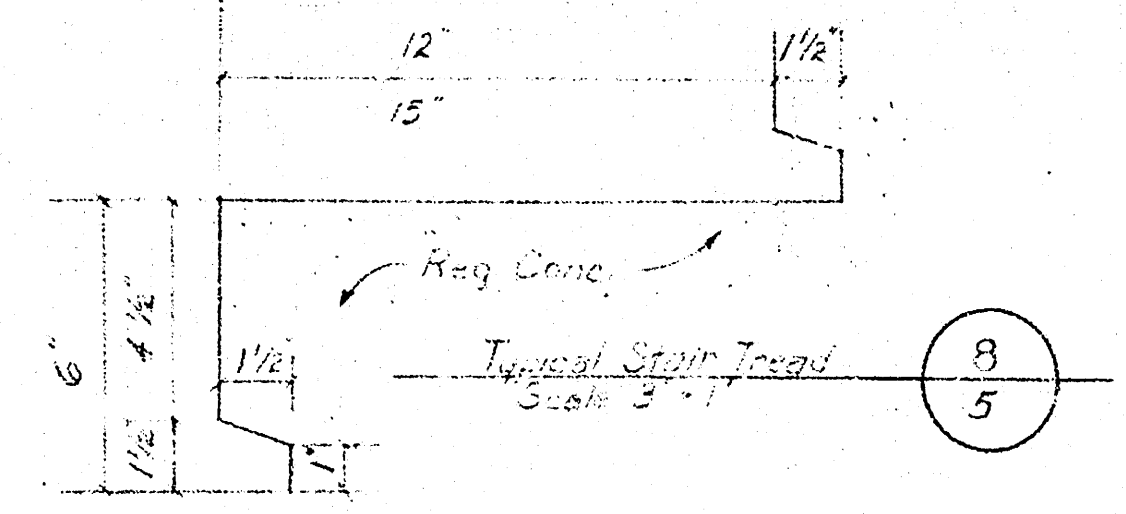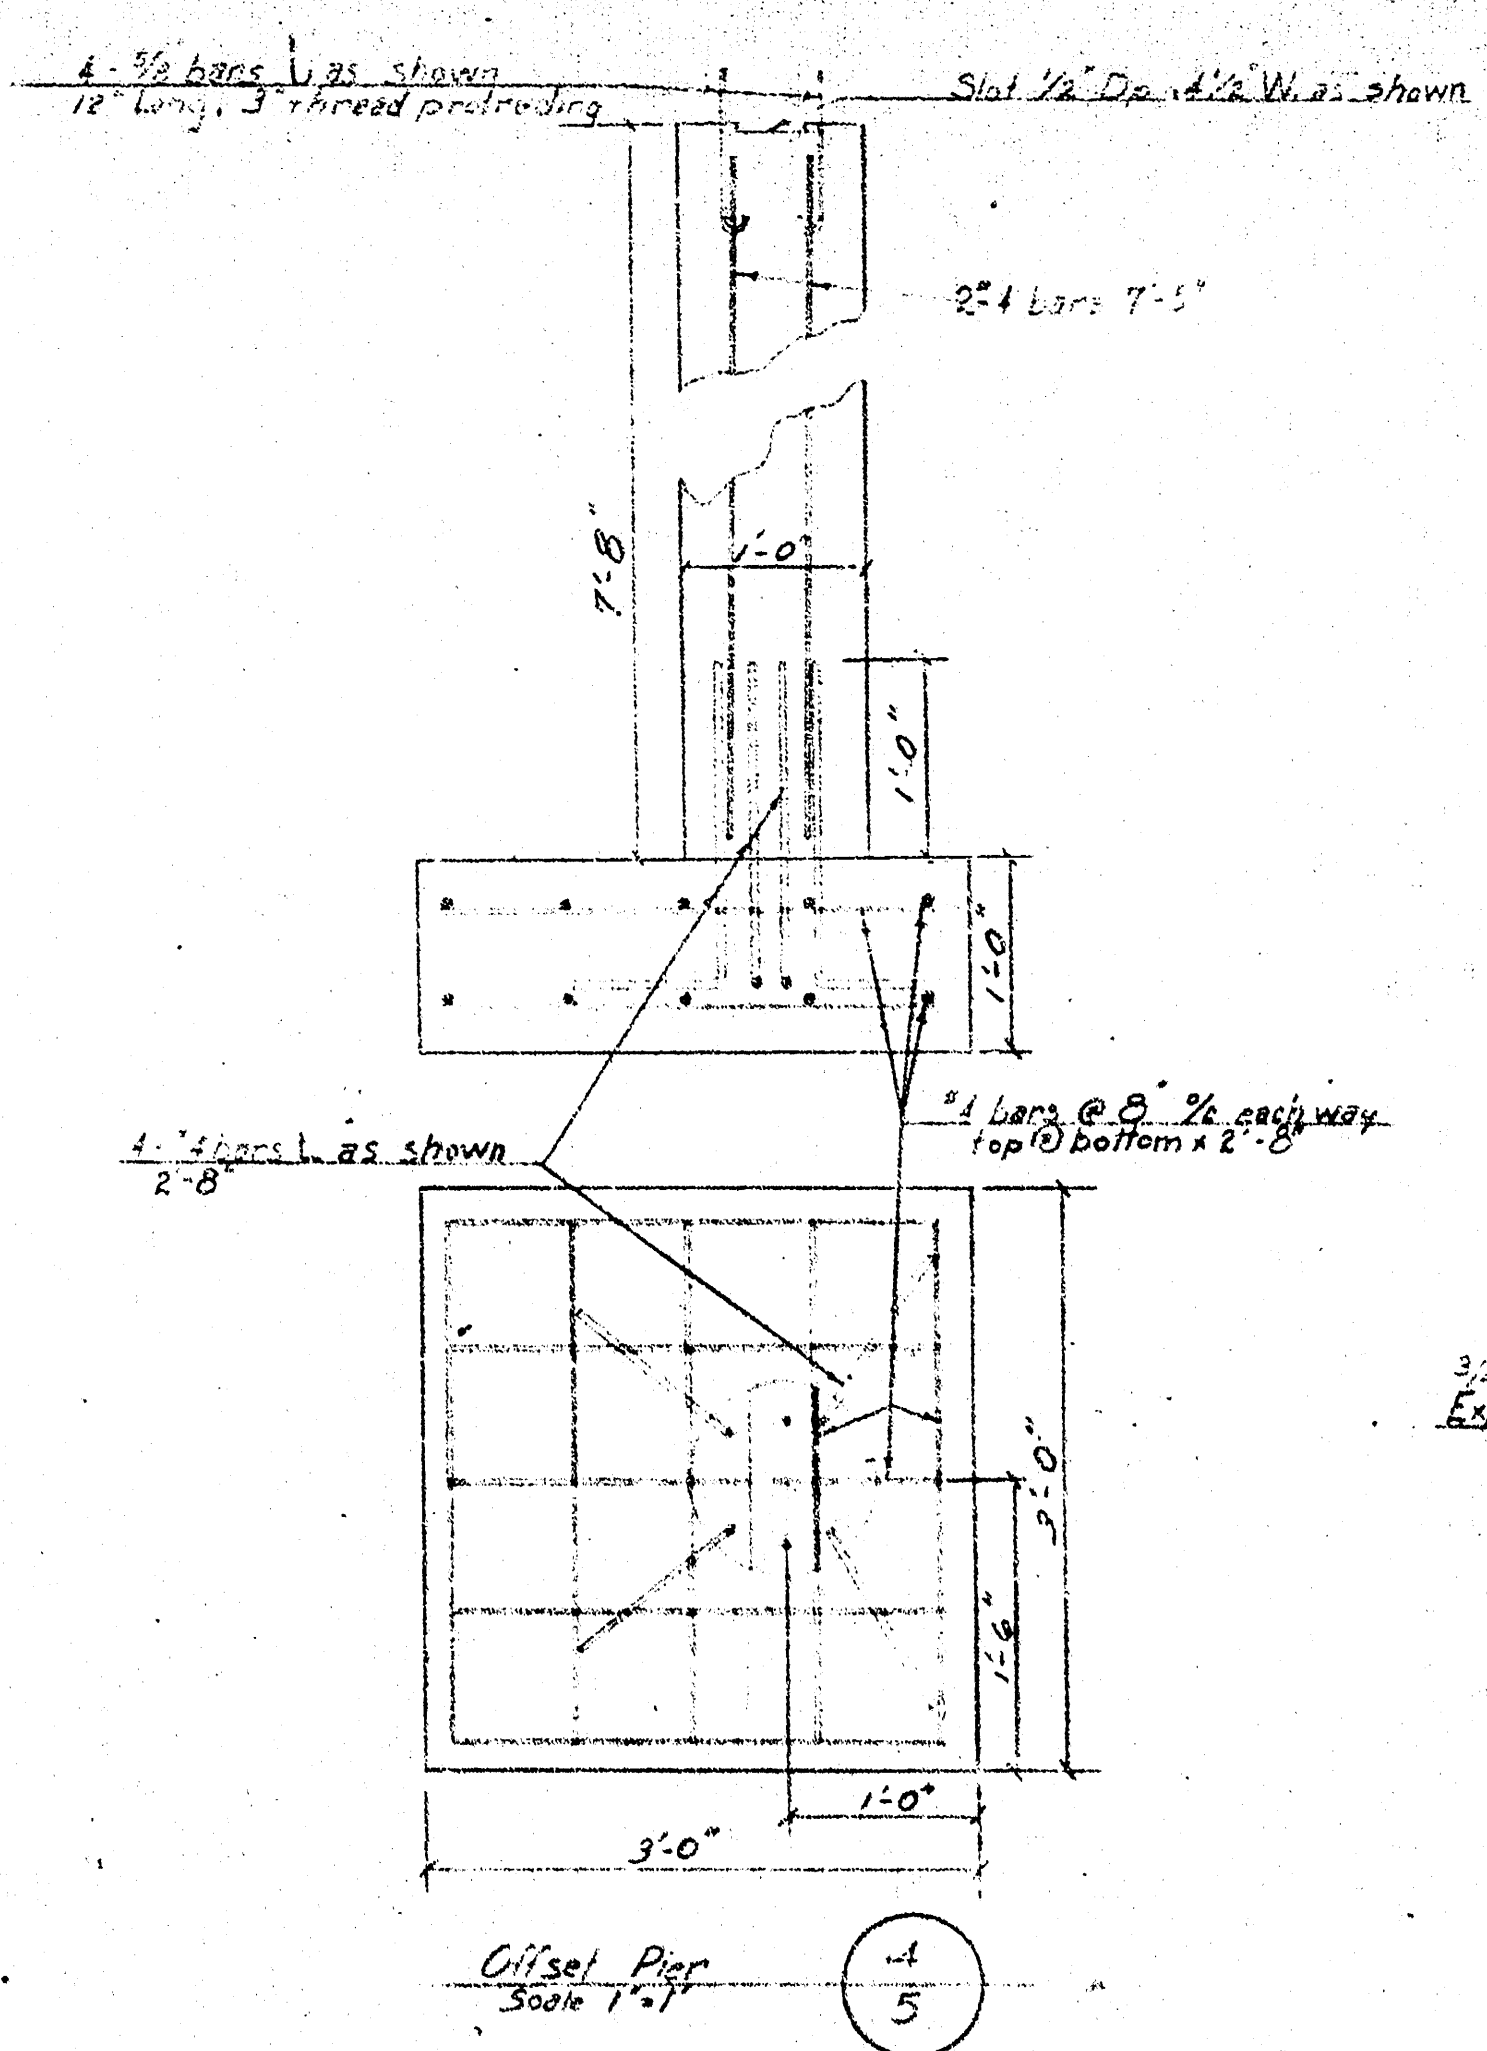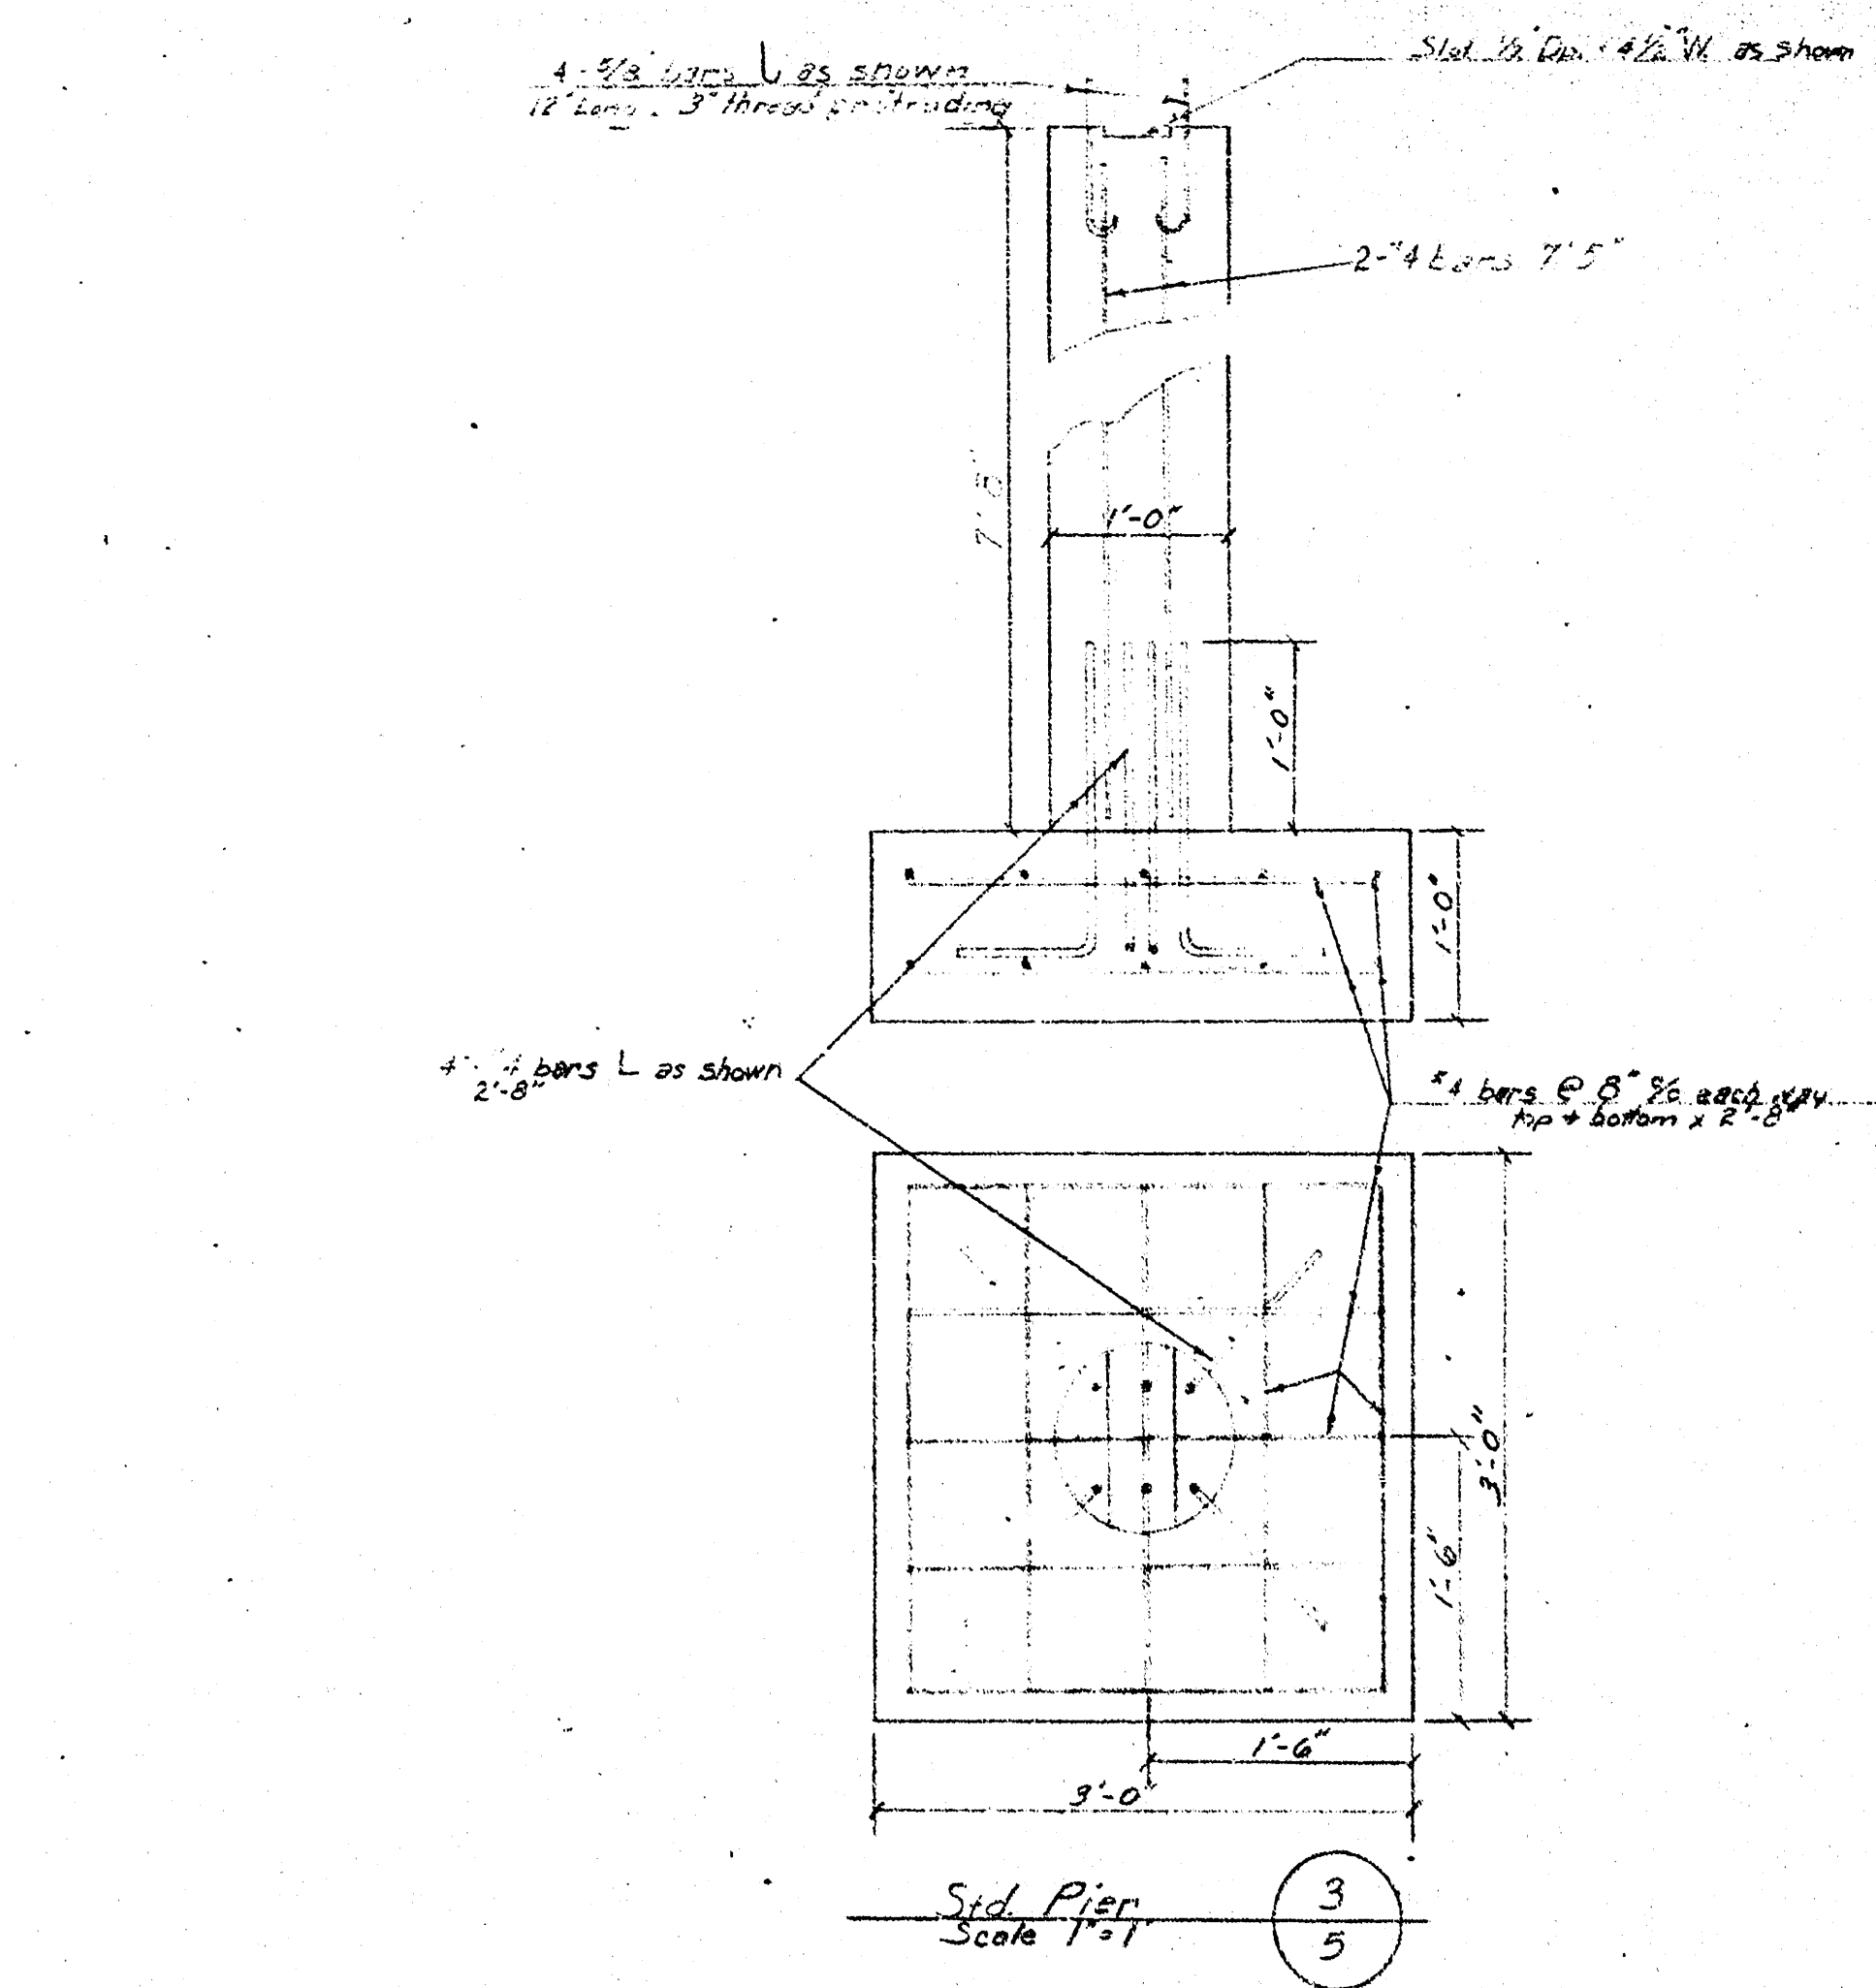

Note: All concrete shall be composed of Portland Cement, fine and coarse aggregate, and water. Cement content shall be 7.0 sacks per C.Y. proportions; parts by volume shall be as follows: Cement 1, fine aggregate 1 1/2-2, coarse aggregate 2 1/2-3, maximum total water content per bag of cement 5.5. Required consistency range for slump shall be vibrated in-place 1 1/2"-3", non-vibrated in-place 2"-4". Strength requirements shall be 7 days 1,800 psi, 28 days 3,000 psi.

Note: Bar reinforcement shall conform to the latest published requirements for Billet Steel Bars for Concrete Reinforcement of Intermediate Grade, ASTM Designation A-15. Deformation of Deformed Steel Bars of Concrete Reinforcement, ASTM Designation A-305. Welded wire fabric for reinforcement shall conform to the latest published requirements of the Standard Specifications for Welded Steel Wire Fabric for Concrete Reinforcement, ASTM Designation A-185.

McCALEB ENGINEERING EDMOND, OKLAHOMA		Drawn: _____ Title: _____ Checked: _____ Reviewed: _____
CONTINENTAL VILLAGE MARINA		
DETAIL SHEET		
Sheet No. 5 of 6		NOV 12 1970

