
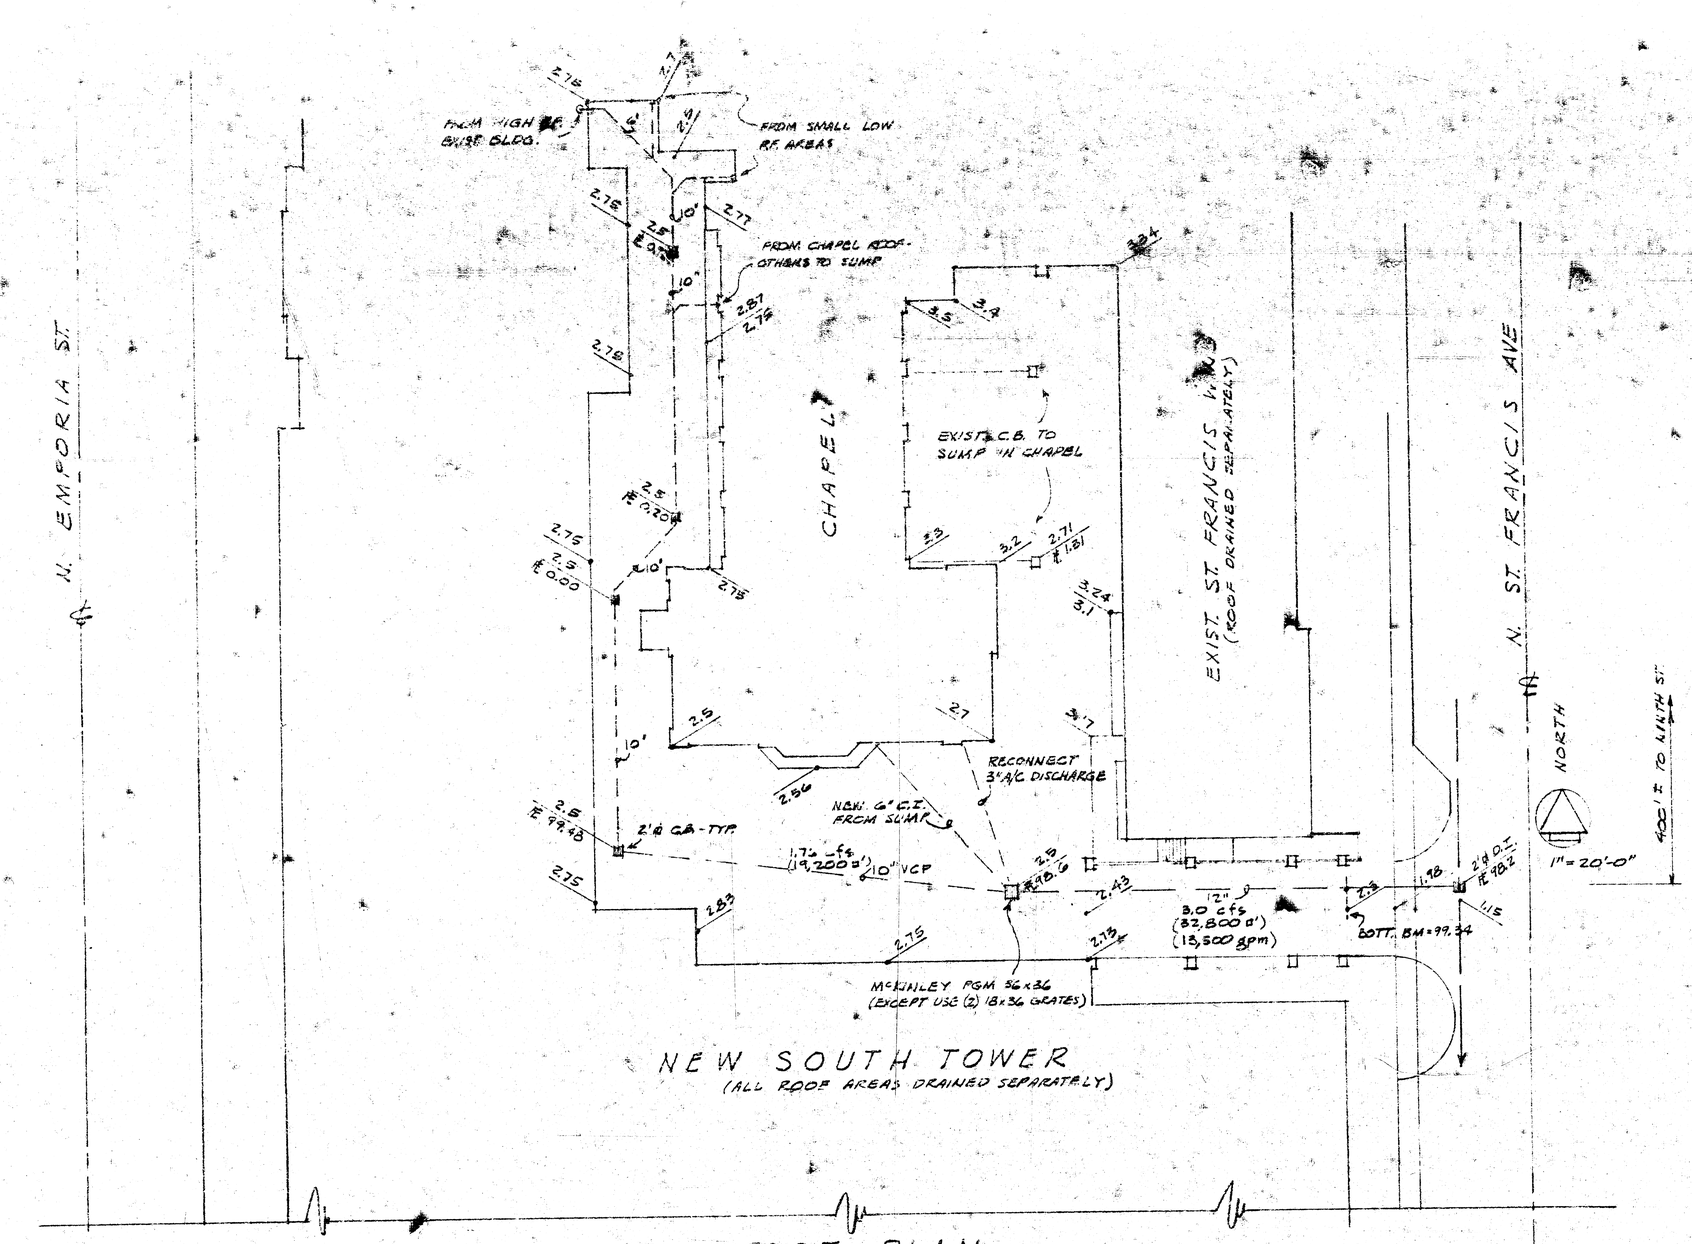


PLOT PLAN
1" = 20'-0"

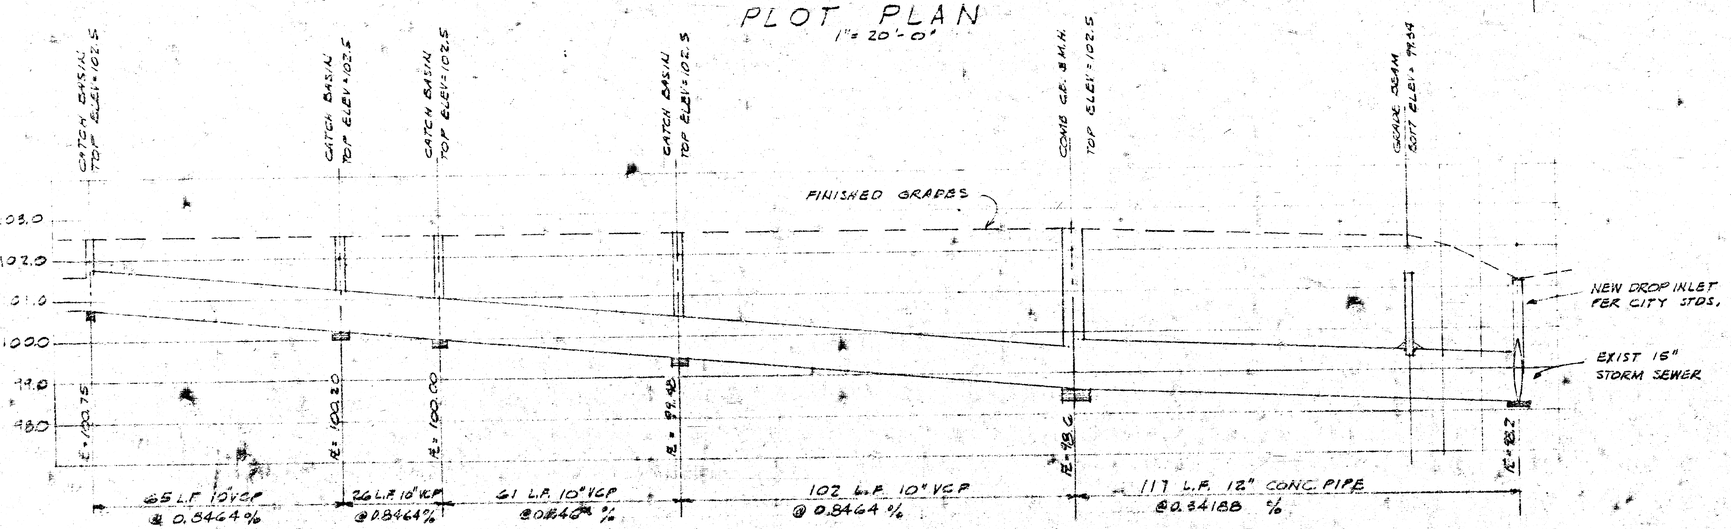

PROFILE

McKINLEY PGM 24x24

APPROVED AS NOTED
By CITY ENGINEER OF WICHITA
Sanitary Sewers
Storm Sewers 6/19/78
Driveway Approaches

NOTE TO CONTRACTOR

This project will be constructed under the supervision of the CITY ENGINEER and conforming to the SPECIFICATIONS of the CITY OF WICHITA. The CONTRACTOR will reimburse the City of Wichita for all cost of Engineering, Plans, and inspection.

PROPOSED
SAMBO'S
RESTAURANT

Proposed
Greased Trap

207 L.F. 15" R.C.P. Cl. III
to Upstream Manhole P-2

Sta. 1+10
Catch Basin
Rim Elev. 100.60
Inv. In 97.00, Inv. Out 96.75

110' L.F. 18" R.C.P., CL. III

150 L.F. 15" R.C.P., CL. III

Sta. 2+60
Catch Basin
Rim Elev. 100.00
Inv. Elev. 97.70

Sta. 0+00
Construct Manhole over
Box Culvert

Existing 5'x5' Box Culvert

4" SS

R/W Line

Sta. 0+60
Proposed Manhole

6" SS

Existing Sidewalk

G

G

G

36" SS

Sta. 0+00
Existing Manhole
Rim Elev. 101.12

Existing Raised Median

℄ PAWNEE AVENUE

BROADWAY

N

SCALE
Plan 1" = 20'
Profile: Horiz. 1" = 20'
Vert. 1" = 4'

CITY OF WICHITA
PRIVATE STORM AND SANITARY SEWERS
DR-7-325-80SR-001-000-008

STORM SEWER

104
100
96
92
88

15"RCP@0.90%

18" RCP @ 0.74%

15"RCP@1.00%

Exist. Box Culvert
Sta. 0+00
FL. 18" 97.00

Catch Basin
Sta. 1+10
Inv. 18" 96.75
Inv. 15" 97.00

Catch Basin
Sta. 2+60
Inv. 15" 97.70

0

1

2

SANITARY SEWER

104
100
96
92
88

Exist. MH
Sta. 0+00
FL. 8" 96.00

Sewerage MH
Sta. 0+60
FL. 8" 96.50

0

1

2