
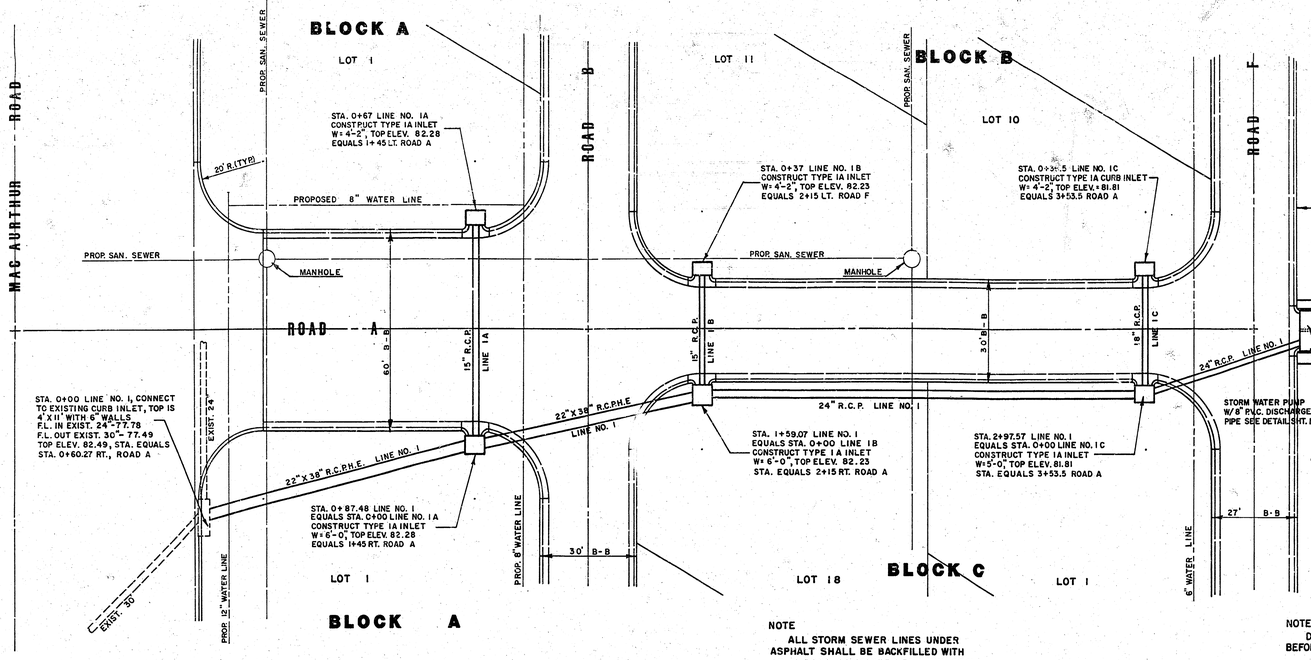


NOTE
ALL STORM SEWER LINES UNDER ASPHALT SHALL BE BACKFILLED WITH AB-3 ROCK, COMPACTED TO A MIN. 95% STANDARD DENSITY.

NOTE
DISCHARGE PIPE MUST BE INSTALLED BEFORE CONCRETE DRAINAGE SWALE IS BUILT.

CHARLES M. GOODNESS 10 LICENSED KANSAS PROFESSIONAL ENGINEER

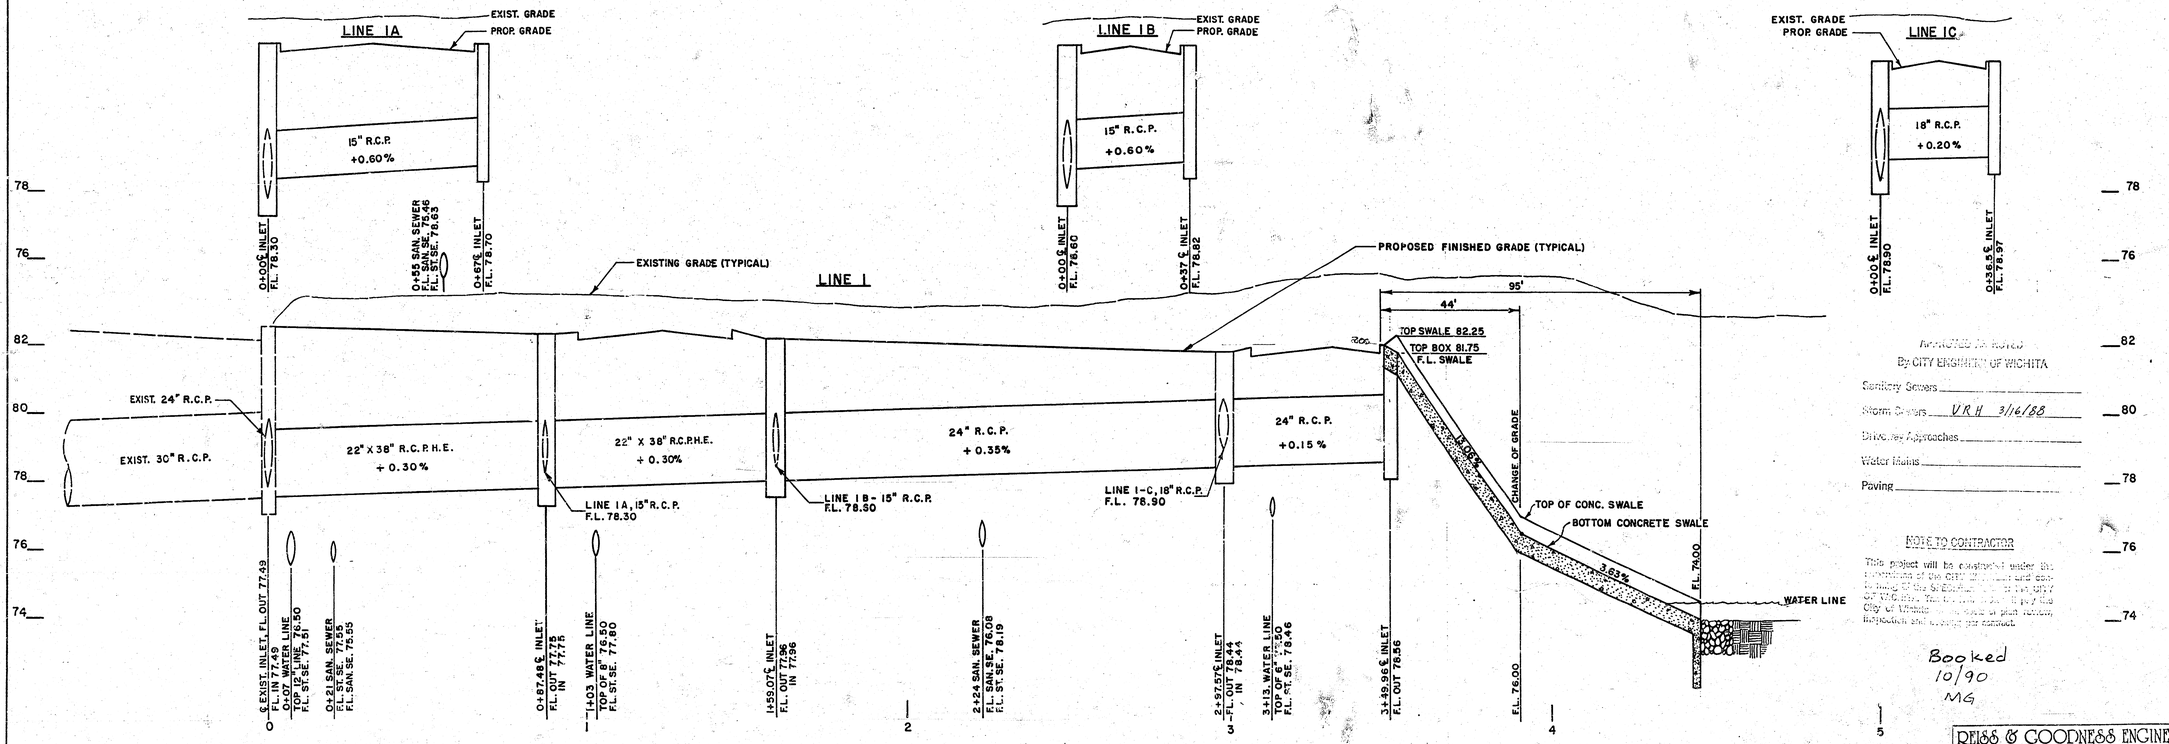

APPROVED AS NOTED
By CITY ENGINEER OF WICHITA
Sanitary Sewers _____
Storm Sewers V.R.H. 3/16/88
Driveway Approaches _____
Water Mains _____
Paving _____

NOTE TO CONTRACTOR
This project will be constructed under the supervision of the CITY INSPECTOR and compliance to the SPECIFICATIONS of the CITY OF WICHITA. The Contractor is to notify the City of Wichita _____ prior to start of construction and arrange pre-construction and progress conferences.

Booked 10/90 MG

CITY OF WICHITA PRIVATE PROJECT # 468-76-245-90001-000-000-160

REISS & GOODNESS ENGINEERS
2160 WEST 21ST STREET
WICHITA, KANSAS 67204
(316) 832-0213

REVISION	DRAWN BY	CHECKED BY	DESIGNED BY	PROJECT	CUSTOMER	SCALE	PROJECT NO.
	M	AB	A.B.	STORM SEWER LINES 1, 1A, 1B, 1C & DETAILS	LAMPLIGHTER MOBILE HOME PARK	NOTED	NS. 1288
						DATE	SHEET 9 OF