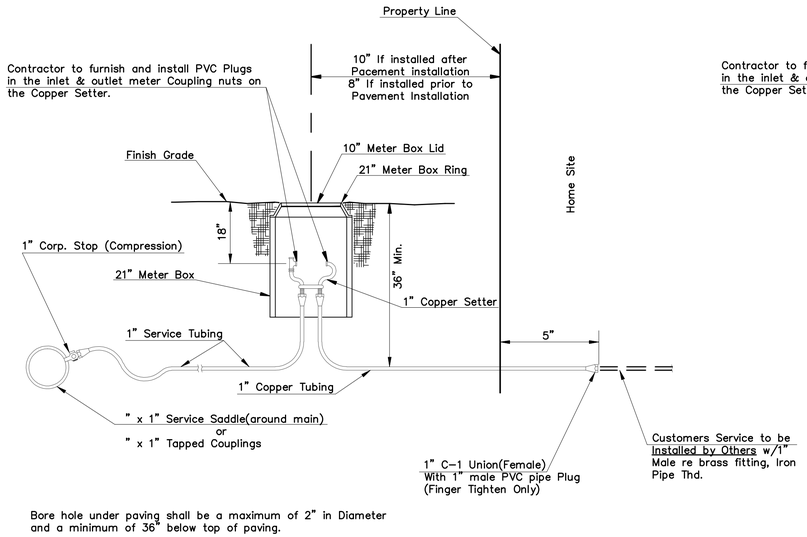

Bore hole under paving shall be a maximum of 2" in Diameter and a minimum of 36" below top of paving.

Note: Service Saddles are not required on top of 8" mains or larger

Meter boxes will be located on each lot to be served, as indicated in the SPECIAL PROVISIONS

TYPICAL METER SETTING
LONG SERVICE 1"

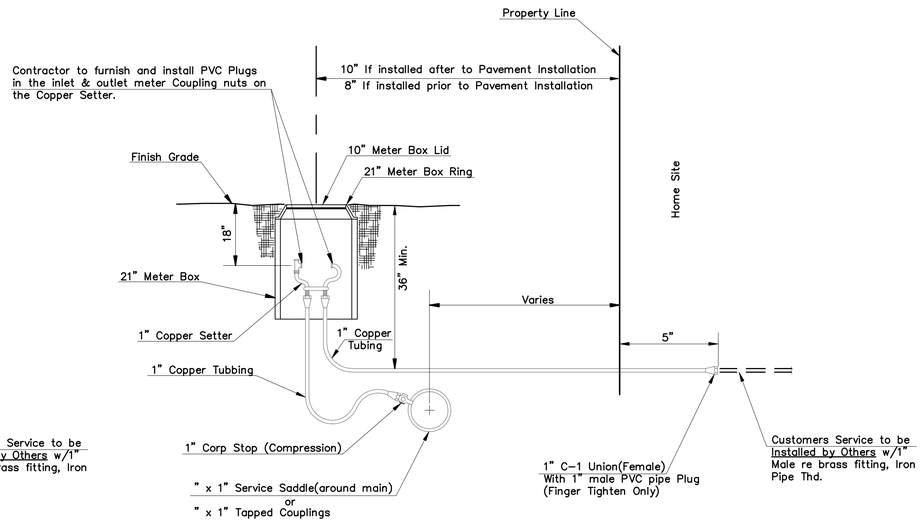

Note: Service Saddles are not required on top of 8" mains or larger

Meter boxes will be located on each lot to be served, as indicated in the SPECIAL PROVISIONS

TYPICAL METER SETTING
SHORT SERVICE 1"

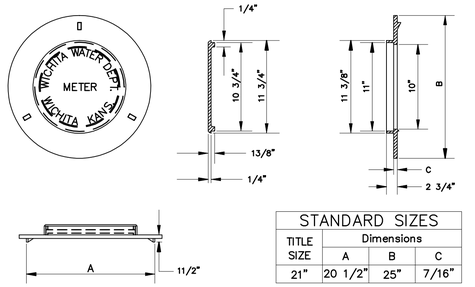

STANDARD SIZES			
TITLE SIZE	Dimensions A	B	C
21"	20 1/2"	25"	7/16"

Other Approved Ring And Lids: Ford Meter Box Co. Inc. 21" Ring & Lid Catalog No. C-4

RING & LID FOR METER VAULTS

1 – 1" Mueller Thread Corporation Stop
– 1" Type "K" Copper Tubing
1 – 1" Copper to Iron Union (Male)
1 – 1" Brass Curb Stop (Iron to Iron)
2 – 1"x4" Brass Nipple
Air Release
2 – 1" Brass Elbows (90°)
1 – 1"x6" Brass Nipple
1 – 21" Meter Tile
1 – 21" Meter Ring
1 – 10" Meter Lid

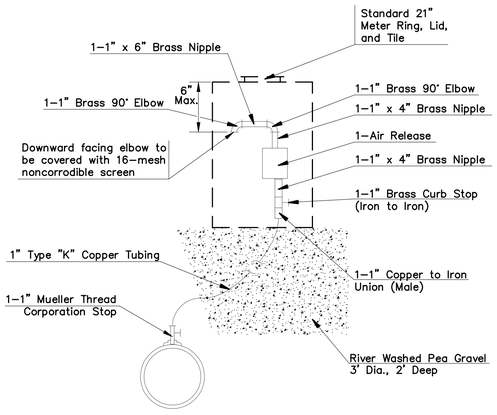

MATERIALS FOR AIR RELEASE ASSEMBLY

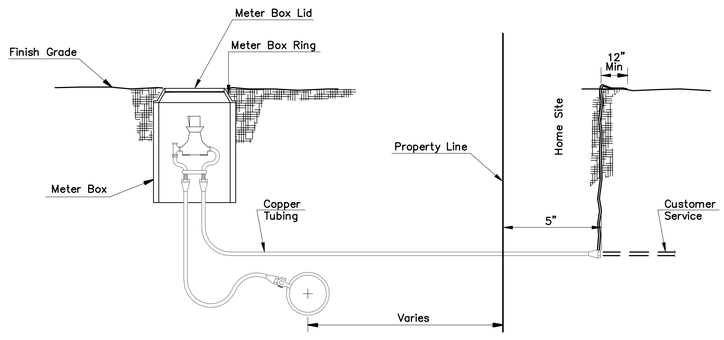

If customers service line is not installed at the time Meter Box and Setter are installed, Plastic Flagging is to be tied to the end of copper tubing & brought straight up to top of ground and be exposed a minimum of 12" on top of ground.
(Plastic Flagging to be Furnished by Contractor)

TYPICAL METER SETTING
PLASTIC FLAGGING

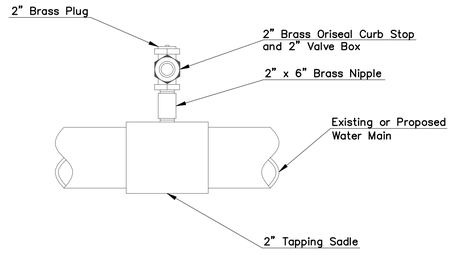

Note: Where the 2" service outlet assembley is to be used to connect a 2" main to another main, the 2" valve shall be a 2" IPT Gate Valve. 2" Ball or Globe valve shall not be approved for this use.

2" SERVICE OUTLET ASSEMBLY

No.	Date	By	Approved	Revision
1	10/16/2007	SS	JU	Replaced Detail with revised Detail

PARKSTONE ADDITION
WATER DISTRIBUTION SYSTEM IMPROVEMENTS
STANDARD DETAILS – WATER SERVICE
CITY OF WICHITA, KANSAS
JAMES L. ARMOUR, P.E. – CITY ENGINEER
Proj. #448-90303 O.C.A. #735380

POE & ASSOCIATES, INC.
CONSULTING ENGINEERS
5940 E. Central, Suite 200 • Wichita, KS 67208-4242
Phone 316/685-4114 • FAX 316/685-4444

FINAL
Designed By: S. Schmidt
Drawn By: M. Tucker/A. Moss
Poe Job No.: 1879
Date: OCTOBER 2007

CITY OF WICHITA PUBLIC WORKS ENGINEERING

STANDARD WATER SERVICE DETAILS

CITY ENGINEER
JAMES L. ARMOUR, P.E., L.S.
ACTING

PROJECT NUMBER	OCA NUMBER	DATE
448-90303	735380	10/07

DESIGN	DRAWN
JU	SS

SHEET 4 OF 8

CITY ENGINEER'S OFFICE
CITY HALL – SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202-1620
(316) 268-4501
(316) 268-4114 FAX