



Architects  
1133 E. 2nd St.  
Wichita, KS 67214  
316.262.7435

Seal:


PIPING AND EQUIPMENT  
NEW BUILDING  
37TH STREET NORTH & OHIO STREET  
WICHITA, KANSAS

Revisions:

Proj no: PPNEN07100  
Date: 8/2007  
Sheet title:


PPW FH Details  
Drawn by: NS  
Checked by: KM

C3.3  
of  
© 2007 PBA Architects

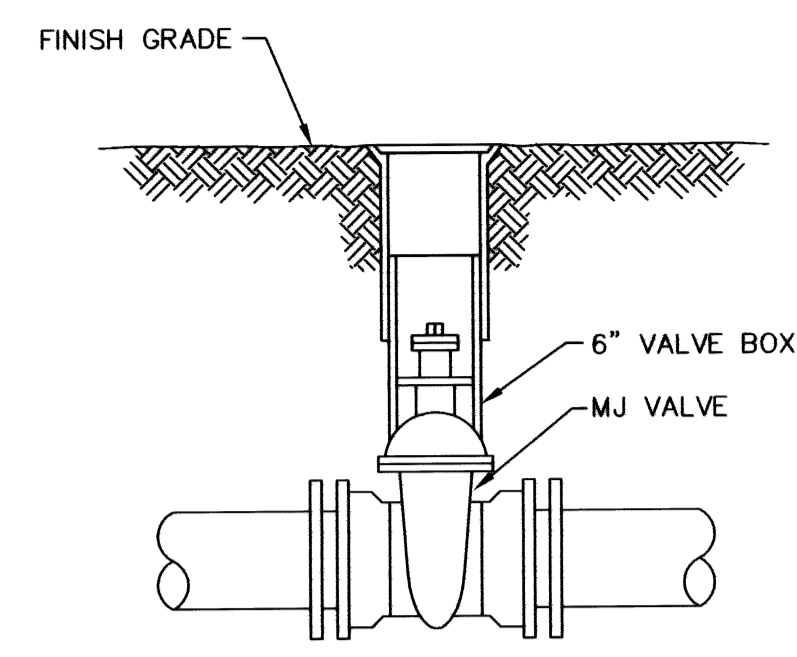


LINE VALVE ASSEMBLY

- MATERIALS LIST**  
1-MJ GATE OR BUTTERFLY VALVE (AS PER PLAN)  
1-6" VALVE BOX  
CONCRETE SUPPORT BLOCK SHALL BE FULL WIDTH OF THE TRENCH

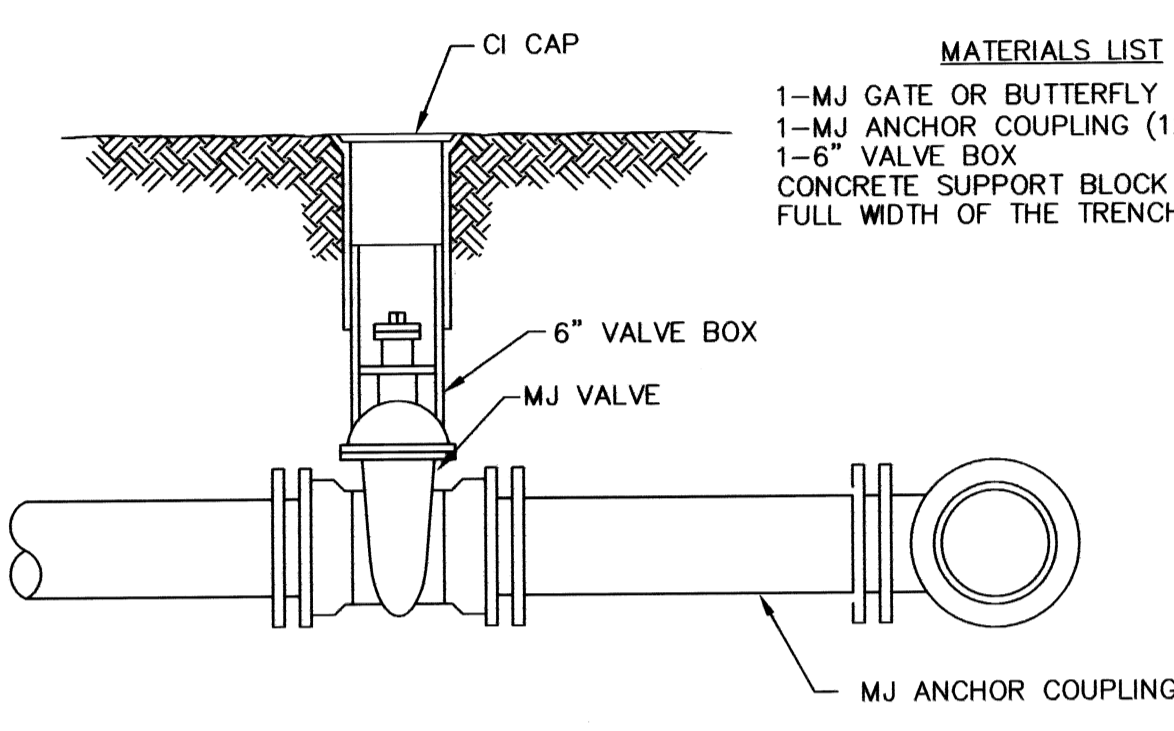


ANCHORED VALVE ASSEMBLY

- MATERIALS LIST**  
1-MJ GATE OR BUTTERFLY VALVE (AS PER PLAN)  
1-MJ ANCHOR COUPLING (12" OR SMALLER)  
1-6" VALVE BOX  
CONCRETE SUPPORT BLOCK SHALL BE FULL WIDTH OF THE TRENCH

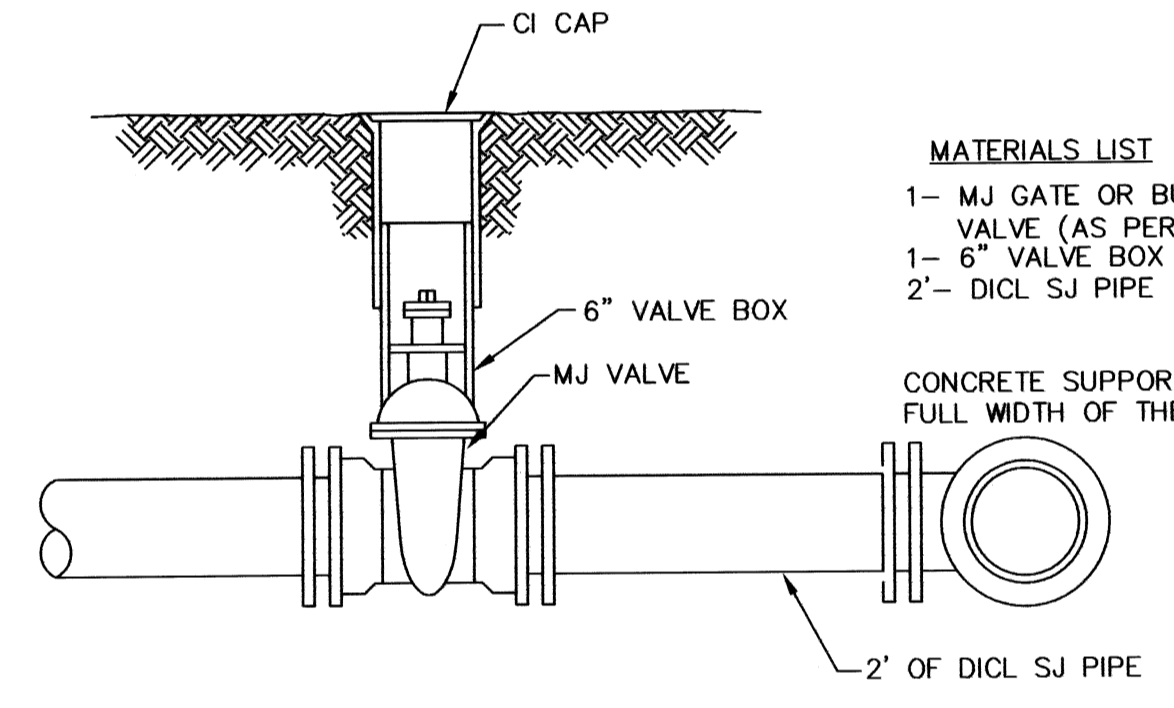

VALVE ASSEMBLY


- MATERIALS LIST**  
1-MJ GATE OR BUTTERFLY VALVE (AS PER PLAN)  
1-6" VALVE BOX  
2"- DI CL SJ PIPE  
CONCRETE SUPPORT BLOCK SHALL BE FULL WIDTH OF THE TRENCH

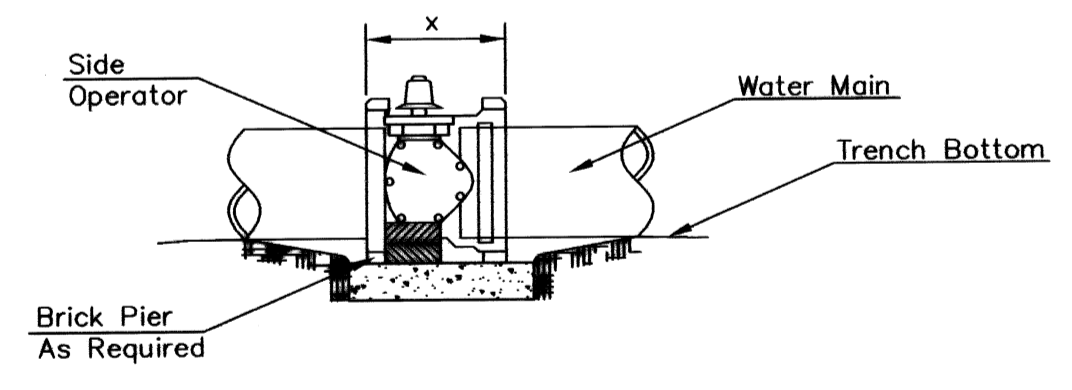

CONCRETE SUPPORT BLOCKING FOR BUTTERFLY VALVE INSTALLATION

**NOTES**

- This detail covers Butterfly Valve installation, inclusive, regardless of type of pipe or joint used. Larger lines to be detailed on plans.
- 6" Valve Box and Cover required per City of Wichita Std. Specifications.
- Conc. Support Block to be full width of trench.

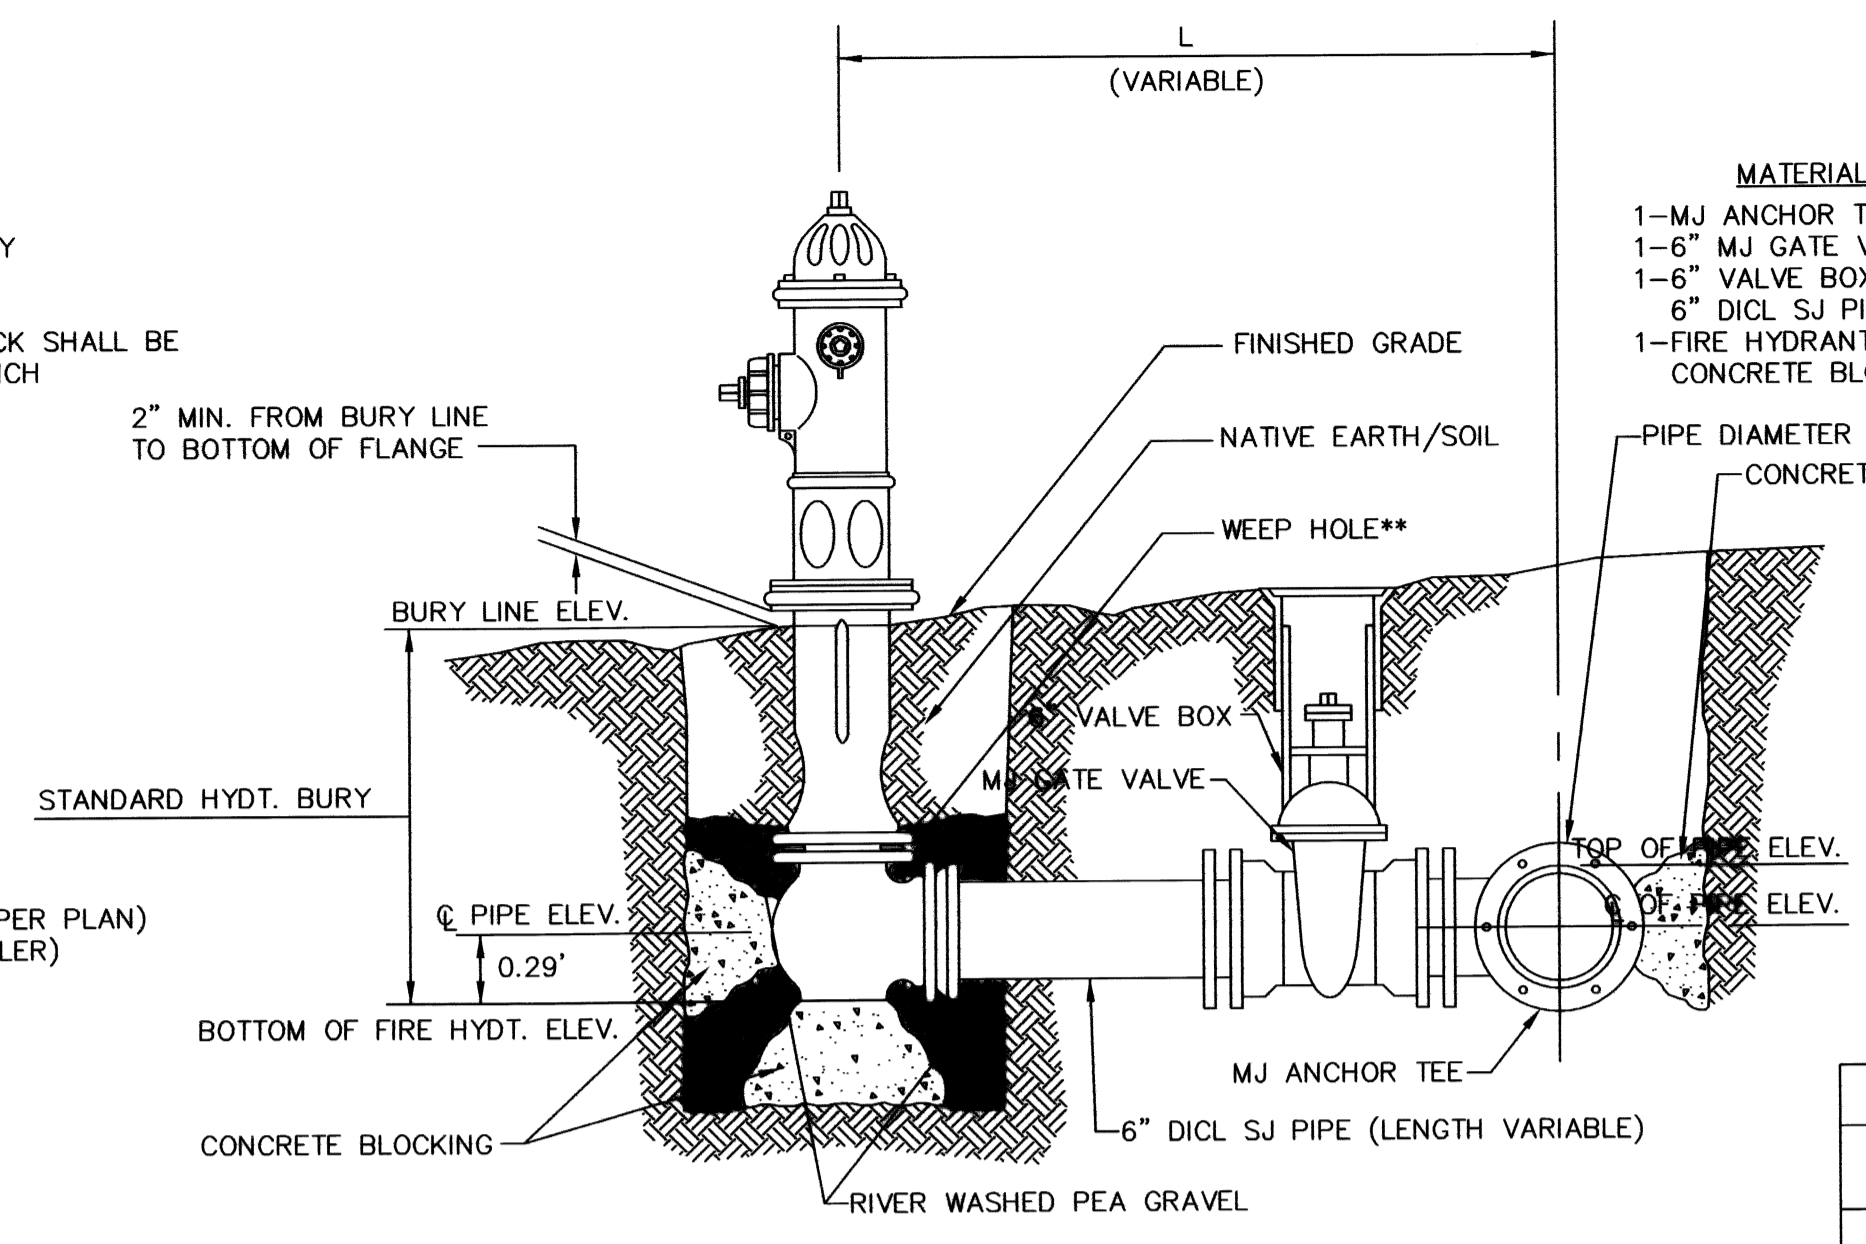


FIRE HYDRANT ASSEMBLY  
PER CITY OF PARK CITY SPECIFICATIONS

- MATERIALS LIST**  
1-MJ ANCHOR TEE ("D"x 6")  
1-6" MJ GATE VALVE  
1-6" VALVE BOX  
6" DI CL SJ PIPE (LENGTH VARIABLE)  
1-FIRE HYDRANT  
CONCRETE BLOCKING (AS NEEDED)

- \*\* CAUTION! WEEP HOLES TO BE KEPT CLEAR DURING CONSTRUCTION AND BACKFILL. CONCRETE FOR THRUST BLOCKING SHALL NOT OBSTRUCT WEEP HOLES.  
# CONCRETE THRUST BLOCKING SHALL BE KEPT CLEAR OF BOLTS, NUTS, AND MJ ACCESSORIES.  
\* IF HYDRANT BURY IS IN EXCESS OF 5', CONTRACTOR SHALL USE STANDARD 5" HYDRANT BURY AND HYDRANT BARREL EXTENSIONS AS NECESSARY.

FIRE HYDRANTS REQUIRED			
STATION	BURY LINE ELEVATION	TOP OF PIPE ELEVATION	FIRE HYDRANT BURY REQUIRED*
02+68.82	134.22	129.22	5.0'

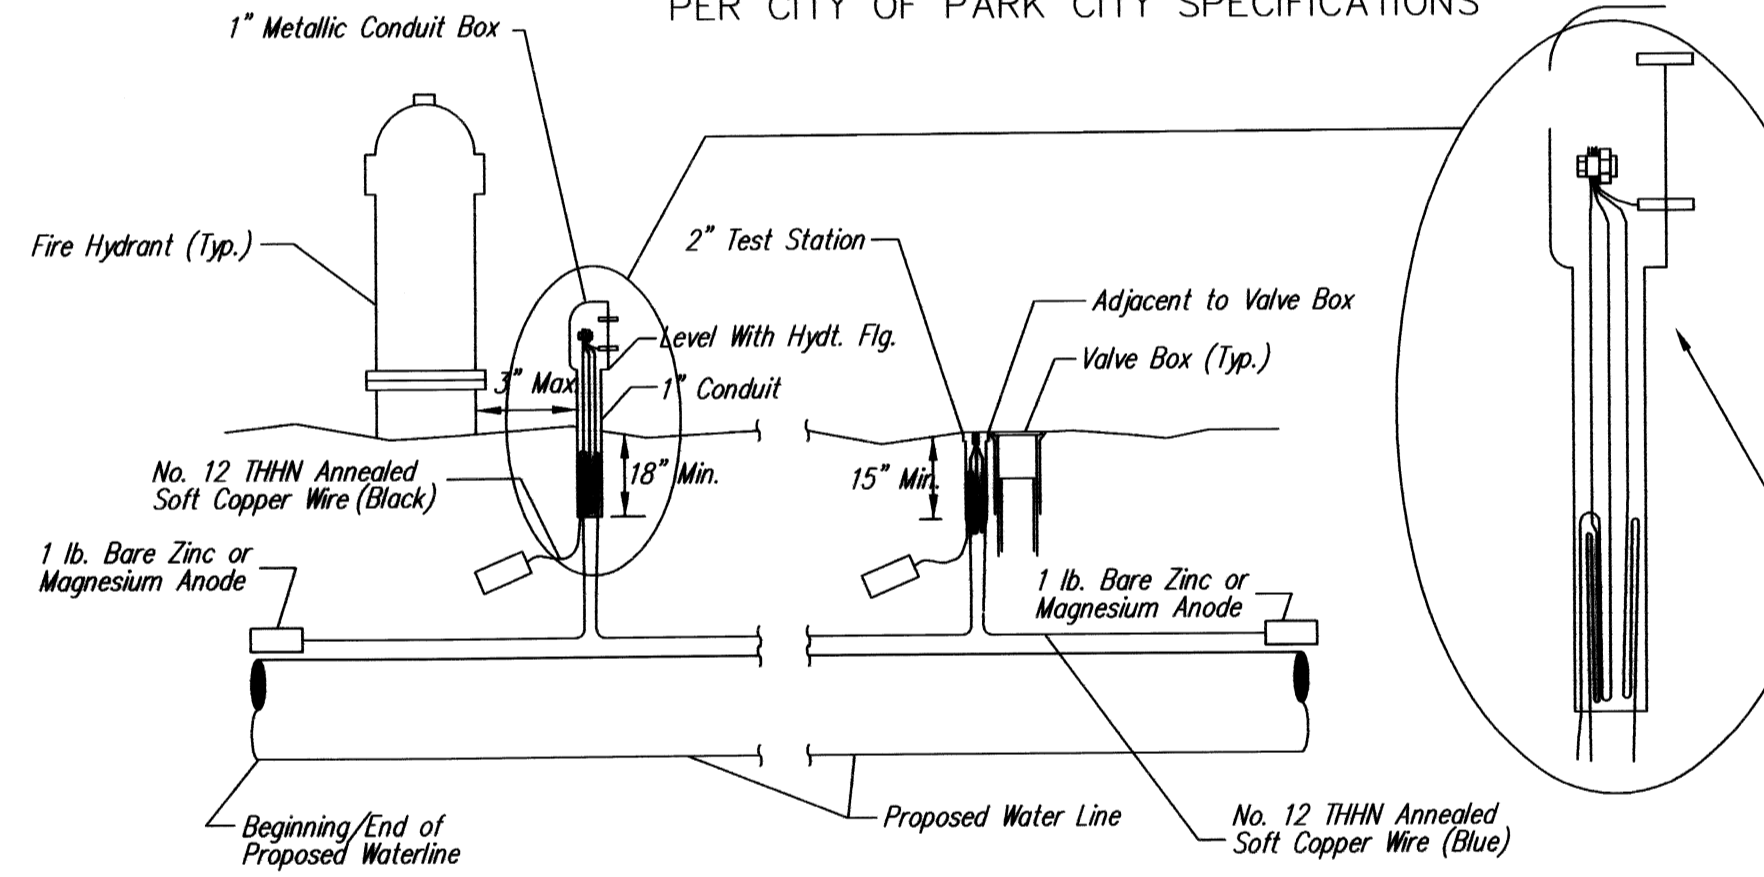


TRACER WIRE DETAIL  
COST IS SUBSIDIARY TO PIPE INSTALLATION

**TRACER WIRE**  
Conductive type pipe locator/tracer wire shall be installed to locate all waterline pipe regardless of pipe material. The wire shall extend the entire length of the proposed pipe. The wire shall be taped to the waterline and pulled with the pipe. Split-bolt connectors shall be used at splice locations. Electrical tape shall cover all splices so no bare wire is exposed. Test stations shall be installed adjacent to all fire hydrants along the waterline and at blowoffs or valves near the ends of the waterlines. Any exceptions to the location of test stations shall be approved by the engineer. At each test station, the tracer wire shall be connected to a 1 lb. Zinc or magnesium anode. Anodes shall also be attached to the tracer wire at both the beginning and the end of the proposed waterline. A typical layout of the tracer wire and test station is provided in the above figure.

The tracer wire shall be Blue No. 12 THHN annealed soft copper wire with thermal plastic insulation. The insulation shall be heat, oil, and gasoline resistant as manufactured by Temple Electric or approved equal. To allow for grade adjustment, a minimum of 12" of excess wire shall be coiled at the bottom of the test station for all wires. The insulation sheathing shall be removed such that 1" bare copper wire is exposed at all points of connection. Contractor shall attach wire being installed with proposed water main to any tracer wire installed with adjacent waterline projects.


**TEST STATIONS**  
The test station for fire hydrant applications shall be a 1 inch galvanized conduit style test station as manufactured by ACR Industries with a removable solid cover having two leads extending from the face or approved equal. The test station for valve applications shall be 2 inch flush style test station T2PS3B as manufactured by HANDLEY Industries or approved equal. The conduit style shall be attached to a 1 inch rigid galvanized conduit with a minimum length of 36" and plastic end bushing. The flush style shall have the word "WATER" stamped or molded into the lid. All test stations shall be manufactured using molded blue tops or sufficiently coated with blue enamel paint. The tracer wire and the anode wire shall be installed to allow 10 inches of wire within the test station. In concrete environments such as sidewalks or in the downtown area the contractor shall use the flush style test station. The location of all test stations shall be approved by the engineer, recorded, and shown in the as-built drawings.

**ANODES**  
The anodes shall be 1 lb. bare zinc or magnesium. The anodes shall be buried at the same elevation as the waterline at each test station. The anodes shall be connected to Black No. 12 THHN annealed soft copper wire which shall be extended to the test station.

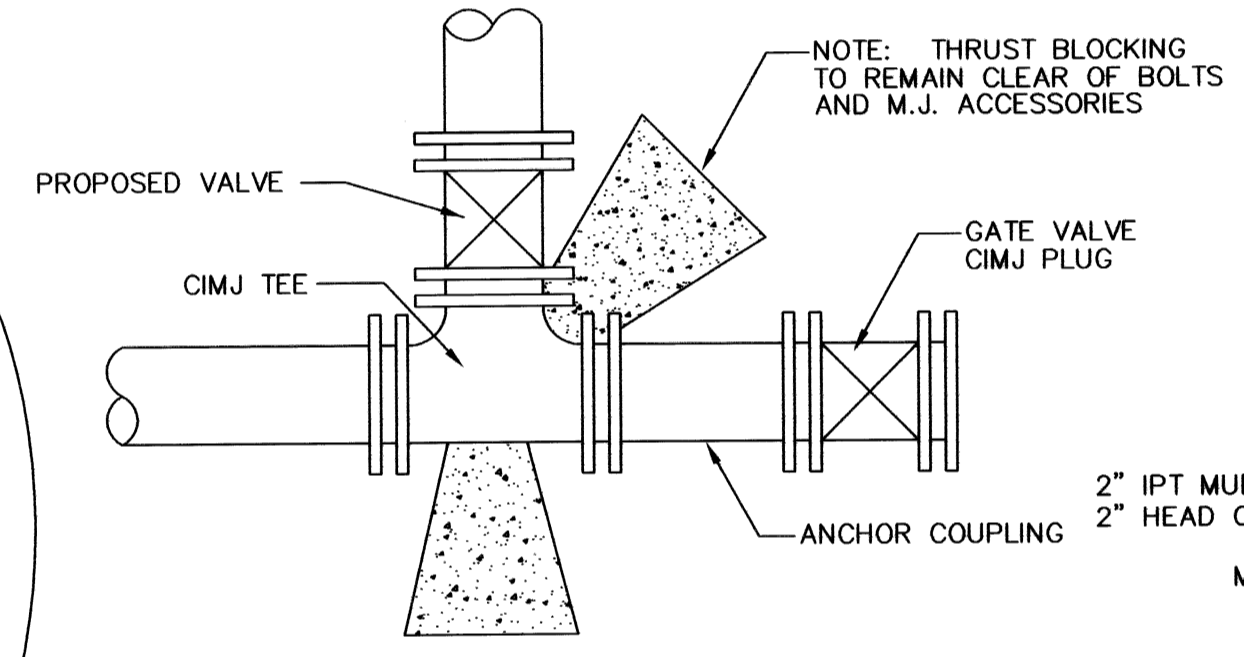

KEY BLOCK DETAIL


- NOTE: THRUST BLOCKING TO REMAIN CLEAR OF BOLTS AND M.J. ACCESSORIES
- 2 Blue Wires and 1 Black Wire  
All Connected to Single Test Lead  
With Split Bolt Connection and Blue No. 12 THHN Annealed Soft Copper Wire

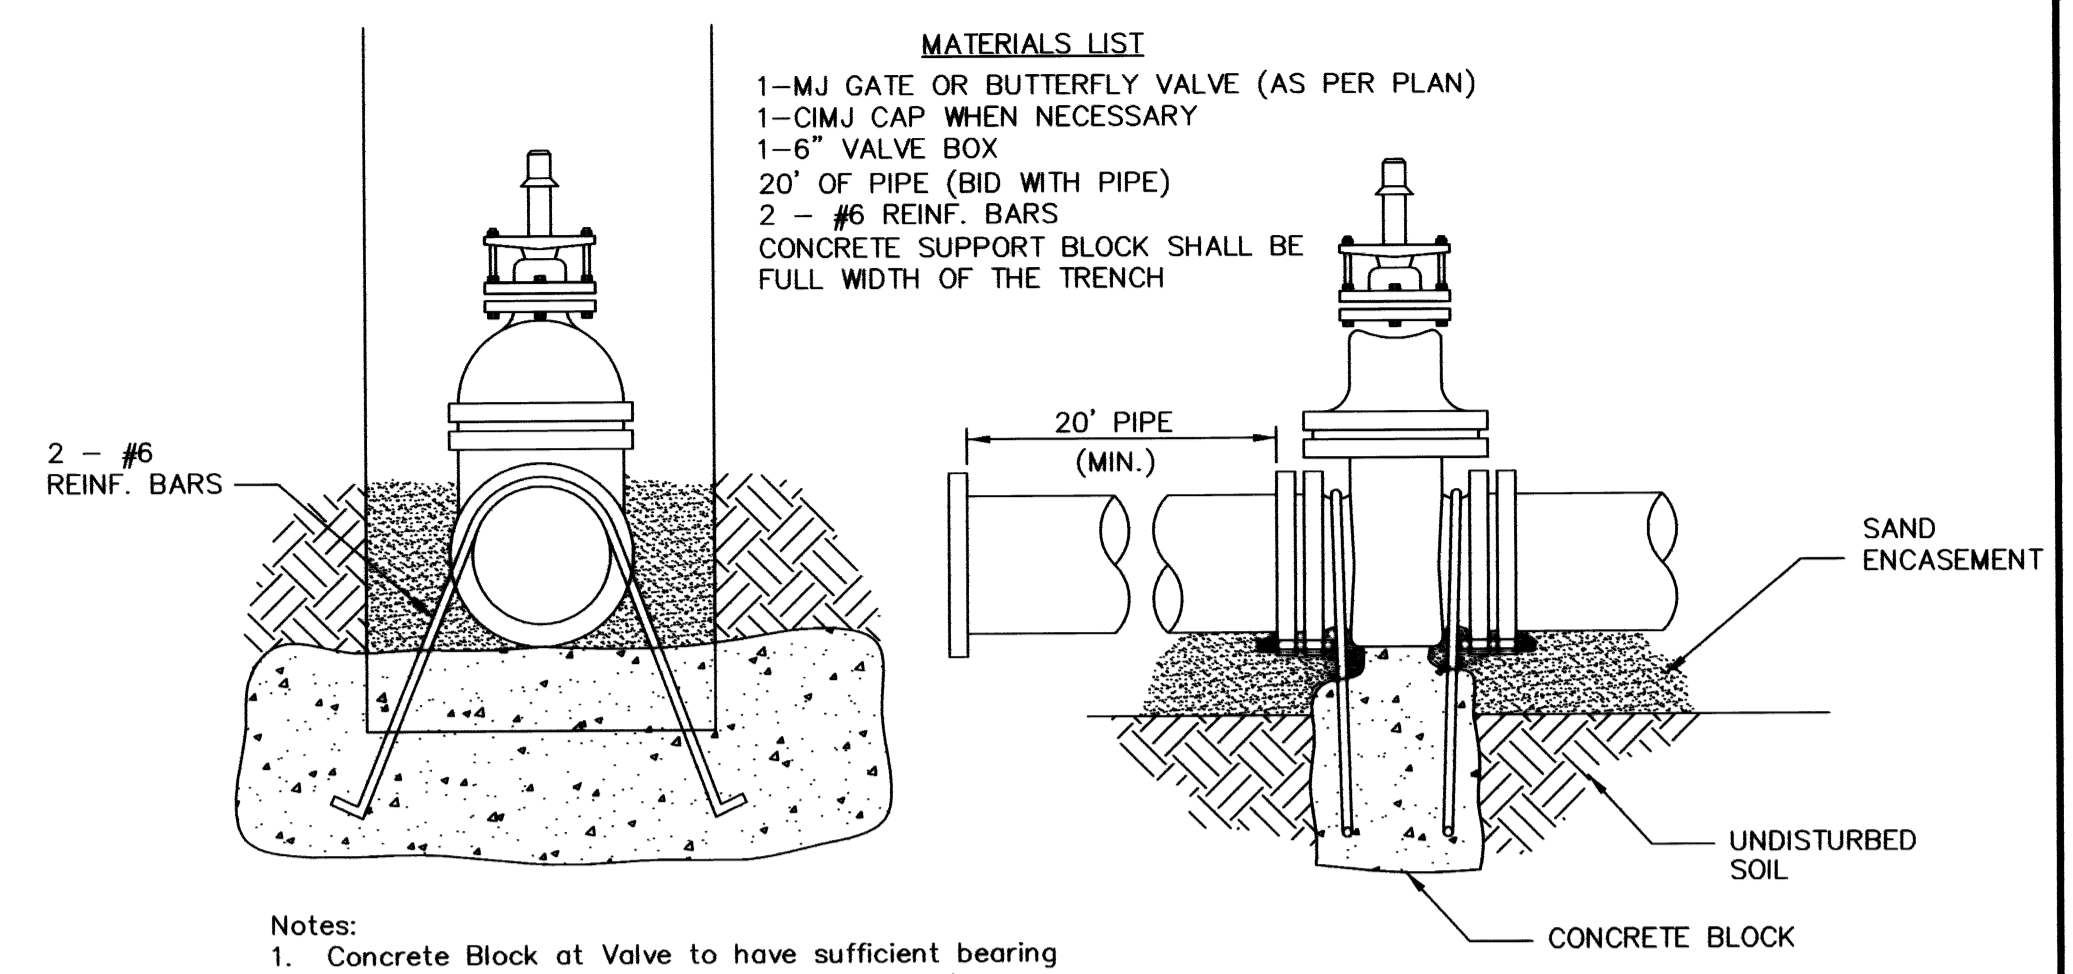

- Notes:**  
1. Concrete Block at Valve to have sufficient bearing in undisturbed soil to prevent thrust movement as shown in table at right. Field Engineer to determine thrust loading of undisturbed soil and final size of thrust block.  
2. The thrust block shall be constructed such that bolts, nuts, and other MJ accessories are kept clear of concrete.  
3. All valves at dead ends and at other locations as called out on the plans shall be blocked as shown here.


THRUST AT VALVES	
VALVE	THRUST AT 150 #/sq
4"	1809 lbs.
6"	4245 lbs.
8"	7540 lbs.
12"	16965 lbs.

ANCHORED VALVE ASSEMBLY, SPECIAL

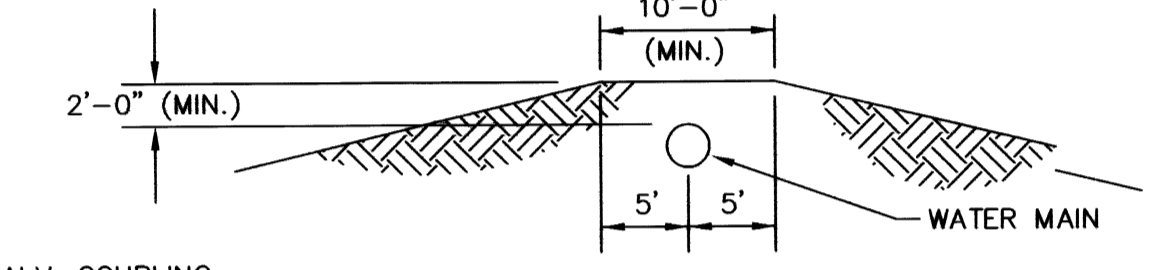


PROTECTIVE FILL DETAIL

MINIMUM PROTECTIVE FILL SHALL BE PROVIDED IN ALL INSTANCES WHERE COVER OVER THE PROP. WATER LINE IS LESS THAN (2) FEET. (COST SUBSIDIARY TO PIPE INSTALLATION)

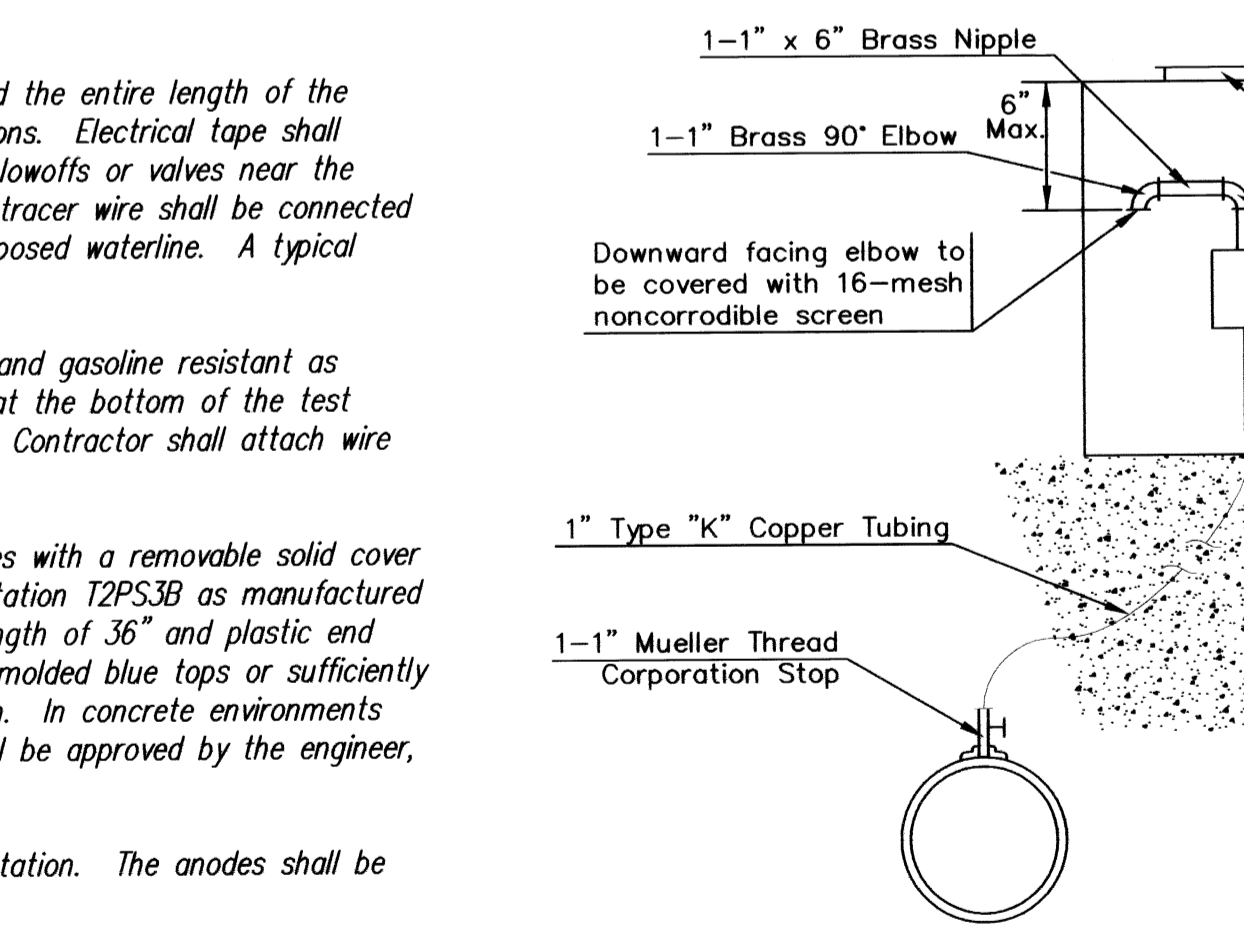

MATERIALS FOR AIR RELEASE ASSEMBLY

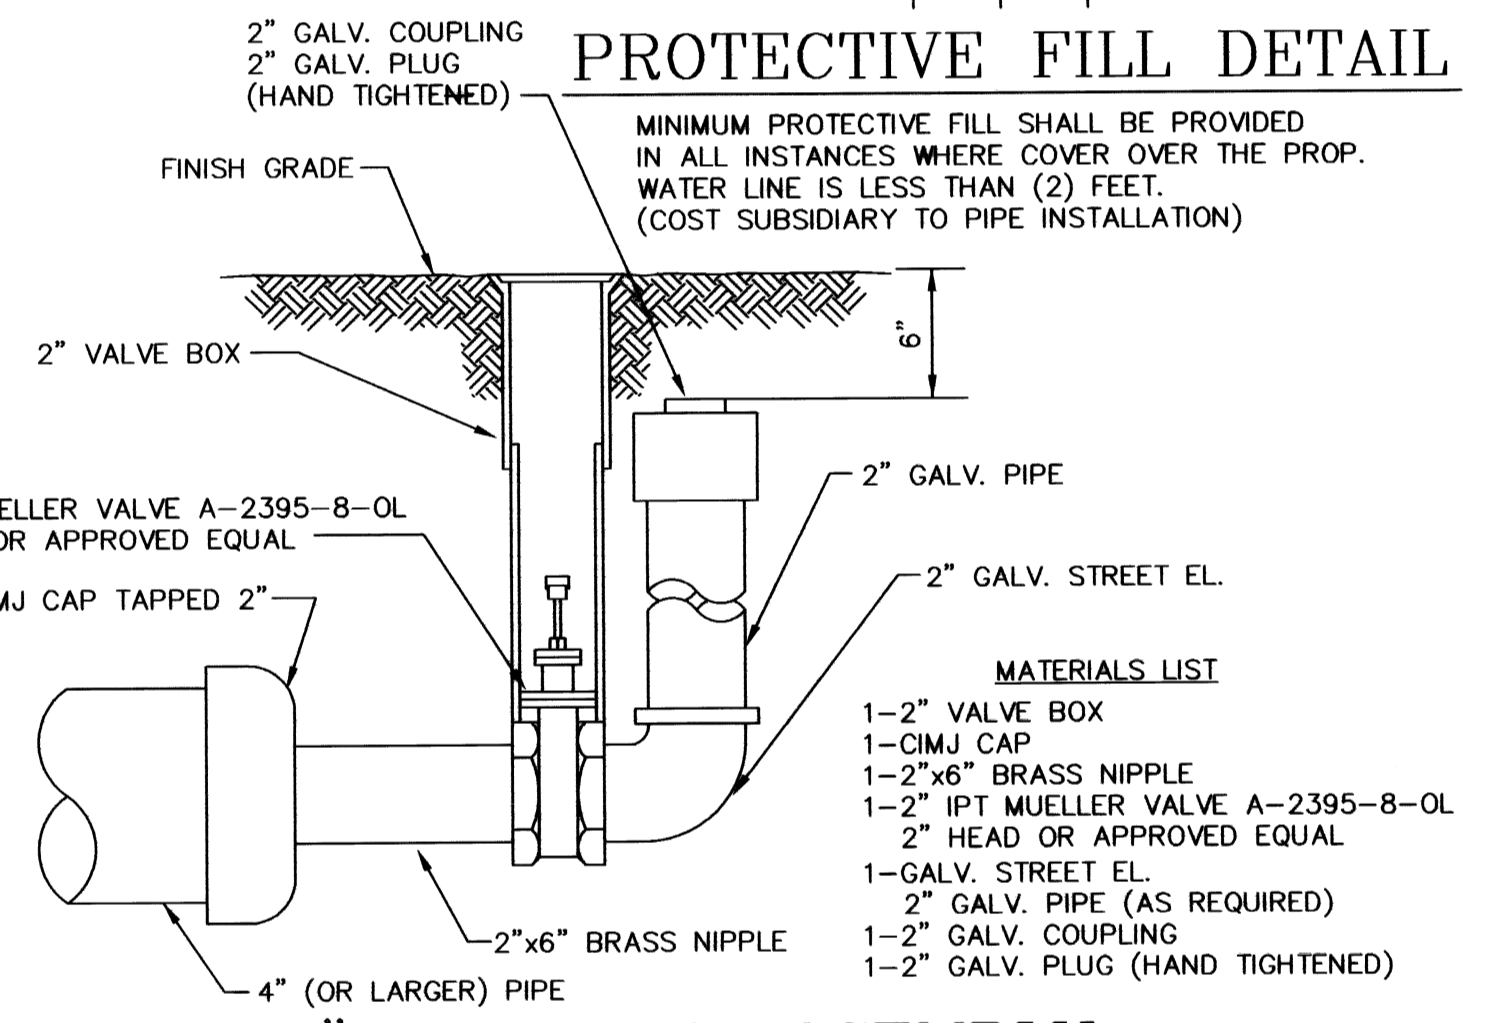

2" BLOWOFF ASSEMBLY

- MATERIALS LIST**  
1-2" VALVE BOX  
1-CIMJ CAP  
1-2"x6" BRASS NIPPLE  
1-2" IPT MUELLER VALVE A-2395-8-OL  
2" HEAD OR APPROVED EQUAL  
1-GALV. STREET EL.  
2" GALV. PIPE (AS REQUIRED)  
1-2" GALV. COUPLING  
1-2" GALV. PLUG (HAND TIGHTENED)
- 1-1" Mueller Thread Corporation Stop  
1-1" Type "K" Copper Tubing  
1-1" Copper to Iron Union (Male)  
1-1" Brass Curb Stop (Iron to Iron)  
2-1"x4" Brass Nipple  
Air Release  
2-1" Brass Elbows (90°)  
1-1"x6" Brass Nipple  
1-21" Meter Tile  
1-21" Meter Ring  
1-10" Meter Lid

316/264-0242



516 S. Market,  
Wichita, KS 67202