

STA 21+50.00, LINE 9
BL STA 21+69.32, 24.00' LT.
MATCH POINT

REMOVE OLD FIRE HYDRANT
AND RETURN TO 1825 S. McLEAN.

STA 22+75.04 LINE 9 =
STA 12+90.13 LINE 8
BL STA 22+94.36, 24.00' LT
1 - 8" X 8" MJ TEE
2 - 8" GATE VALVE ASSEMBLY (N,W)
DEFLECT PIPE 4'00"00" RT.
VALVE BOX ELEV = 1325.95
7.00 L.F. 8" DI CL PIPE

NEW WATER METER SUMMARY

No.	BL Station	Lt./Rt.	Service (Long or Short)	Meter Size	Address	AS BUILT
40	24+90.20	Lt.	Short	0.75	1611 N. VOLUTSIA ST.	
41	24+91.49	Rt.	Long	0.63	1612 N. VOLUTSIA ST.	
42	25+38.61	Rt.	Long	0.63	1618 N. VOLUTSIA ST.	
43	25+39.13	Lt.	Short	0.63	1615 N. VOLUTSIA ST.	
44	25+86.79	Lt.	Short	XX	1622 N. VOLUTSIA ST.	
45	26+40.26	Rt.	Long	0.63	1621 N. VOLUTSIA ST.	
46	26+41.90	Rt.	Long	0.63	1628 N. VOLUTSIA ST.	
47	26+42.54	Lt.	Short	0.63	1625 N. VOLUTSIA ST.	
48	26+74.57	Lt.	Short	XX	1631 N. VOLUTSIA ST.	
49	26+91.61	Rt.	Long	0.63	1632 N. VOLUTSIA ST.	
50	27+32.71	Lt.	Short	0.63	1639 N. VOLUTSIA ST.	
51	27+41.83	Rt.	Long	0.63	1638 N. VOLUTSIA ST.	
52	27+74.57	Rt.	Long	0.63	1642 N. VOLUTSIA ST.	
53	27+78.93	Lt.	Short	0.63	1643 N. VOLUTSIA ST.	
54	28+27.66	Rt.	Long	0.63	1648 N. VOLUTSIA ST.	
55	28+36.82	Lt.	Short	0.63	1649 N. VOLUTSIA ST.	
56	28+80.59	Lt.	Short	0.63	1653 N. VOLUTSIA ST.	
57	28+83.03	Rt.	Long	0.63	1652 N. VOLUTSIA ST.	
58	29+45.99	Lt.	Short	0.63	1657 N. VOLUTSIA ST.	

STA 29+48.08 LINE 9 =
BL STA 29+67.22, 19.00' LT
1 - FH ASSEMBLY
BURY LINE ELEV. = 1333.18
VALVE BOX ELEV. = 1332.71
L = 5.0'
1 - 8" MJ GATE VALVE ASS'Y (S)


REMOVE OLD FIRE HYDRANT
AND RETURN TO 1825 S. McLEAN.

NEW WATER METER SUMMARY


No.	BL Station	Lt./Rt.	Service (Long or Short)	Meter Size	Address	AS BUILT
59	30+48.38	Lt.	Short	0.63	1701 N. VOLUTSIA ST.	
60	30+54.95	Rt.	Long	0.63	1700-1702 N. VOLUTSIA ST.	
61	30+90.72	Rt.	Long	0.63	1708 N. VOLUTSIA ST.	
62	30+99.64	Lt.	Short	0.63	1707 N. VOLUTSIA ST.	
63	31+40.32	Rt.	Long	0.63	1712 N. VOLUTSIA ST.	
64	31+51.54	Lt.	Short	XX	1711 N. VOLUTSIA ST.	
65	31+96.52	Rt.	Long	0.63	1718 N. VOLUTSIA ST.	
66	32+48.58	Rt.	Long	0.75	1724 N. VOLUTSIA ST.	
67	32+56.91	Lt.	Short	0.63	1717 N. VOLUTSIA ST.	
68	33+09.89	Lt.	Short	0.63	1723 N. VOLUTSIA ST.	

BENCHMARK #21:
1" CUT ON TOP OF CURB WEST SIDE OF
THE NW CURB RETURN @ 15TH AND VOLUTSIA
ELEV. = 1325.61 NGVD

BENCHMARK #22:
1/2" PIPE IN THIMBLE @ CL 16TH AND VOLUTSIA
ELEV. = 1332.46 NGVD

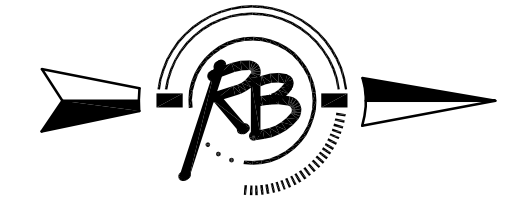

SCALE 1" = 40'
1" = 5' (VERT.)

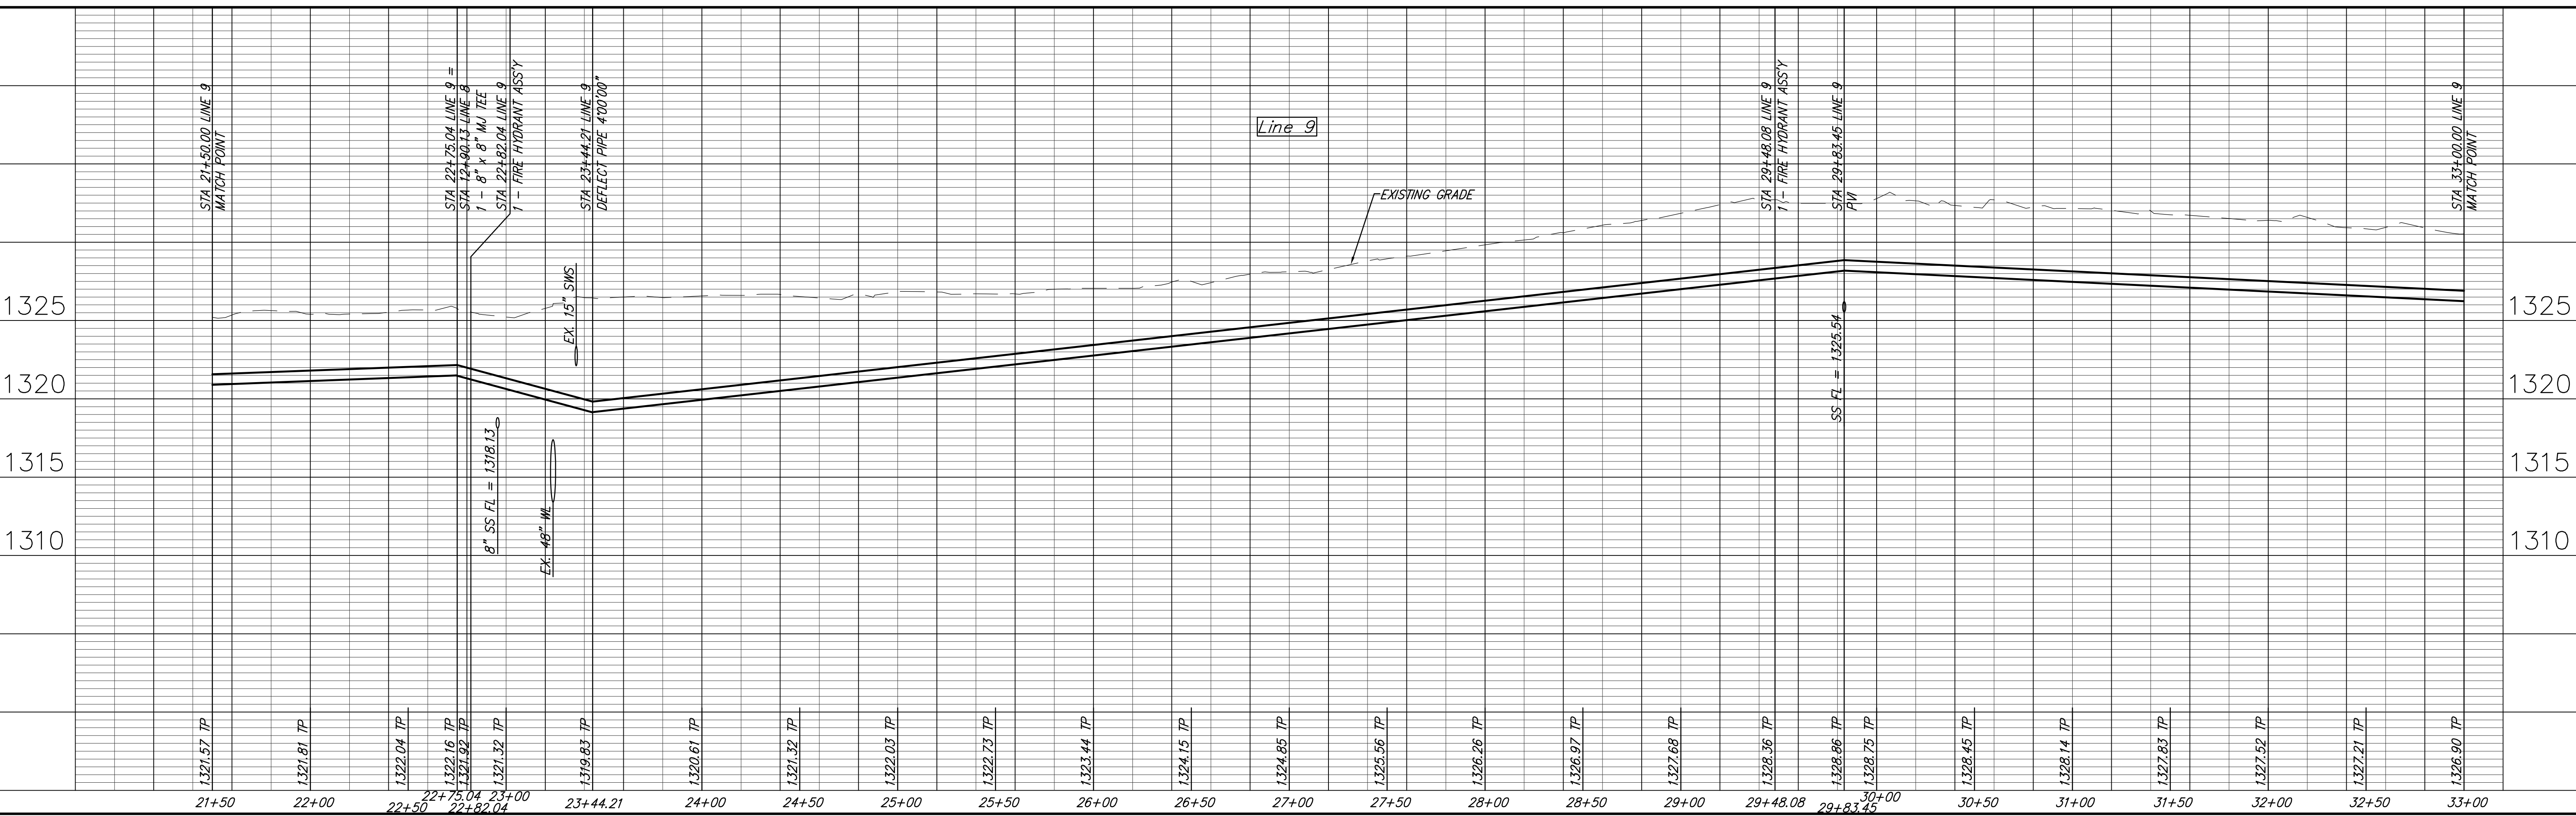

Ruggles & Polheim, P.A.
Engineering, Surveying, Land Planning
9000 W. 15th St., Suite 100
Wichita, Kansas 67205
www.rugglespa.com

PROJECT NUMBER
448-90210

DESIGN
PC
UTILITY

DRAWN
MLP

DATE
Dec. 19, 2006

REVIEW

**LOGAN WATER DISTRIBUTION
VOLUTSIA (LINE 9)
WICHITA, KANSAS**

RB JOB
2969W

SHEET
20
OF
30