



**WATERFRONT RESIDENTIAL
AND
GREENWICH OFFICE PARK
DRAINAGE PHASE 1**

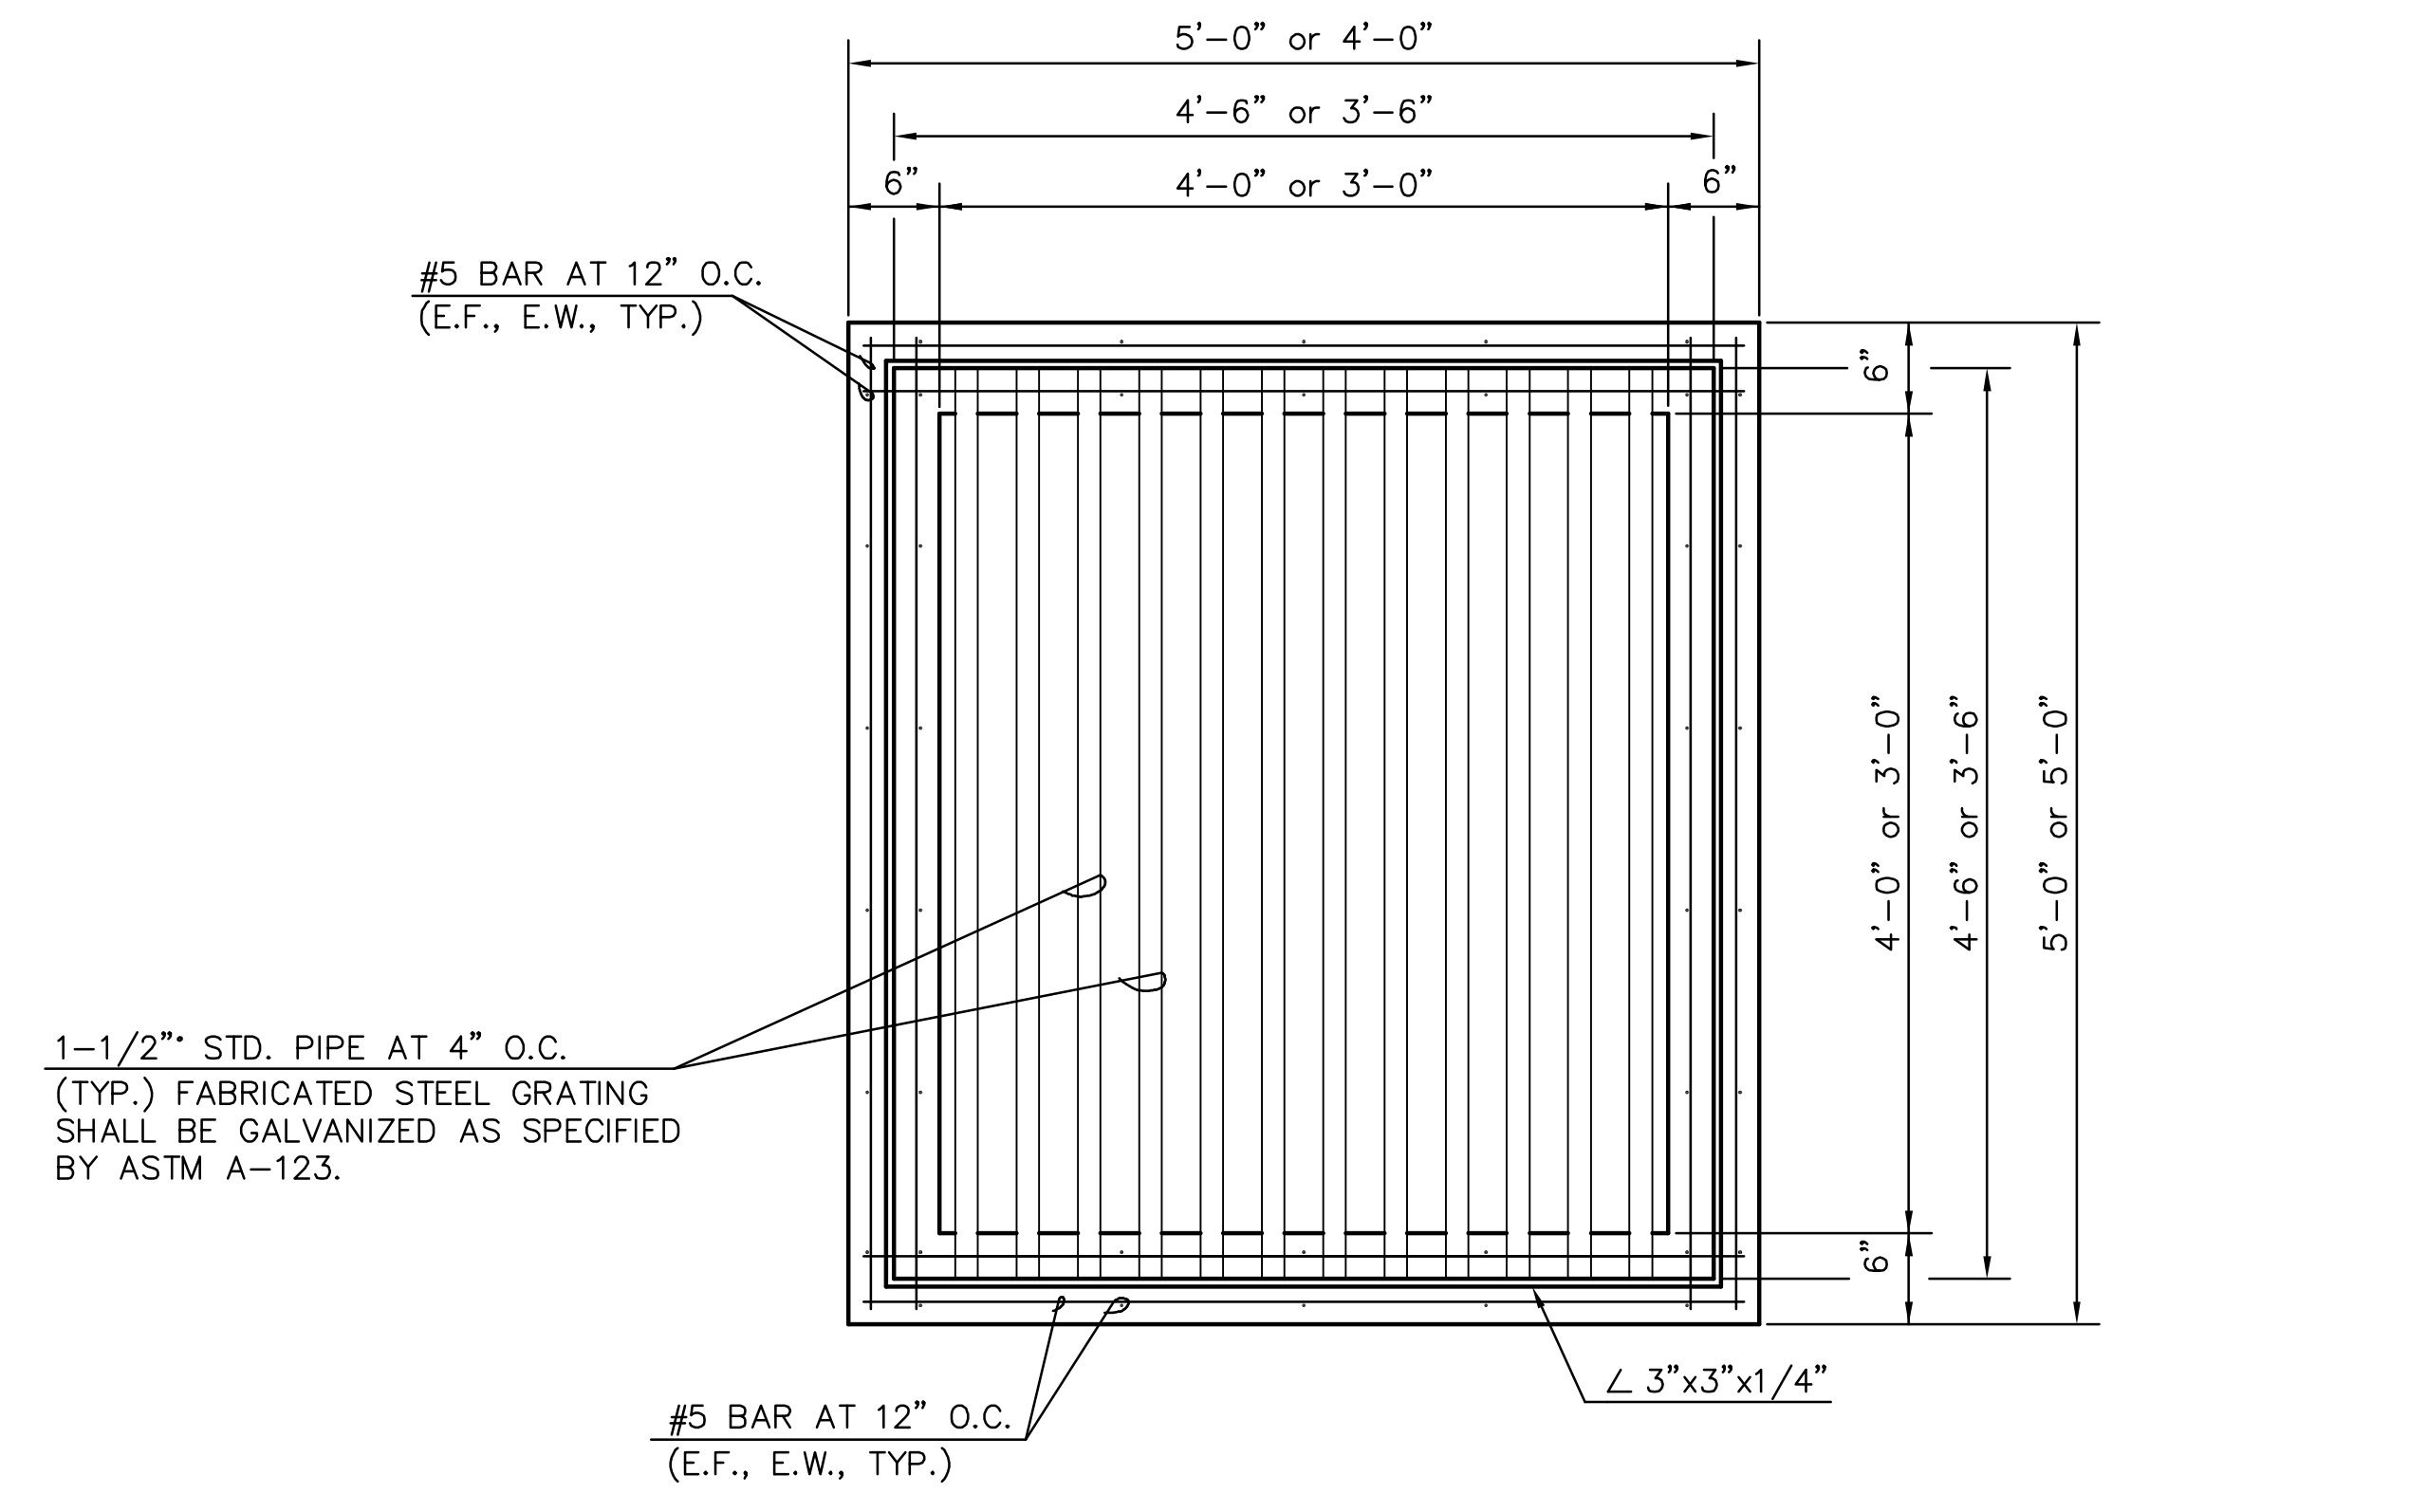


PLAN VIEW

CONTRACTOR MAY SUBSTITUTE 8" BRICK WALL FOR 6" REINFORCED CONCRETE WALL.

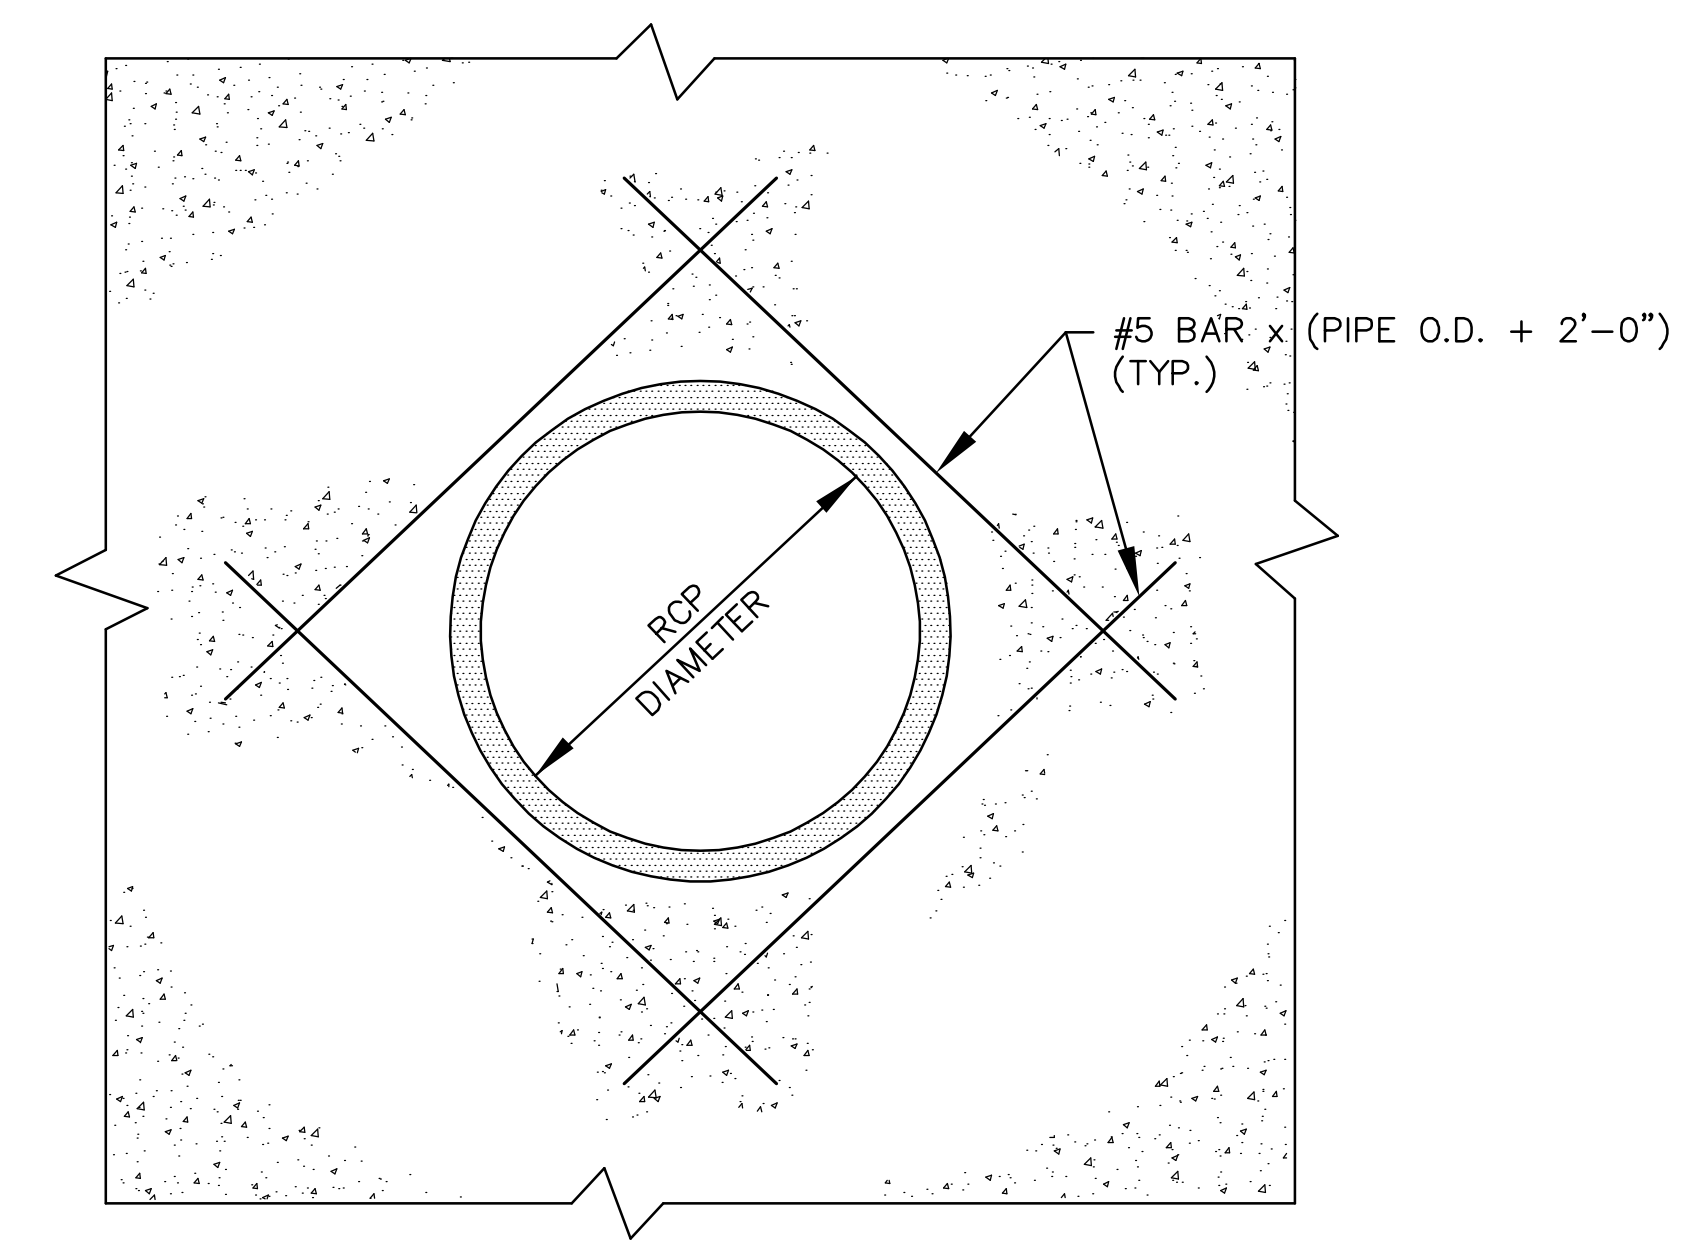


NOTE:
CUT REINFORCING AS REQUIRED TO CLEAR RCP.

TYPICAL REINFORCING AT PIPE

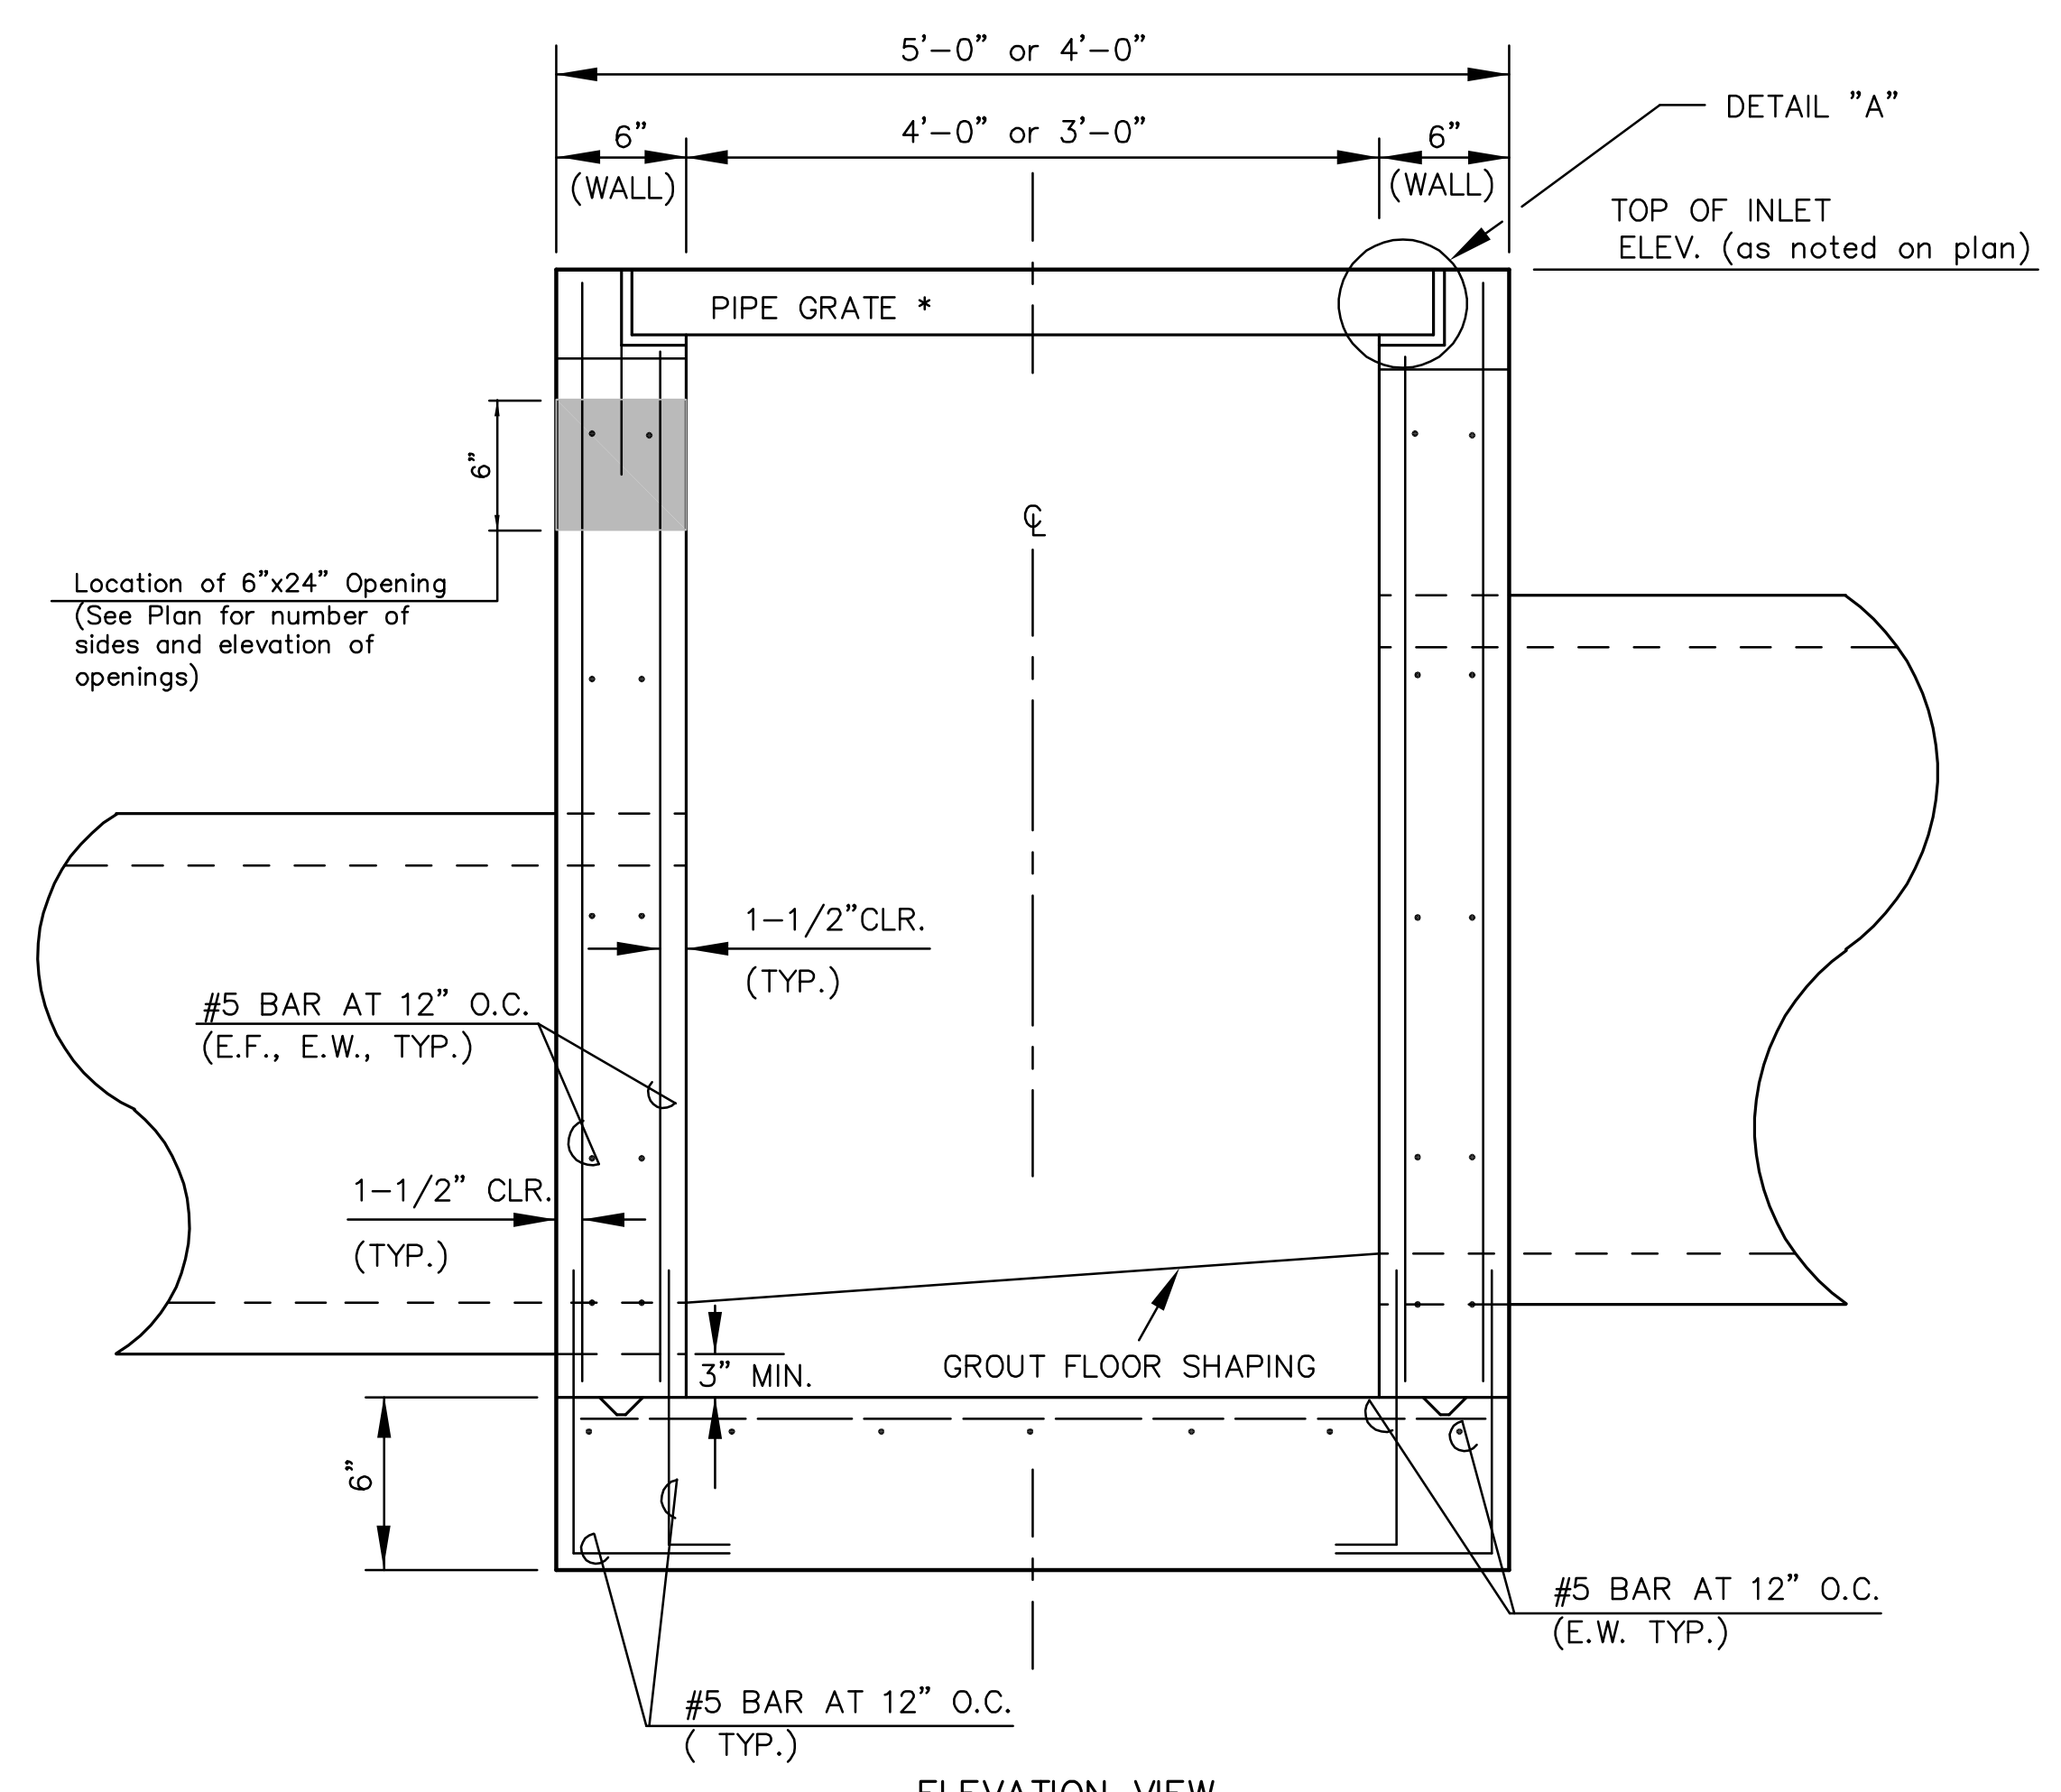

ELEVATION VIEW

- MATERIAL SPEC'S
- MORTAR - TYPE "M"
 - BRICK - ASTM C62 GRADE MW
 - STEEL - ASTM A36 OR EQUIVALENT GALV. ASTM A-123 STDS.
 - CONCRETE - $f'_c = 4,000$ PSI MINIMUM WITH 6 SACKS OF CEMENT PER CUBIC YARD MINIMUM.

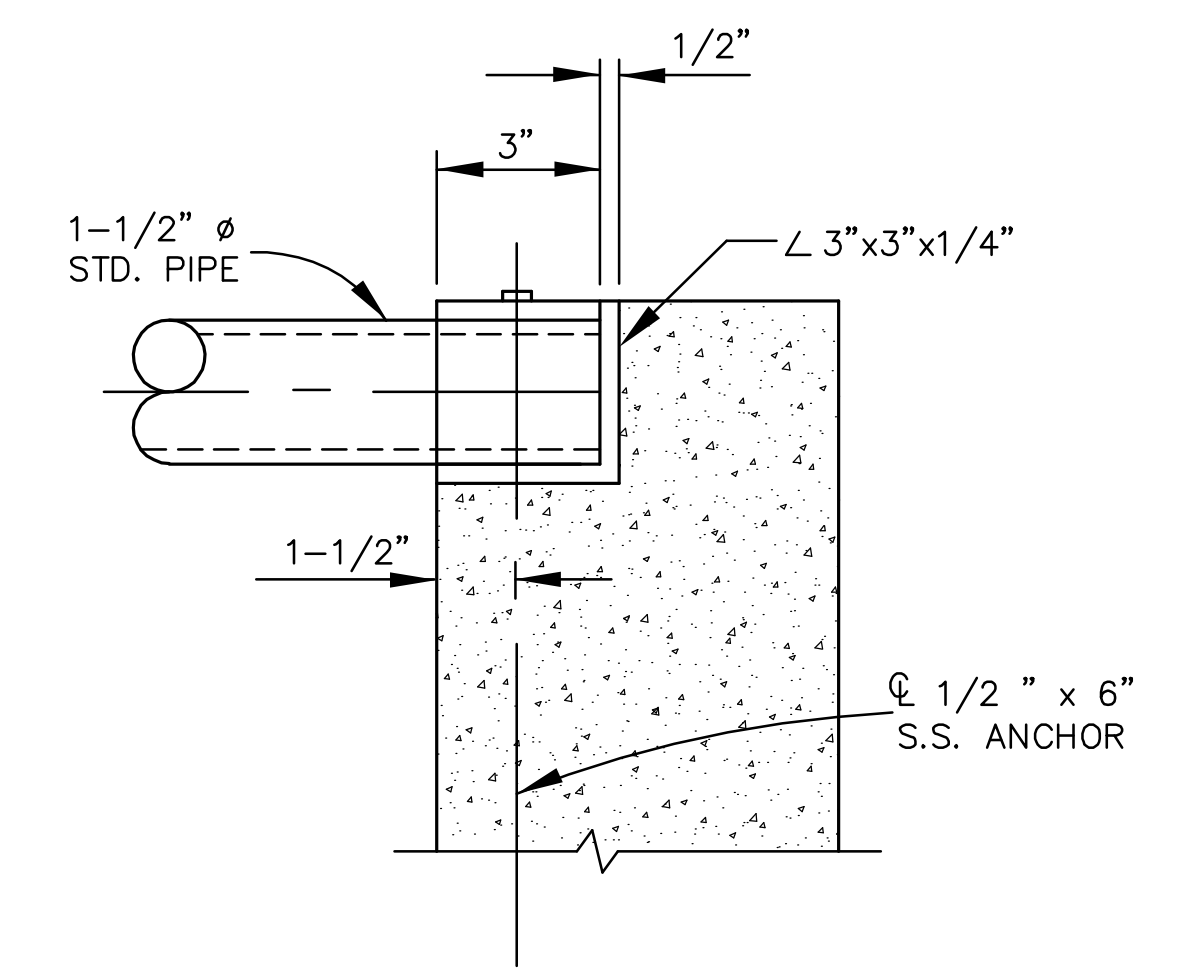

NOTE:
FABRICATED STEEL GRATING SHALL BE GALVANIZED AS SPECIFIED BY ASTM A-123.

DETAIL "A"

AREA INLET DETAILS

SHEET TITLE
468-84409
PROJECT NUMBER

DESIGN BY: SRS
DRAWN BY: MKEC
CHECKED BY: GJA

ISSUED: November 2007
REVISED:

SHEET NO.
4 of 21