


TYPICAL 31' PAVEMENT DETAILS

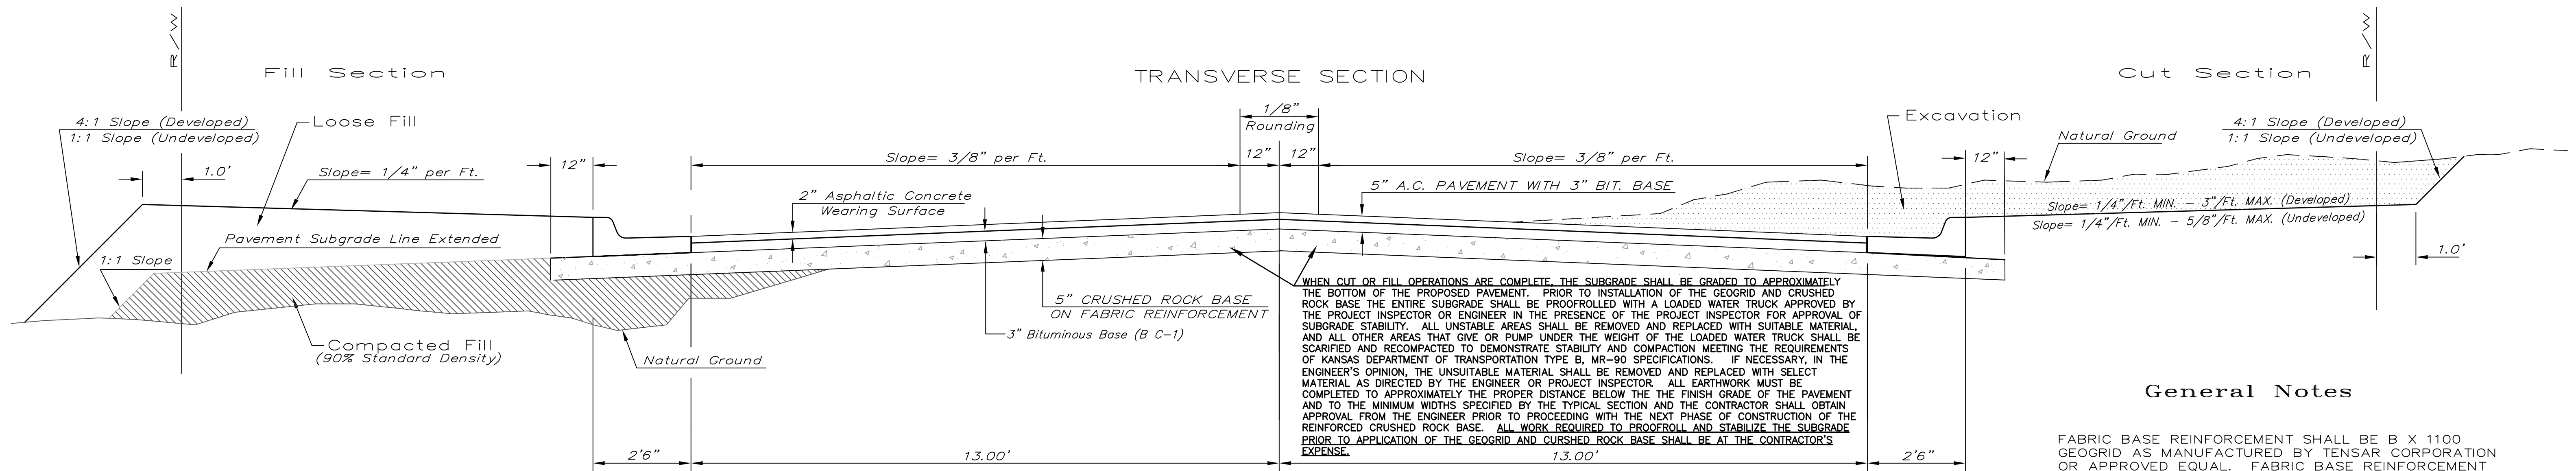

WHEN CUT OR FILL OPERATIONS ARE COMPLETE, THE SUBGRADE SHALL BE GRADED TO APPROXIMATELY THE BOTTOM OF THE PROPOSED PAVEMENT. PRIOR TO INSTALLATION OF THE GEOGRID AND CRUSHED ROCK BASE THE ENTIRE SUBGRADE SHALL BE PROOFROLLED WITH A LOADED WATER TRUCK APPROVED BY THE PROJECT INSPECTOR OR ENGINEER IN THE PRESENCE OF THE PROJECT INSPECTOR FOR APPROVAL OF SUBGRADE STABILITY. ALL UNSTABLE AREAS SHALL BE REMOVED AND REPLACED WITH SUITABLE MATERIAL, AND ALL OTHER AREAS THAT GIVE OR PUMP UNDER THE WEIGHT OF THE LOADED WATER TRUCK SHALL BE SCARIFIED AND RECOMPACTED TO DEMONSTRATE STABILITY AND COMPACTION MEETING THE REQUIREMENTS OF KANSAS DEPARTMENT OF TRANSPORTATION TYPE B, MR-90 SPECIFICATIONS. IF NECESSARY, IN THE ENGINEER'S OPINION, THE UNSUITABLE MATERIAL SHALL BE REMOVED AND REPLACED WITH SELECT MATERIAL AS DIRECTED BY THE ENGINEER OR PROJECT INSPECTOR. ALL EARTHWORK MUST BE COMPLETED TO APPROXIMATELY THE PROPER DISTANCE BELOW THE THE FINISH GRADE OF THE PAVEMENT AND TO THE MINIMUM WIDTHS SPECIFIED BY THE TYPICAL SECTION AND THE CONTRACTOR SHALL OBTAIN APPROVAL FROM THE ENGINEER PRIOR TO PROCEEDING WITH THE NEXT PHASE OF CONSTRUCTION OF THE REINFORCED CRUSHED ROCK BASE. ALL WORK REQUIRED TO PROOFROLL AND STABILIZE THE SUBGRADE PRIOR TO APPLICATION OF THE GEOGRID AND CRUSHED ROCK BASE SHALL BE AT THE CONTRACTOR'S EXPENSE.

General Notes

FABRIC BASE REINFORCEMENT SHALL BE B X 1100 GEOGRID AS MANUFACTURED BY TENSAR CORPORATION OR APPROVED EQUAL. FABRIC BASE REINFORCEMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS. CRUSHED ROCK SHALL BE UNIFORMLY GRADED FROM 1-1/2' MAXIMUM SIZE TO NOT MORE THAN 10% PASSING A NO. 200 SIEVE. ROCK QUALITY SHALL BE THE SAME AS SPECIFIED FOR COARSE AGGREGATE FOR CONCRETE MIXES.


ROCK BASE IS TO BE COMPACTED AND SMOOTHED WITH A STEEL FACED ROLLER PRIOR TO PLACEMENT OF ASPHALT. TACK COAT WILL NOT BE APPLIED TO ROCK BASE.

A TACK COAT OF EMULSIFIED ASPHALT (SC-1H OR CSS-1H) SHALL BE APPLIED AT AN APPROXIMATE RATE OF 0.05 GALLONS PER SQUARE YARD BETWEEN EACH LIFT OF ASPHALTIC MATERIAL.


BITUMINOUS BASE AND ASPHALTIC CONCRETE WEARING SURFACE SHALL BE PLACED WITH A LAYDOWN MACHINE HAVING AUTOMATIC CONTROLS FOR LINE AND GRADE.

CONSTRUCTION JOINTS IN EACH LIFT SHALL BE STAGGERED A MINIMUM DISTANCE OF ONE (1) FOOT FROM JOINTS IN PRECEDING LIFTS AND PLACED SO THAT A JOINT WILL BE CONSTRUCTED ON THE CENTERLINE OF THE TOP LIFT.


THE ASPHALTIC CONCRETE PAVEMENT BETWEEN THE COMBINED CURB AND GUTTER SHALL BE PAID AS SQUARE YARDS OF 5" ASPHALTIC CONCRETE (3" BITUMINOUS BASE).

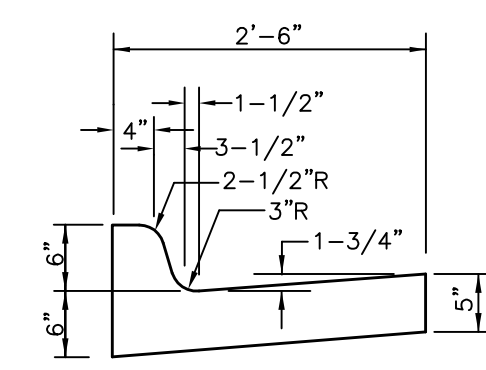


MODIFIED TYPE I COMBINED CURB & GUTTER

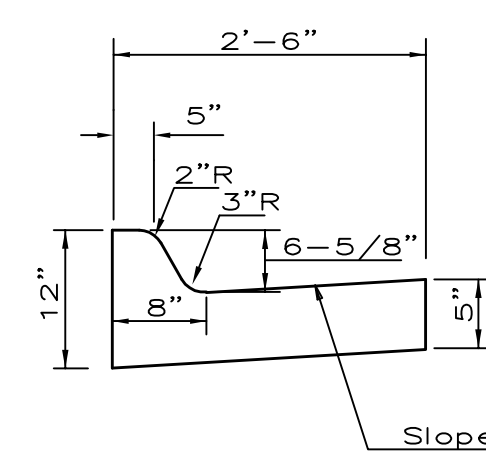

COMBINED CURB & GUTTER

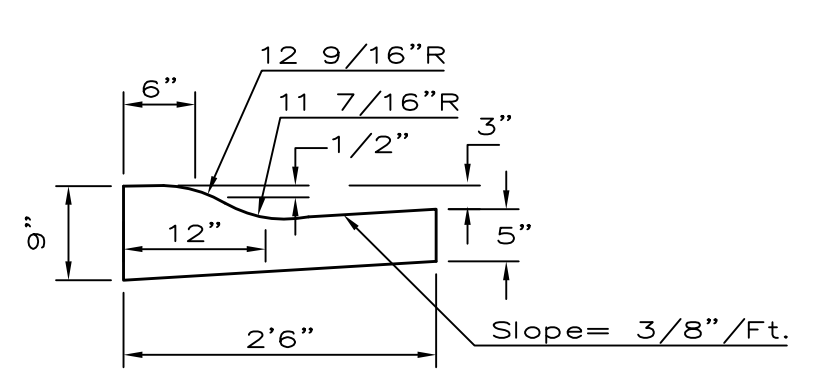

COMBINED ROLL TYPE CURB & GUTTER

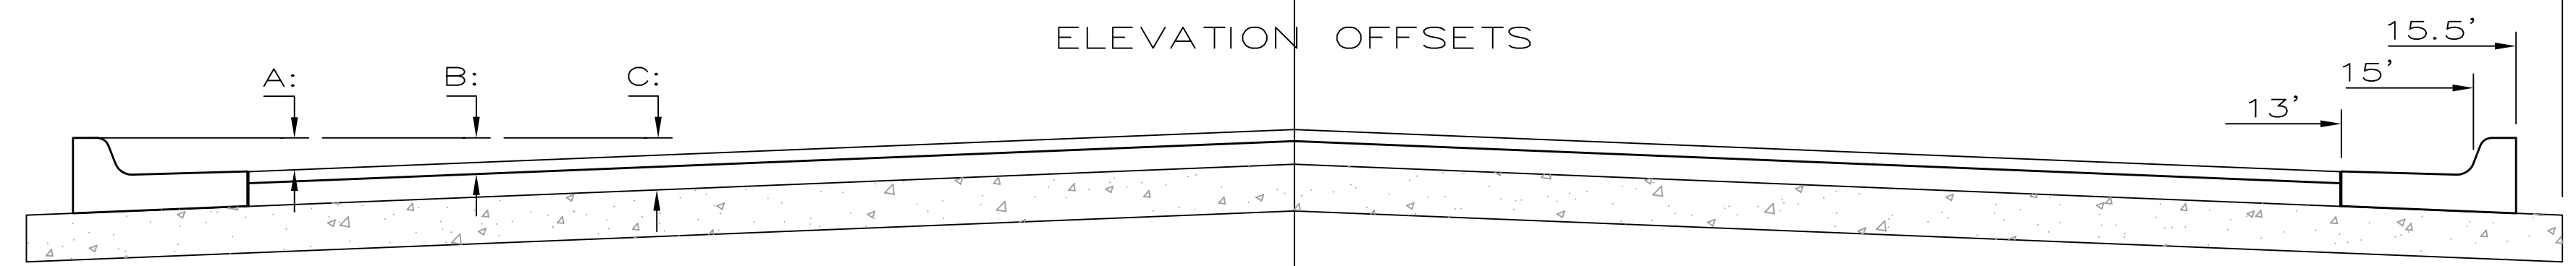


	DISTANCE FROM CENTERLINE (L.T. & RT.)										
	0'	2'	4'	6'	7.5'	10'	12'	13'	15'	15.5'	16.5'
A: Top of Curbs to Top of Surface Lift	0.10	0.14	0.21	0.27	0.32	0.39	0.46	0.49	-	-	-
B: Top of Curbs to Top of Upper Base Lift	0.27	0.31	0.37	0.44	0.48	0.56	0.62	0.65	-	-	-
C: Top of Curbs to Top of C.R. Subgrade	0.52	0.56	0.62	0.69	0.73	0.81	0.87	0.90	0.97	0.98	1.01

CRUSHED ROCK GRADATION REQUIREMENTS

Percent of Aggregate Retained


1 1/2"	0
3/4"	15-60
# 4	40-80
#40	74-92
#200	88-96

Rock Quality Shall Be The Same As Specified For Coarse Aggregate For Asphalt Concrete Mixes.

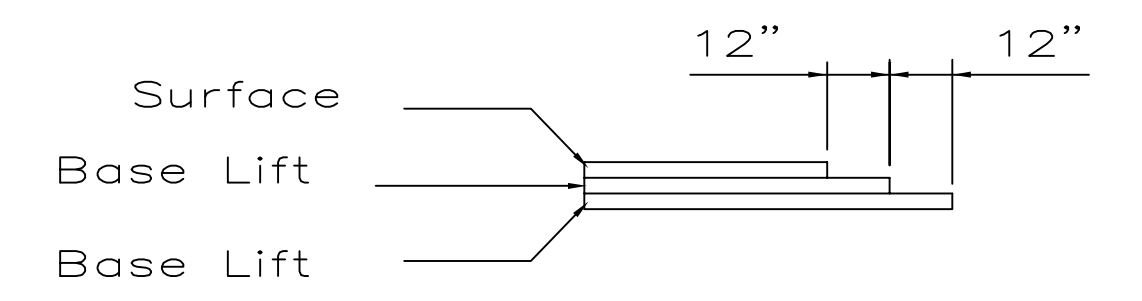

TRANSVERSE CONSTRUCTION JOINTS

Transverse construction joints shall be constructed in flexible base pavements at locations where pavement joints existing flexible base pavement as shown by the detail. All costs associated with the construction of the transverse joint shall be included in the bid price for Square Yards 5" ASPHALTIC CONCRETE (3" BITUMINOUS BASE).

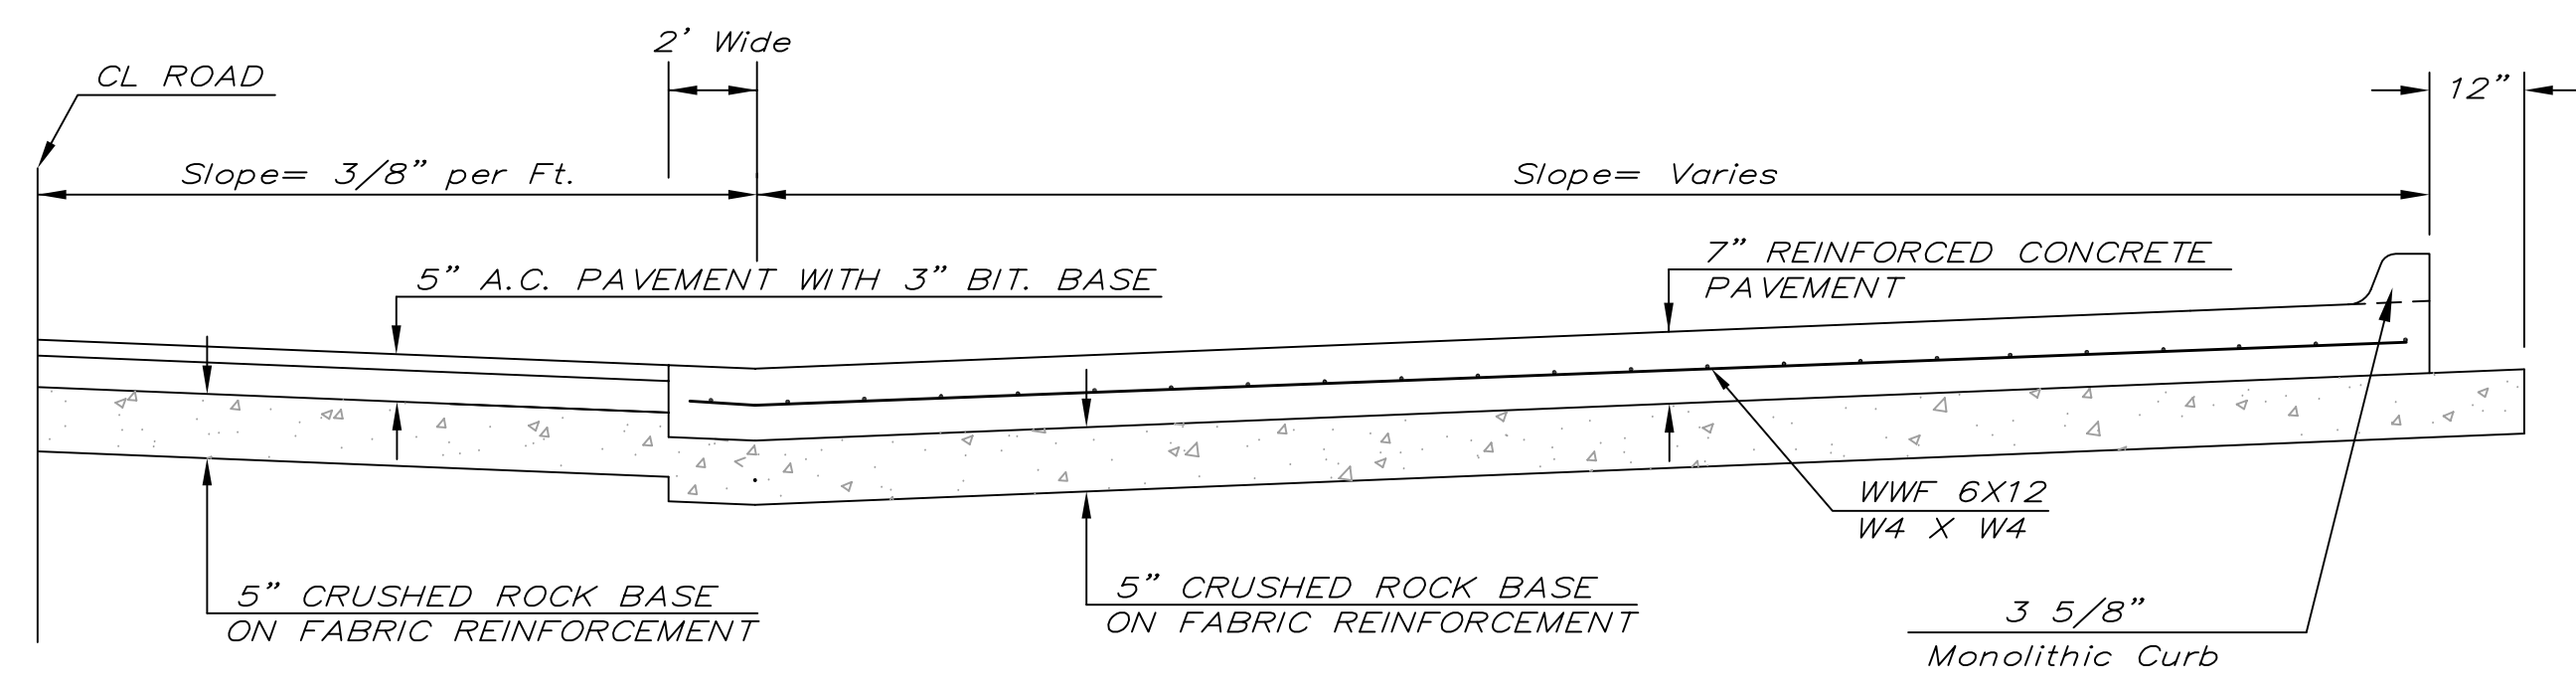

HAMMERHEAD WING

THE CITY OF WICHITA

CITY ENGINEER'S OFFICE
CITY HALL - SEVENTH FLOOR
455 NORTH MAIN STREET
WICHITA, KANSAS 67202
(316) 268-4501
(316) 268-4114 FAX

5 INCH RESIDENTIAL ASPHALTIC CONCRETE PAVEMENT WITH 3 INCH BITUMINOUS BASE

JIM ARMOUR P.E. - CITY ENGINEER

PROJECT NUMBER	INDEX CODE
472 84603	766174
DATE	SHEET 3 OF 12
03-06	