
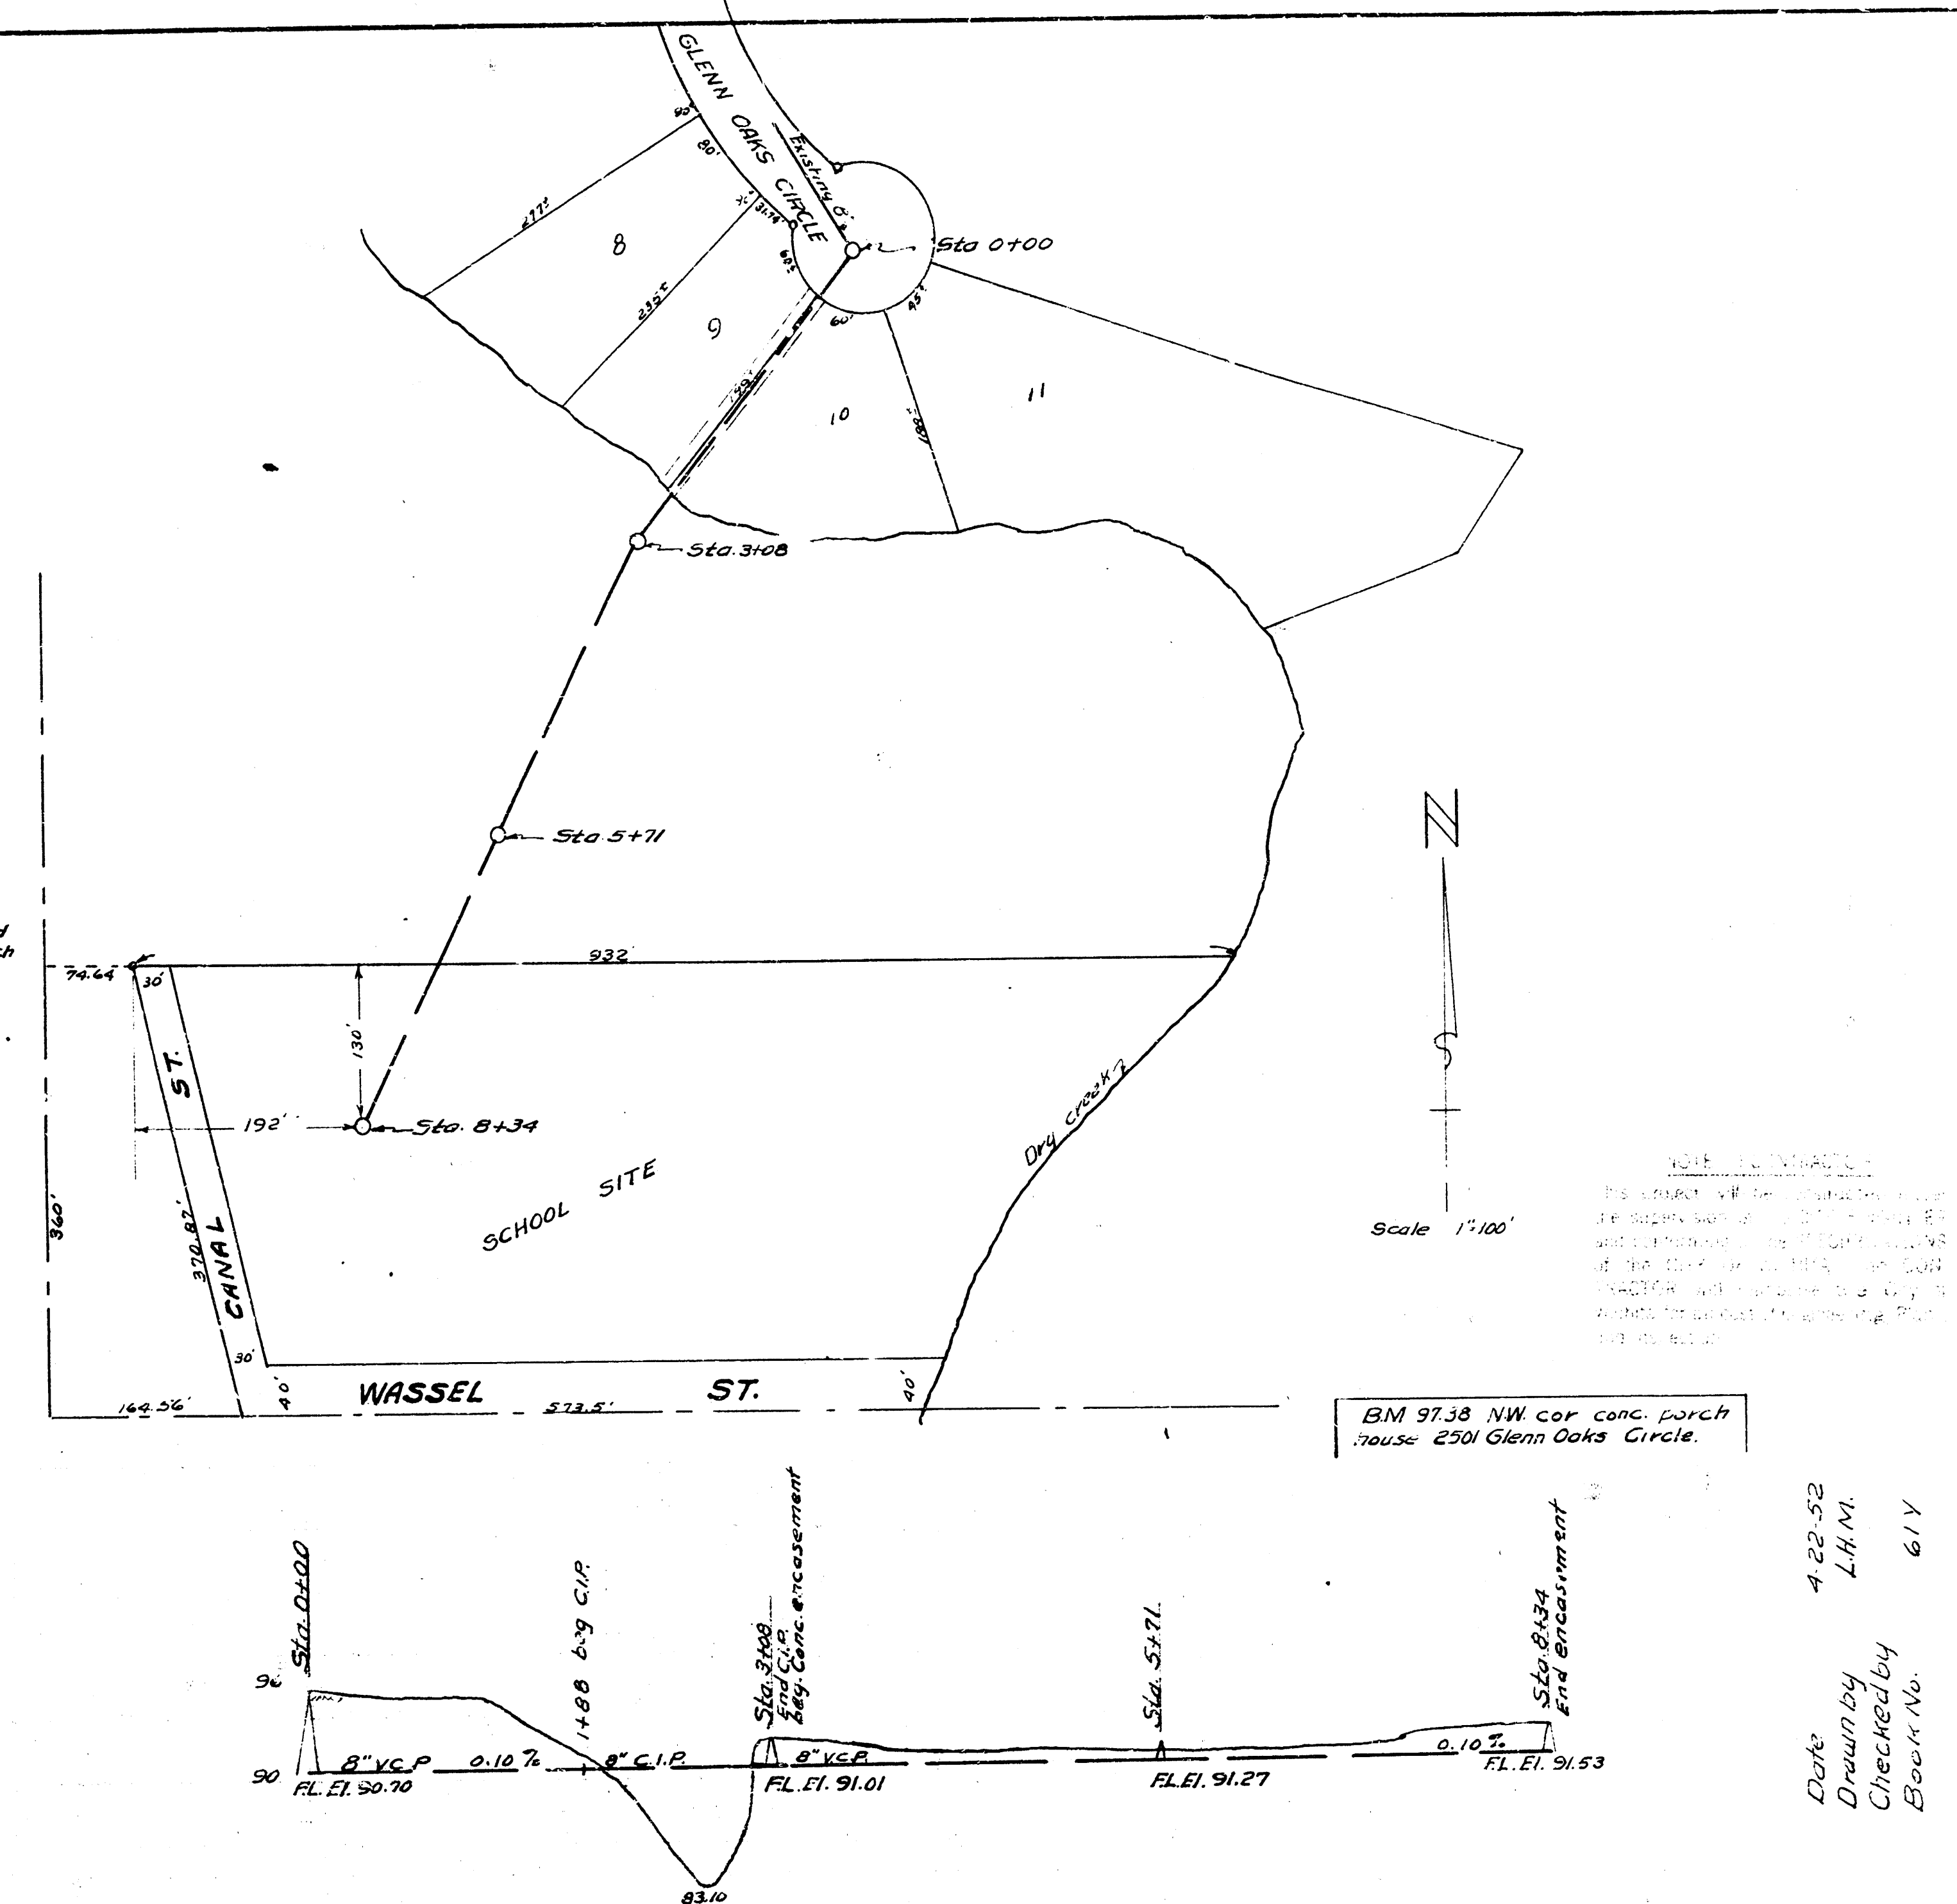


All pipe with less than 36" of cover shall be encased in 6" above pipe pipe.
Sta 1+00 to Sta 3+00 shall be 8" C.I.P. all other 8" V.C.P.
If suitable bearing cannot be obtained under pipe support use two 6" piling under each footing

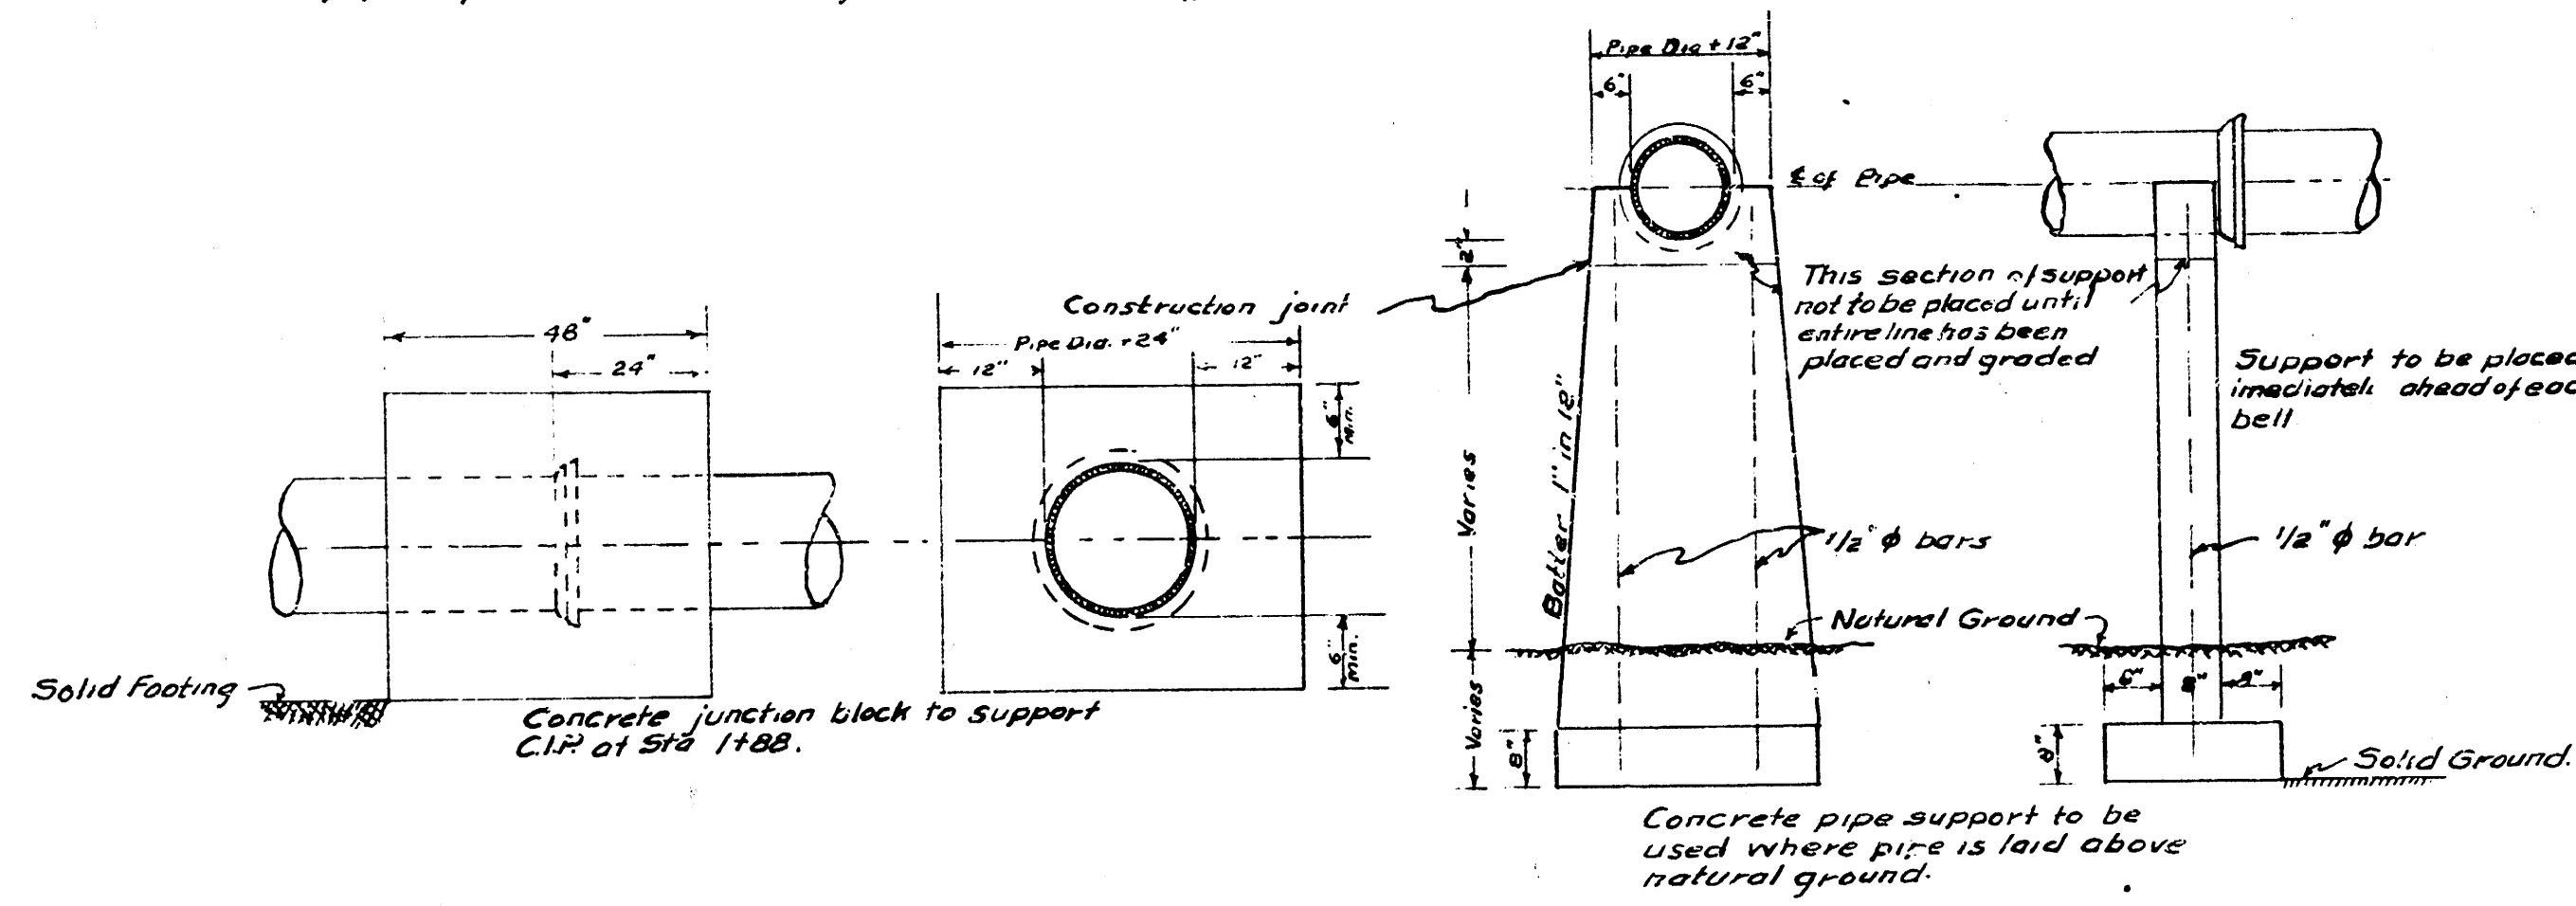

SOWER'S SCHOOL SS
CITY OF WICHITA KANSAS
L.H. WHITE CITY ENGINEER
Private Proj

Date: 4-22-52
Drawn by: L.H.W.
Checked by: B.W.N.
Book No: 61Y