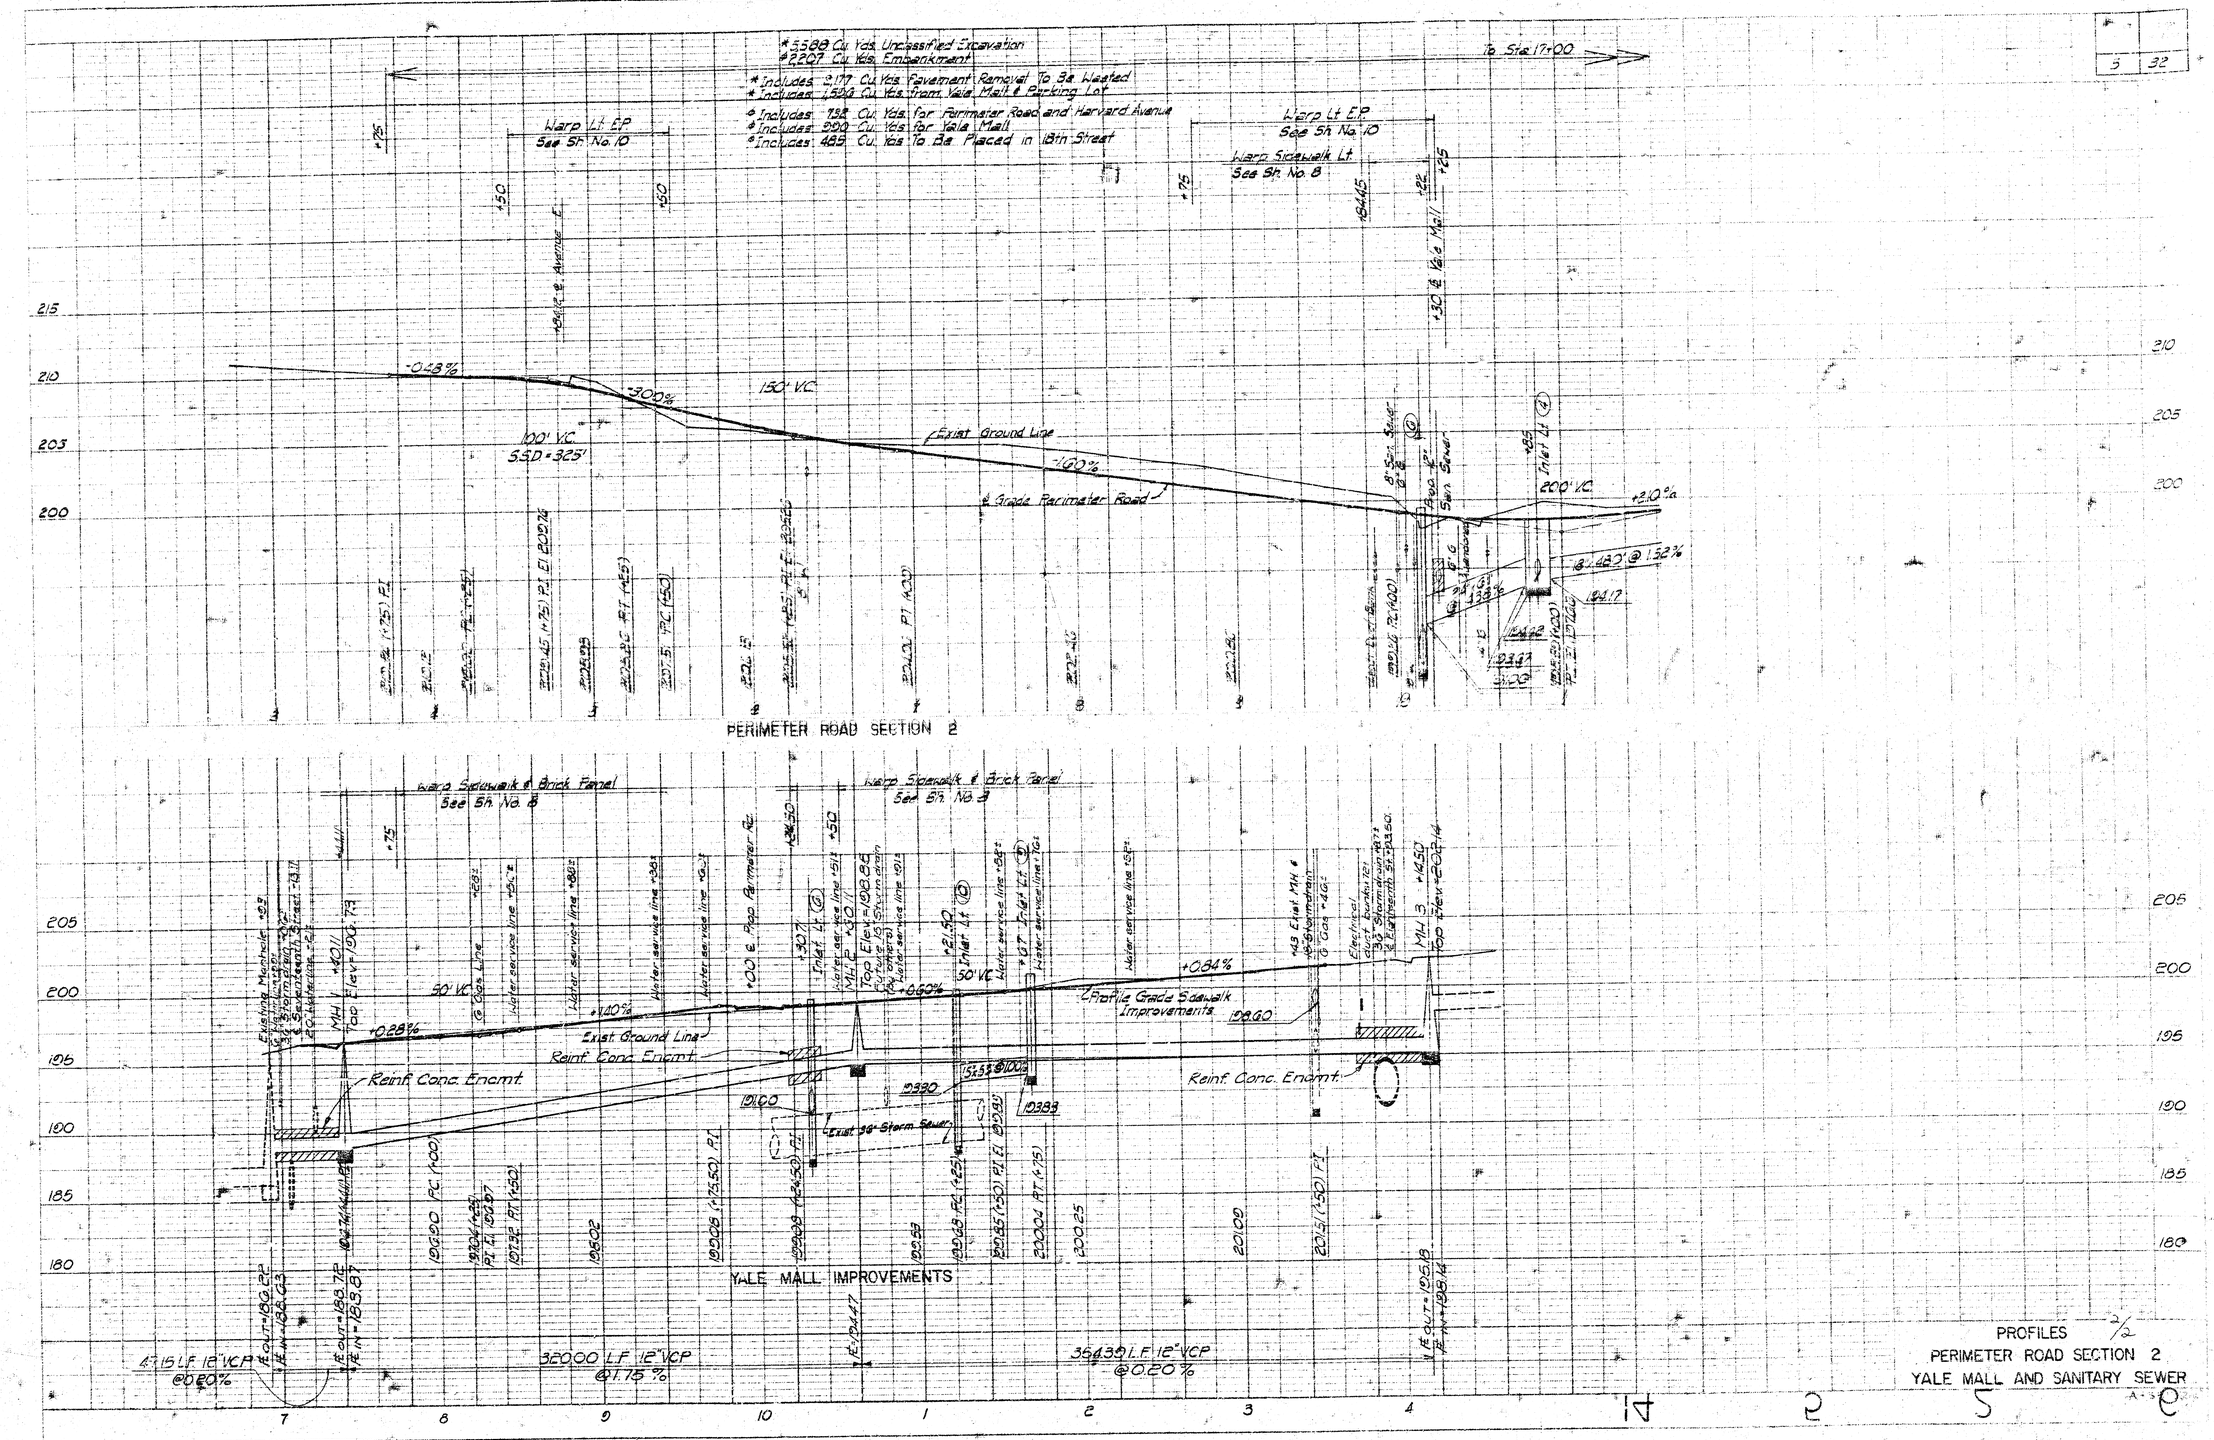

PROFILES 2/2
PERIMETER ROAD SECTION 2
YALE MALL AND SANITARY SEWER

SHEET NO.	TOTAL SHEETS
3	32

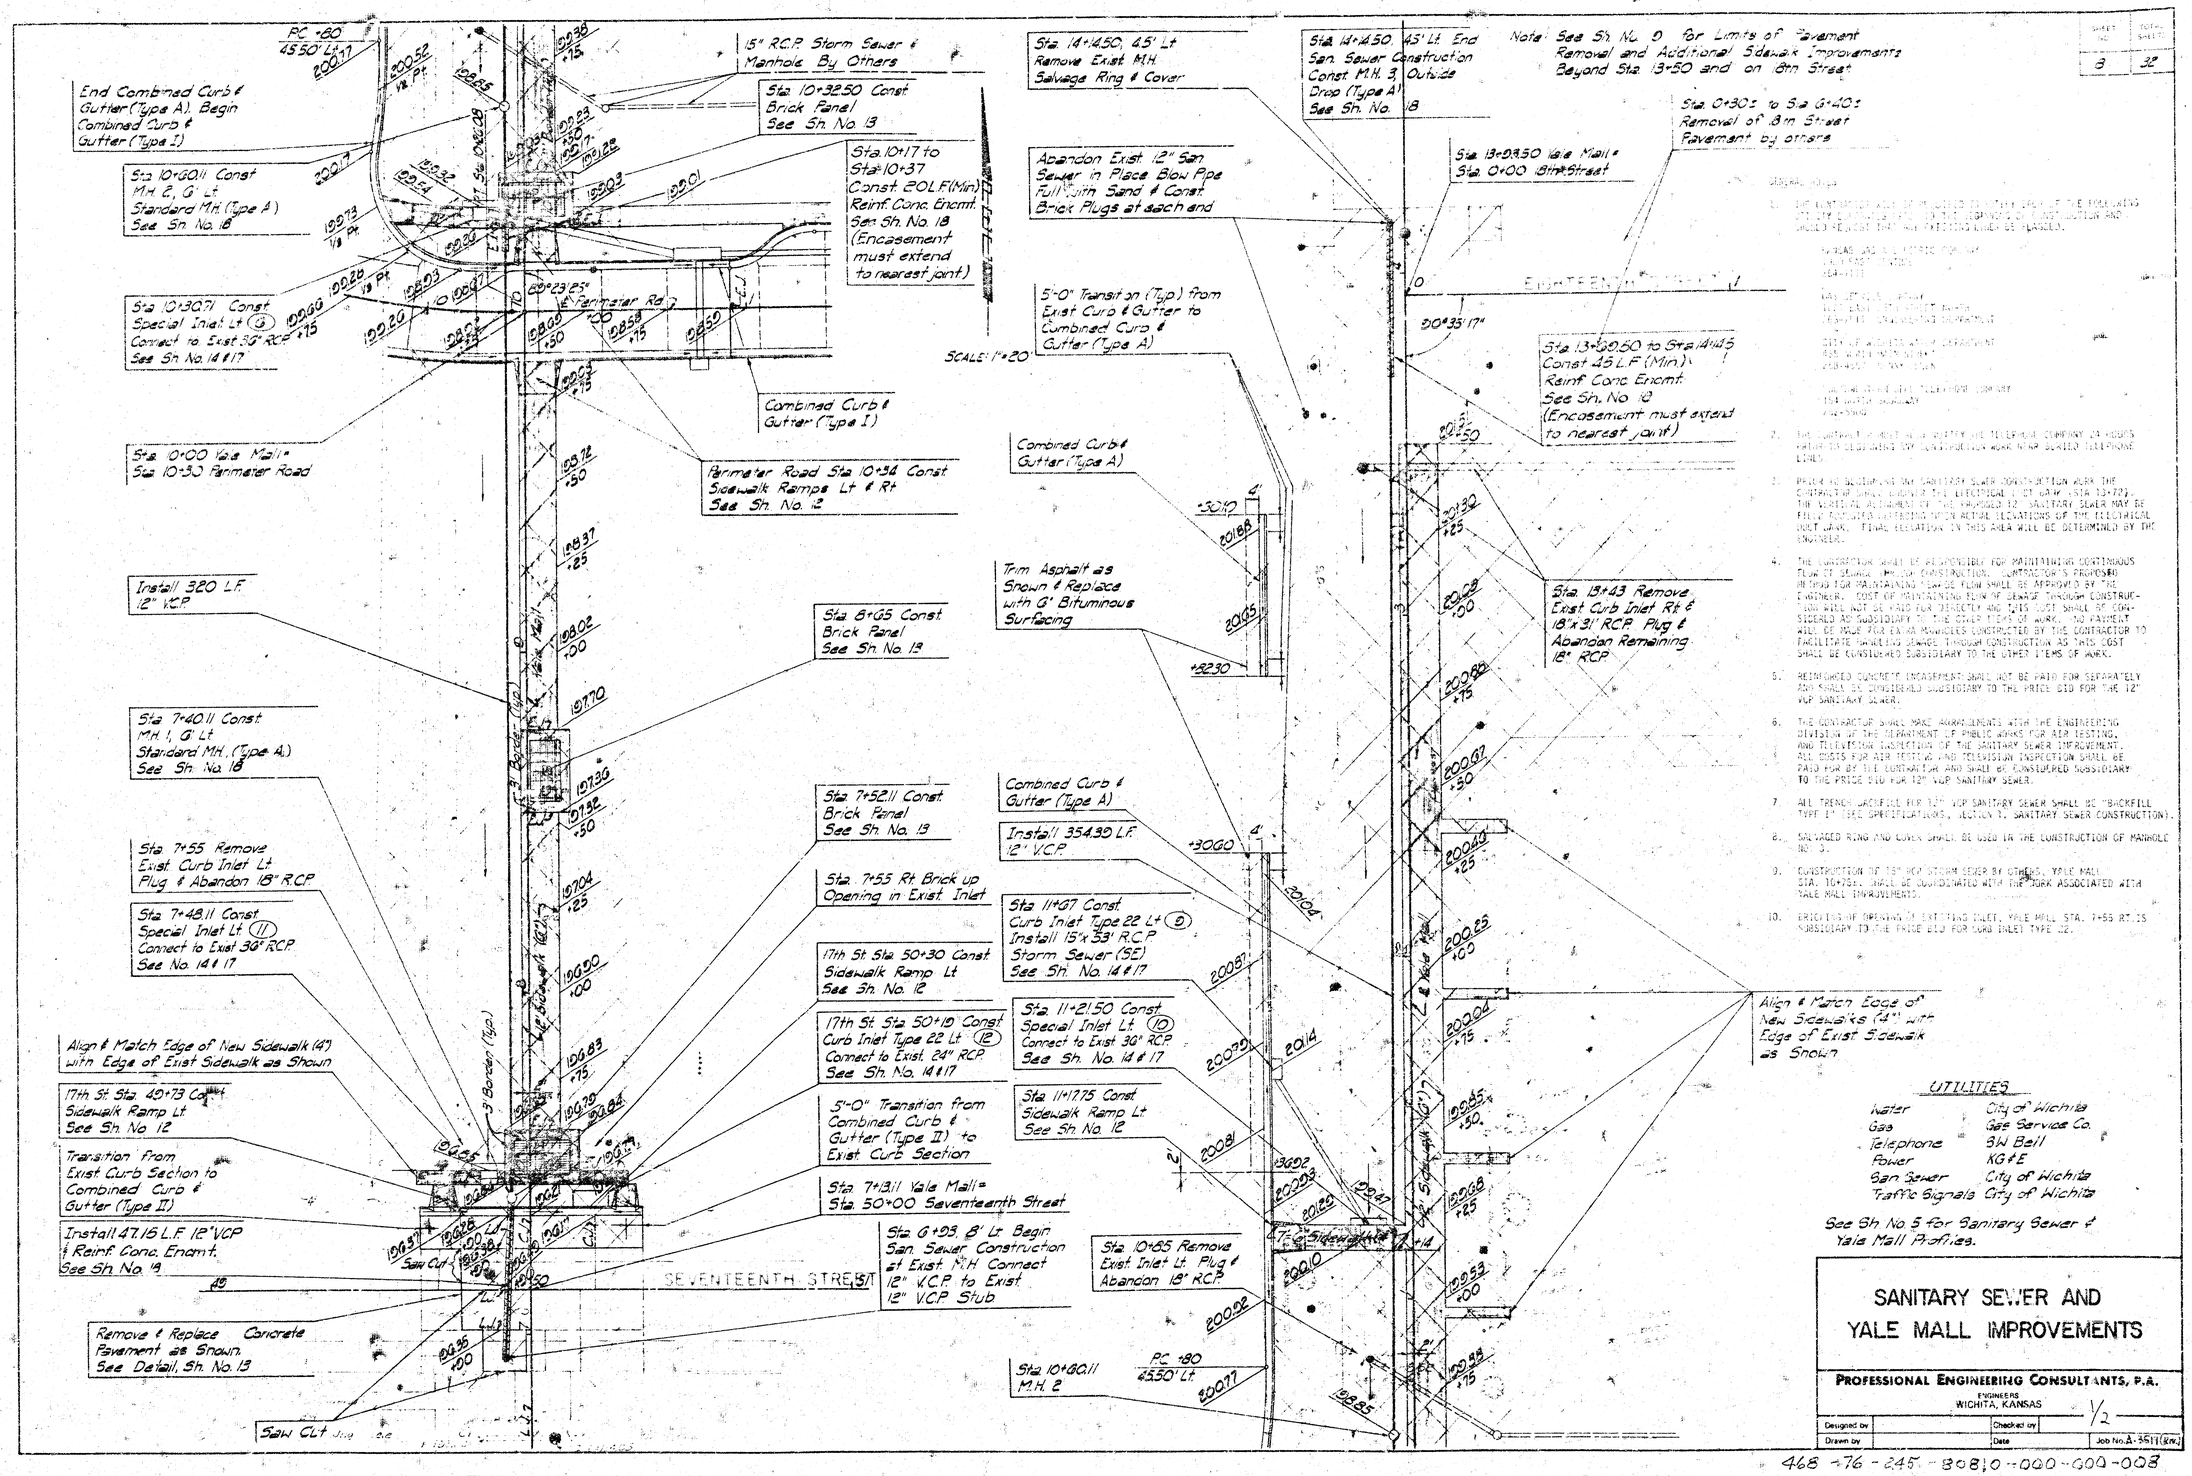

GENERAL NOTES

1. THE CONTRACTOR SHALL CONTACT THE FOLLOWING UTILITY COMPANIES AT LEAST 48 HOURS PRIOR TO BEGINNING ANY CONSTRUCTION WORK NEAR SUCH UTILITIES LINES:

   WATER AND SANITARY SEWER
   CITY OF WICHITA
   264-4111

   GAS SERVICE LINES
   GAS SERVICE COMPANY
   264-7123

   TRAFFIC SIGNAL LINES
   CITY OF WICHITA, TRAFFIC ENGINEER
   264-1993

   ELECTRICAL POWER LINES
   KANSAS GAS & ELECTRIC COMPANY
   264-6511

   TELEPHONE LINES
   SOUTHWESTERN BELL TELEPHONE COMPANY
   264-9500

2. THE CONTRACTOR MUST ALSO NOTIFY THE TELEPHONE COMPANY 24 HOURS PRIOR TO BEGINNING ANY CONSTRUCTION WORK NEAR BURIED TELEPHONE LINES.

3. PRIOR TO BEGINNING THE SANITARY SEWER CONSTRUCTION WORK THE CONTRACTOR SHALL VERIFY THE ELECTRICAL LIGHT BANK (STA 13+72). THE VERTICAL ALIGNMENT OF THE PROPOSED 12" SANITARY SEWER MAY BE FIELD ADJUSTED DEPENDING UPON ACTUAL ELEVATIONS OF THE ELECTRICAL LIGHT BANK. FINAL ELEVATION IN THIS AREA WILL BE DETERMINED BY THE ENGINEER.

4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR MAINTAINING CONTINUOUS FLOW OF SEWAGE THROUGH CONSTRUCTION. CONTRACTOR'S PROPOSED METHOD FOR MAINTAINING SEWAGE FLOW SHALL BE APPROVED BY THE ENGINEER. COST OF MAINTAINING FLOW OF SEWAGE THROUGH CONSTRUCTION WILL NOT BE PAID FOR SEPARATELY AND THIS COST SHALL BE CONSIDERED AS SUBSIDIARY TO THE OTHER ITEMS OF WORK. NO PAYMENT WILL BE MADE FOR EXTRA MANHOLES CONSTRUCTED BY THE CONTRACTOR TO FACILITATE HANDLING SEWAGE THROUGH CONSTRUCTION AS THIS COST SHALL BE CONSIDERED SUBSIDIARY TO THE OTHER ITEMS OF WORK.

5. REINFORCED CONCRETE ENCASEMENT SHALL NOT BE PAID FOR SEPARATELY AND SHALL BE CONSIDERED SUBSIDIARY TO THE PRICE BID FOR THE 12" VCP SANITARY SEWER.

6. THE CONTRACTOR SHALL MAKE ARRANGEMENTS WITH THE ENGINEERING DIVISION OF THE DEPARTMENT OF PUBLIC WORKS FOR AIR TESTING AND TELEVISION INSPECTION OF THE SANITARY SEWER IMPROVEMENT. ALL COSTS FOR AIR TESTING AND TELEVISION INSPECTION SHALL BE PAID FOR BY THE CONTRACTOR AND SHALL BE CONSIDERED SUBSIDIARY TO THE PRICE BID FOR 12" VCP SANITARY SEWER.

7. ALL TRENCH BACKFILL FOR 12" VCP SANITARY SEWER SHALL BE "BACKFILL TYPE I" (SEE SPECIFICATIONS, SECTION 3, SANITARY SEWER CONSTRUCTION).

8. SALVAGED RING AND COVER SHALL BE USED IN THE CONSTRUCTION OF MANHOLE NO. 3.

9. CONSTRUCTION OF 15" RCP STORM SEWER BY OTHERS, YALE MALL STA. 10+75±, SHALL BE COORDINATED WITH THE WORK ASSOCIATED WITH YALE MALL IMPROVEMENTS.

10. REMOVAL OF OPENING OF EXISTING INLET, YALE MALL STA. 7+55 RT. IS SUBSIDIARY TO THE PRICE BID FOR CURB INLET TYPE 22.

UTILITIES

Water	City of Wichita
Gas	Gas Service Co.
Telephone	SW Bell
Power	KG&E
San Sewer	City of Wichita
Traffic Signals	City of Wichita

See Sh. No. 5 for Sanitary Sewer & Yale Mall Profiles.

SANITARY SEWER AND YALE MALL IMPROVEMENTS

PROFESSIONAL ENGINEERING CONSULTANTS, P.A.
ENGINEERS
WICHITA, KANSAS

Designed by		Checked by	1/2
Drawn by		Date	Job No. A-3511 (K.W.)

468-76-245-80810-000-000-008