NOTE:
Where San. Sewer crosses walk Contractor shall remove & replace walk to nearest joint both sides of ditch. All pavt removed shall be sawed. All saw joint shall be included in price bid of S.Y. Pavt Rem & Rep. Alley Return shall be replaced with 6 sk Rock Mix. Asphalt Surface shall be trimmed 1'H beyond base repair by sawing both sides prior to replacement.

B.M. 200.70 R.R. Spk. W. side R.P. No. 602. 13TH & WOODLAWN

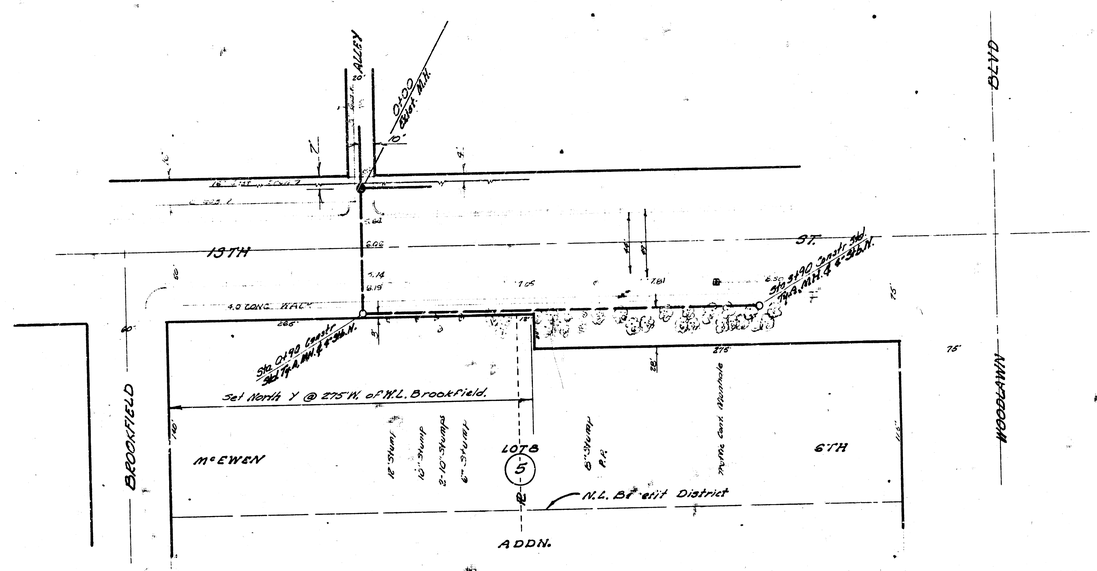

NOTE: FIELD ENGR. & CONTRACTOR: Remove only those trees that are necessary for construction of sanitary sewer on public R.O.W.

Tops of Manholes Sta. 0+90 & 3+90 to match existing walk grade.

Field Engr to check condition of walk prior to & after construction. Any walk damaged during construction shall be replaced by Contractor @ no expense to the City.

PLAN SCALE 1" = 40'
PROFILE SCALE 1" = 40' H.
1" = 4' V.

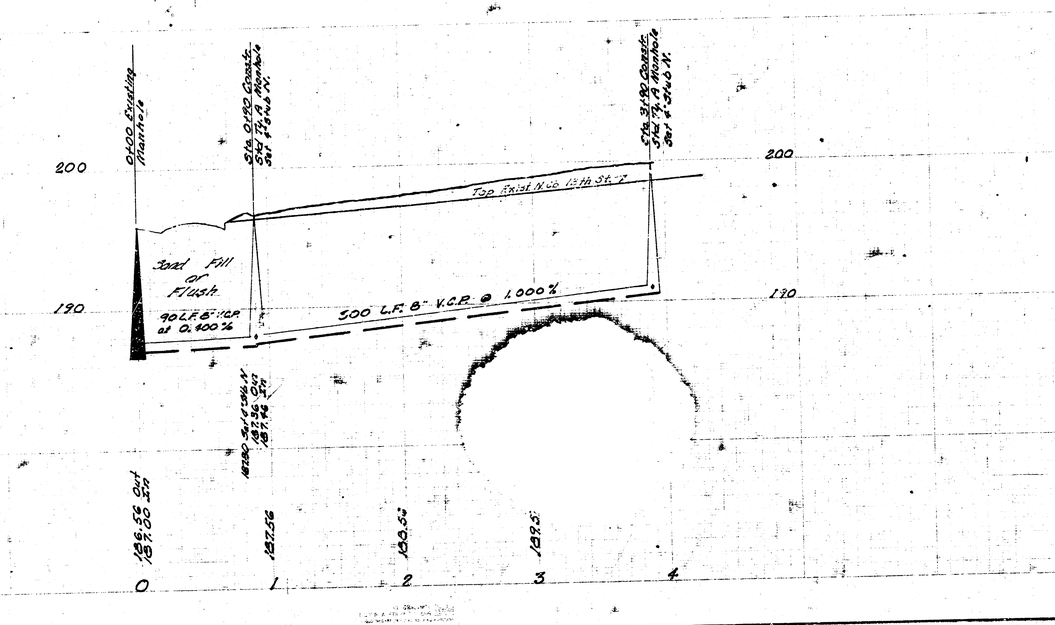

LAT. 14, SUB. 12, W.I.S.
City Of Wichita, Kansas
E. SMITH City Engineer
Date July 1968 Proj. No. C28-12

DEAN S. SELLERS
3983
KANSAS
REGISTERED PROFESSIONAL ENGINEER

REGISTERED
E. SMITH
KANSAS
PROFESSIONAL ENGINEER

3 2 1 (8)