




WL Sta. 00+00.00 Line 1
 BL Sta. 15+40.23 36.46 Rt
 *1- 12"x6" Tapping Sleeve
 *1- 6" Tapping Valve
 *1- 6" Valve Box
 Valve Box Elev. = 0000.00
 * To be Installed by COW
 * To be Paid by Contractor

CAUTION !!!!
 Exist Gas
 Field Verify
 Depth & Size

WL Sta. 01+05.00 Line 1
 BL Sta. 15+40.10 141.46 Rt
 1- 6" 90° MJ Bend
 Rotate 2° Left

WL Sta. 01+94.00 Line 1
 BL Sta. 14+51.13 143.82 Rt
 1- 6" 90° MJ Bend

WL Sta. 01+97.22 Line 1
 BL Sta. 14+51.22 147.04 Rt
 Backflow in Building

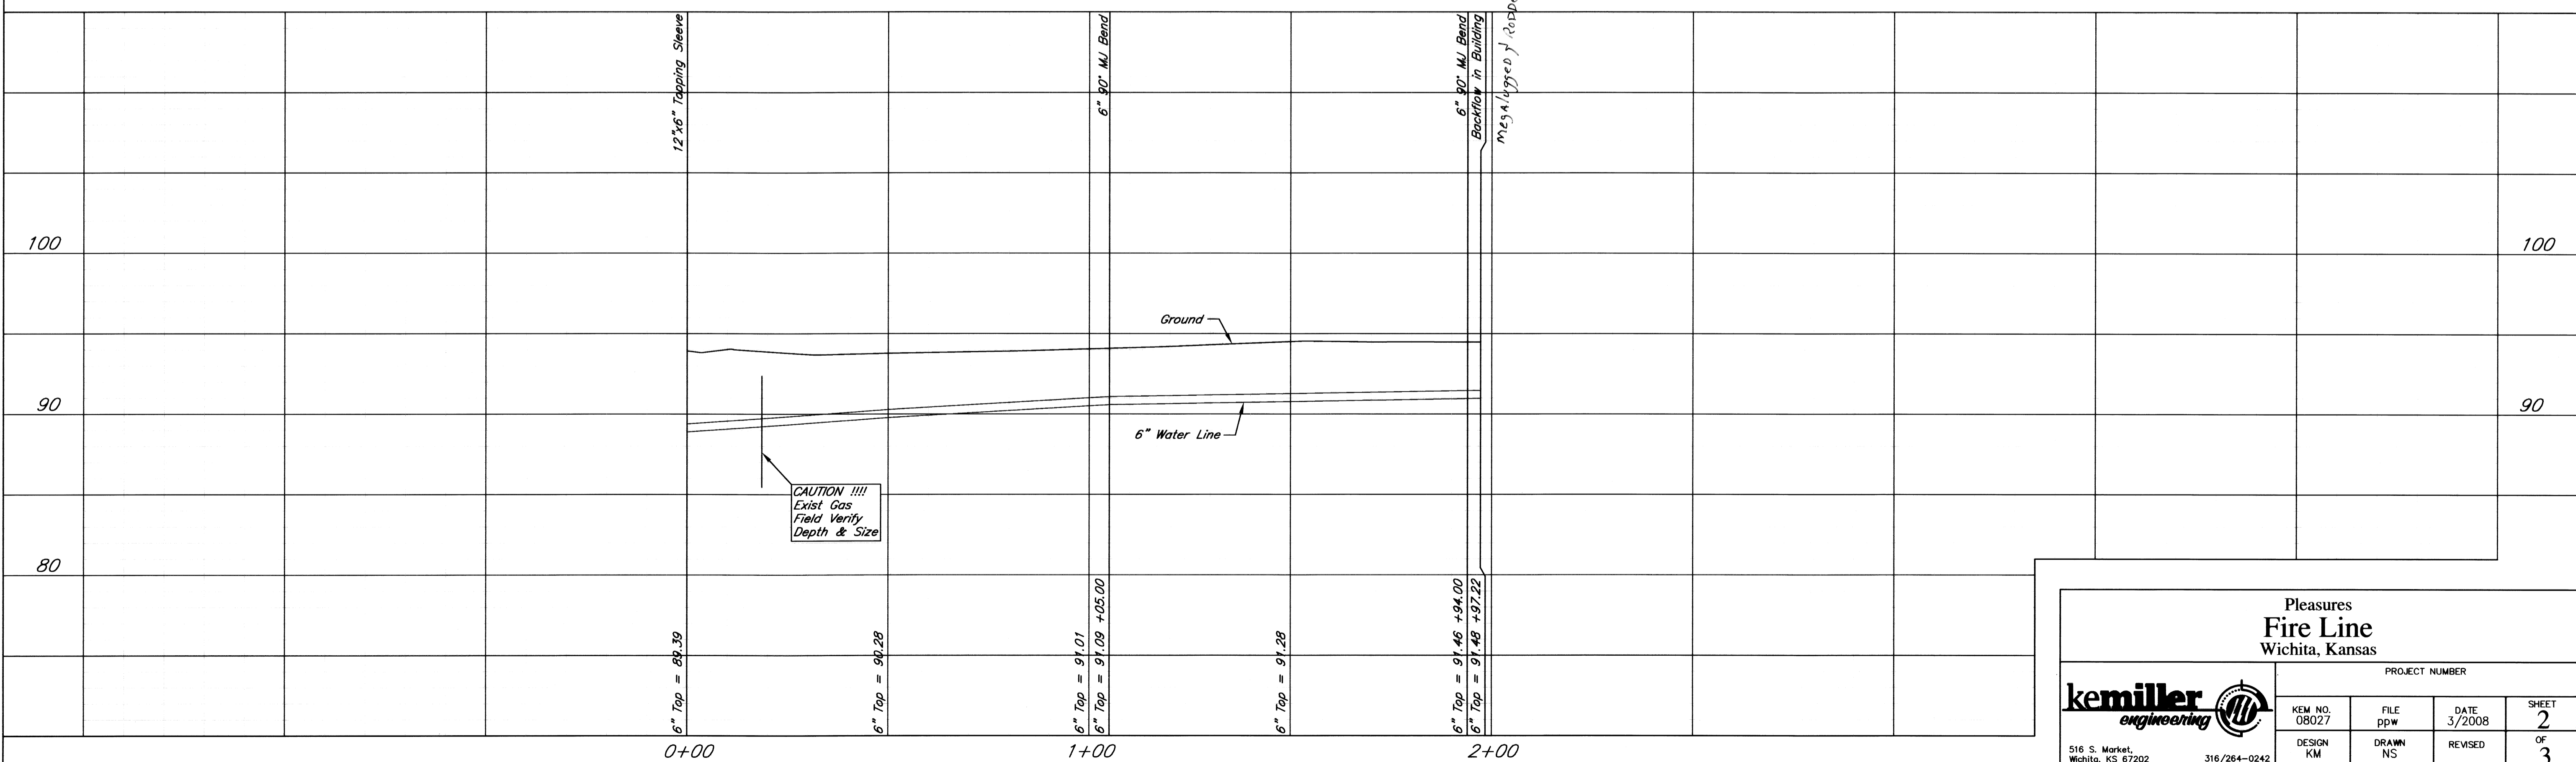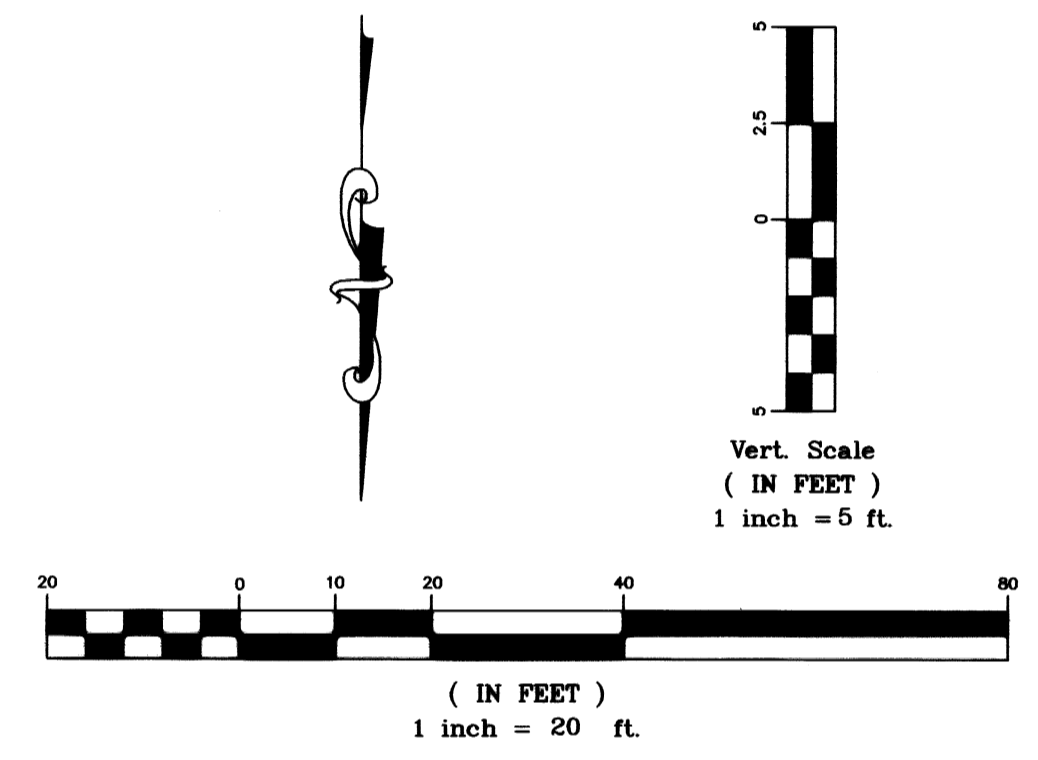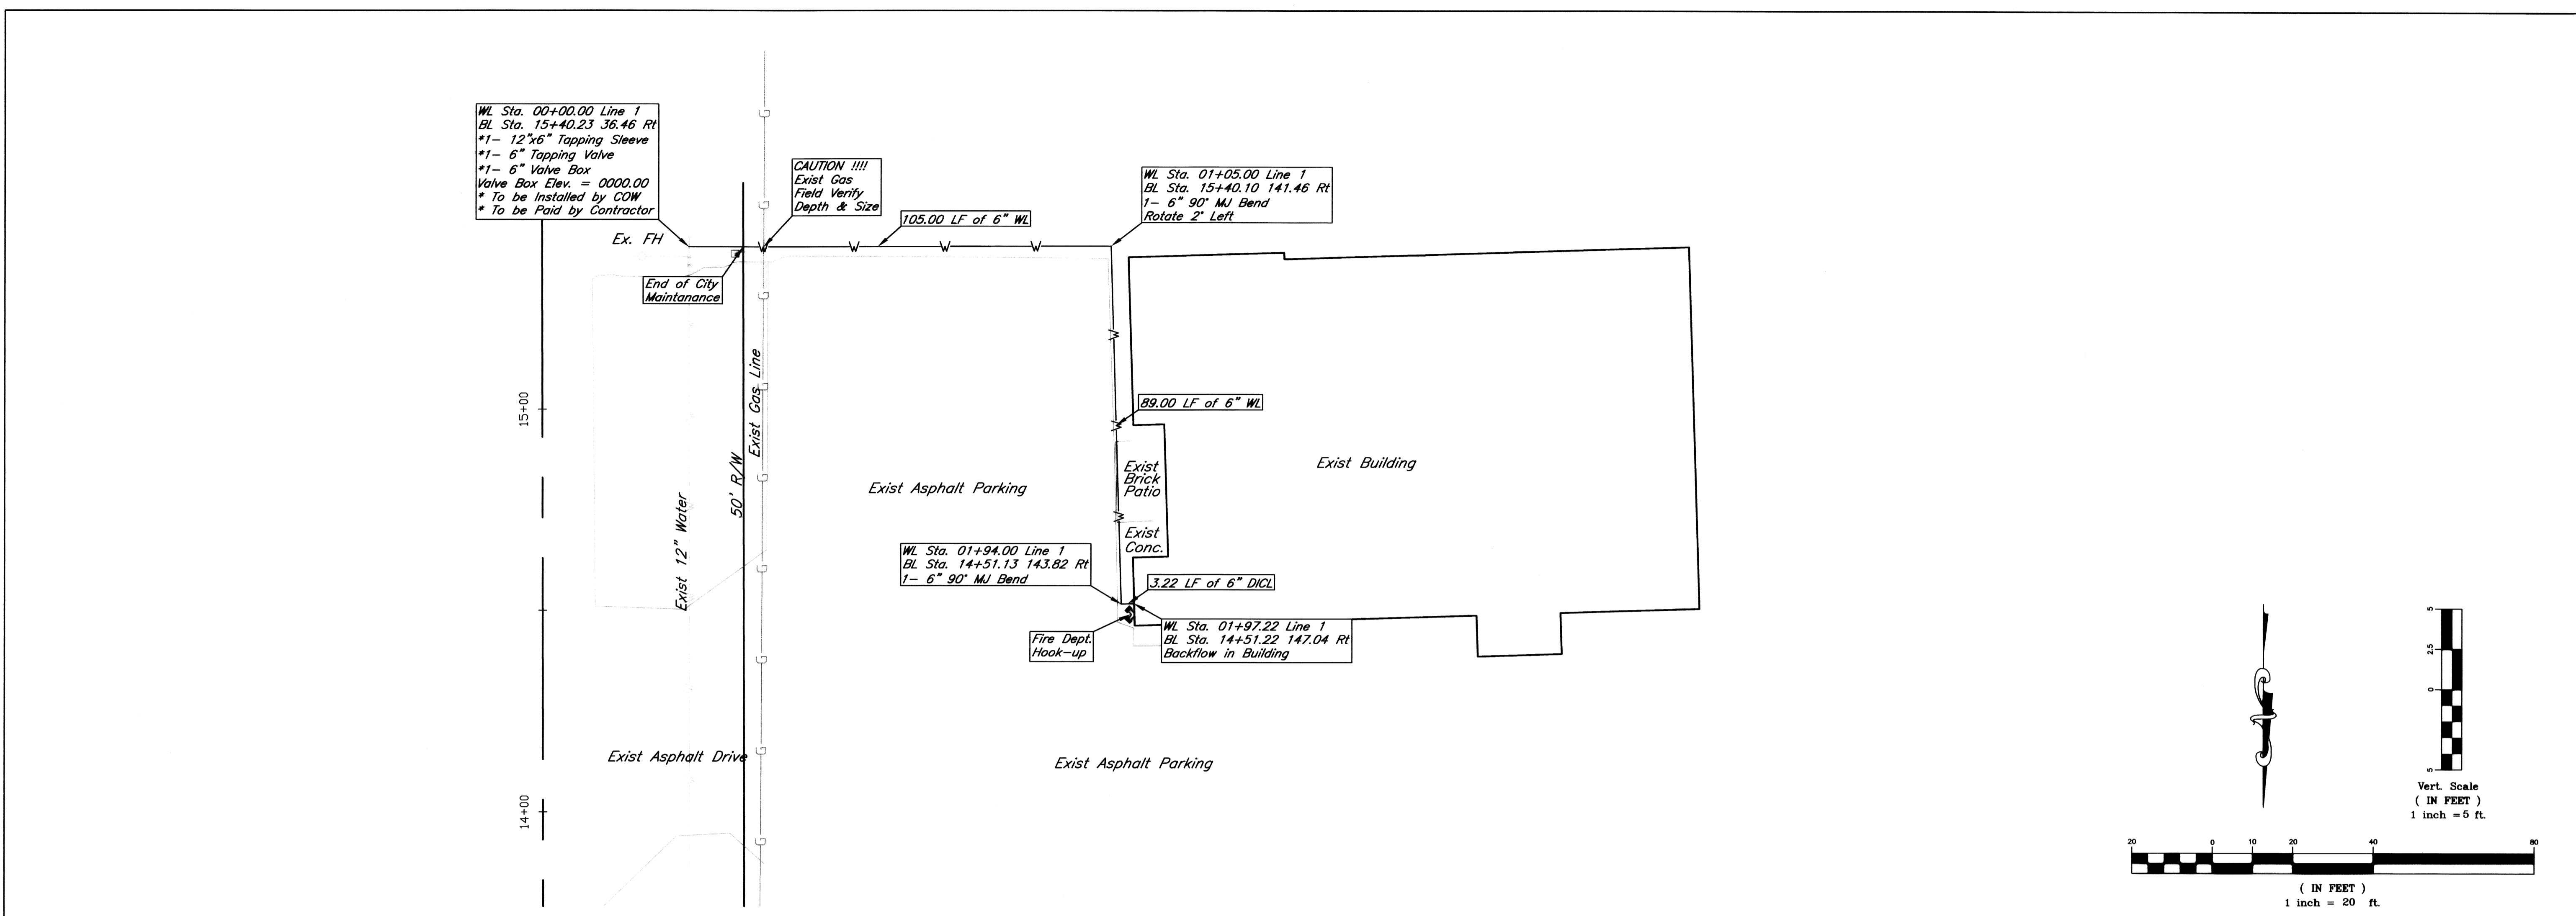

**Pleasures
 Fire Line
 Wichita, Kansas**

PROJECT NUMBER			
kemiller <i>engineering</i>	KEM NO. 08027	FILE ppw	DATE 3/2008
516 S. Market, Wichita, KS 67202	316/264-0242	DESIGN KM	DRAWN NS
		REVISED	SHEET 2 OF 3