
Note: Contractor to replace all fences. Contractor shall also replace all water lines, gas lines, and septic tank laterals disturbed during construction of the sewer. The work of removing and replacing gas lines, water lines, and septic tank laterals will not be paid for directly, and is to be considered as incidental to the construction of the sewer.

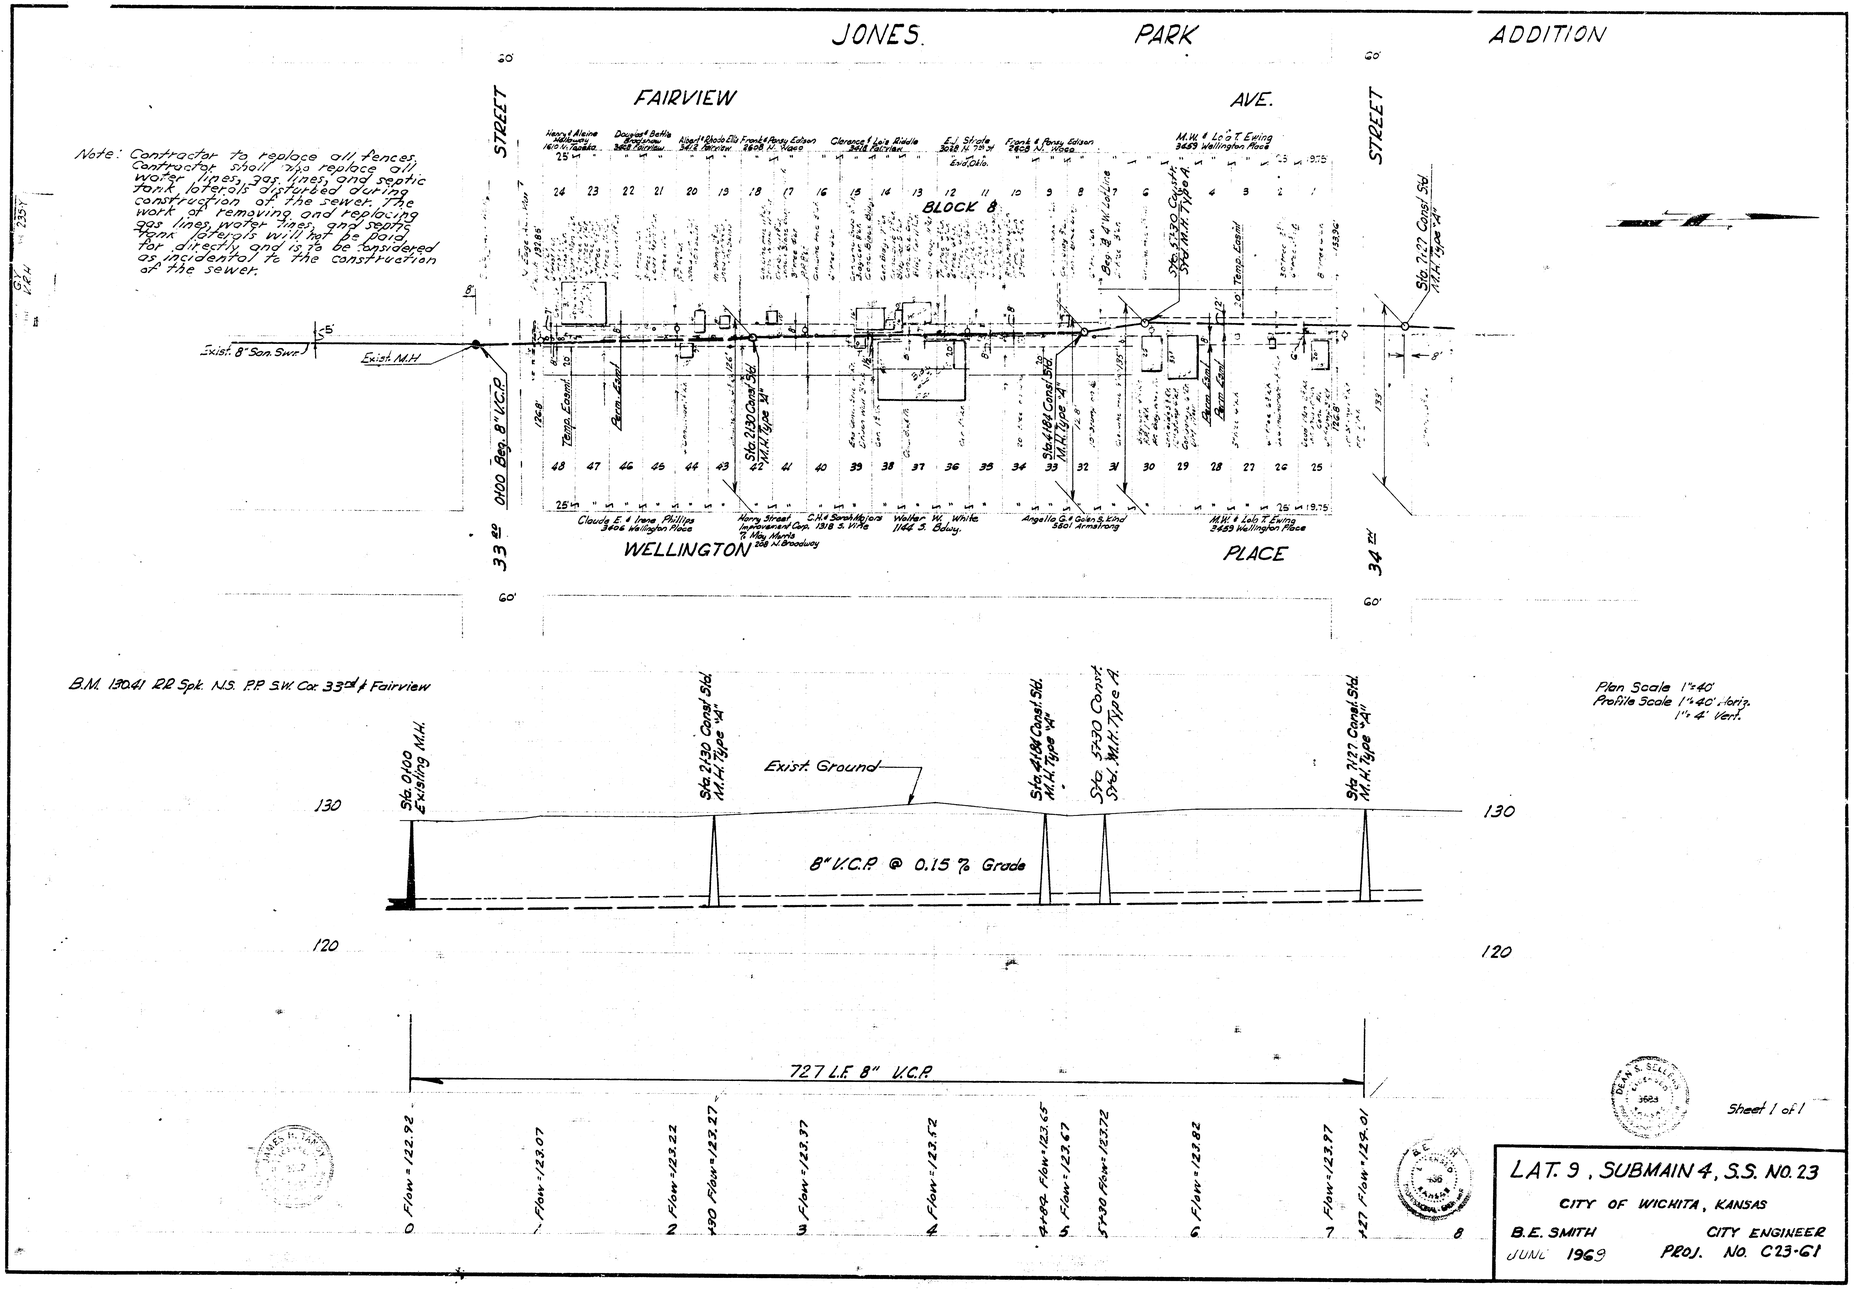

Plan Scale 1"=40'
Profile Scale 1"=40' Horiz.
1"=4' Vert.

Sheet 1 of 1

LAT. 9, SUBMAIN 4, S.S. NO. 23

CITY OF WICHITA, KANSAS

B.E. SMITH — CITY ENGINEER

JUNE 1969 — PROJ. NO. C23-61

JONES PARK ADDITION

FAIRVIEW AVE.

WELLINGTON PLACE

BLOCK 8

BLOCK 3

34 ST

35 ST

STREET

Sta. 7+27 Const. Sta. M.H. Type A.

Sta. 10+27 Const. Sta. M.H. Type A

Sta. 13+14 Const. Sta. M.H. Type A with 8" Sch. Swr.

Stub North

Perm. Easm't

Temp. Easm't

B.M. 130.41 12.2 Spk. N.S. P.P. S.W. Cor. 33rd & Fairview

Exist. Ground

8" V.C.P. @ 0.15 % Grade

587 L.F. 8" V.C.P.

+27 Flow = 129.01

8 Flow = 129.12

9 Flow = 129.27

10 Flow = 129.42

+27 Flow = 129.46

11 Flow = 129.57

12 Flow = 129.72

13 Flow = 129.87

+48 Flow = 129.91

Plan Scale 1" = 40'
Profile Scale 1" = 40' Horiz.
1" = 4' Vert.

Sheet 2 of 2

LAT. 9, SUB. 4, S.S. 23