


BY	DATE
REFERENCES NOTED	REFERENCES CHECKED



- NOTES:**
- See Sheet 17 for Standard Water Details.
 - Valve for 6" Service shall remain closed until waterline construction is complete and water has been tested.

LINE NO. 1

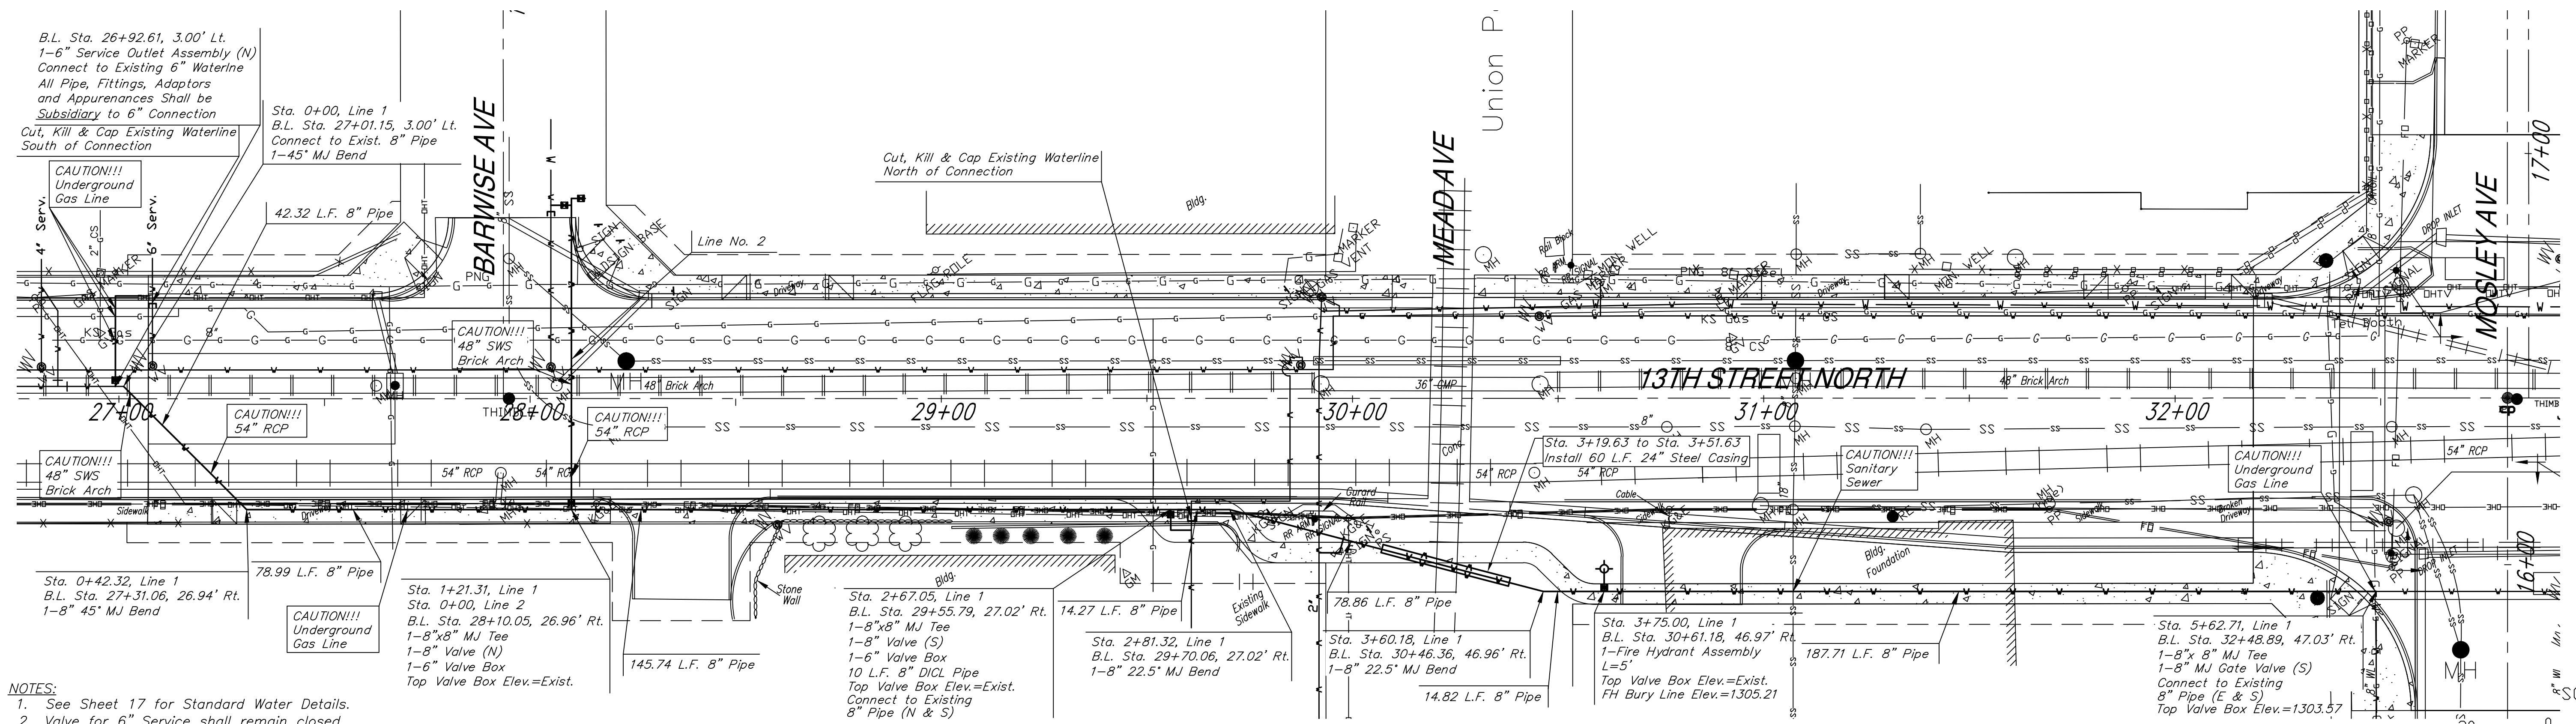