




STA. 0+00 WL4
 BL STA. 49+93.8, 30.0' RT
 ROTATE EXISTING TEE AND VALVE
 INSTALL 1 - 6" VALVE BOX
 VB ELEV. = 1323.24

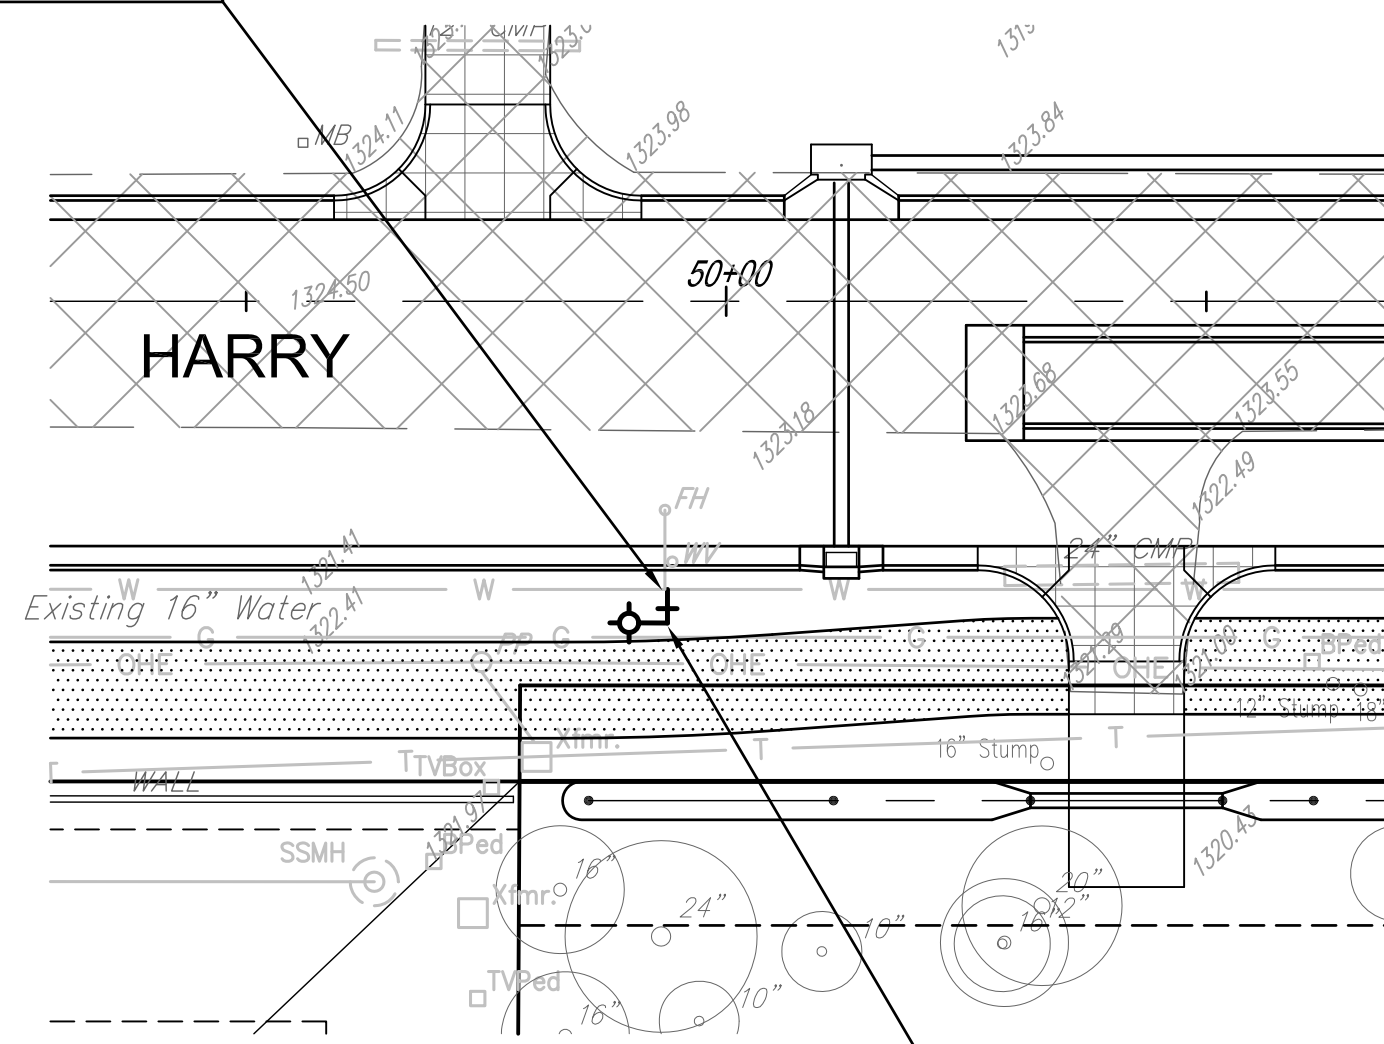

STA. 0+00 WL5
 BL STA. 56+37.8, 47.6' RT
 ROTATE EXISTING TEE AND VALVE
 1 - 6" VALVE BOX
 1 - 6" ANCHOR COUPLING
 VB ELEV. = 1320.30

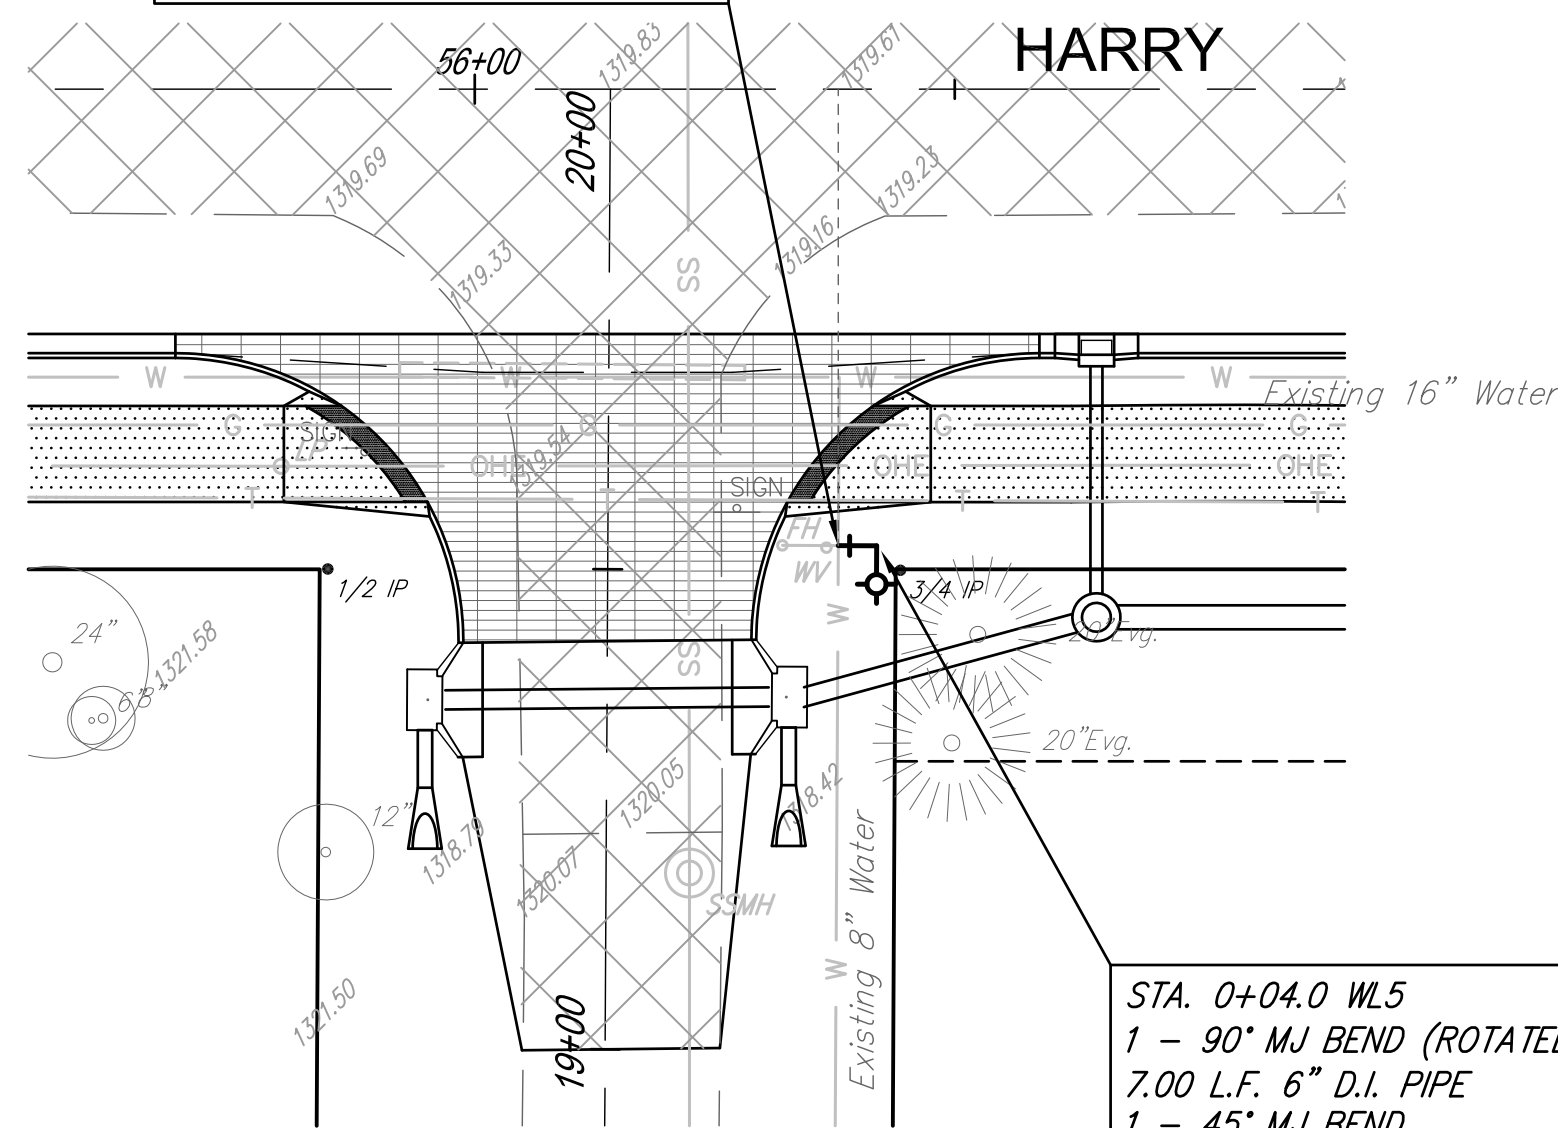

STA. 0+00 WL6
 BL STA. 62+64.9, 37.4' RT
 ROTATE EXISTING TEE AND VALVE
 1 - 6" VALVE BOX
 1 - 6" ANCHOR COUPLING
 VB ELEV. = 1316.15

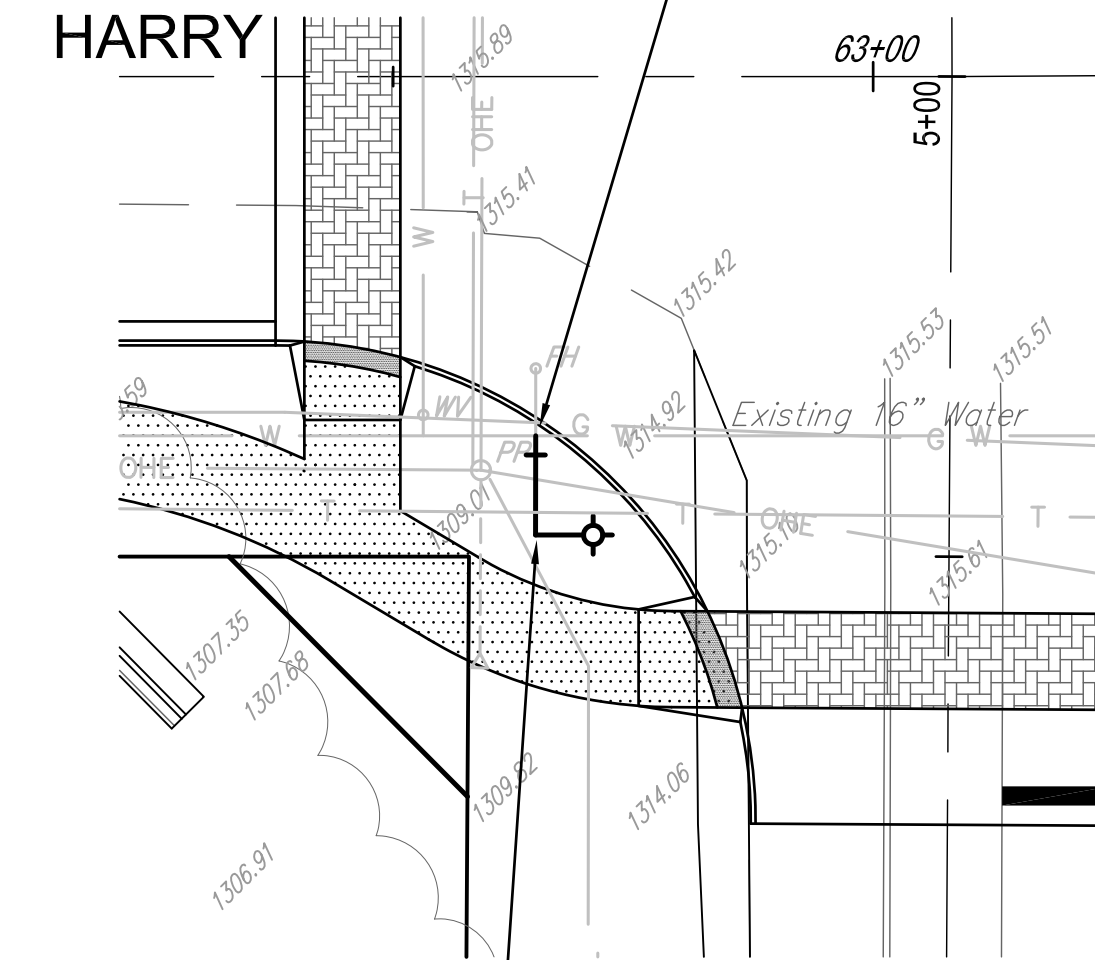

STA. 0+04.0 WL5
 1 - 90° MJ BEND (ROTATED 45°)
 7.00 L.F. 6" D.I. PIPE
 1 - 45° MJ BEND
 1 - FIRE HYDRANT
 BL ELEV. = 1320.40


STA. 0+10.6 WL6
 1 - 90° MJ BEND (ROTATED 45°)
 8.50 L.F. 6" D.I. PIPE
 1 - 45° MJ BEND
 1 - FIRE HYDRANT
 BL ELEV. = 1316.30

STA. 0+03.5 WL4
 1 - 90° MJ BEND (ROTATED 45°)
 5.70 L.F. 6" D.I. PIPE
 1 - 45° MJ BEND
 1 - FIRE HYDRANT
 BL ELEV. = 1323.24


NOTES:

NEW HYDRANTS WITH STORZ CONNECTIONS
 REQUIRED FOR THIS PROJECT. SALVAGE EXISTING
 HYDRANTS TO CITY OF WICHITA.

ALL LABOR AND MATERIALS ASSOCIATED WITH EACH
 FIRE HYDRANT RELOCATION SHALL BE PAID FOR AS
 "FIRE HYDRANT RELOCATION".

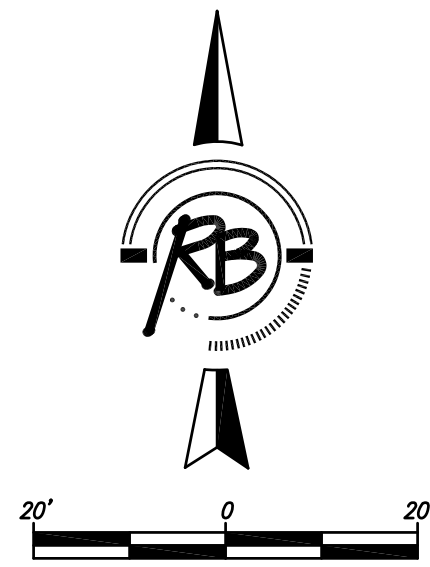

Station	Notes	1300	1305	1310	1315	1320	1325	1330	1335
0+00	1315.12 TP (16")								
0+03.5	1314.70 TP (6") 1318.70 TP (6") (AT HYDRANT)								
0+00	1311.00 TP (8")								
0+04.0	1310.92 TP (6") 1314.92 TP (6") (AT HYDRANT)								
0+00	1305.00 TP (16")								
0+10.6	1304.58 TP (6") 1310.58 TP (6") (AT HYDRANT)								


 Kuegels & Bohm, P.A.
 Engineering, Surveying, Land Planning
 924 North Main
 Wichita, Kansas 67203
 Phone: 316.264.0000
 Fax: 316.264.0001
 Email: info@kuegels.com

PROJECT NUMBER: 87 N-0514-01
 DRAWING TITLE: fire hydrant relocations
 DRAWN: KWL
 CHECKED: KWL
 DATE: Feb. 16, 2010
 REVISIONS: REVIEW
 SHEET: 116 OF 148
**HARRY STREET IMPROVEMENTS
 HYDRANT RELOCATIONS
 WICHITA, KANSAS**