


SCALE 1" = 20'
IRON = ●

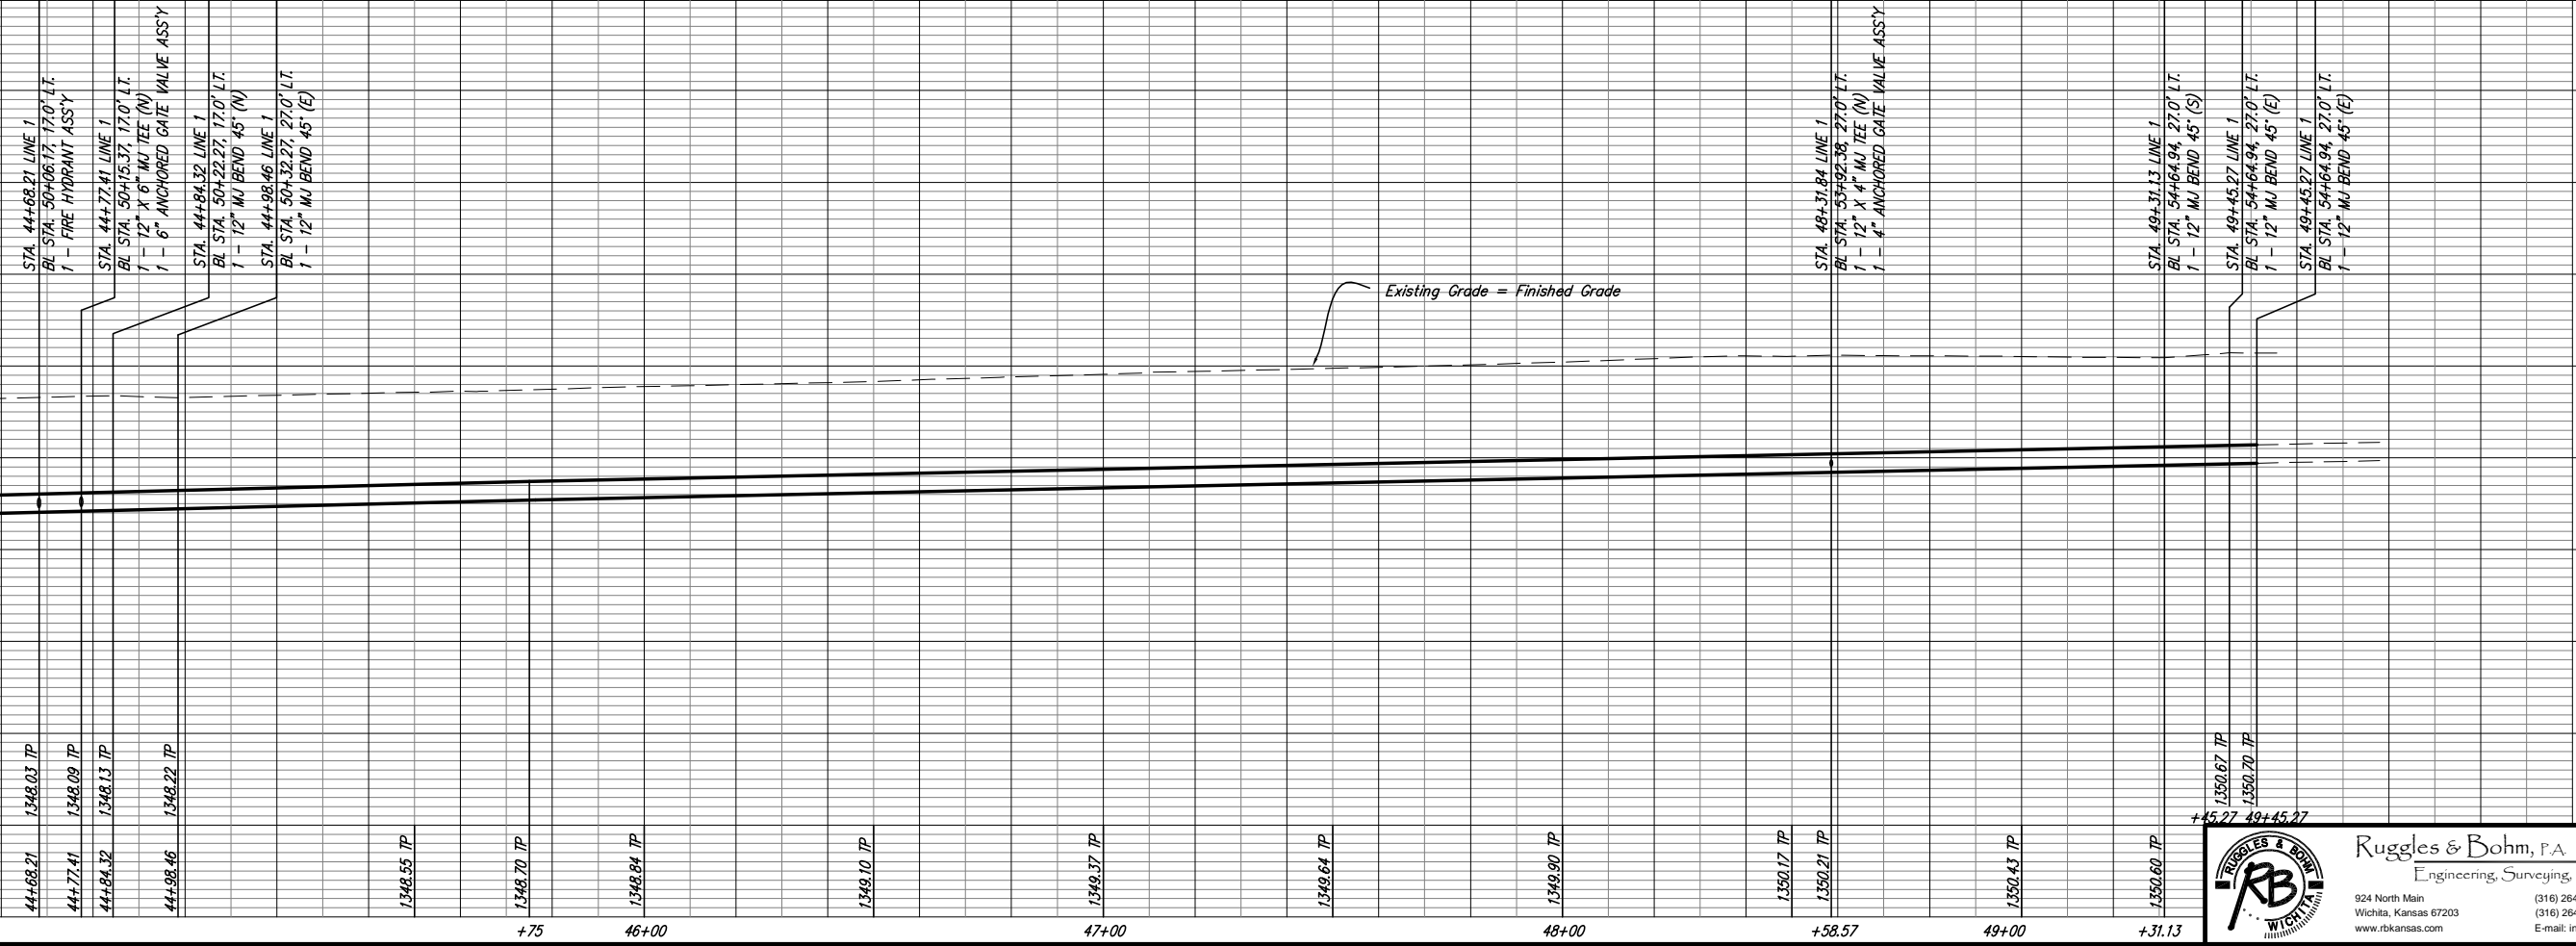

STA. 44+68.21 LINE 1
BL STA. 50+06.17, 17.0' LT.
1 - FIRE HYDRANT ASS'Y

STA. 44+77.41 LINE 1
BL STA. 50+15.37, 17.0' LT.
1 - 12" X 6" MJ TEE (N)
1 - 6" ANCHORED GATE VALVE ASS'Y

STA. 44+84.32 LINE 1
BL STA. 50+22.27, 17.0' LT.
1 - 12" MJ BEND 45° (N)

STA. 44+98.46 LINE 1
BL STA. 50+32.27, 27.0' LT.
1 - 12" MJ BEND 45° (E)

STA. 48+58.57 LINE 1
BL STA. 53+92.38, 27.0' LT.
1 - 12" X 4" MJ TEE (N)
1 - 4" ANCHORED GATE VALVE ASS'Y

STA. 49+31.13 LINE 1
BL STA. 54+64.94, 27.0' LT.
1 - 12" MJ BEND 45° (S)

STA. 49+45.27 LINE 1
BL STA. 54+64.94, 27.0' LT.
1 - 12" MJ BEND 45° (E)

STA. 49+51.27 LINE 1
BL STA. 54+80.94, 27.0' LT.
1 - 8" PLUG IN NORTH SIDE OF TEE.

PROJECT NUMBER	448-89893
DESIGN	KWL
DRAWN	RA
DATE	July 11, 2006
REVIEW	
DRAWING FILE	water {sheet 11}
12" Water Main Replacement	
WICHITA, KANSAS	
RB JOB	2136W
SHEET	W11
OF	W15