

General Notes

Bevel all exposed edges with a 3/4" triangular molding or an approved edging tool.

Reinforcing Steel shall be a minimum Grade 60 ASTM A615.


All dimensions relative to placement of reinforcing are to the centerline of bars unless otherwise noted. All Clearances are 1-1/2" unless otherwise noted.

Reinforcement shall be field bent or cut to clear pipe leaving structure.

Inlet invert shall be shaped with unreinforced Class A Concrete.

Special Ditch Inlet shall be measured and paid for at the contract unit price bid per each. This shall be considered full compensation for all excavation, backfilling, materials, labor, equipment, tools and incidentals necessary to complete the work.

The grate shall be fabricated from standard or commercial grade structural steel and black steel pipe. The unit shall be hot dipped, galvanized after fabrication, in accordance with ASTM A123.

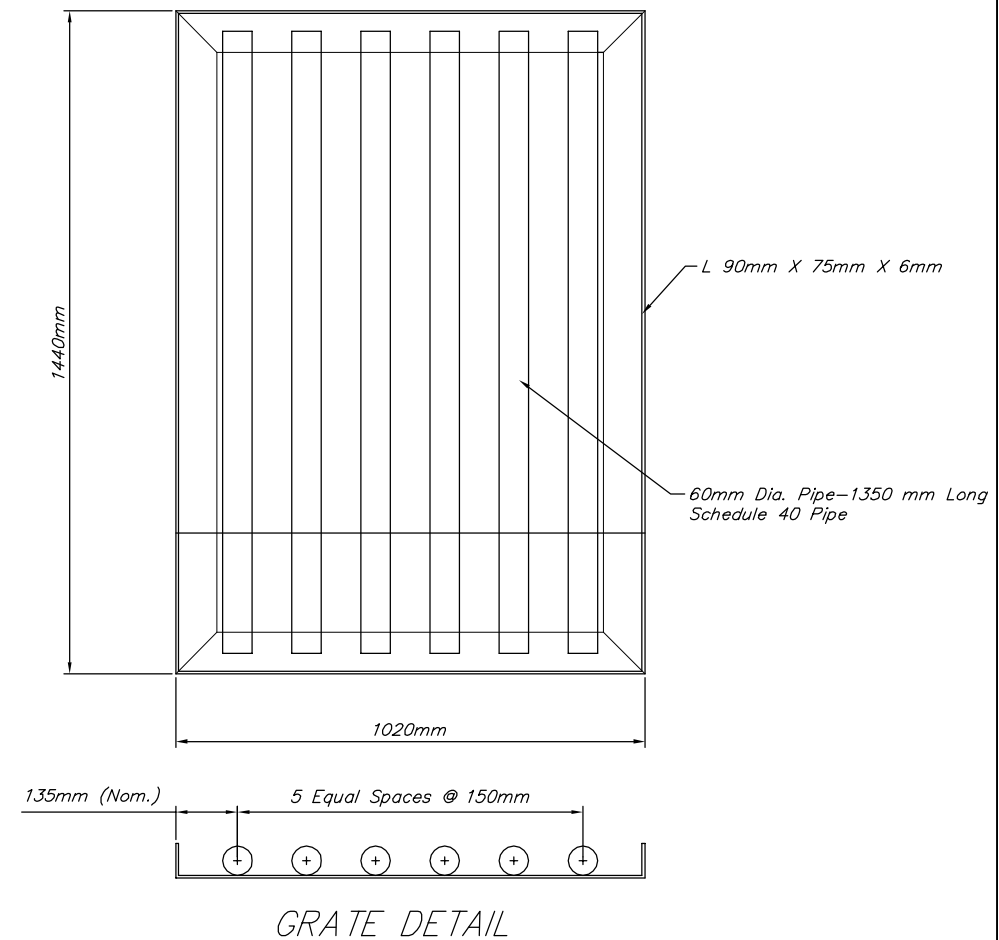

PROJECT NUMBER 472-83863		SHEET NAME Ditch Inlet		ENGINEERING DIRECTORY F:\29th North\Details	
DESIGN TPV	DRAWN TPV	APPROVED JFB	DATE Oct. 2004	SCALE None	BAUGHMAN NO 02-02-E232

CAPITAL IMPROVEMENT PROJECT
SPECIAL DITCH INLET DETAILS

BAUGHMAN COMPANY, P.A.
ENGINEERING, SURVEYING, & PLANNING
316-262-7271 • 315 ELLIS • WICHITA, KANSAS 67211

SHEET
63
OF
129