


NOTE:  
Expansion Joint Only in Curb Area  
With Concrete Pavement.

**PLAN**

Left Side Shown Without Stop Reinforcing,  
Right Side Shown With Stop Reinforcing.

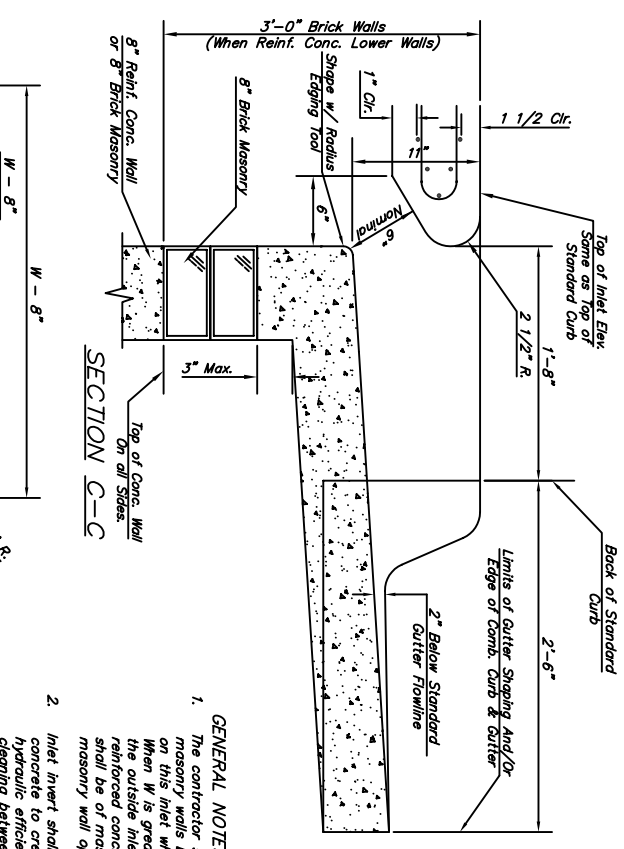

**GENERAL NOTES:**


- The contractor shall be required to construct 8" brick masonry walls between the concrete inlet base and top on this inlet when W=6'-4" or less and H=7'-0" or less. When W is greater than 6'-4" and H is less than 7'-0" the outside inlet walls below the brick stack shall be reinforced concrete construction and the center wall shall be of masonry construction as shown for the masonry wall option.
- Inlet invert shall be shaped with B sack sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipes.
- Concrete tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be spaced pavement mix.
- Inlet top reinforcing shall be spaced on 6" max. centers. Inlet ribs shall be notched out as indicated to facilitate construction of curb. Bars in inlet top to be held bent or cut to clear manhole ring.
- The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.

**PRECAST SLAB AND FLOOR REINFORCING**

MARK	SIZE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
W1	4'-4"	13	6'-2"	13	10'-7"	13	14'-7"	13	14'-7"	13	14'-7"
W2	4'-4"	23	4'-1"	23	5'-1"	23	12'-0"	23	12'-0"	23	14'-0"
W3	4'-4"	23	4'-1"	23	5'-1"	23	12'-0"	23	12'-0"	23	14'-0"
X1	4'-4"	16	3'-10"	16	4'-2"	16	4'-10"	16	4'-10"	16	5'-2"

**WALL REINFORCING**

MARK	SIZE	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH	NO.	LENGTH
W1	4'-4"	11	1'-1"	11	1'-1"	11	1'-1"	11	1'-1"	11	1'-1"
W2	4'-4"	11	1'-1"	11	1'-1"	11	1'-1"	11	1'-1"	11	1'-1"
W3	4'-4"	11	1'-1"	11	1'-1"	11	1'-1"	11	1'-1"	11	1'-1"

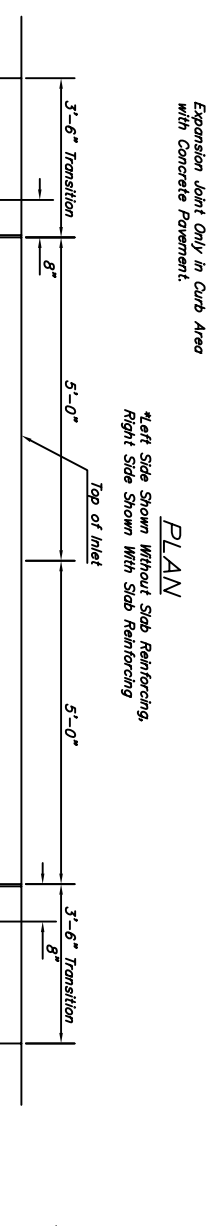

**SECTION A-A**



**GENERAL NOTES:**

- The contractor shall be required to construct 8" brick masonry walls between the concrete inlet base and top on this inlet when W=6'-4" or less and H=7'-0" or less. When W is greater than 6'-4" and H is less than 7'-0" the outside inlet walls below the brick stack shall be reinforced concrete construction and the center wall shall be of masonry construction as shown for the masonry wall option.
- Inlet invert shall be shaped with B sack sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipes.
- Concrete tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be spaced pavement mix.
- Inlet top reinforcing shall be spaced on 6" max. centers. Inlet ribs shall be notched out as indicated to facilitate construction of curb. Bars in inlet top to be held bent or cut to clear manhole ring.
- The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.


**STANDARD CURB INLET PRECAST TOPS**

W	PRE-CAST TOP SIZE	PIPE SIZE	CU. YD. CONC.
4'-4"	3'-8" 11'-4" 7 1/2"	21" & SMALLER	0.83x
5'-4"	4'-8" 11'-4" 7 1/2"	24" & 30"	1.08x
6'-4"	5'-8" 11'-4" 7 1/2"	36" & 48"	1.35x
7'-4"	6'-8" 11'-4" 7 1/2"	48" & 54"	1.61x
8'-4"	7'-8" 11'-4" 7 1/2"	60" & 66"	1.87x

**BENDING DIAGRAM**

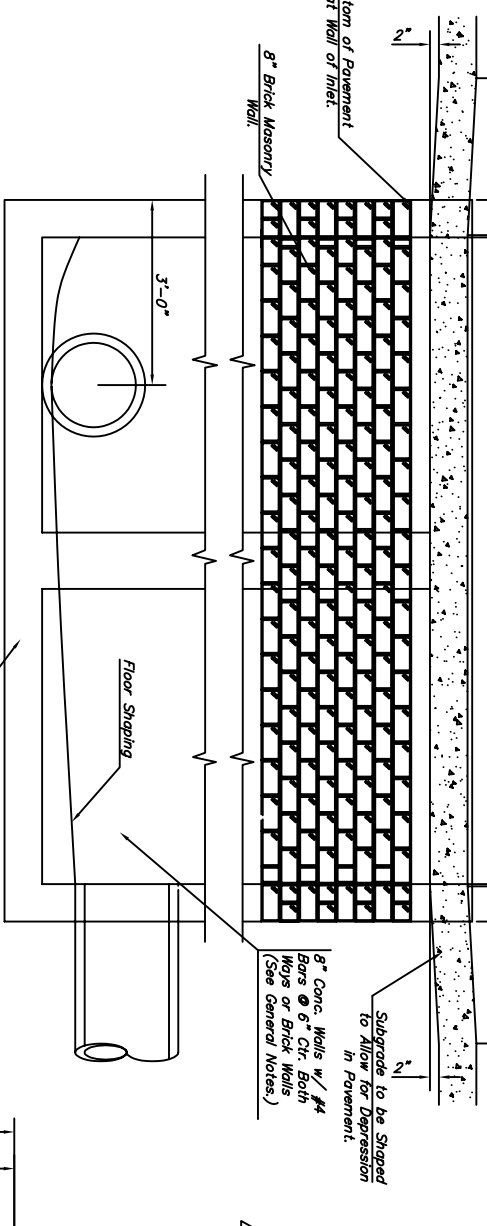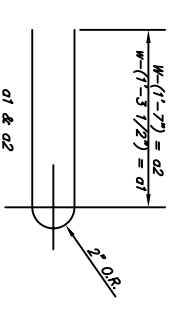


**ELEVATION**

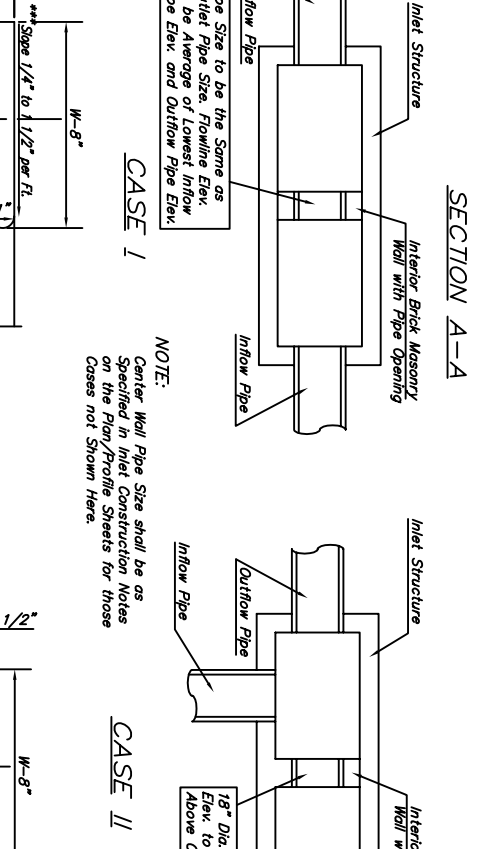


**CASE I**

**CASE II**


NOTE:  
Center Wall Pipe Size shall be as Specified in Inlet Construction Notes on the Plan/Profile Sheets for those Cases not Shown Here.

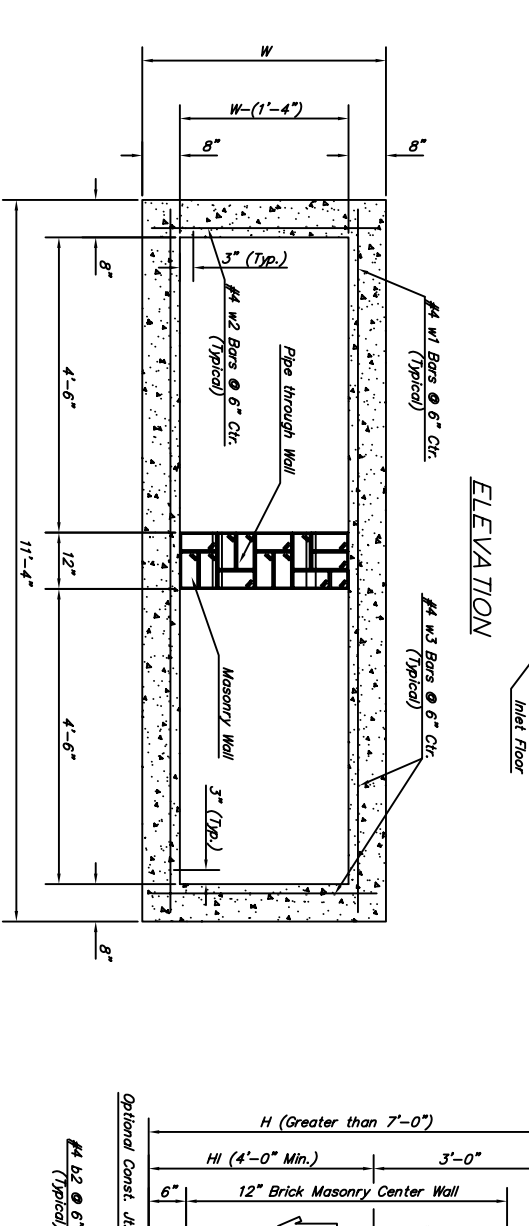


**SECTION B-B**

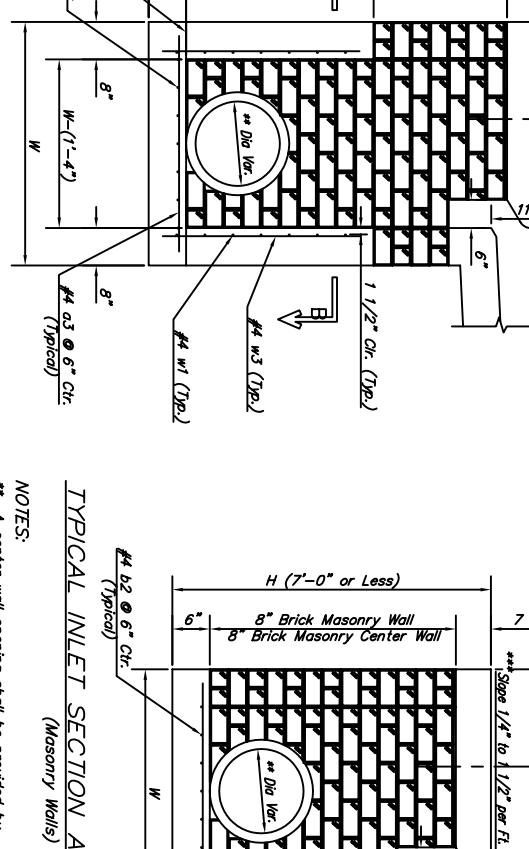

**TYPICAL INLET SECTION AT CENTER WALL**  
(Reinforced Concrete Walls)

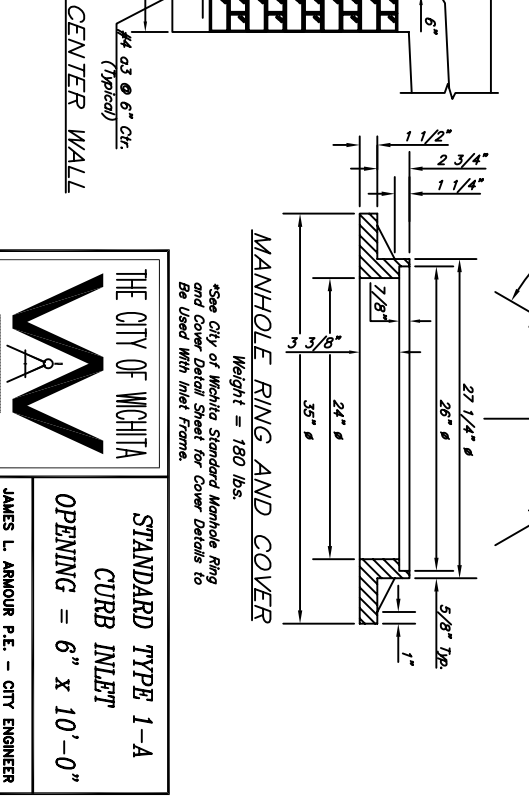

**TYPICAL INLET SECTION AT CENTER WALL**  
(Masonry Walls)

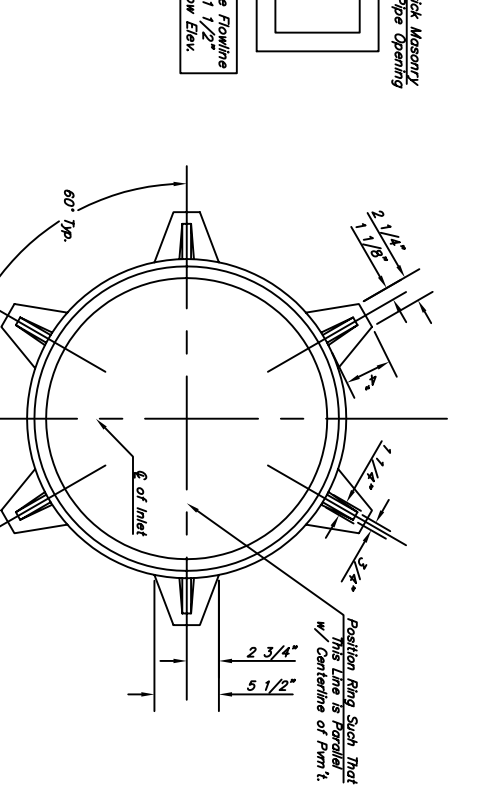

**MANHOLE RING AND COVER**  
Height = 180 lbs.  
\*See City of Wichita Standard Manhole Ring and Cover Detail Sheet for Cover Details to Be Used With Inlet Frames.

**STANDARD TYPE 1-A CURB INLET**  
OPENING = 6" X 10'-0"

**THE CITY OF WICHITA**  
CITY ENGINEER'S OFFICE  
JAMES L. ARMOUR P.E. - CITY ENGINEER  
PRODUCT NUMBER: 87N-0237-01  
DATE: MAR 96  
SHEET 35 OF 78