



SECTION A-A

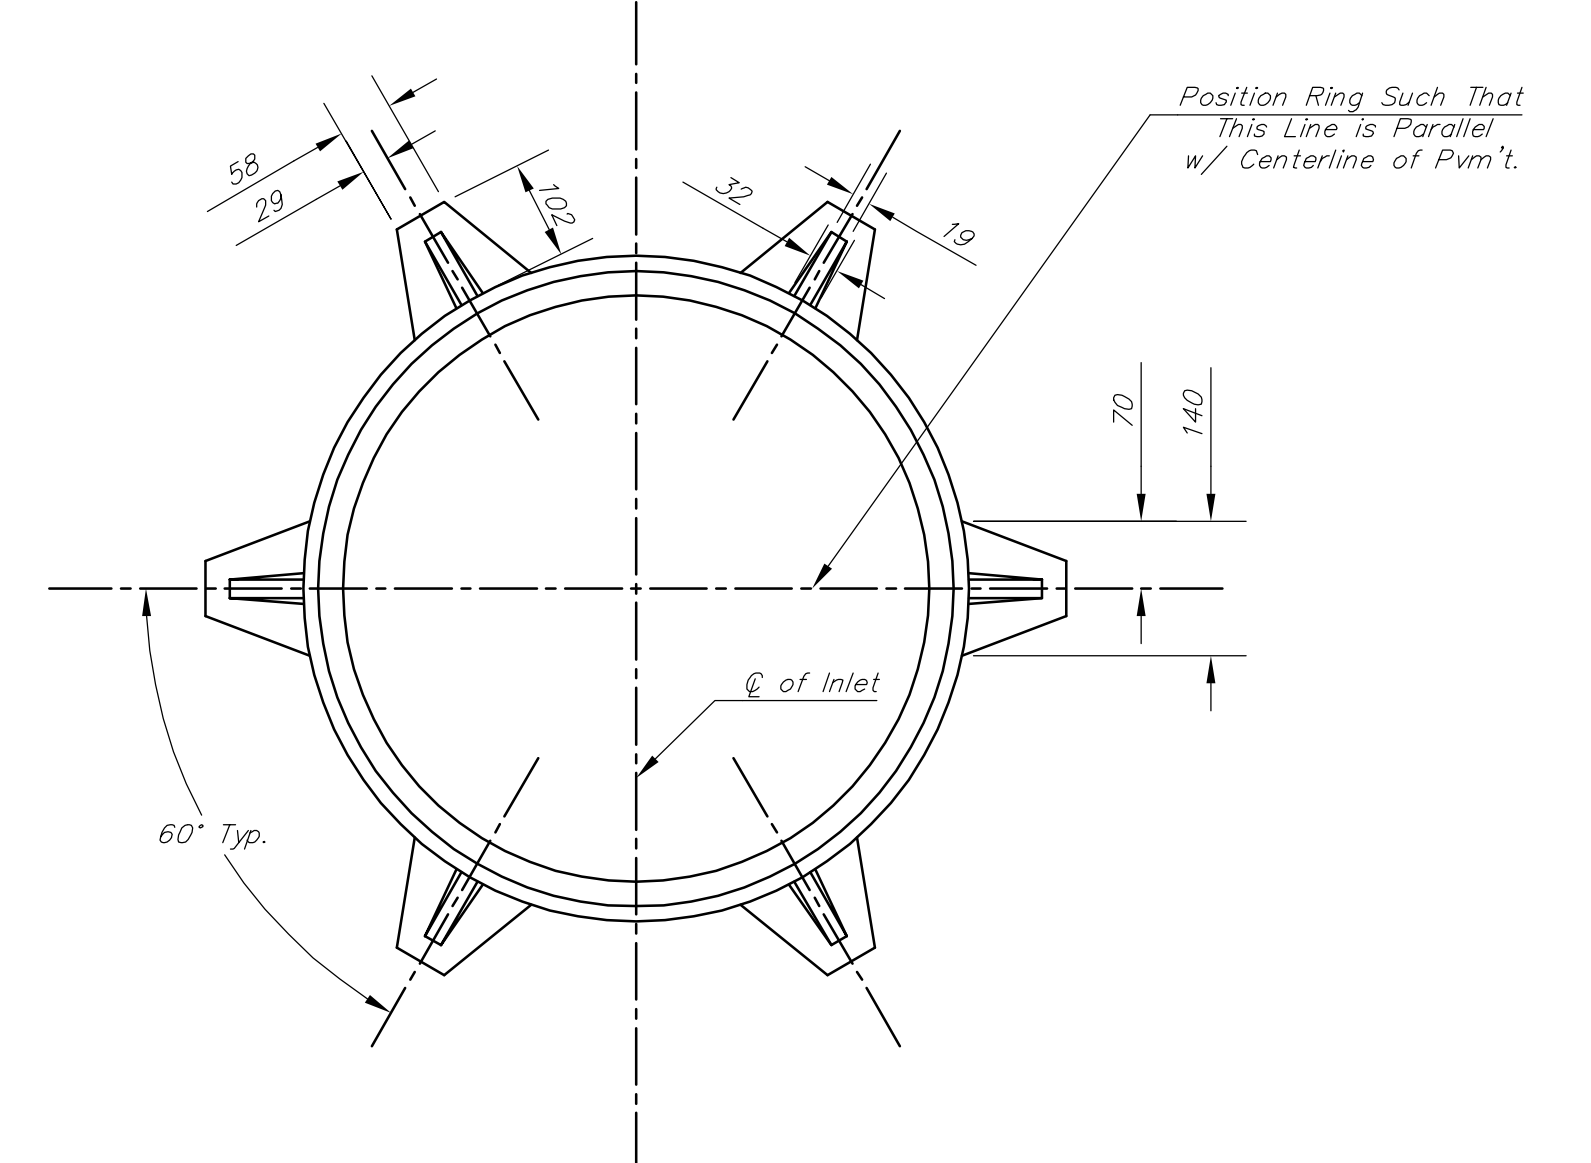


MANHOLE RING AND COVER


\*See City of Wichita Standard Manhole Ring and Cover Detail Sheet for Cover Details to Be Used With Inlet Frame.

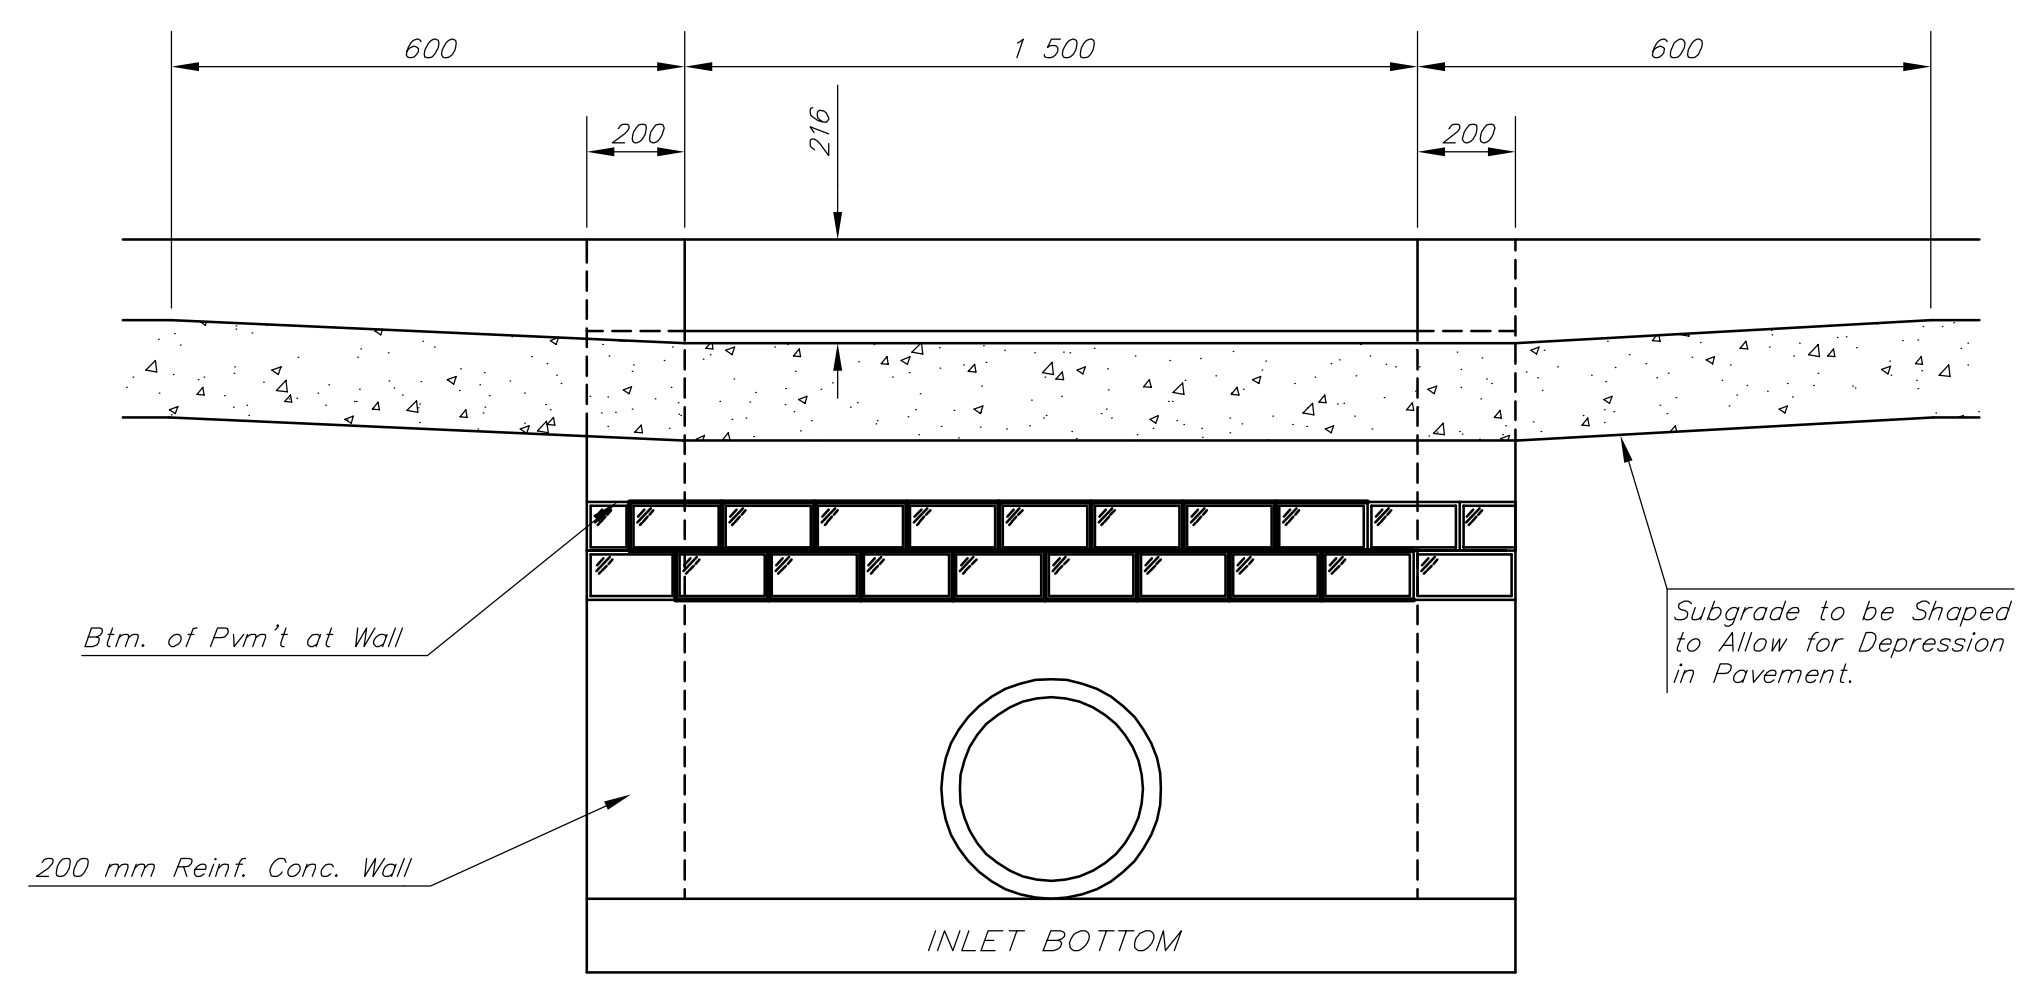

SECTION C-C

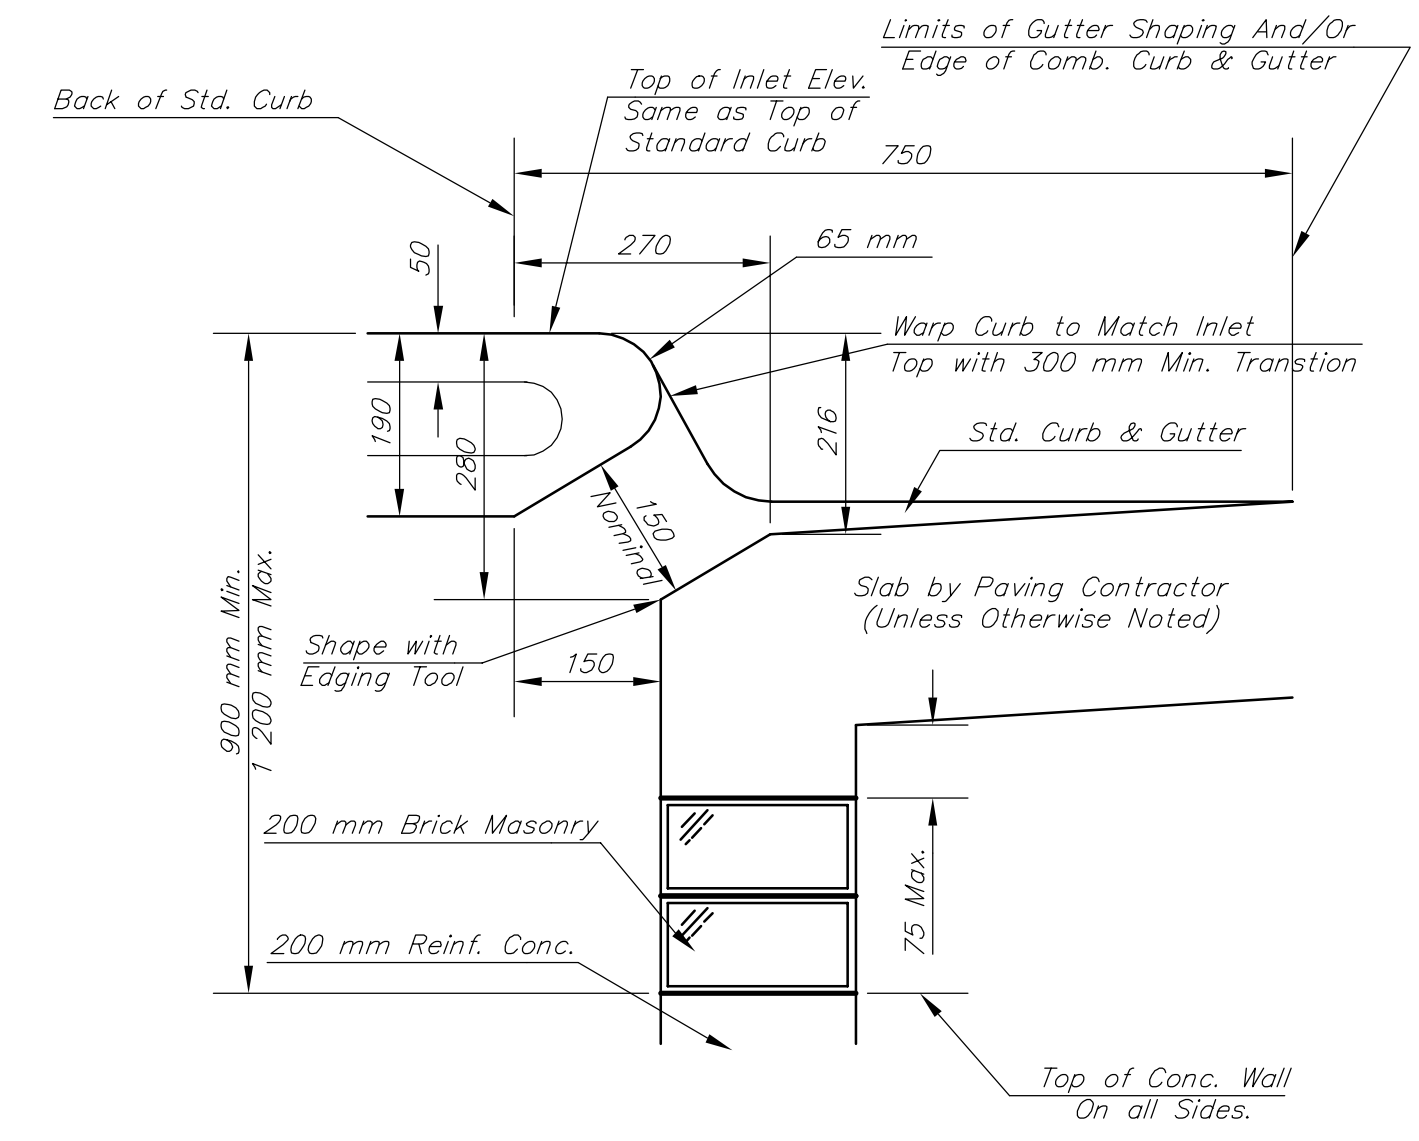

SECTION B-B

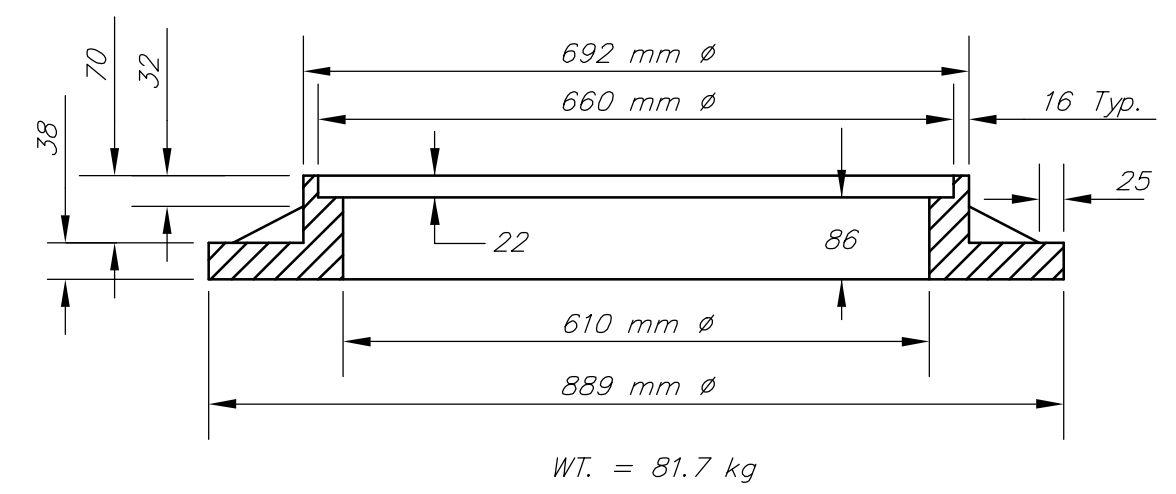

BENDING DIAGRAM

STEEL SCHEDULE

BAR	$a_1$	$a_2$	$a_3$	$b_1$					$b_2$	$b_3$	$b_4$	Wt. Kg.
				#=1.321 m	#=1.625 m	#=1.930 m	#=2.235 m	#=2.540 m				
NUMBER	4	4	2	1	3	5	7	9	6	1	1	
SIZE	#13	#13	#13	#13	#13	#13	#13	#13	#13	#13	#19	
LENGTH	W=1.321 m	1.700 m	2.000 m	1.220 m	1.850 m	-	-	-	530 mm	1,880 m	1,420 m	27.2±
	W=1.625 m	2.310 m	2.610 m	1.520 m	1,850 m	-	-	-	530 mm	1,880 m	1,420 m	36.7±
	W=1.930 m	2.920 m	3.220 m	1,830 m	-	1,850 m	-	-	530 mm	1,880 m	1,420 m	45.8±
	W=2.235 m	3.530 m	3.830 m	2,130 m	-	-	1,850 m	-	530 mm	1,880 m	1,420 m	54.9±
	W=2.540 m	4.140 m	4.440 m	2,440 m	-	-	-	1,850 m	530 mm	1,880 m	1,420 m	64.0±

Note:  $a_3$  Bars to be Placed Approx. 50 mm Below Top of Inlet Cover.

STANDARD CURB INLET PRECAST TOPS

W	PRE-CAST TOP SIZE	PIPE SIZE	cu m Conc.
1.321 m	1.121 m 1.9 m 190 mm	525 mm & SMALLER	0.29±
1.625 m	1.425 m 1.9 m 190 mm	600 mm & 750 mm	0.39±
1.930 m	1.730 m 1.9 m 190 mm	900 mm & 1 050 mm	0.49±
2.235 m	2.035 m 1.9 m 190 mm	1 200 mm & 1 350 mm	0.59±
2.540 m	2.340 m 1.9 m 190 mm	1 500 mm & 1 650 mm	0.69±

GENERAL NOTES

- Concrete tops to be installed on thin mortar cushion to insure full support along brick walls. Concrete tops may be cast in place or precast. Concrete used for inlet construction shall be concrete pavement mix with air entrainment.
- Contractor shall have the option of constructing 200 mm brick masonry walls between the concrete inlet base and top on this inlet when W=1.90 m and H=2.1 m or less.
- Inlet invert shall be shaped with 8 sack sand mix concrete to create flow channels and to increase hydraulic efficiency such that the inlet will be self cleaning between all inlet and/or outlet pipes.
- The ends of all pipes installed in inlets shall be cut off flush with the inside face of the inlet wall.

Note:  
All dimensions shown without a SI suffix are in millimeters.

<p>THE CITY OF WICHITA</p> <p>CITY ENGINEER'S OFFICE 455 NORTH MAIN STREET WICHITA, KANSAS 67202 (316) 268-4501 (316) 268-4114 FAX</p>	<p><b>STANDARD TYPE 1</b></p> <p><b>CURB INLET</b></p> <p><b>OPENING=150 x 1500 mm</b></p>	
	<p>NEIL CABLE P.E. - CITY ENGINEER</p>	
	<p>PROJECT NUMBER</p> <p>468-83631</p>	<p>INDEX CODE</p> <p>XXXXXX</p>
	<p>DATE</p> <p>MAR 96</p>	<p>SHEET 11 OF 76</p>

STYP1-S.DWG