
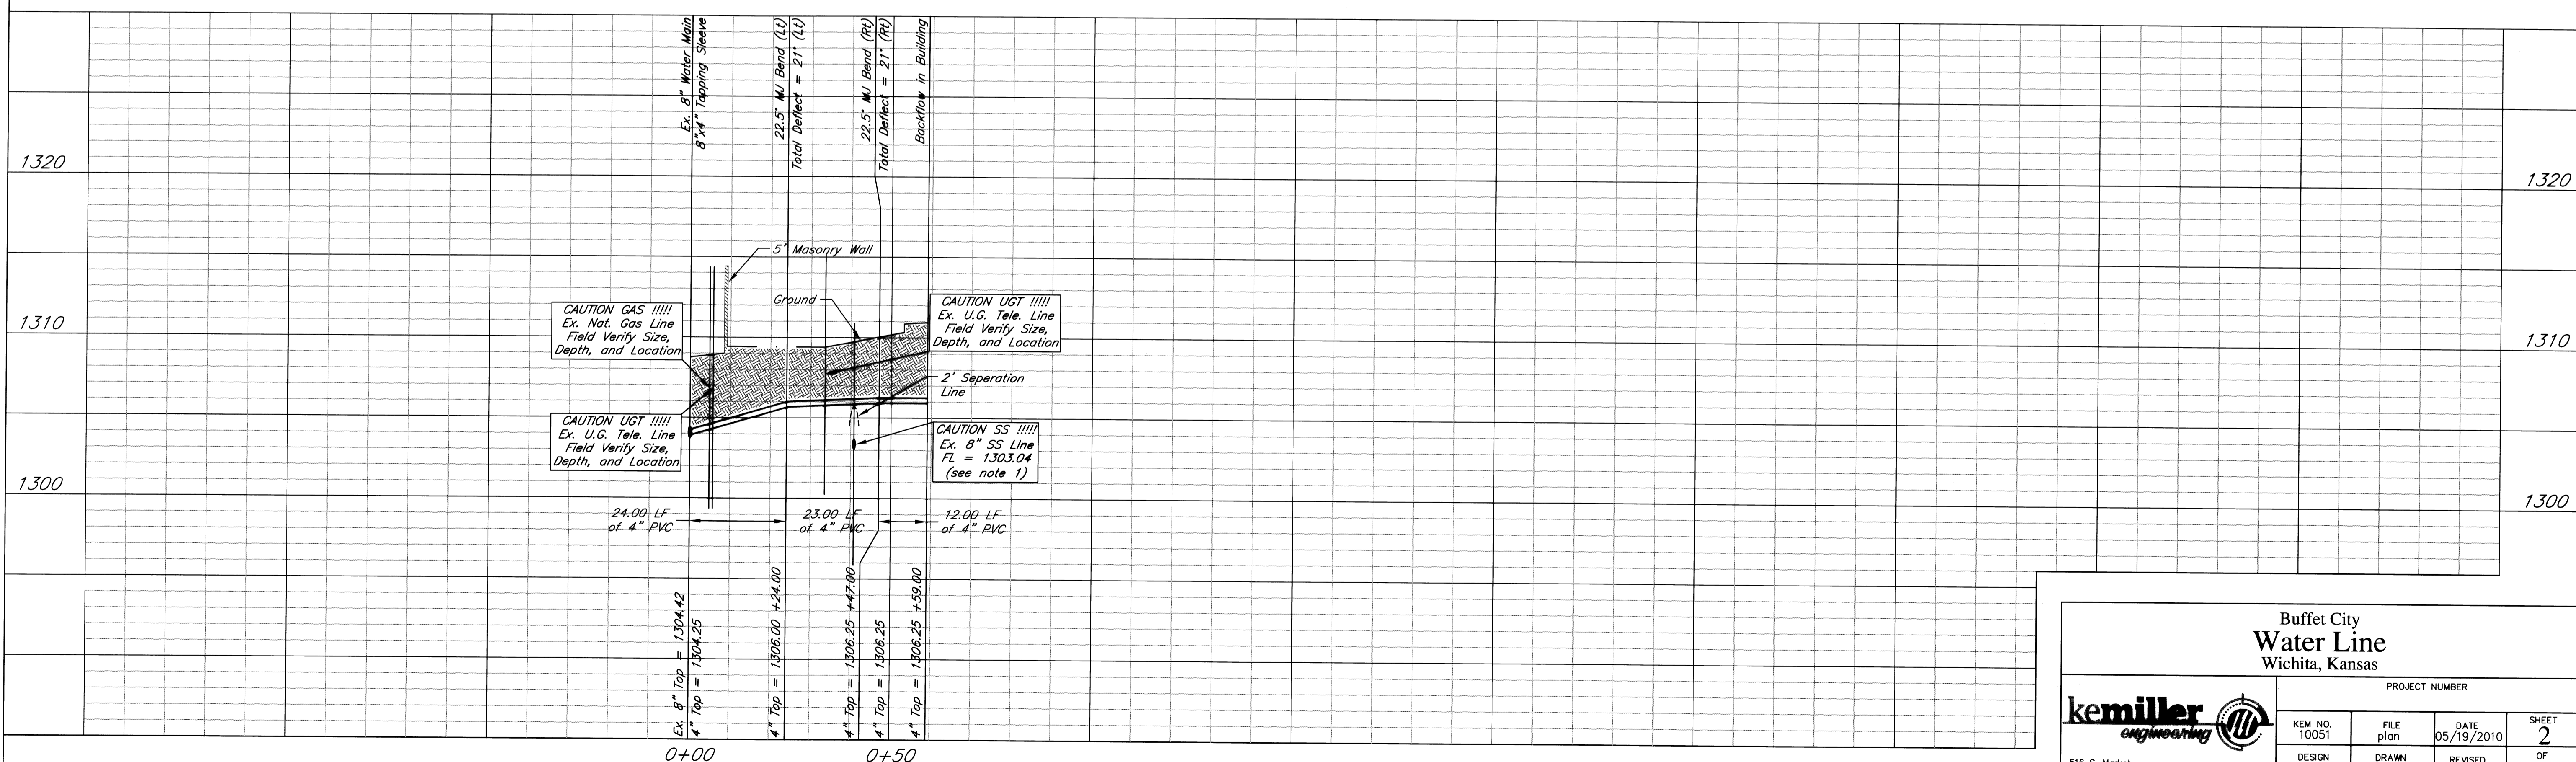


SECTION A-A  
SECTION B-B  
**REINFORCED CONCRETE ENCASEMENT OF SANITARY SEWER**

Note: Encasement to begin and end at a Bell on Sanitary Sewer Pipe.

- Notes:**
- Existing sanitary sewer to be incased ten feet on either side of proposed water line if less than two feet of clearance under water line, see detail.
  - Proposed water line to be directional drilled under existing masonry wall.
  - No pipe joints within five feet of masonry wall.

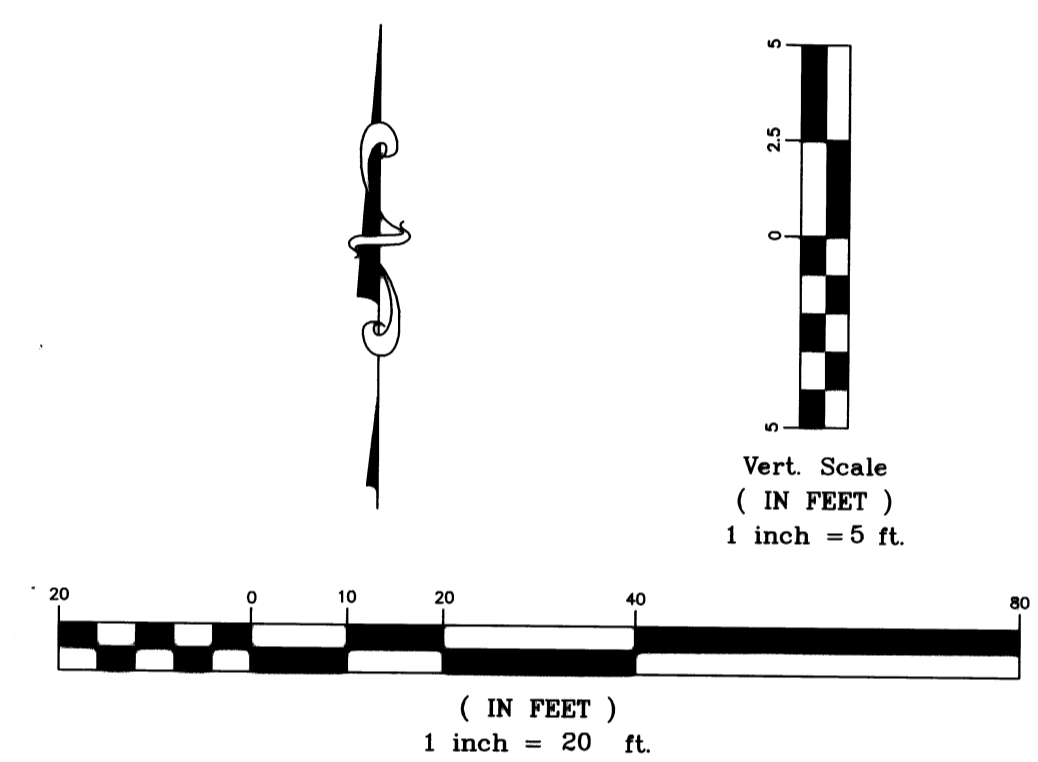

**Buffet City  
Water Line  
Wichita, Kansas**

PROJECT NUMBER

<b>kemiller</b> <i>engineering</i>	KEM NO. 10051	FILE plan	DATE 05/19/2010	SHEET 2
	DESIGN KM	DRAWN NS	REVISED	OF 3

516 S. Market,  
Wichita, KS 67202      316/264-0242