


BY	DATE

The information shown on this drawing concerning type and location of underground utilities is not guaranteed to be accurate or all inclusive. The Contractor is responsible for making his own determinations as to type and location of underground utilities as may be necessary to avoid damage thereto.

This sheet designed by:

**HNTEB**  
 ARCHITECTS ENGINEERS PLANNERS

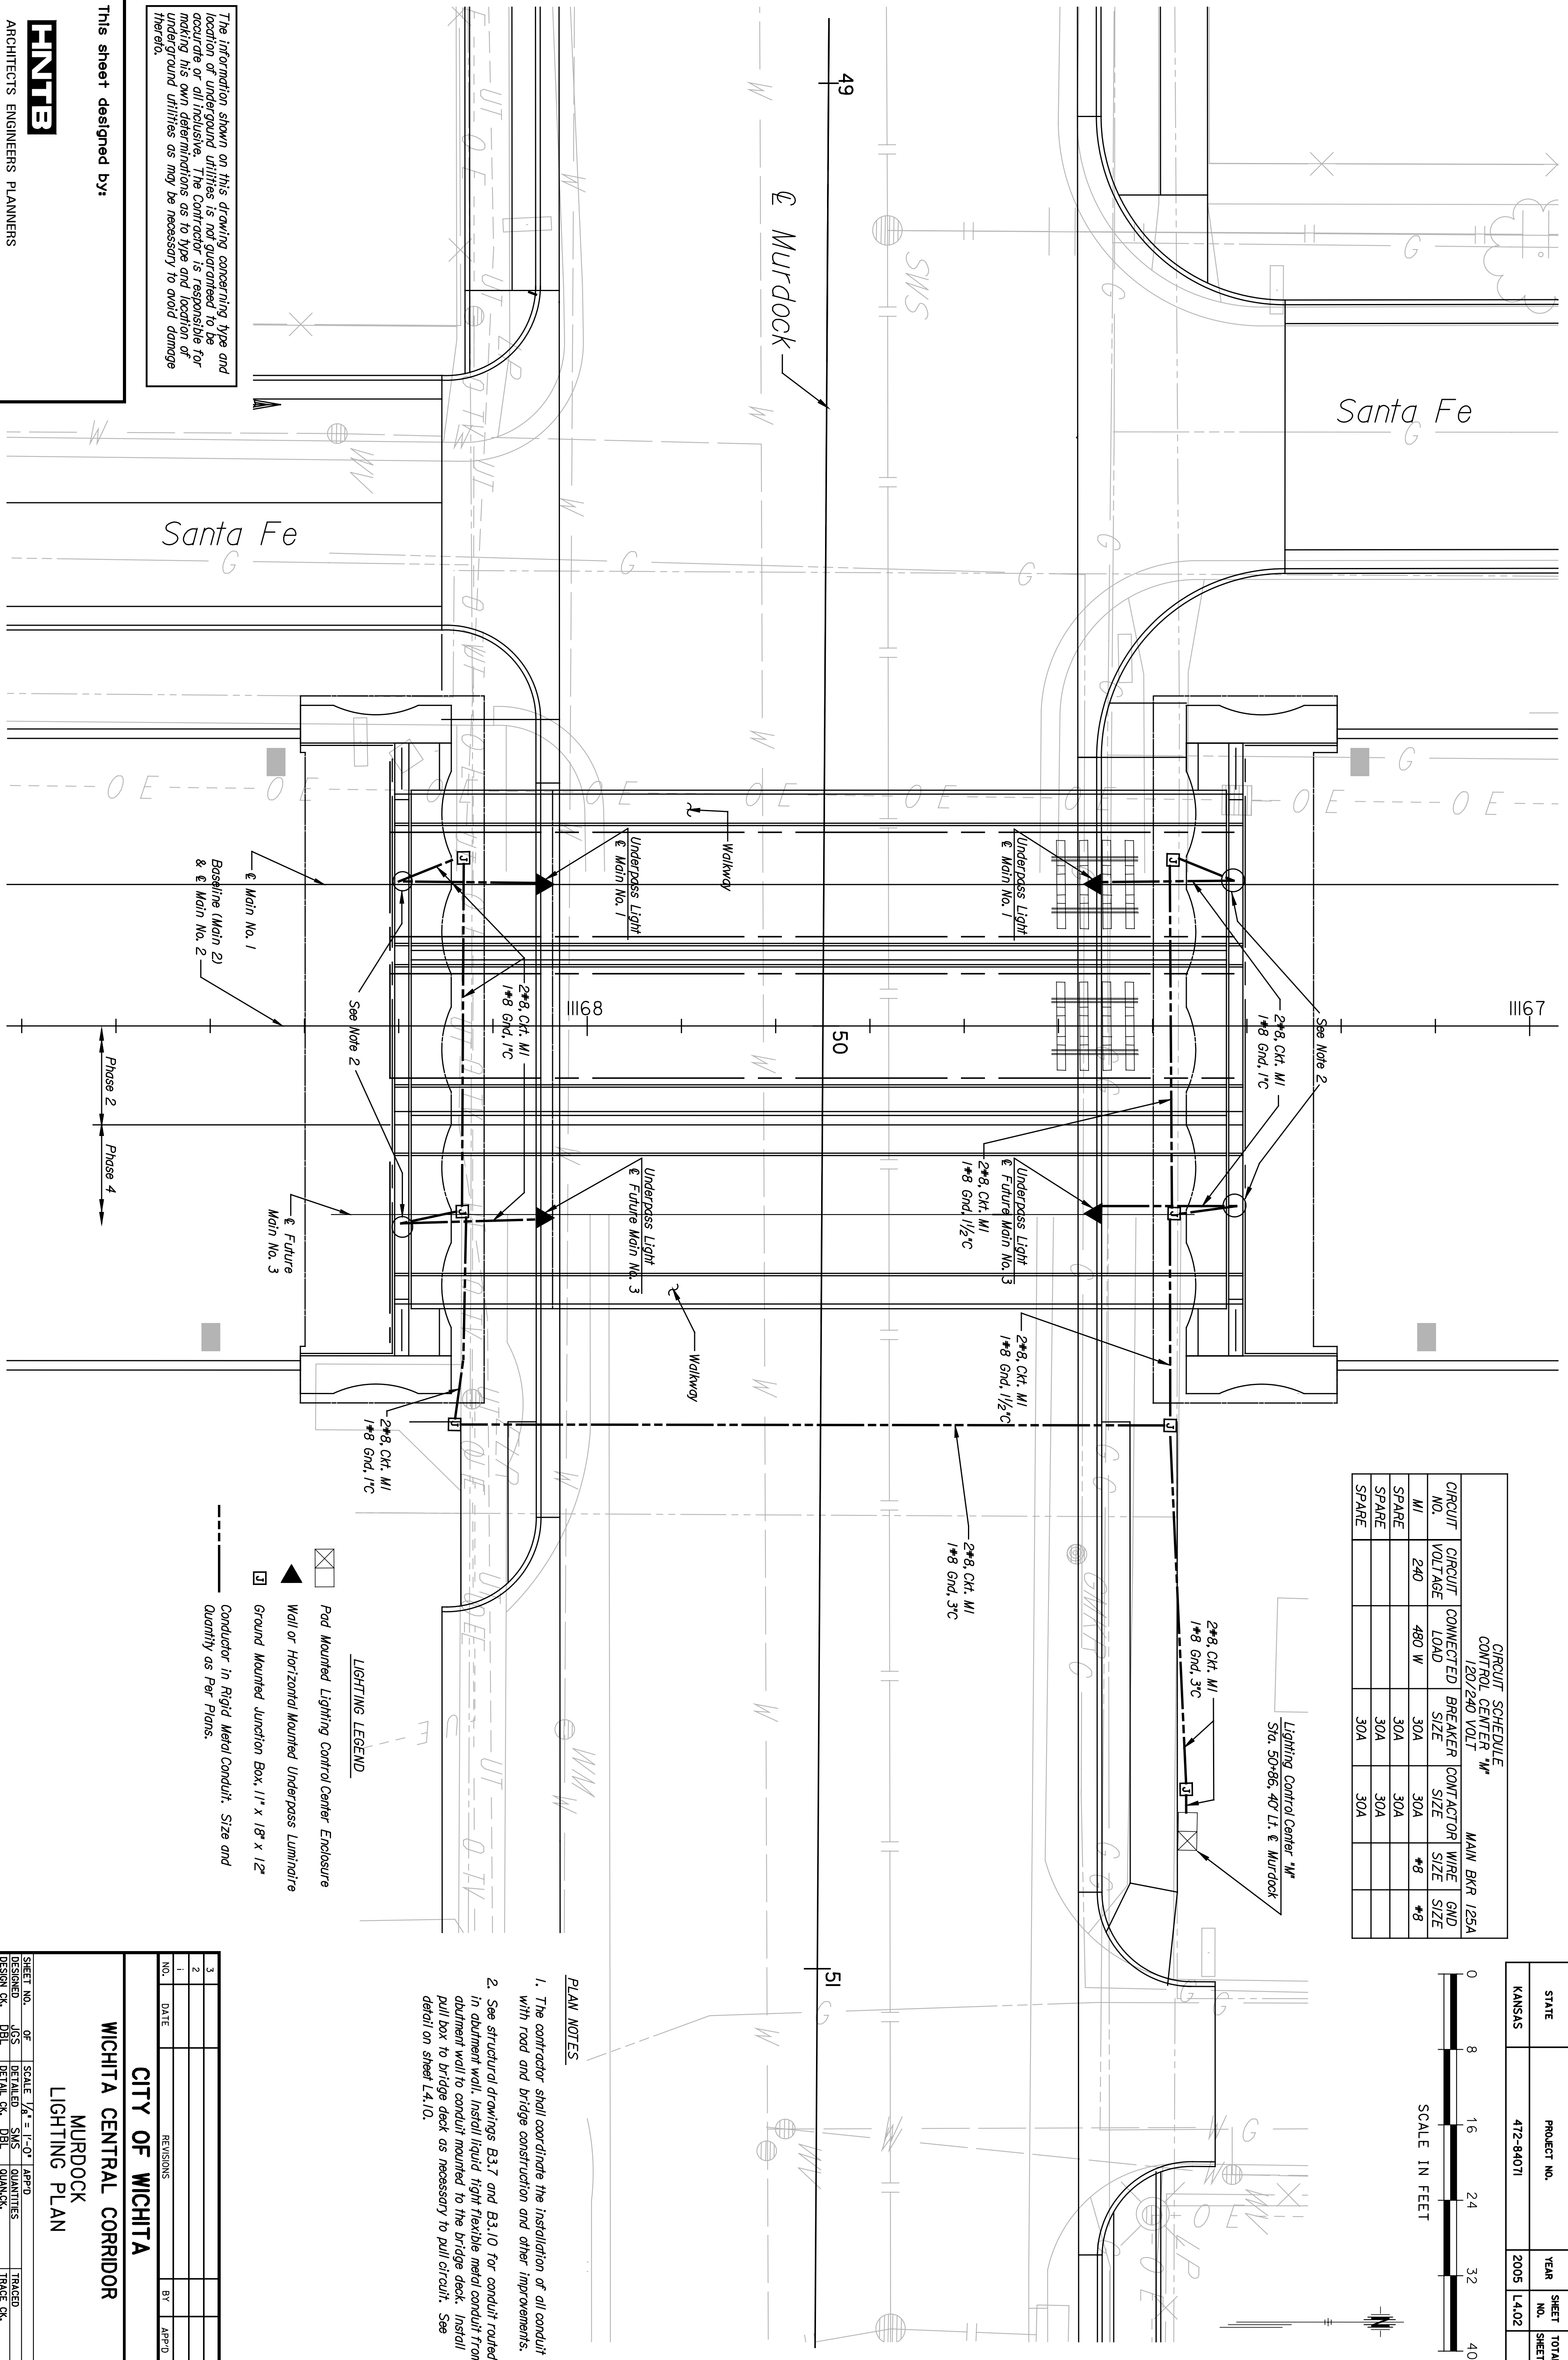

CIRCUIT SCHEDULE		CONTROL CENTER #1		MAIN BKR 125A	
CIRCUIT NO.	VOLTAGE	CONNECTED LOAD	BREAKER SIZE	CONDUCTOR SIZE	WIRE SIZE
MI	240	480 W	30A	30A	#8
SPARE			30A	30A	#8
SPARE			30A	30A	
SPARE			30A	30A	

STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
KANSAS	472-94071	2005	14.02	

SCALE IN FEET

**LIGHTING LEGEND**

- ☒ Pad Mounted Lighting Control Center Enclosure
- ◀ Wall or Horizontal Mounted Underpass Luminaire
- ◻ Ground Mounted Junction Box, 11" x 18" x 12" Quantity as Per Plans.
- Conductor in Rigid Metal Conduit, Size and Quantity as Per Plans.

**PLAN NOTES**

- The contractor shall coordinate the installation of all conduit with road and bridge construction and other improvements.
- See structural drawings B3.7 and B3.10 for conduit routed in abutment wall. Install liquid tight flexible metal conduit from abutment wall to conduit mounted to the bridge deck. Install pull box to bridge deck as necessary to pull circuit. See detail on sheet LA.10.

**CITY OF WICHITA**  
**WICHITA CENTRAL CORRIDOR**  
**MURDOCK LIGHTING PLAN**

SHEET NO.	OF	SCALE	V/A	1"=1'-0"	APP'D.
DESIGNED	UGS	DETAILS	SNS	QUANTITIES	TRACED
DESIGN CR.	DBL	DETAIL CR.	DBL	QUANT. CR.	TRACE CR.

REVISIONS	
NO.	DATE