


	BY	DATE

Plotted on: Tuesday, January 04, 2005 09:01
 dlutz Plot Queue: \\cbsw100\KC029049-P5
 Plot Scale: 8.000000h.000000 Pen Table: J:\29049\Library\plotpen\1fg-fullsize.pen
 Design Filename: \\kcw30\elec\29049\Dwg\cads Plan C Base\2nd street lighting01.dgn

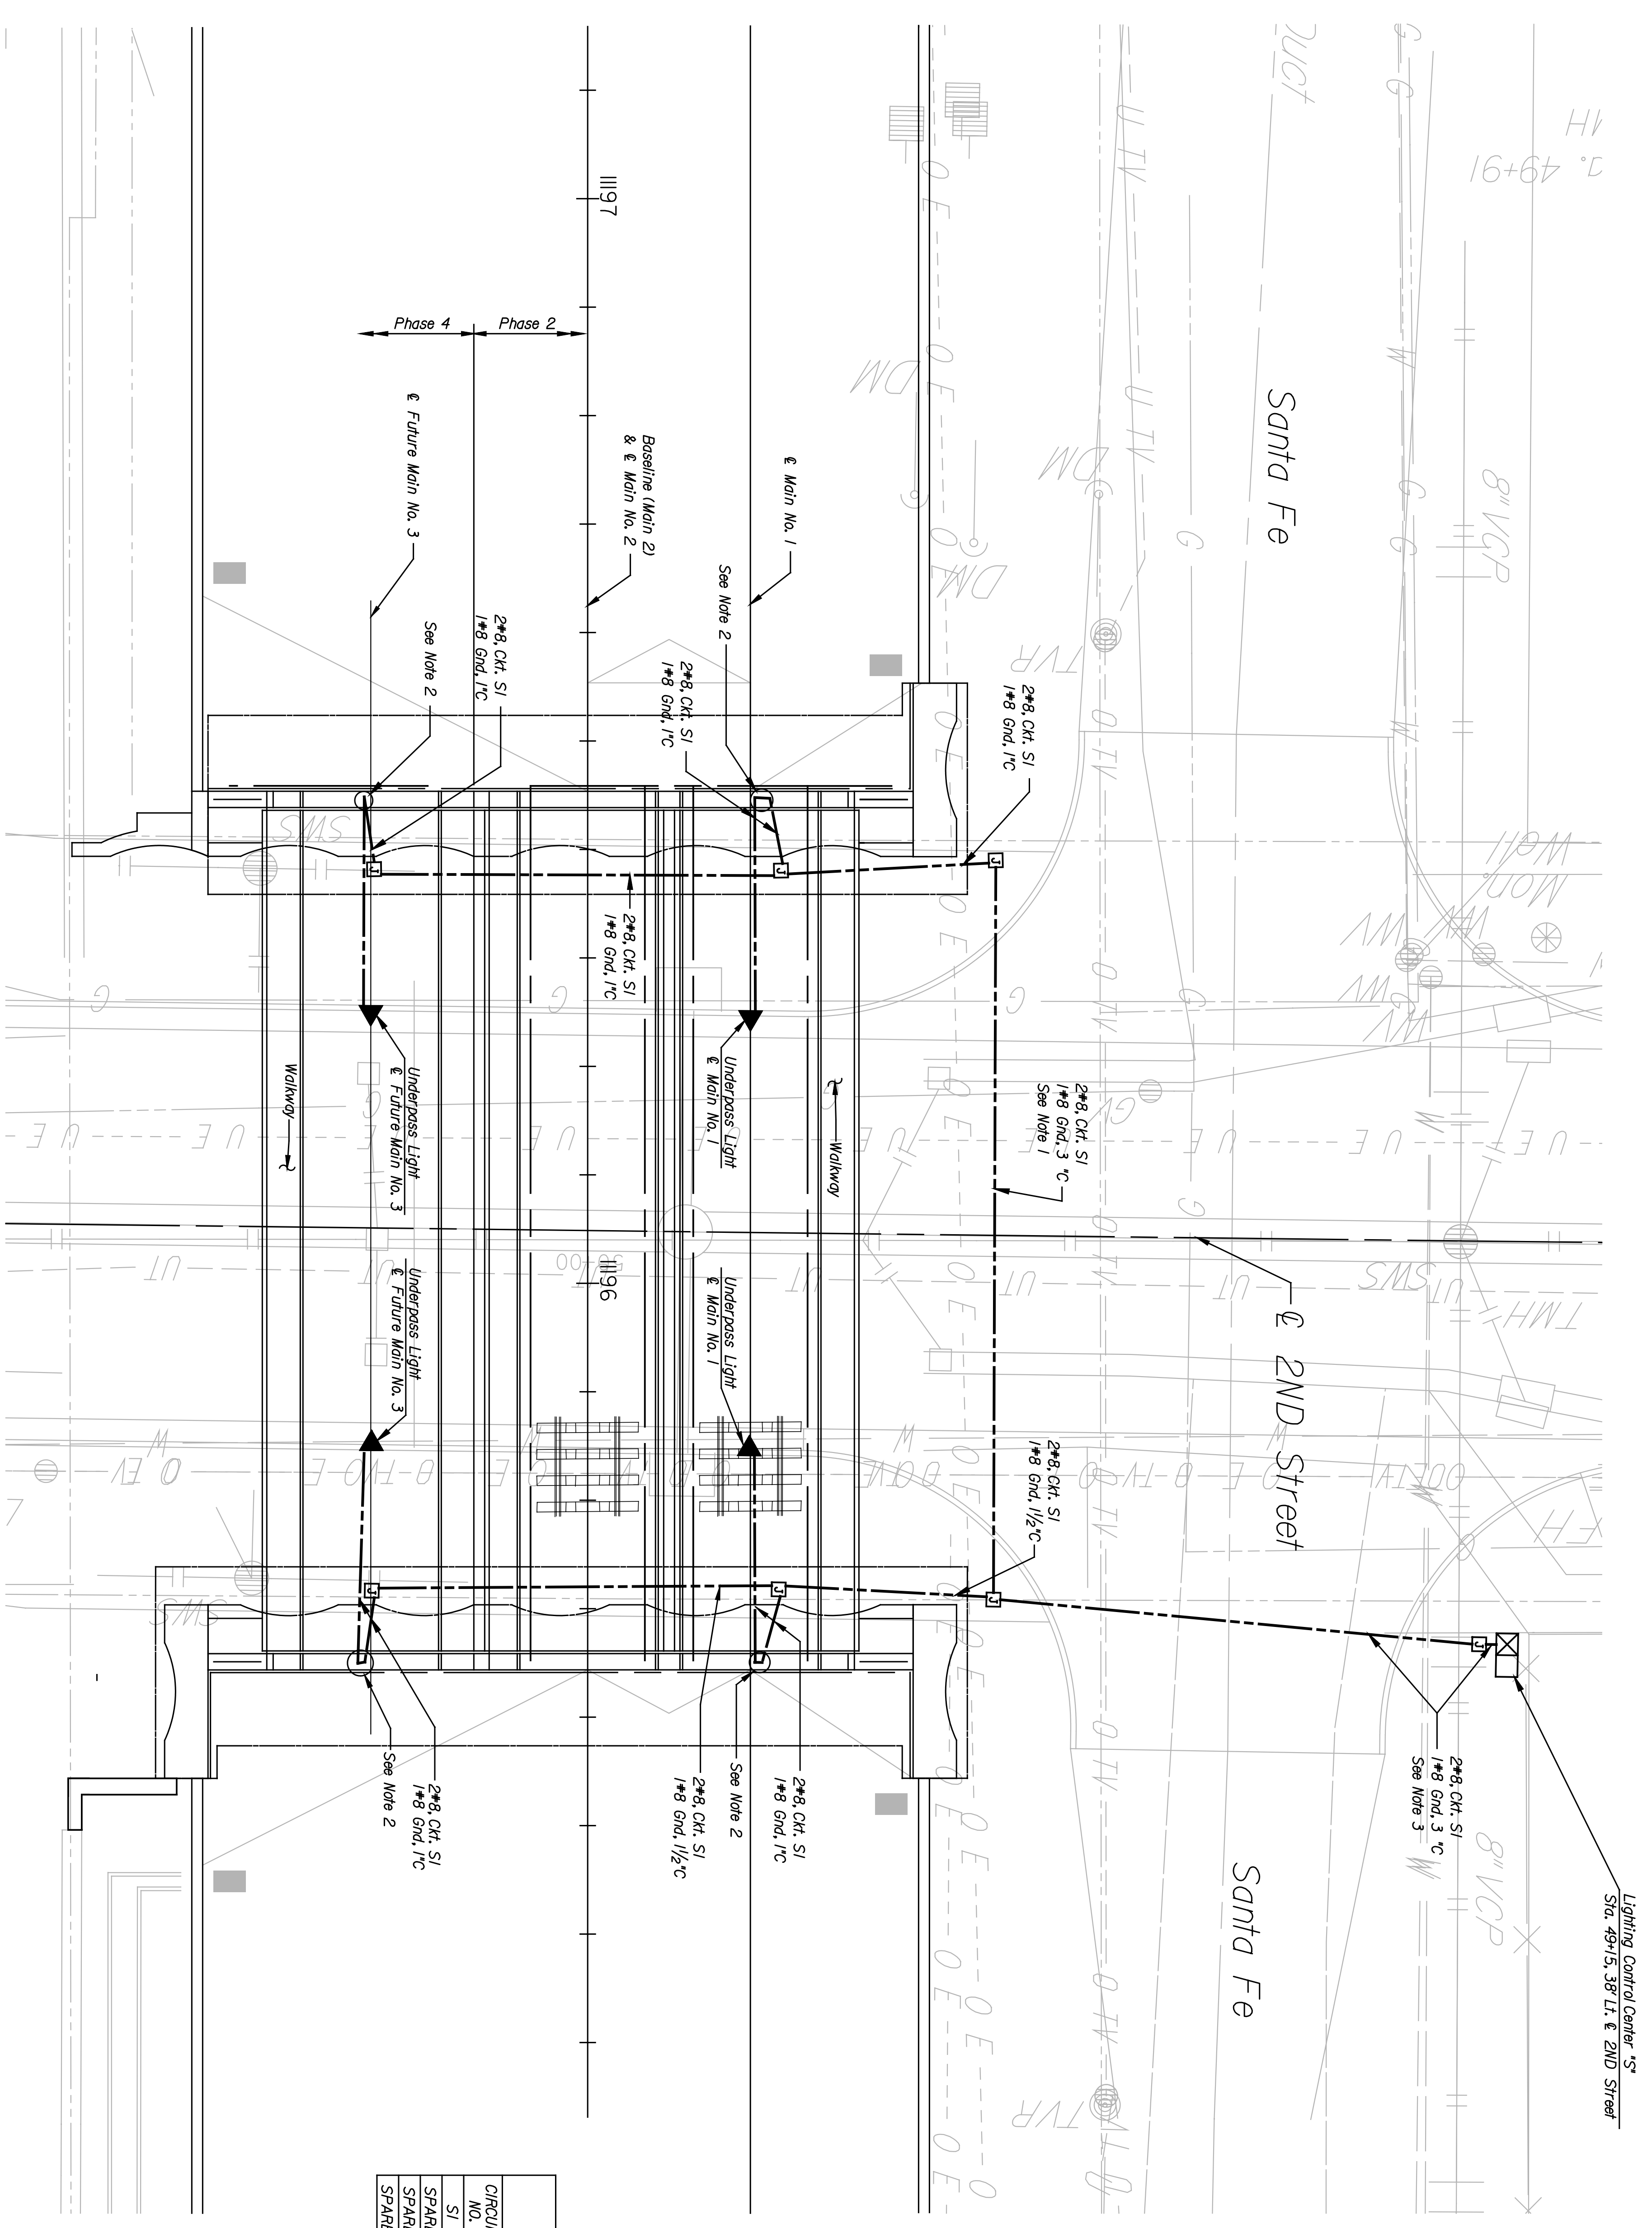

STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
KANSAS	472-94071	2005	14.04	


LIGHTING LEGEND

- ☒ Pad Mounted Lighting Control Center Enclosure
- ▲ Wall or Horizontal Mounted Underpass Luminaire
- ☐ Ground Mounted Junction Box, 11" x 18" x 12" Quantity as Per Plans.
- Conductor in Rigid Metal Conduit. Size and Quantity as Per Plans.

PLAN NOTES

1. Bore 3" RGS conduit under 2nd Street. The Contractor shall coordinate installation with other improvements.
2. See structural drawings B5.7 and B5.10 for conduit routed in abutment wall. Install liquid tight flexible metal conduit from abutment wall to conduit mounted to the bridge deck. Install pull box to bridge deck as necessary to pull circuit. See detail on sheet L4.10.

CIRCUIT SCHEDULE		CONTROL CENTER S*		MAIN BKR 125A	
CIRCUIT NO.	CIRCUIT VOLTAGE	CONNECTED LOAD	BREAKER SIZE	CONDUCTOR SIZE	WIRE GND SIZE
SI	240	480 W	30A	30A	#8
SPARE			30A	30A	#8
SPARE			30A	30A	
SPARE			30A	30A	

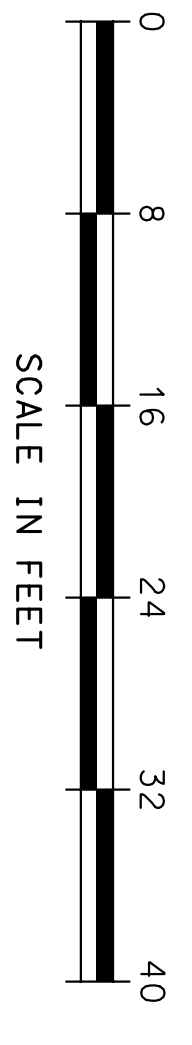

CITY OF WICHITA
WICHITA CENTRAL CORRIDOR
2ND STREET LIGHTING PLAN

SHEET NO.	OF	SCALE	V.A.	1"=1'-0"	APP'D.	TRACED
DESIGNED	UGS	DETAILS	SMS	QUANTITIES		
DESIGN CR.	DBL	DETAIL CR.	DBL	QUANT. CR.		

REVISIONS:

NO.	DATE	BY	APP'D.
1			
2			
3			

This sheet designed by:
HNTEB
 ARCHITECTS ENGINEERS PLANNERS

The information shown on this drawing concerning type and location of underground utilities is not guaranteed to be accurate or all inclusive. The Contractor is responsible for making his own determinations as to type and location of underground utilities as may be necessary to avoid damage thereto.