


BY	DATE

Lighting Control Center - "D"
Sta. 11210+32.47.5' Lt. & Main No. 2

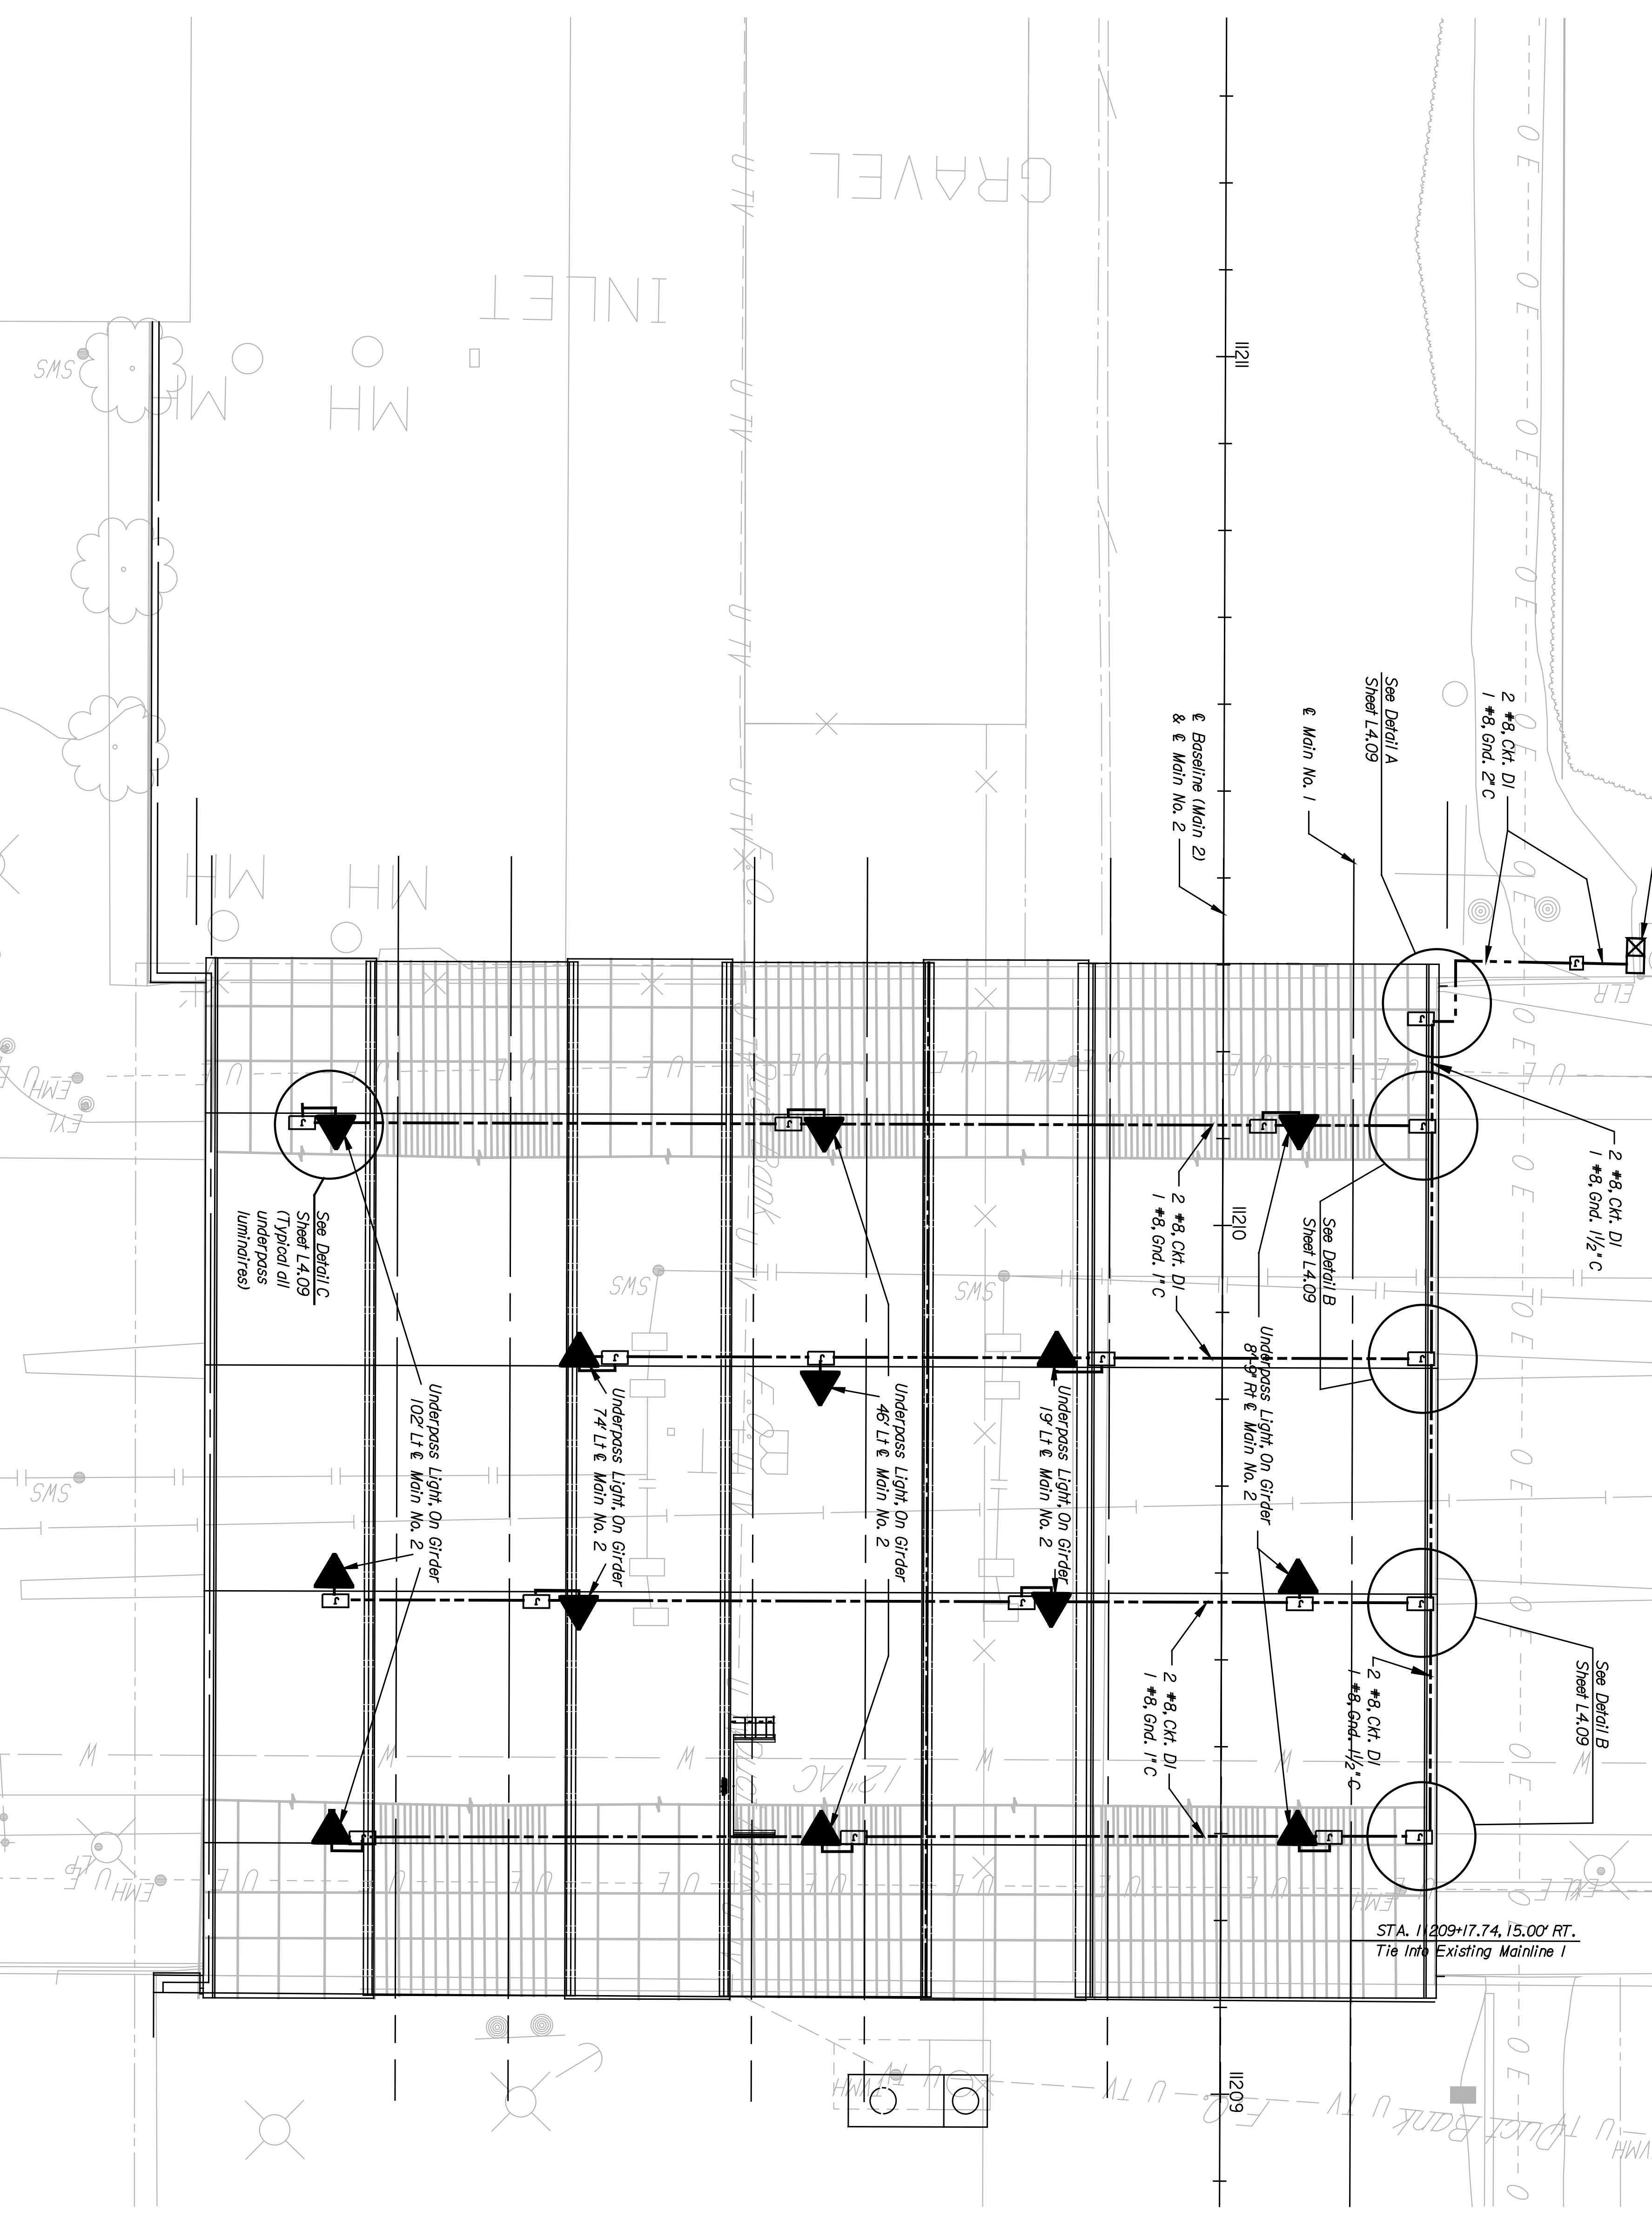

STA. 11209+17.74, 15.00' RT.
Tie Into Existing Mainline 1

PLAN NOTES
1. The contractor shall coordinate the installation of all conduit with bridge construction and other improvements.

- LIGHTING LEGEND**
- ☒ Pad Mounted Lighting Control Center Enclosure
 - ▲ Wall or Horizontal Mounted Underpass Luminaire
 - ▣ Ground Mounted Junction Box, 11" x 18" x 12" Conductor in Rigid Metal Conduit. Size and Quantity as Per Plans.

CIRCUIT SCHEDULE CONTROL CENTER "D" 120/240 VOLT						MAIN BKR 125A	
CIRCUIT NO.	CIRCUIT VOLTAGE	CONNECTED LOAD	BREAKER SIZE	CONTRACTOR SIZE	WIRE SIZE	GND SIZE	
DI	240	1300 W	30A	30A	#8	#8	
SPARE			30A	30A			
SPARE			30A	30A			
SPARE			30A	30A			

This sheet designed by:
PNTB
ARCHITECTS ENGINEERS PLANNERS

The information shown on this drawing concerning type and location of underground utilities is not guaranteed to be accurate or all inclusive. The Contractor is responsible for making his own determinations as to type and location of underground utilities as may be necessary to avoid damage thereto.

NO.	DATE	REVISIONS	BY	APP'D.
3				
2				
1				

CITY OF WICHITA
WICHITA CENTRAL CORRIDOR
DOUGLAS AVENUE
LIGHTING PLAN

SHEET NO. OF	DESIGNED	SCALE	DATE	TRACED
1	JES	3/4" = 1'-0"	01/04/05	
	DBL			

STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
KANSAS	472-84071	2005	14.06	