



STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
KANSAS	54-87-8258-01	2007	332	556

DATE	
BY	
REFERENCE NOTED	
REFERENCE CHECKED	

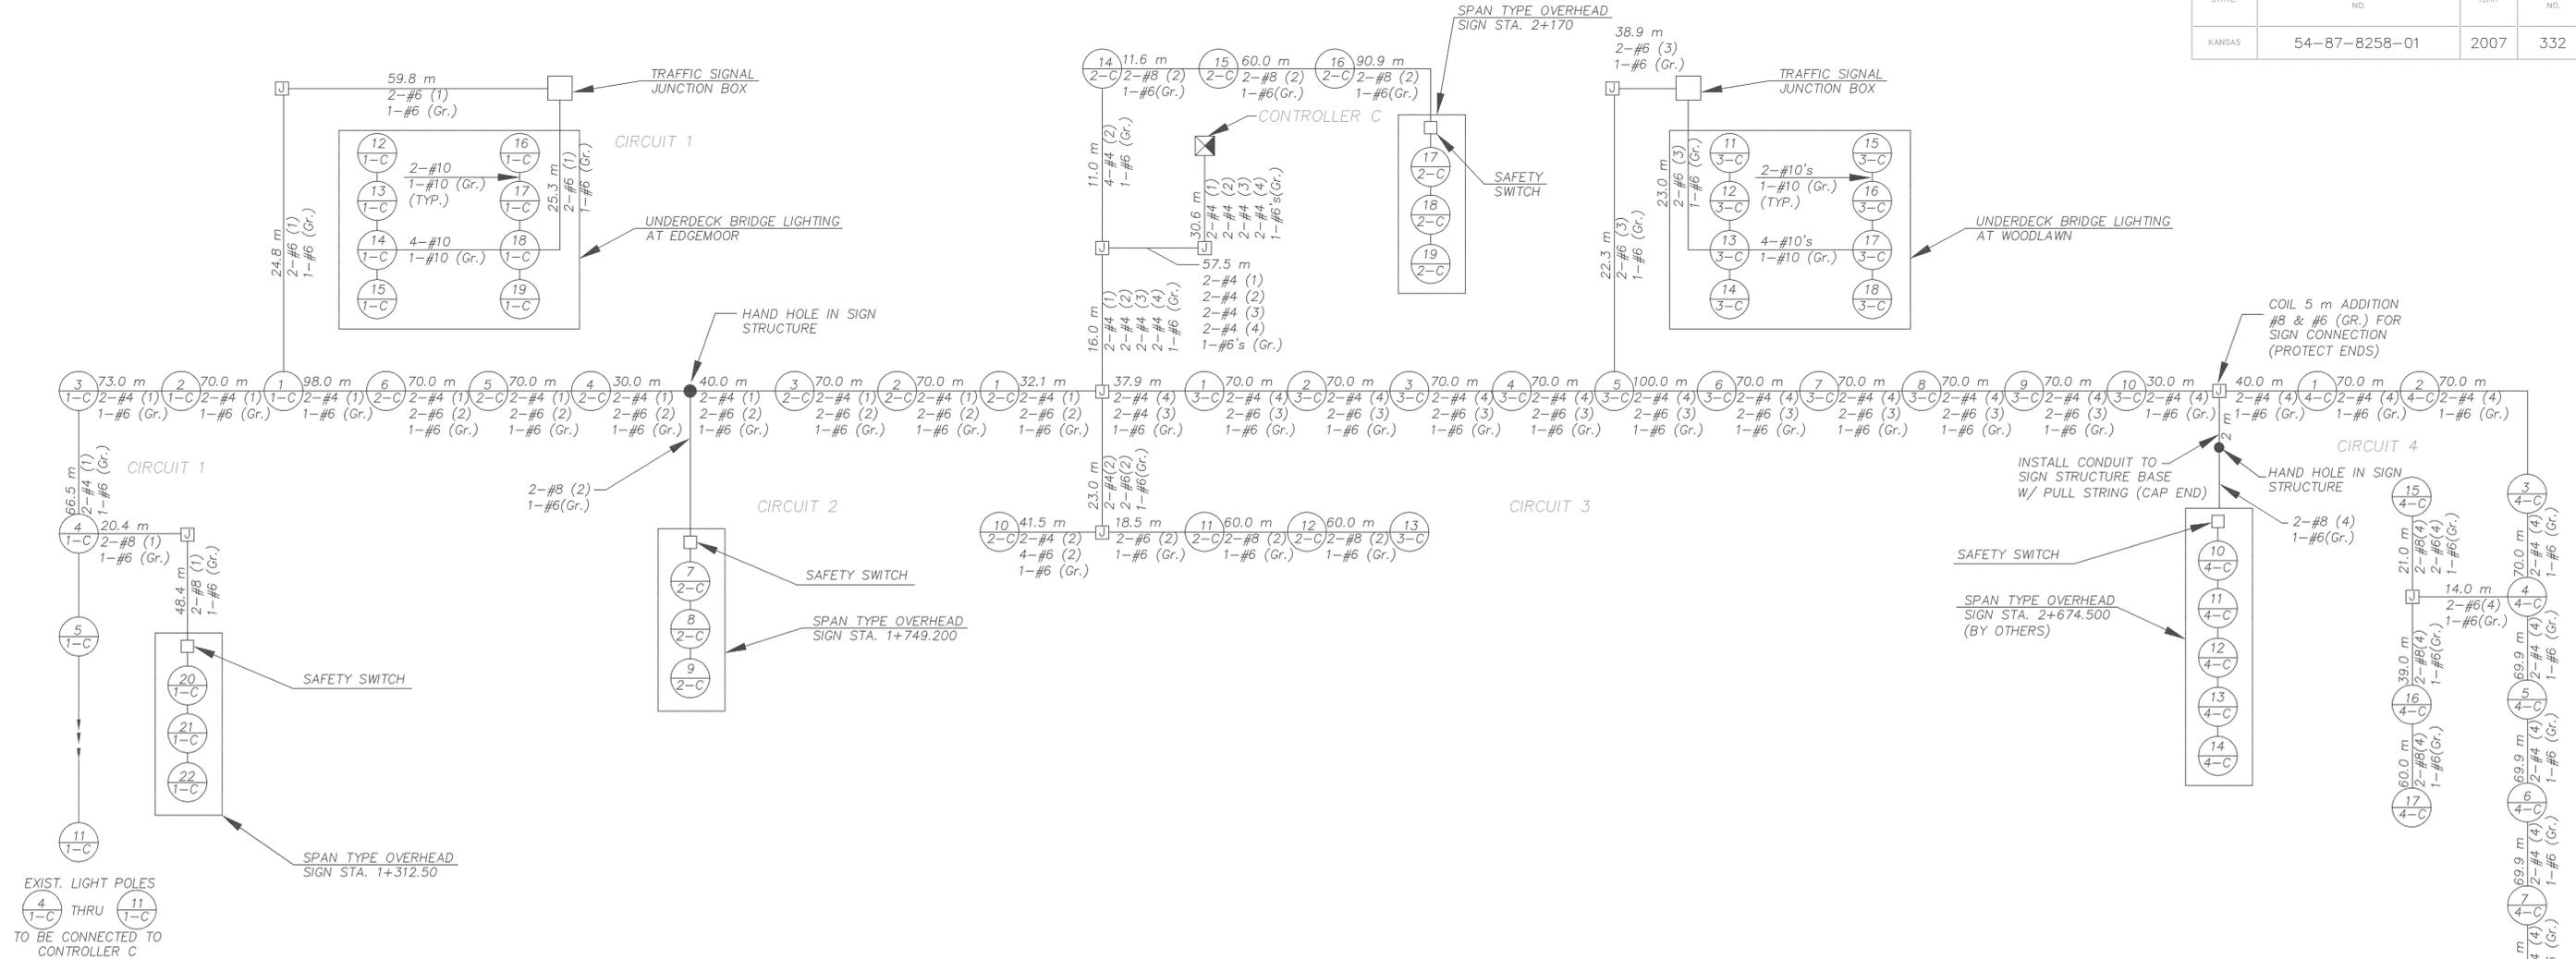

LEGEND

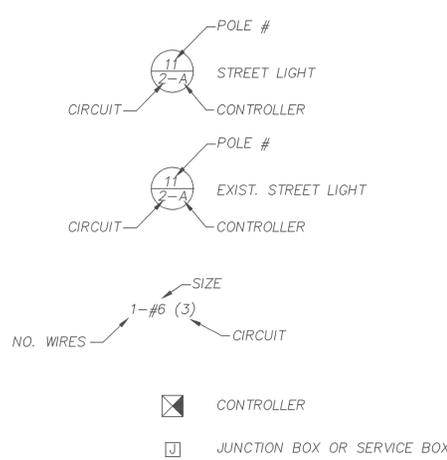

**CONTROLLER C
SCHEMATIC WIRING DIAGRAM
NTS**

Wiring Notes:

1. All wiring runs shall be enclosed in 50 mm PVC or HDPE Schedule 40 housing conduit. Bends and fittings shall be subsidiary.
2. No splices shall be allowed between consecutive poles for each circuit, except grounding wires which may be spliced at Junction and Service boxes.
3. Lengths shown per plan distance. Additional length to accommodate bends, risers, coils and connections shall be subsidiary.

NOTE: Controller C was installed and lighting constructed (except at east end) with Woodlawn Interchange.

Drawn by: M220
Plotted: SCALE