
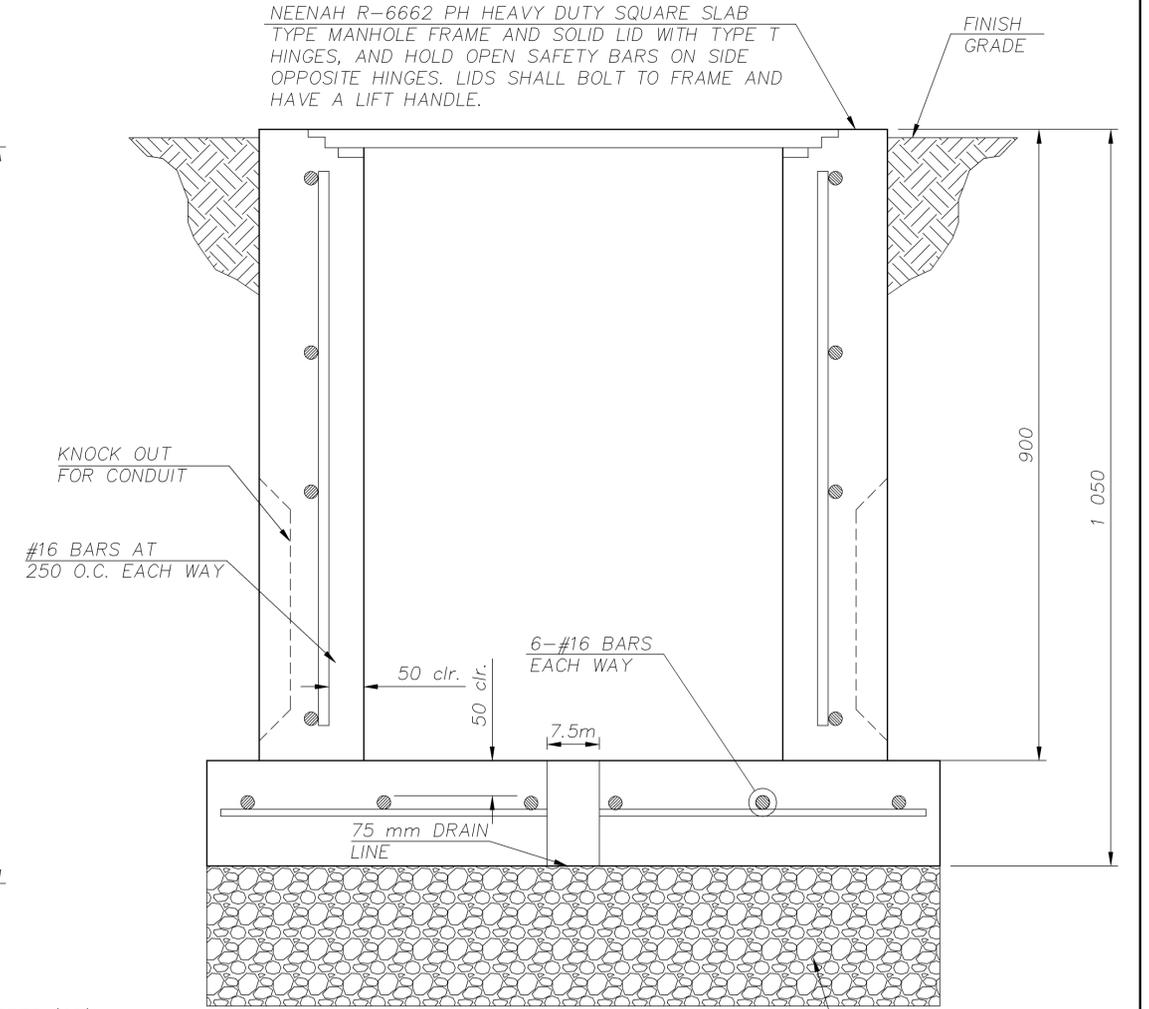
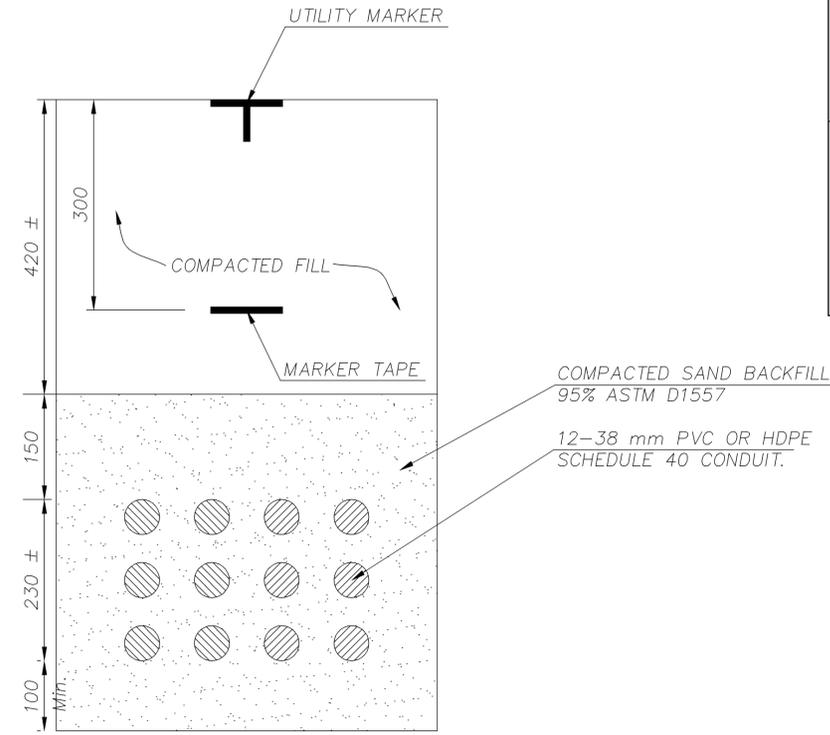


STATE	PROJECT NO.	YEAR	SHEET NO.	TOTAL SHEETS
KANSAS	54-87 K-8258-01	2007	340	556

DATE	
BY	
REFERENCE NOTED	
REFERENCE CHECKED	

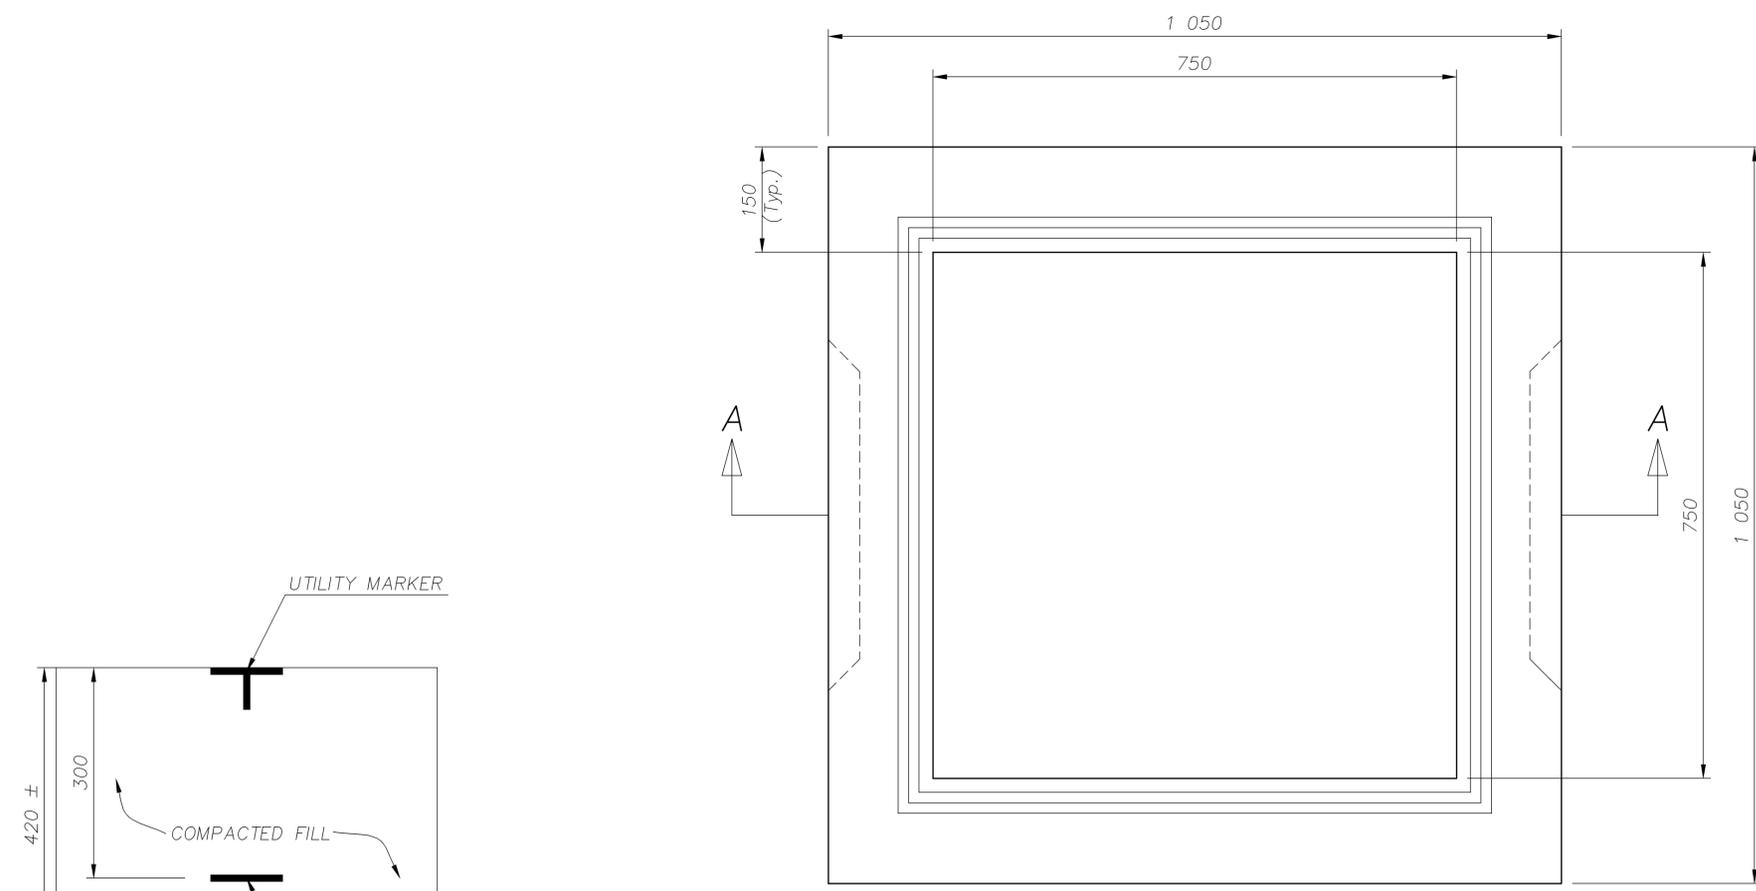

TOP VIEW

SECTION "A-A"

COMMUNICATION DUCT SERVICE BOX

- NOTES:
1. USE GRADE 31 CONCRETE (AE).
 2. REINFORCING STEEL SHALL BE DEFORMED REINFORCING BARS IN COMPLIANCE WITH THE REQUIREMENTS OF ASTM A615M, GRADE 420.

200 mm min. layer of 13 mm clean crushed rock as approved by the Engineer

DUCT BANK DETAIL

NOTE:
THE CONTRACTOR SHALL CONSTRUCT THE 12 CONDUIT DUCT BANK AT THE LOCATIONS SHOWN ON THE PLANS. THE VERTICAL ELEVATION OF THE DUCT BANK SHALL BE ADJUSTED BY THE CONTRACTOR AS APPROVED BY THE ENGINEER TO CLEAR UTILITIES. THIS WORK SHALL BE INCLUDED IN THE LUMP SUM PRICE BID FOR ELECTRIC LIGHTING SYSTEM. THE BID PRICE SHALL INCLUDE ALL MATERIALS, TOOLS, LABOR EQUIPMENT, PULL BOXES AND INCIDENTALS NECESSARY TO COMPLETE THE WORK.

NO.	DATE	REVISIONS	BY	APP'D.

COMMUNICATION DUCT SERVICE BOX & DUCT BANK DETAIL

CFS Cook, Flatt & Strobel
ENGINEERS, P.A.