
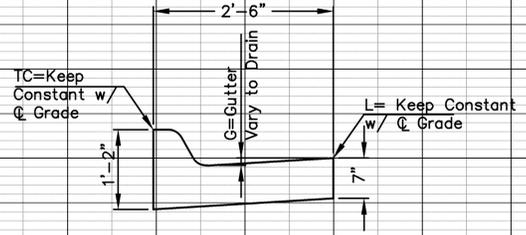
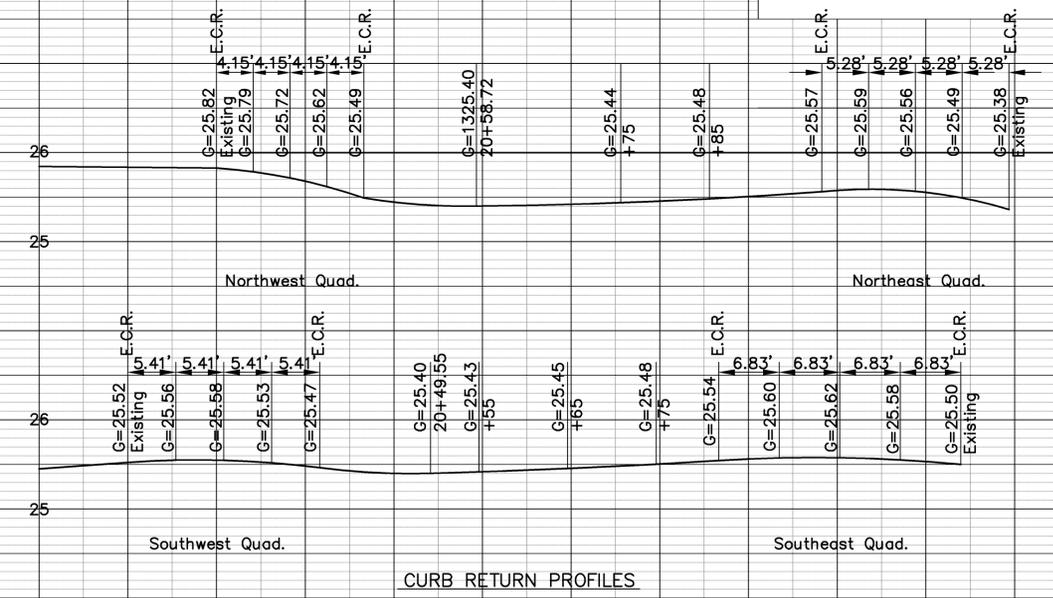


PROFILE
 SURVEIL. BY
 NOTE BOOK NO.
 ALIGNMENT CHECKER
 RT. OF WAY CHECKER

PROFILE
 SURVEIL. BY
 NOTE BOOK NO.
 GRADES CHECKER
 BK'S NOTES
 STRUCTURE DIMENSIONS CHECKER

J:\2008Proj\08566\DWG\08566T.dwg 7/20/2010 7:28am jmartin

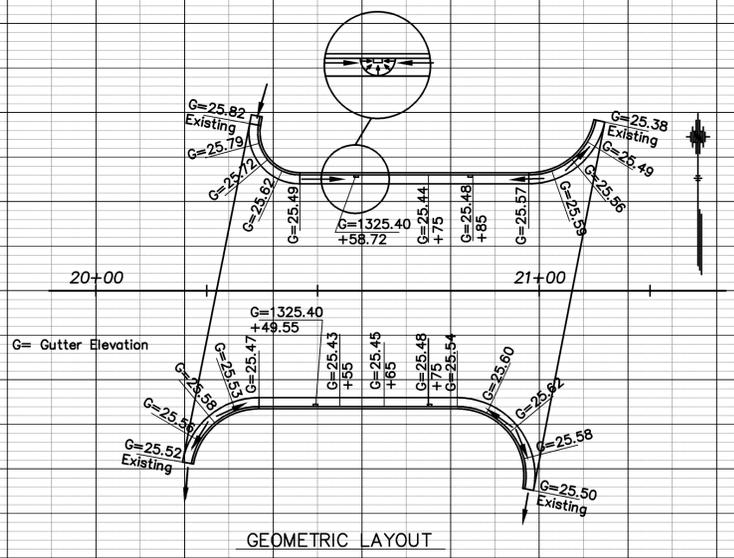


Note: The distance from the lip of the curb & gutter to the top of curb and gutter shall remain constant. Drainage will be controlled by sloping the gutter line.

- * 149 Cu. Yds. Common Excavation (V.M.F.=0.75)
- ** 68 Cu. Yds. Rock Excavation
- 42 Cu. Yds. Embankment

- * Includes 80 Cu. Yds. from channel improvement. 93 Cu. Yds. shall be wasted in an area provided by the Contractor and approved by Engineer.
- ** Rock Excavation consists of existing asphalt/concrete surfacing, concrete curb & gutter and sidewalks which shall be wasted in an area provided by the Contractor and approved by the Engineer.
- 210 Tons Combined Material (AB-3) for backfilling of Structure.

ALL DISPOSAL SITES MUST BE APPROVED BY THE KANSAS DEPARTMENT OF HEALTH AND ENVIRONMENT. MATERIAL EITHER STOCKPILED OR DISPOSED OF IN A FLOOD PLAIN WOULD REQUIRE A KANSAS STATE BOARD OF AGRICULTURE PERMIT. ANY MATERIAL DUMPED IN WATERS OF THE UNITED STATES OR WETLANDS IS SUBJECT TO U.S. CORPS OF ENGINEERS PERMITTING REGULATIONS.

ANY MATERIAL BURIED OR STOCKPILED BEYOND APPROVED CONSTRUCTION LIMITS WOULD REQUIRE ADDITIONAL ARCHEOLOGICAL INVESTIGATION UNLESS BURIED IN A PREVIOUSLY APPROVED BORROW LOCATION.

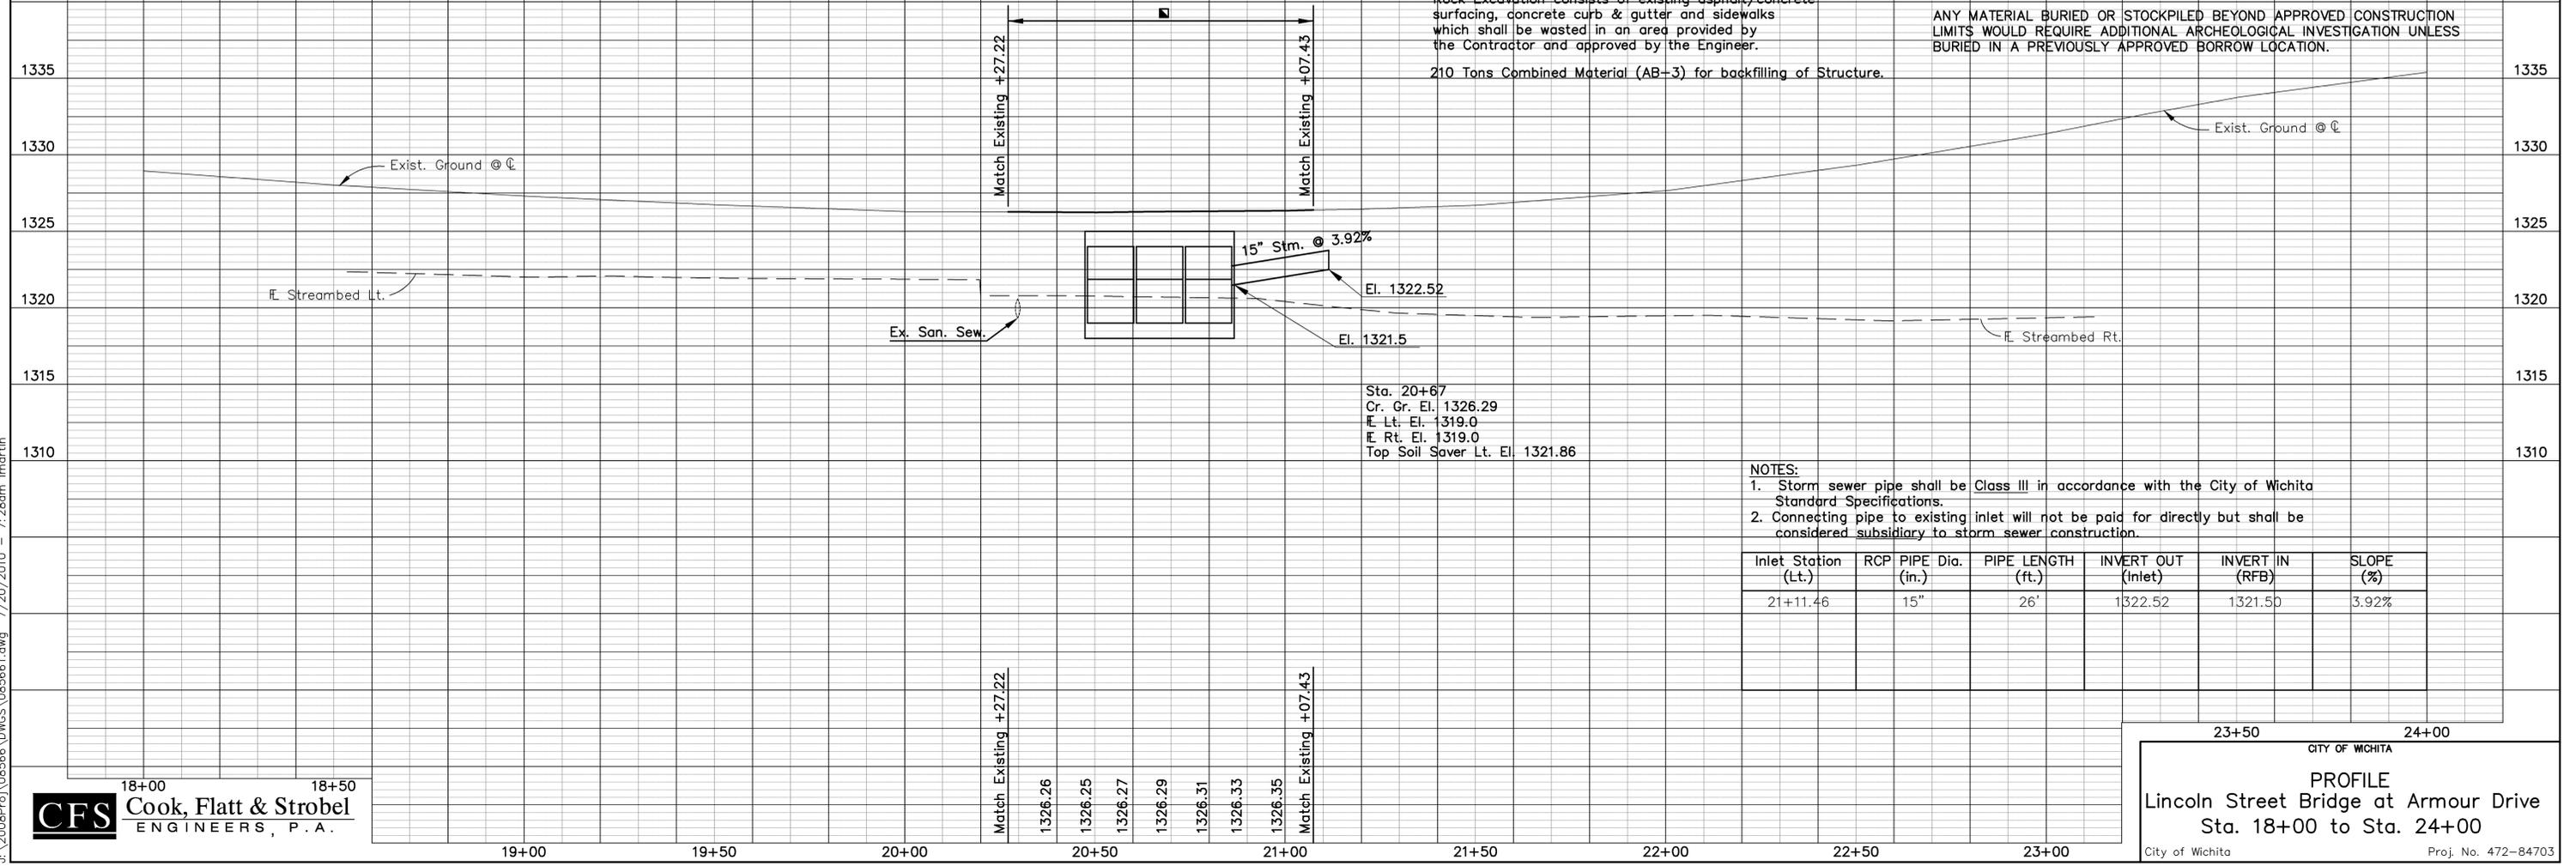

Sta. 20+67
 Cr. Gr. El. 1326.29
 Lt. El. 1319.0
 Rt. El. 1319.0
 Top Soil Saver Lt. El. 1321.86

- NOTES:
- Storm sewer pipe shall be Class III in accordance with the City of Wichita Standard Specifications.
 - Connecting pipe to existing inlet will not be paid for directly but shall be considered subsidiary to storm sewer construction.

Inlet Station (Lt.)	RCP PIPE Dia. (in.)	PIPE LENGTH (ft.)	INVERT OUT (Inlet)	INVERT IN (RFB)	SLOPE (%)
21+11.46	15"	26'	1322.52	1321.50	3.92%