
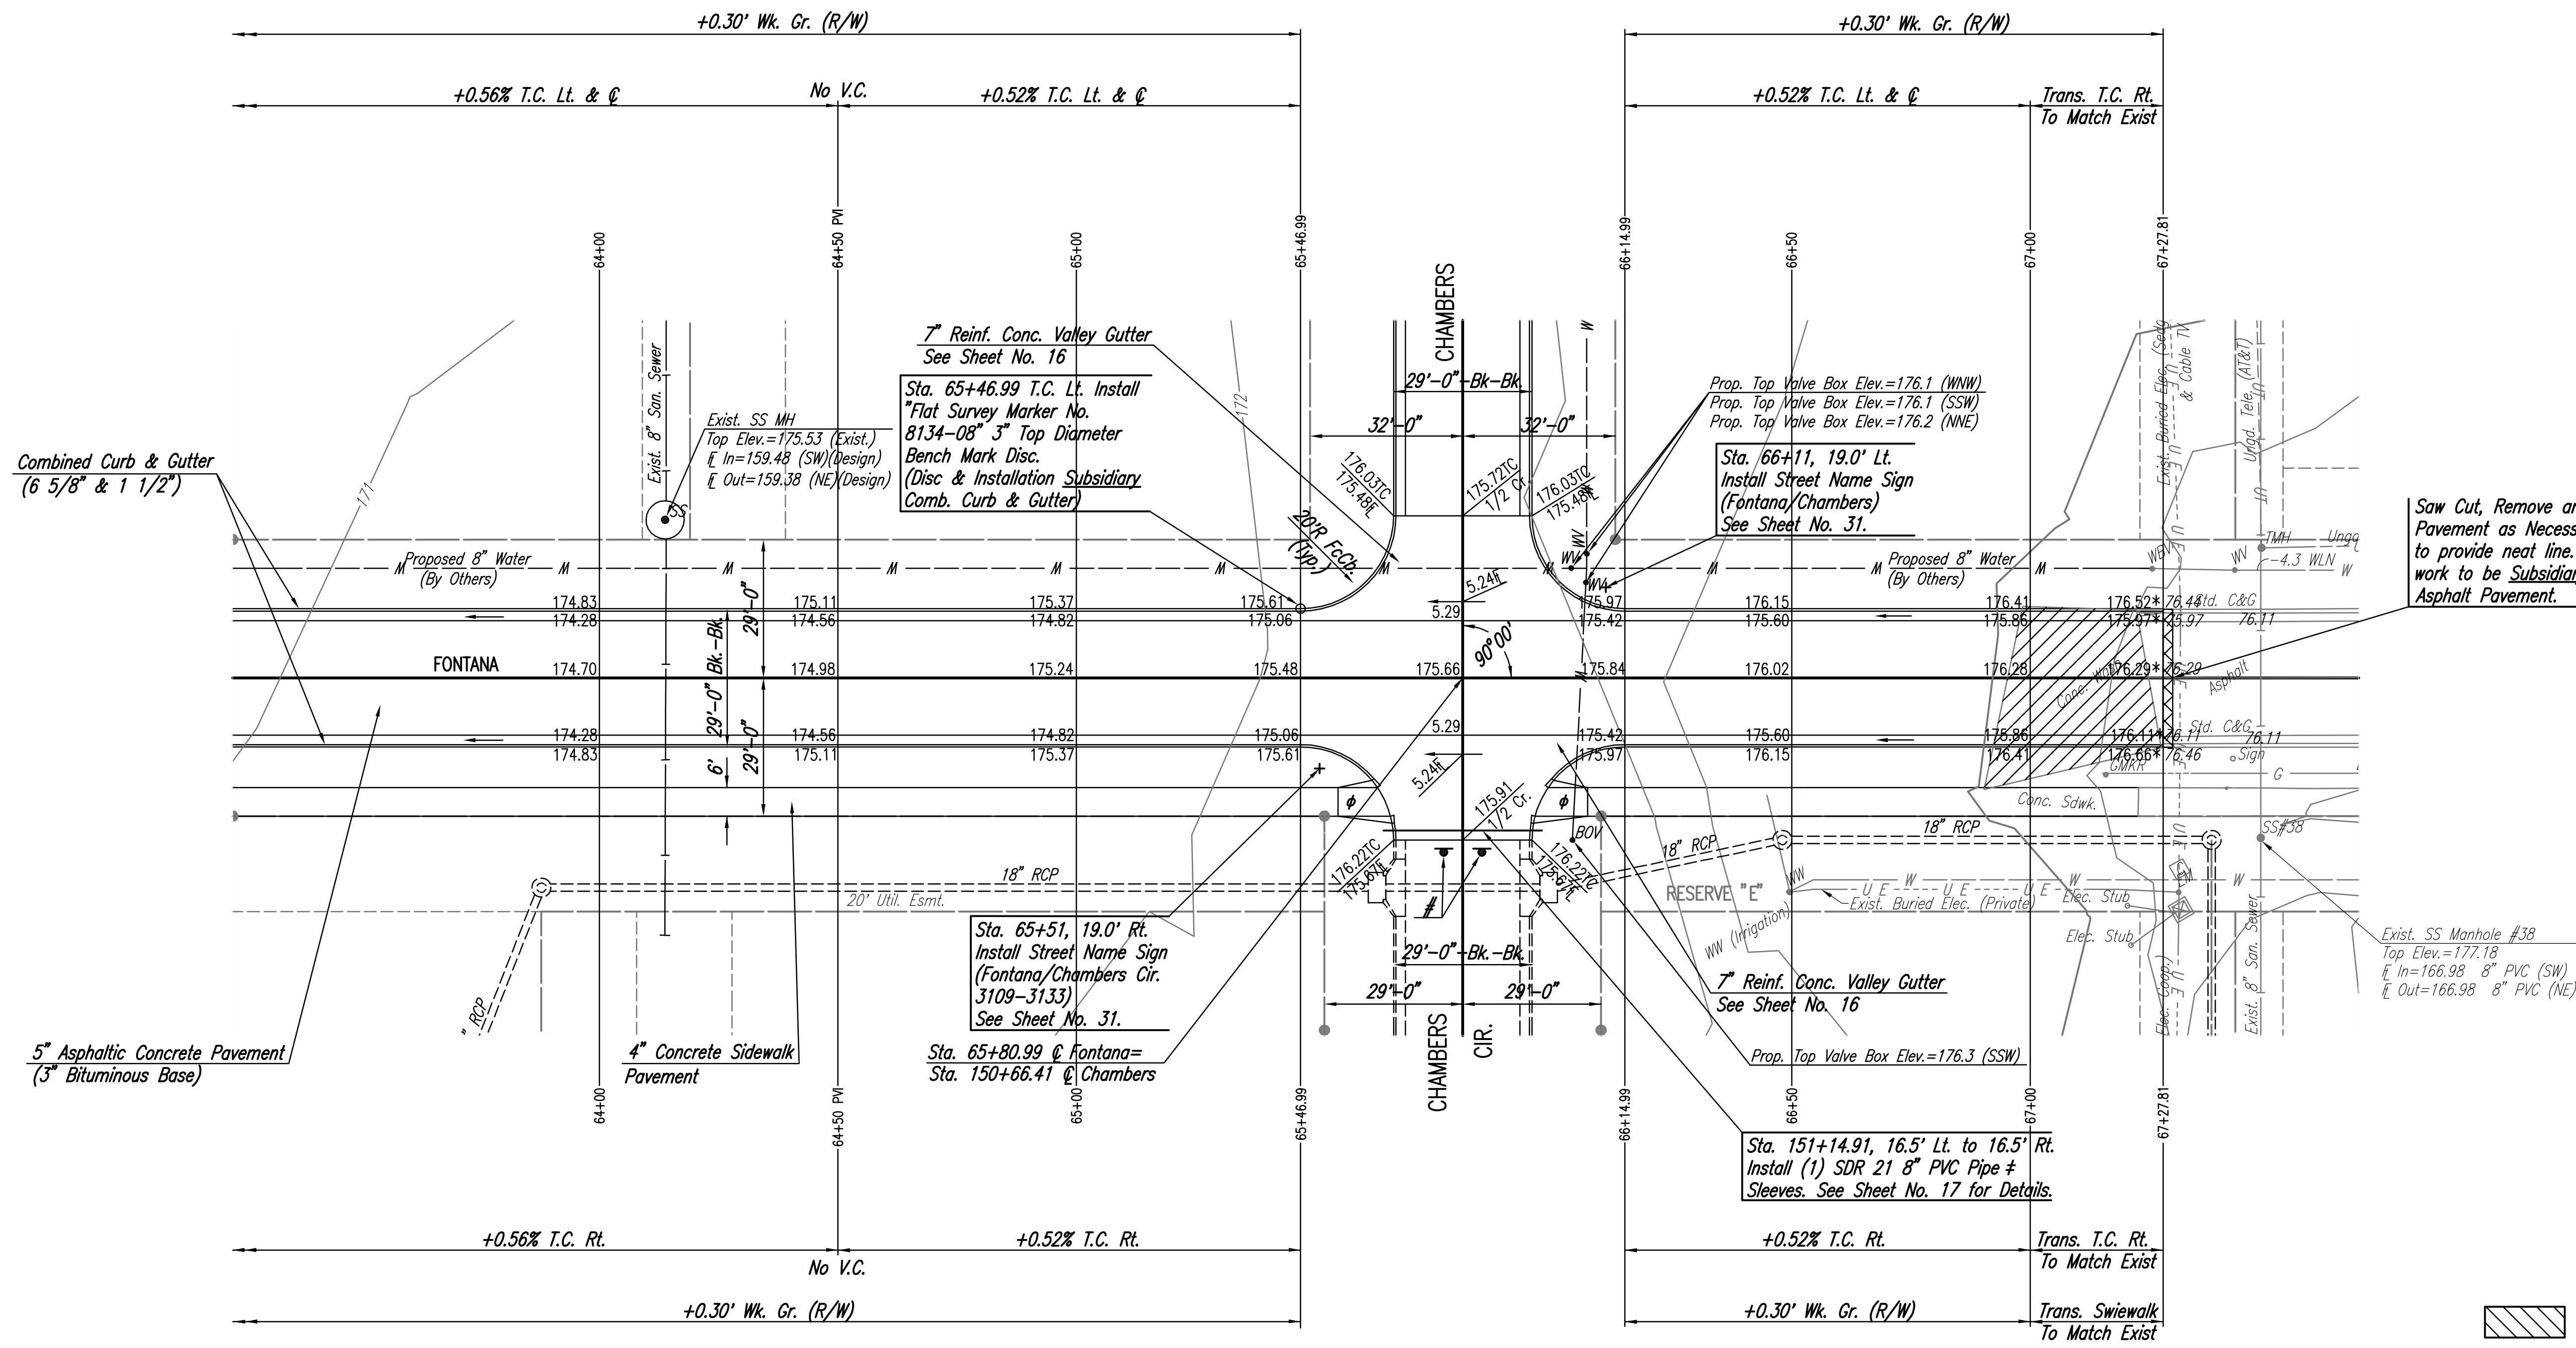


WATER VALVE BOX ELEVATIONS			
STREET	STATION	OFFSET	PROPOSED ELEVATION
FONTANA	66+03.73	23.0' Lt.	176.1
FONTANA	66+04.00	34.0' Rt.	176.3
FONTANA	66+06.84	20.0' Lt.	176.1
FONTANA	66+07.01	26.0' Lt.	176.2

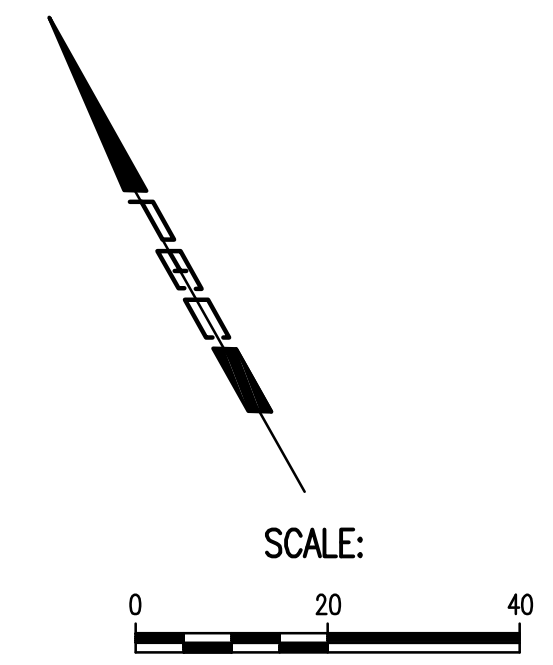


Saw Cut, Remove and Replace Pavement as Necessary to provide neat line. This work to be Subsidiary to Asphalt Pavement.

Exist. SS Manhole #38
Top Elev.=177.18
In=166.98 8" PVC (SW)
Out=166.98 8" PVC (NE)

- * Match Existing
- Pavement Removal (Subsidiary to "Site Restoration".)
- ♠ Construct Std. Wheelchair Ramp, See Sheet No. 17.
- ‡ Install Type OMA-3 (End of Roadway Marker See Sheet No. 31.)

‡ Sleeves to be 42" below top of curb.
Each end of 8" PVC pipe sleeves shall be capped and marked with steel "T" posts or 2" dia. steel pipe a maximum of 12" above finished grade. Pipe, caps, markers, and installation thereof shall be bid per linear foot of "8" PVC Pipe".



No.	Revision	By	Date
FONTANA 4TH ADDITION-PHASE 1			
FONTANA			
STA. 64+00 TO STA. 67+27.81			
JAMES L. ARMOUR, P.E.- CITY ENGINEER			
CITY OF WICHITA PROJ. NO. 472-84800			
Professional Engineering Consultants, P.A.			
303 S. TOPKA • WICHITA, KANSAS 67202			
316-262-2691 • FAX 316-262-3003			
Designed by	BMM	Job No.	35-08389-000
Drawn by	BJS	Date	July 2008
			Sheet 10 of 50

Saved 11-12-2010 11:56:24 AM by BJS
 Plot Scale 1:20 11-12-2010 2:26:59 PM by BILL J. SECKSON
 G:\2008\08389\000\08389-000-C-STR-64-67