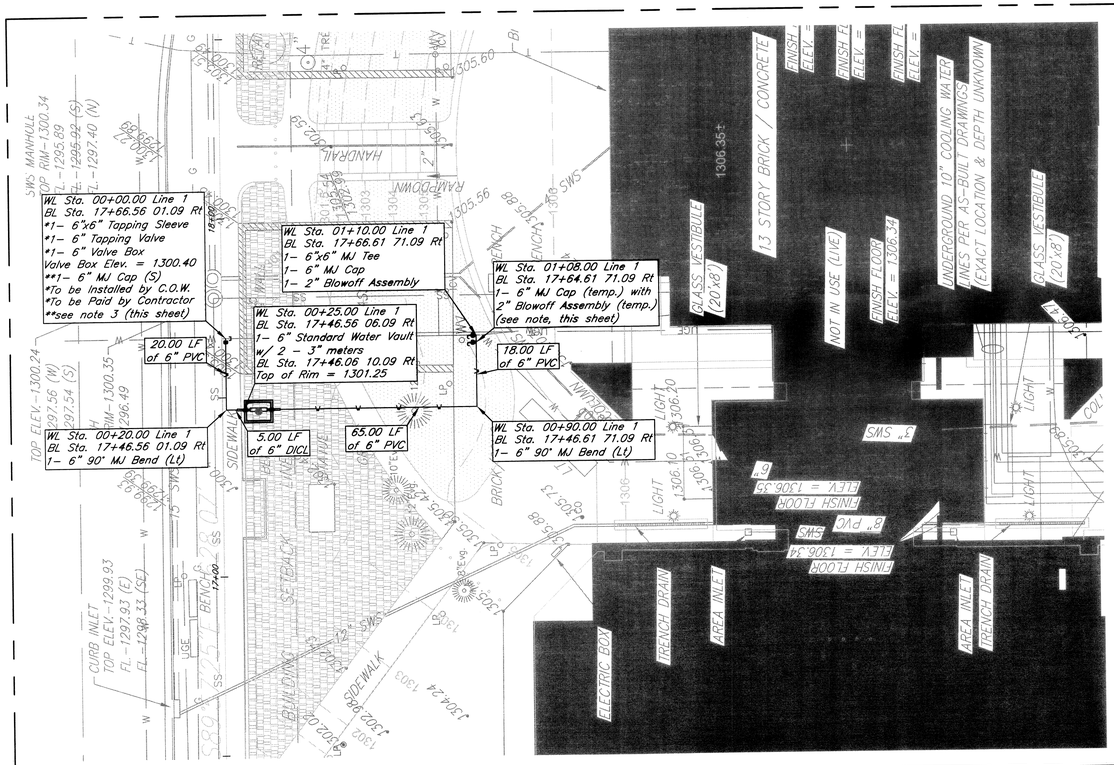

Notes:

1. *Temporary 6" MJ Cap with 2" Blowoff Assembly to be removed after proposed 6" line is flushed and tested.*
2. *Cut existing 6" water line and install 1- 6"x6" MJ Tee. 1- 6" MJ Cap with 2" Blowoff Assembly shall be located on north side of 6"x6" MJ Tee. Connect proposed 6" PVC into proposed 6"x6" MJ Tee with is connected to existing 6" water line.*
3. *Cut and cap existing 6" water line after testing and connecting at station 01+08.00.*
4. *Remove existing 6" water line between stations 00+00.00 and 01+08.00.*
5. *All Joints shall be restrained joints.*

Vert. Scale
(IN FEET)
1 inch = 5 ft.

(IN FEET)
1 inch = 20 ft.

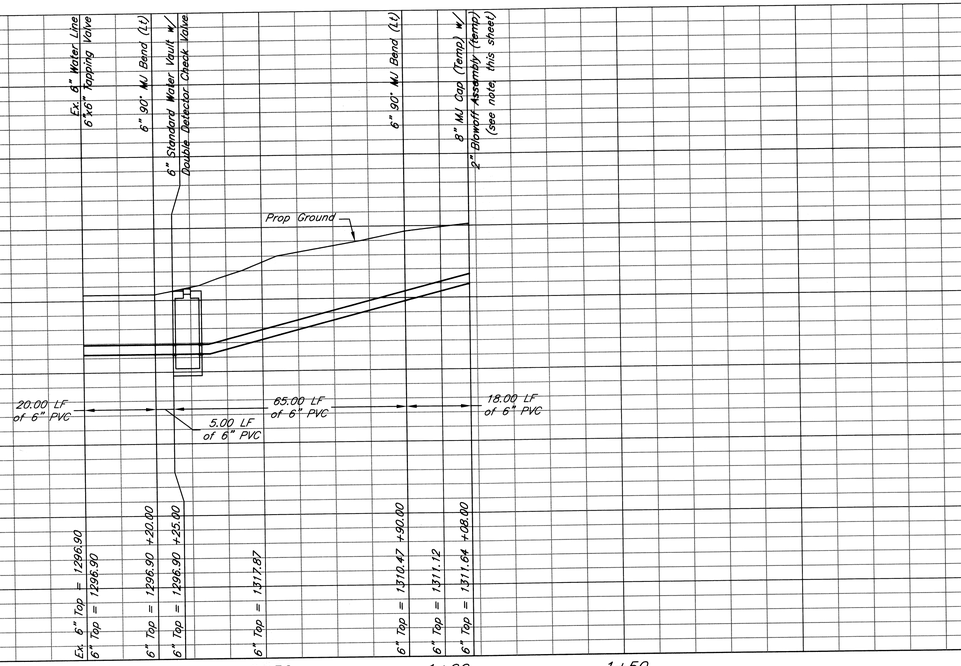

Wichita City Hall
Line 1
Wichita, Kansas

kemiller engineering
516 S. Market,
Wichita, KS 67202
316/264-0242

PROJECT NUMBER			
KEM NO. 09145	FILE plan	DATE 11/23/09	SHEET 2
DESIGN KM	DRAWN NS	REVISED	OF 5