



WEST PUMP STATION MAIN LEVEL PLAN

SCALE: 1/2" = 1'-0"

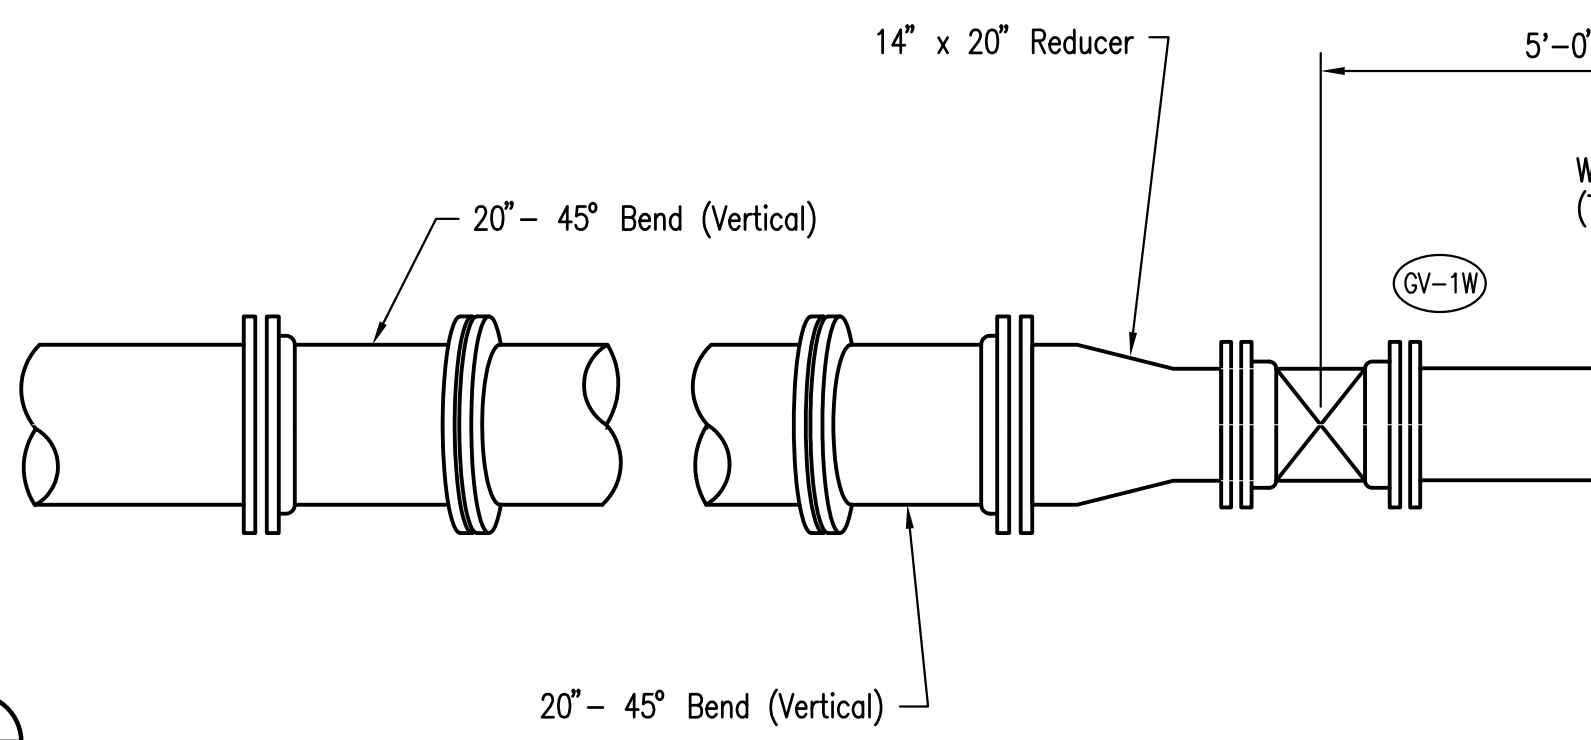


Ladder for access to Wetwell. Halliday Series L1B Ladder with Series L1E Ladder Extension (Safety Post) or pre-approved equal.

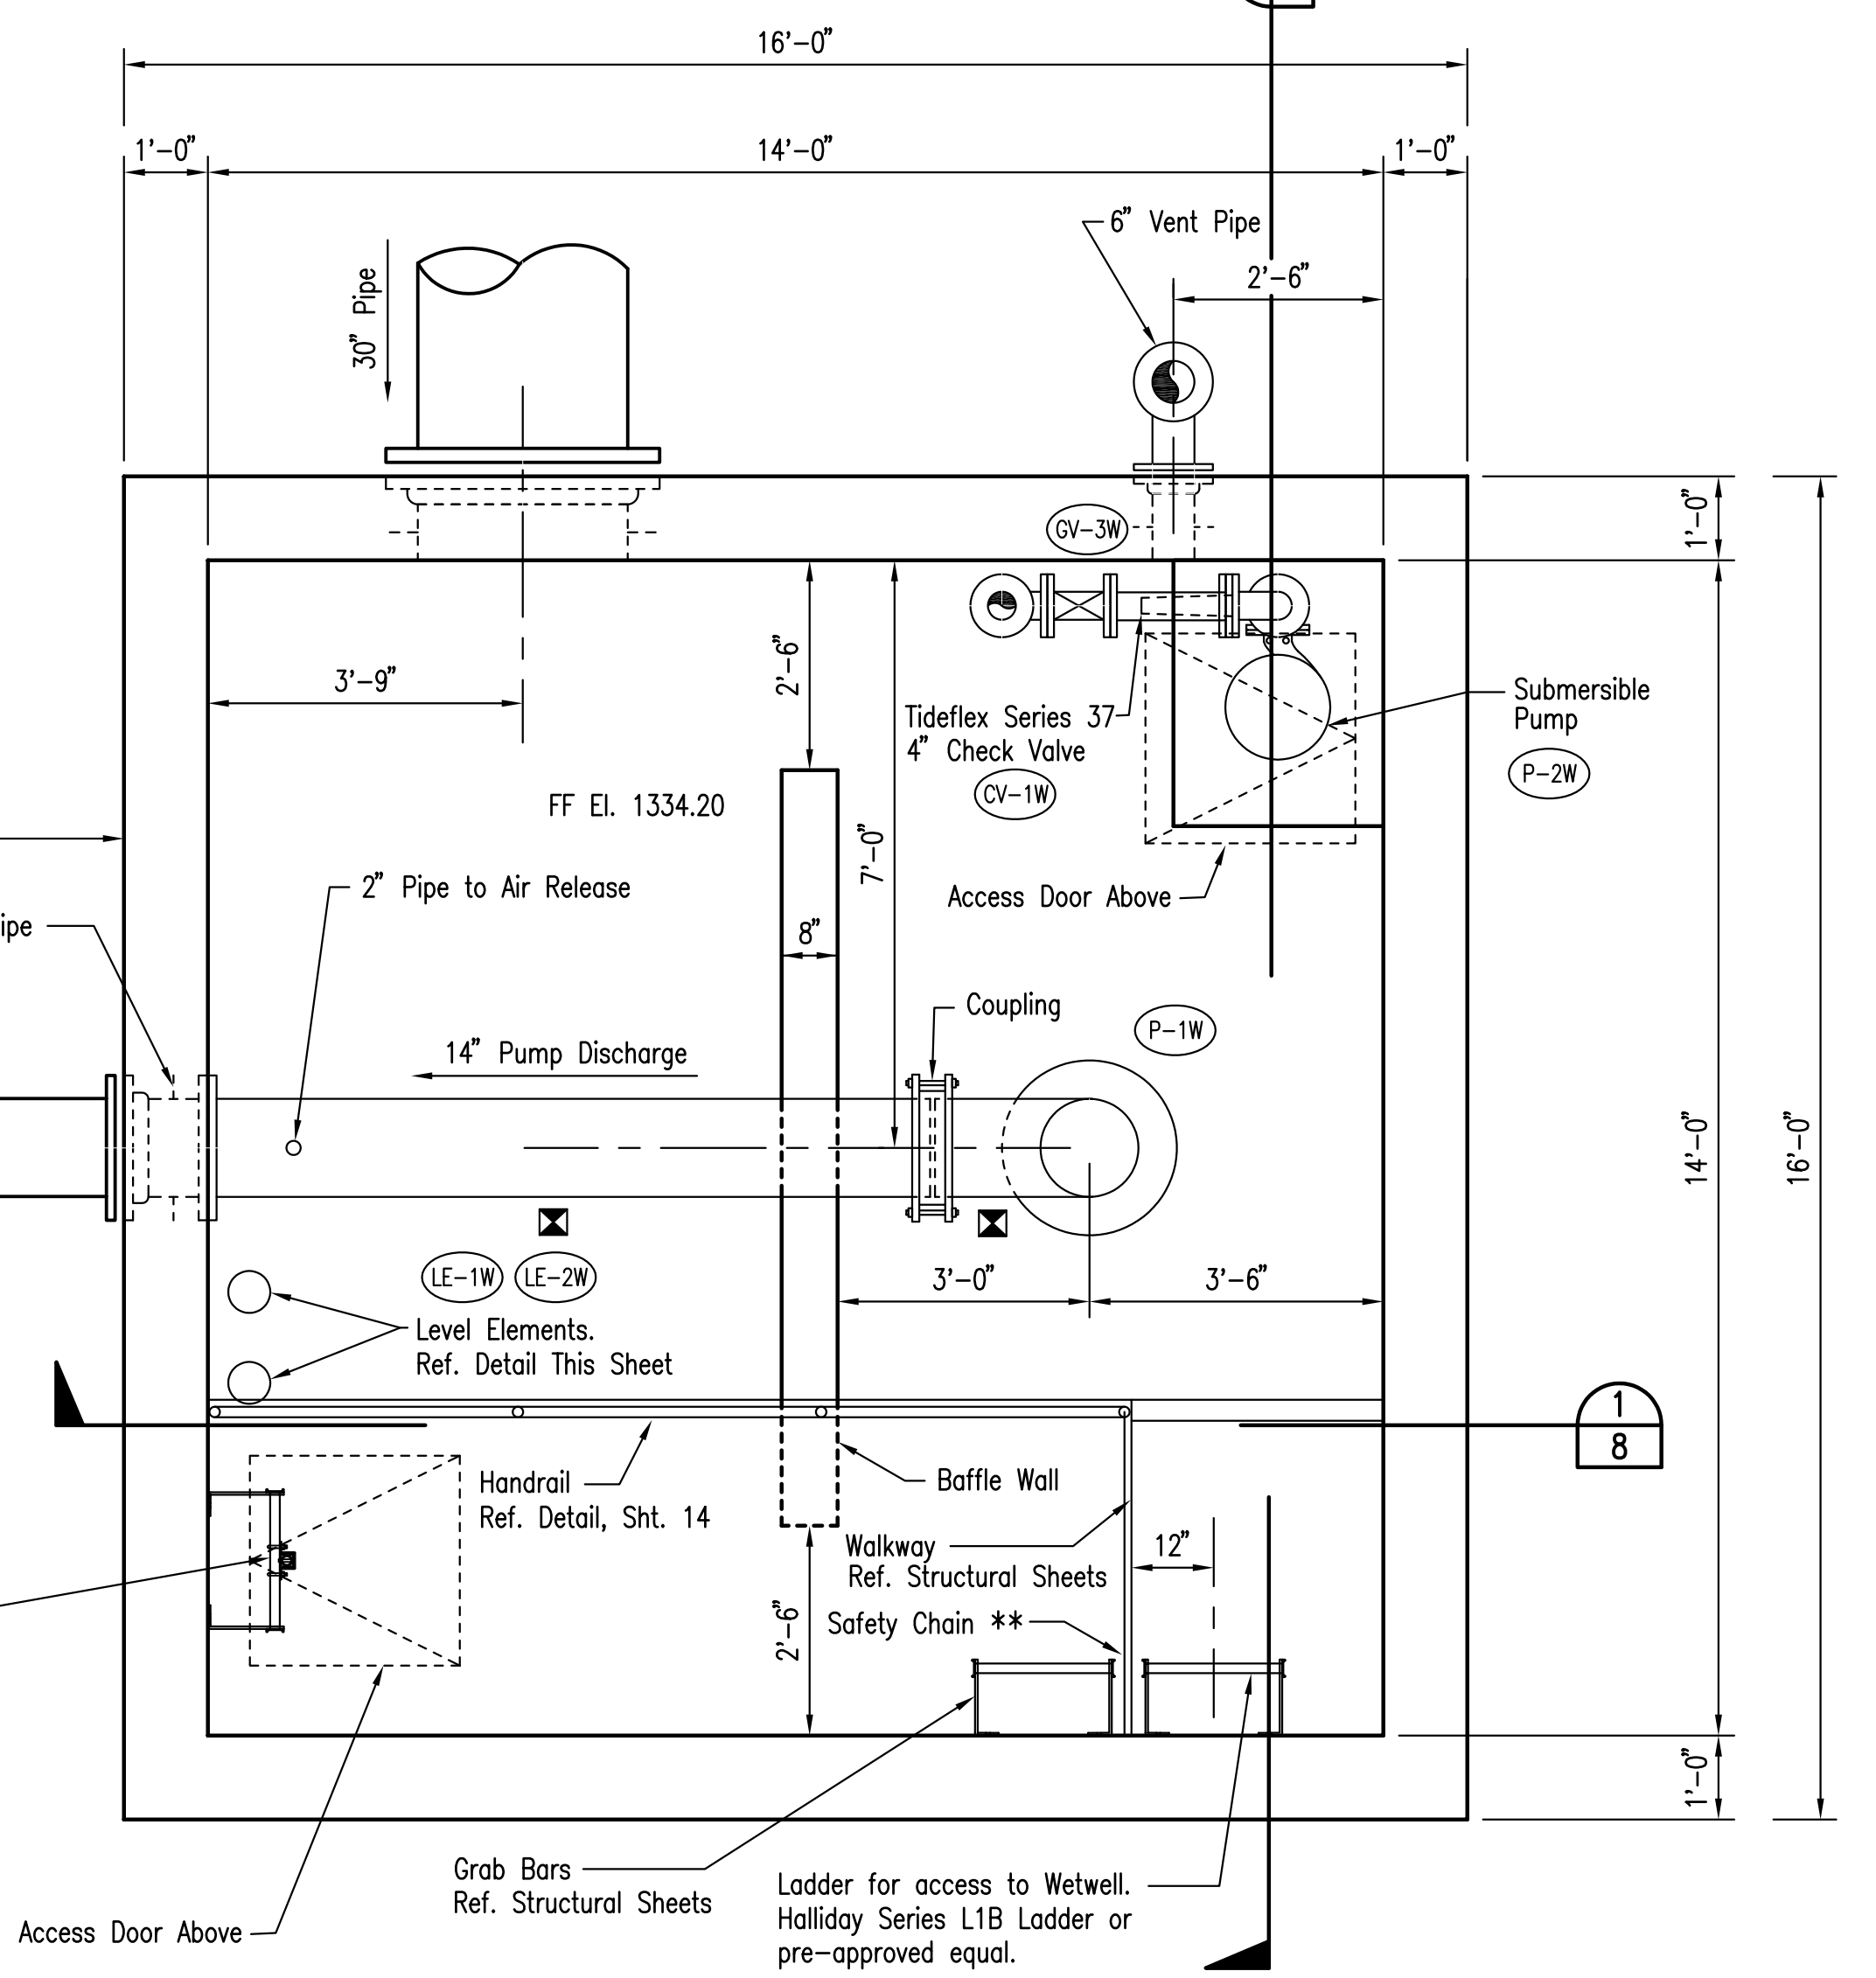


WEST PUMP STATION LOWER LEVEL PLAN

SCALE: 1/2" = 1'-0"

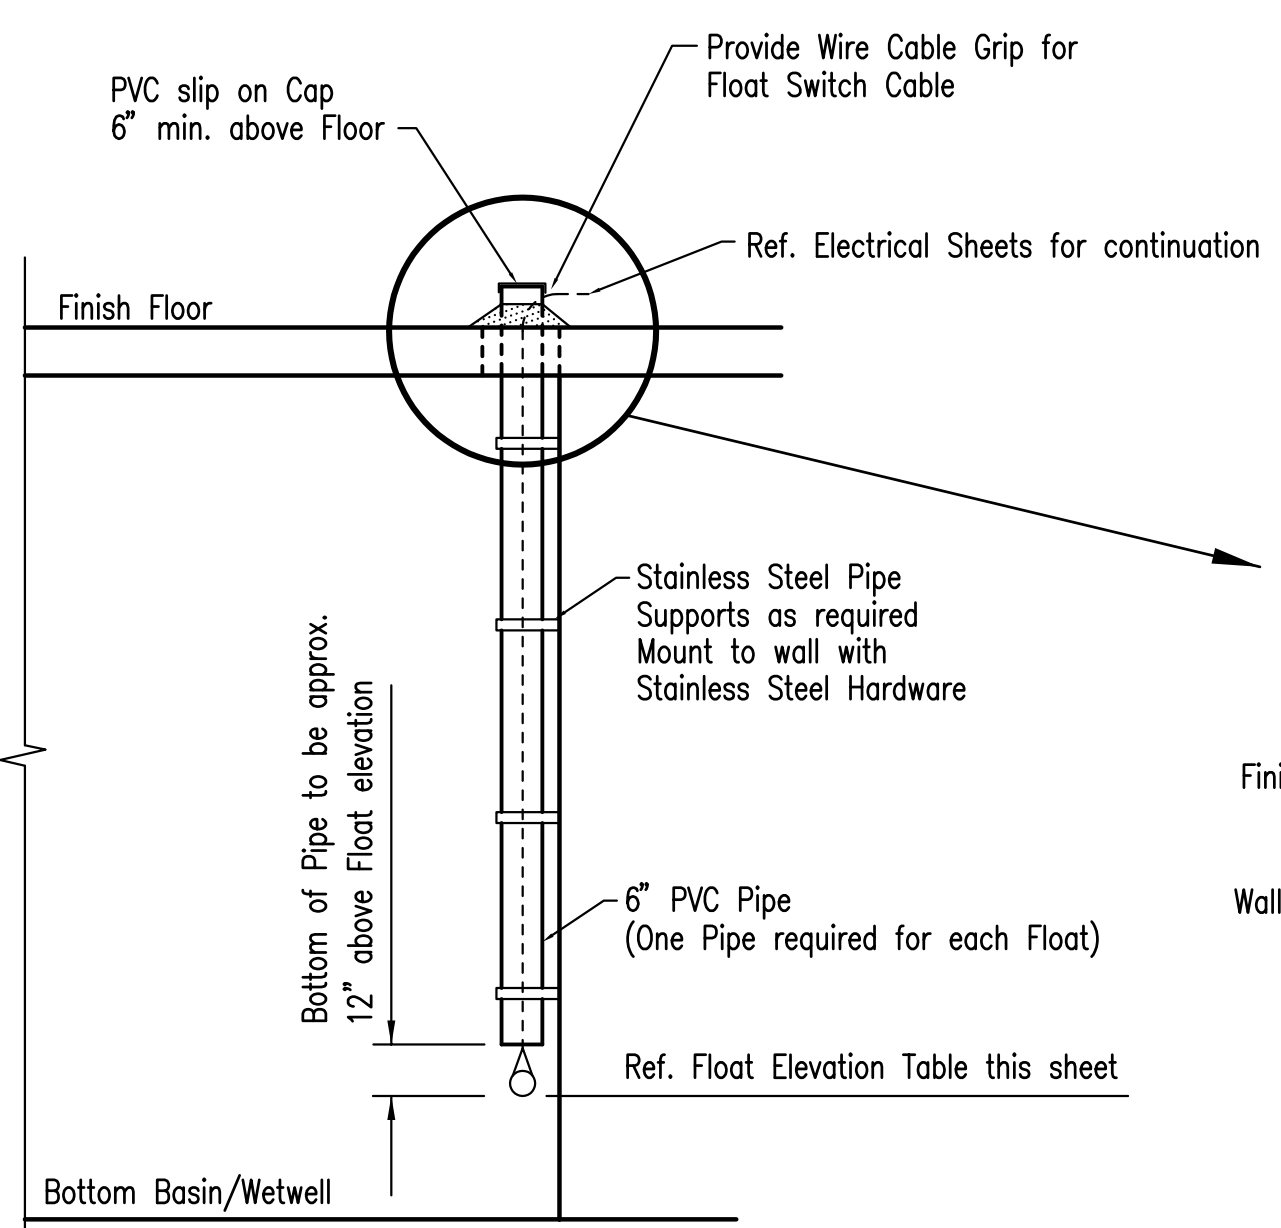

FLOAT SWITCH DETAIL (LE-2W) NO SCALE

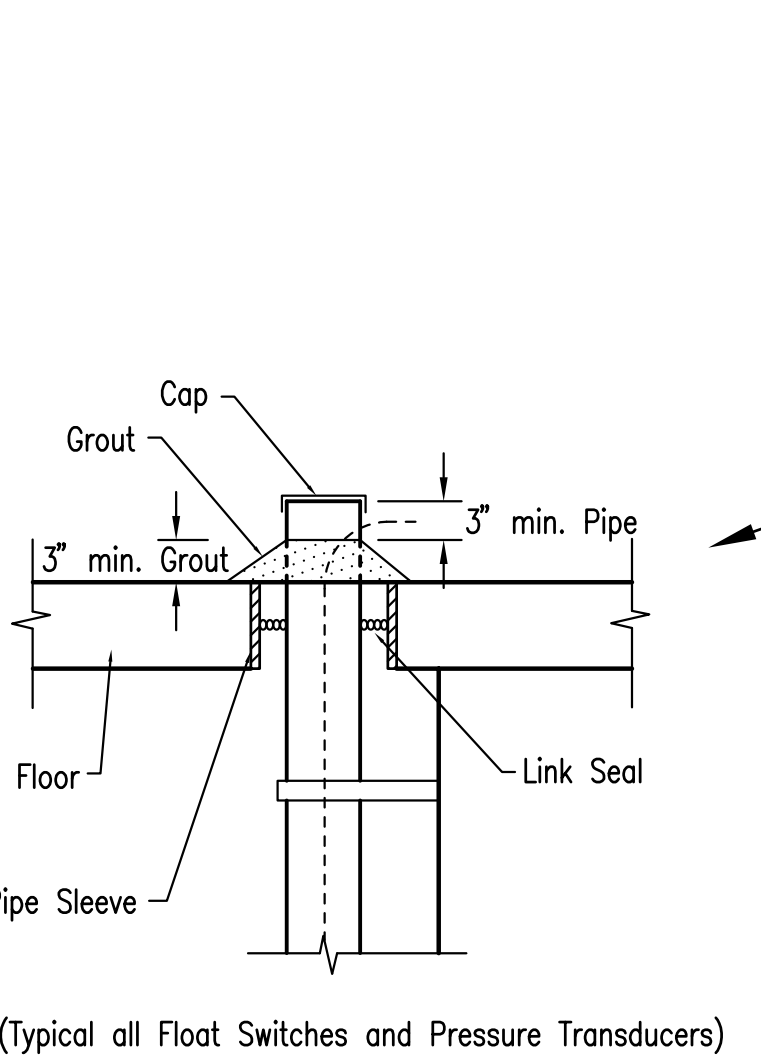

PRESSURE TRANSDUCER DETAIL (LE-1W) NO SCALE


* Contractor shall coordinate Concrete Pad dimensions with Equipment Manufacturer.

** Heavy Duty Aluminum Alloy Chain, Installed per OSHA Requirements. Contractor to provide Hooks/Bolts for Connecting Chain to Handrail.

Note to Contractor: Paint or Tape Safety Yellow Pavement Marking Tape 4" wide around Access Door opening.

⊠ Indicates piping or equipment needs to be adequately supported. Supports such as Wall Brackets, Clevis Hangers and Steel or Concrete supports shall be positioned to adequately support the pipe. The Contractor shall also install any additional pipe supports deemed necessary. The Contractor shall submit to the Engineer for approval the type of pipe support and proposed location(s) for installation.

Sheet 09-29-2009 11:51:14 AM by CAE
 Plot Scale 1:2 09-29-2009 12:00 PM
 C:\2004\04274\004\WEST\RE-BID\04274-04-C-7-West-Pump Sta Plan



No.	Revision	By	Date
PHASE II - STORM WATER DRAIN #332 WEST PUMP STATION PLAN VIEWS JAMES L. ARMOUR, P.E. - CITY ENGINEER CITY OF WICHITA PROJECT NO. 468-84396 Professional Engineering Consultants, P.A. 303 S. TOPKA • WICHITA, KANSAS 67202 316-262-2691 • FAX 316-262-3003			
Designed by	EJJ, SCU	Job No.	35-04274-042
Drawn by	CAE	Date	SEPTEMBER 2009
			Sht. 7 of 63