

## EXHAUST FAN SCHEDULE


MARK	LOC AT ROOM	TYPE	MIN. CAP		MAX. TIP SPEED (FPM)	DRIVE	MOTOR (BY M.C.)				REMARKS	CONTROLS	ELECT REF	
			CFM	SP			HP	RPM	SPEED	ELECT.				STARTER
EF-1	--	PROP	1000	.25	--	D	1/6	950	VAR	115/1	--	①	T-STAT	

① BASED ON LOREN COOK MODEL SPD SIZE 16, PACKAGED WALL FAN



## UNIT HEATER SCHEDULE - ELECTRIC

MARK	LOC. AT ROOM	TYPE	FAN CFM	HEATING CAPACITY		MOTOR		SYSTEM ELECTRIC	REMARKS	ELECT. REF.
				KW	BTUH	HP	RPM			
EUH-1		HORIZ	700	7.5	25.6	1/50	1500	460/3		

① BASED ON MARKEL 5100 SERIES, W/ WALL T'STAT, DISCONNECT, WALL HANGING BRACKET

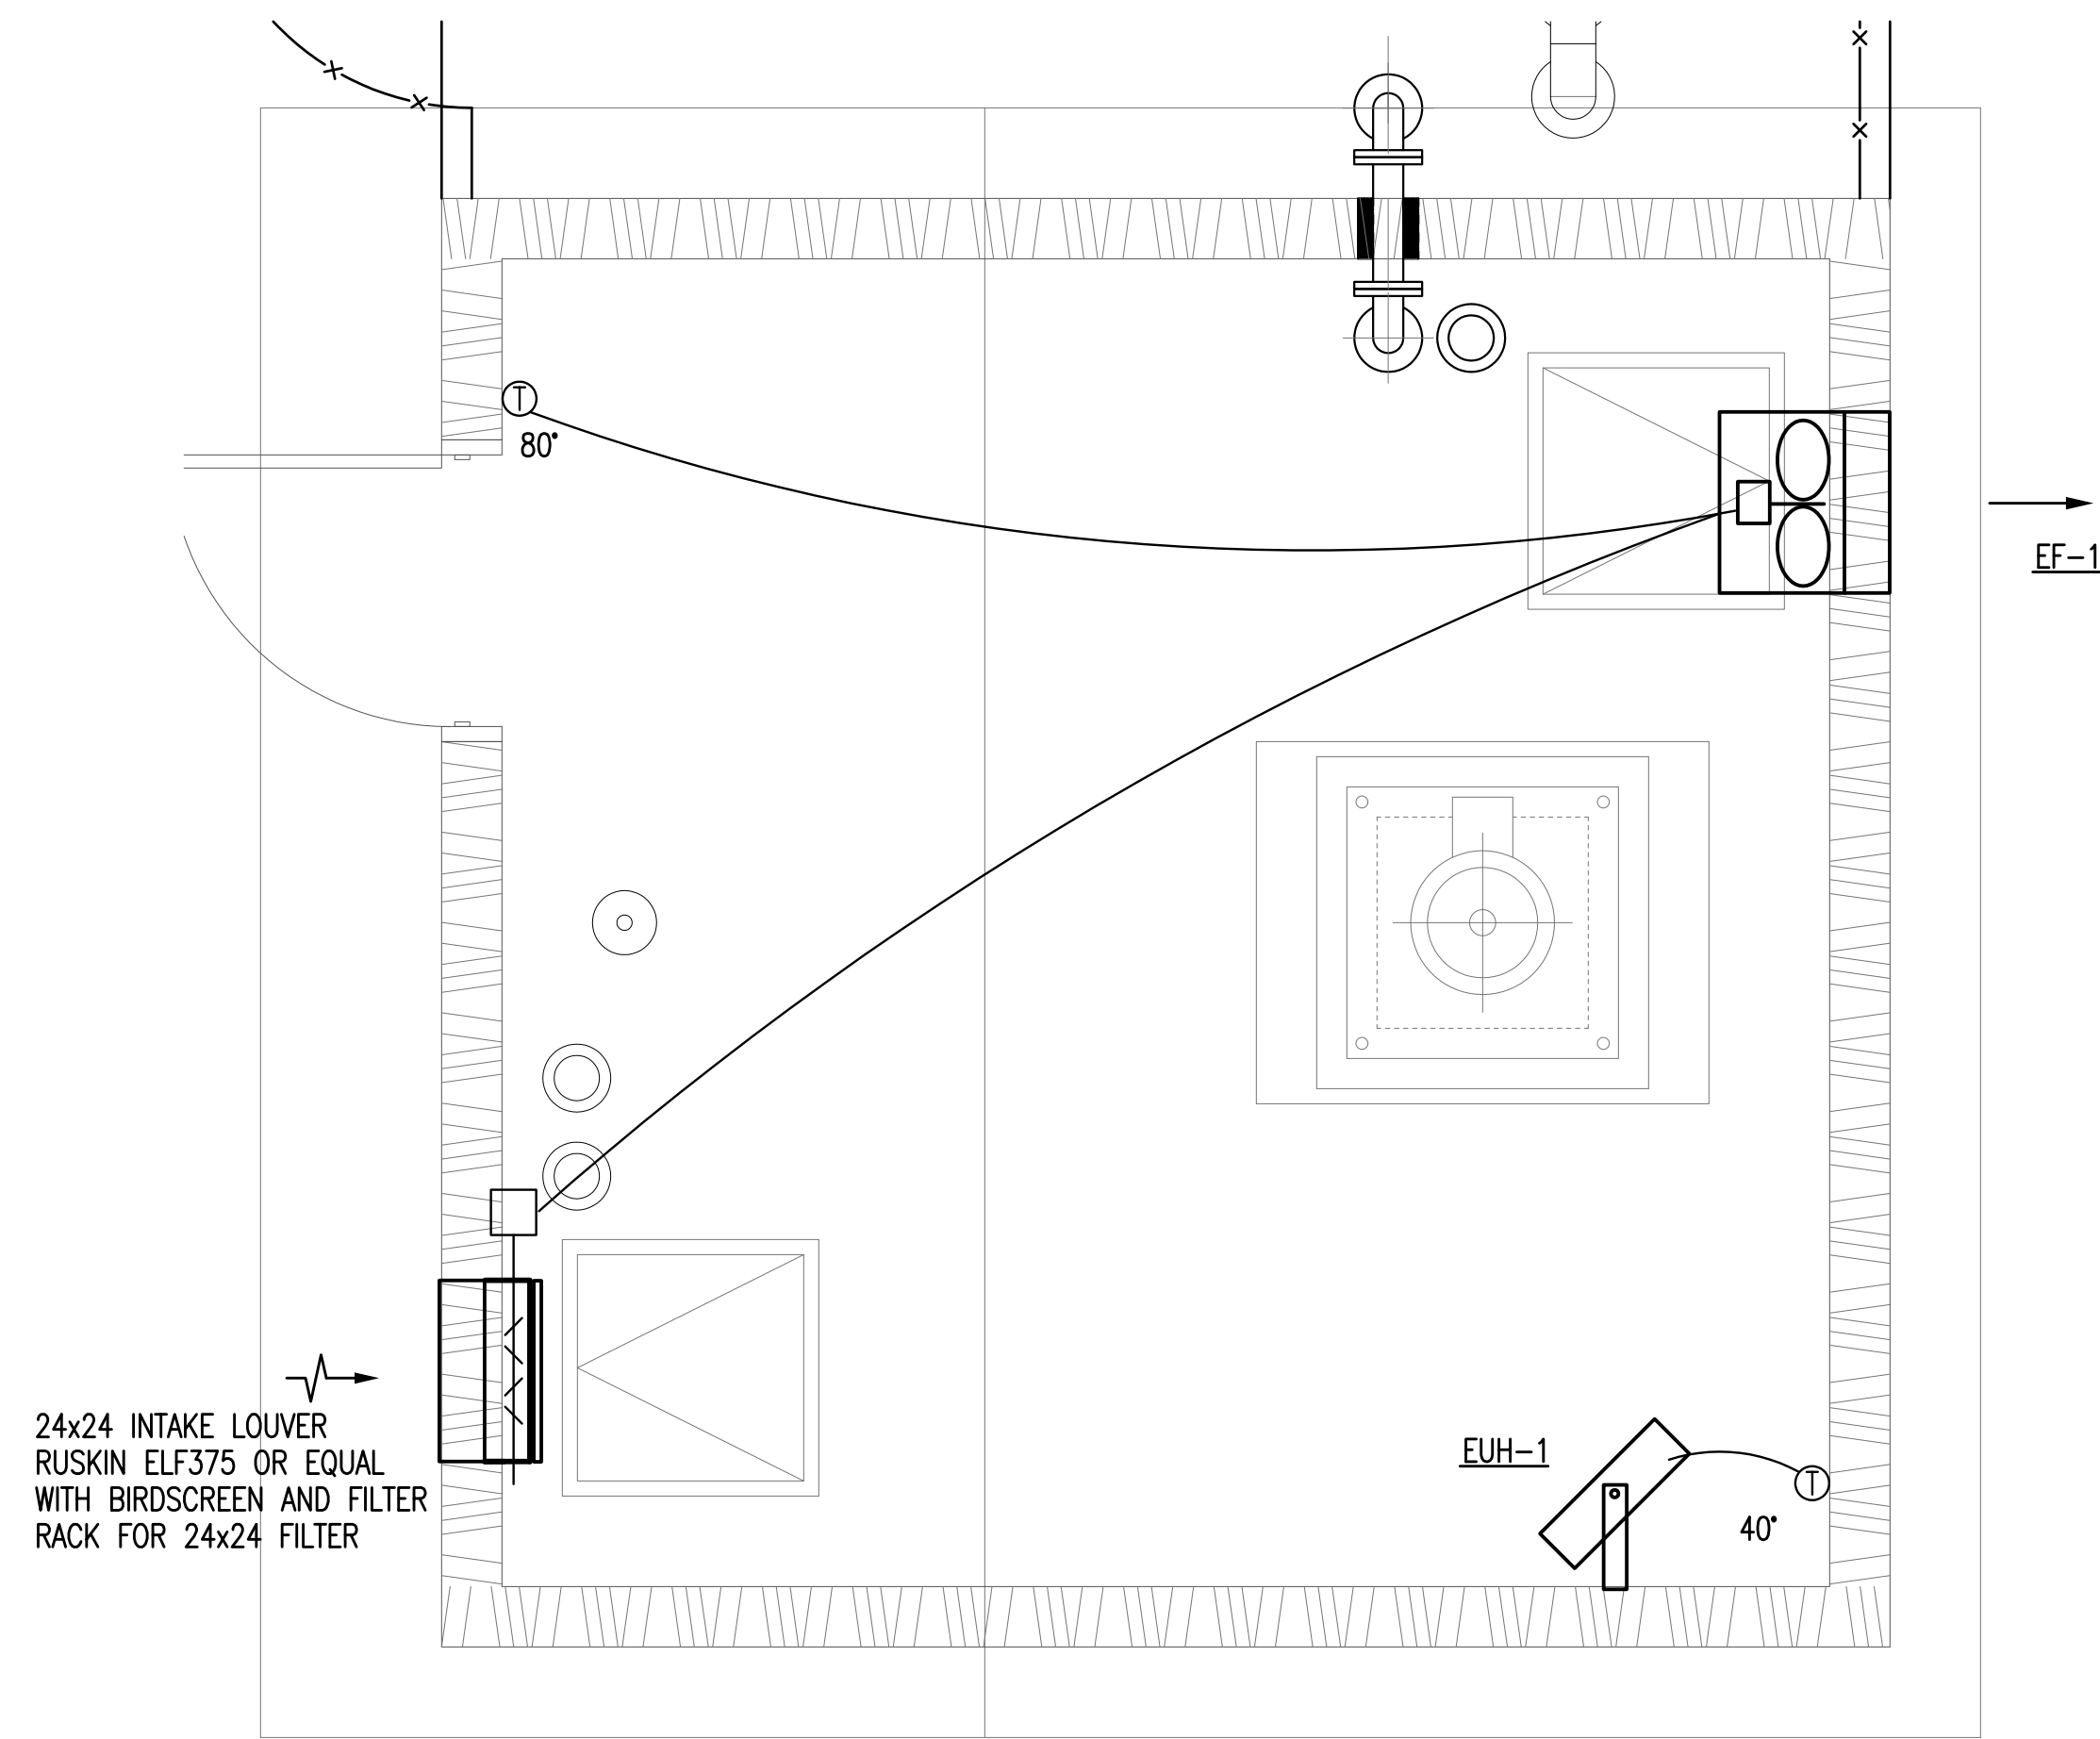

**A MECHANICAL MAIN LEVEL PLAN**  
1/2" = 1'-0"

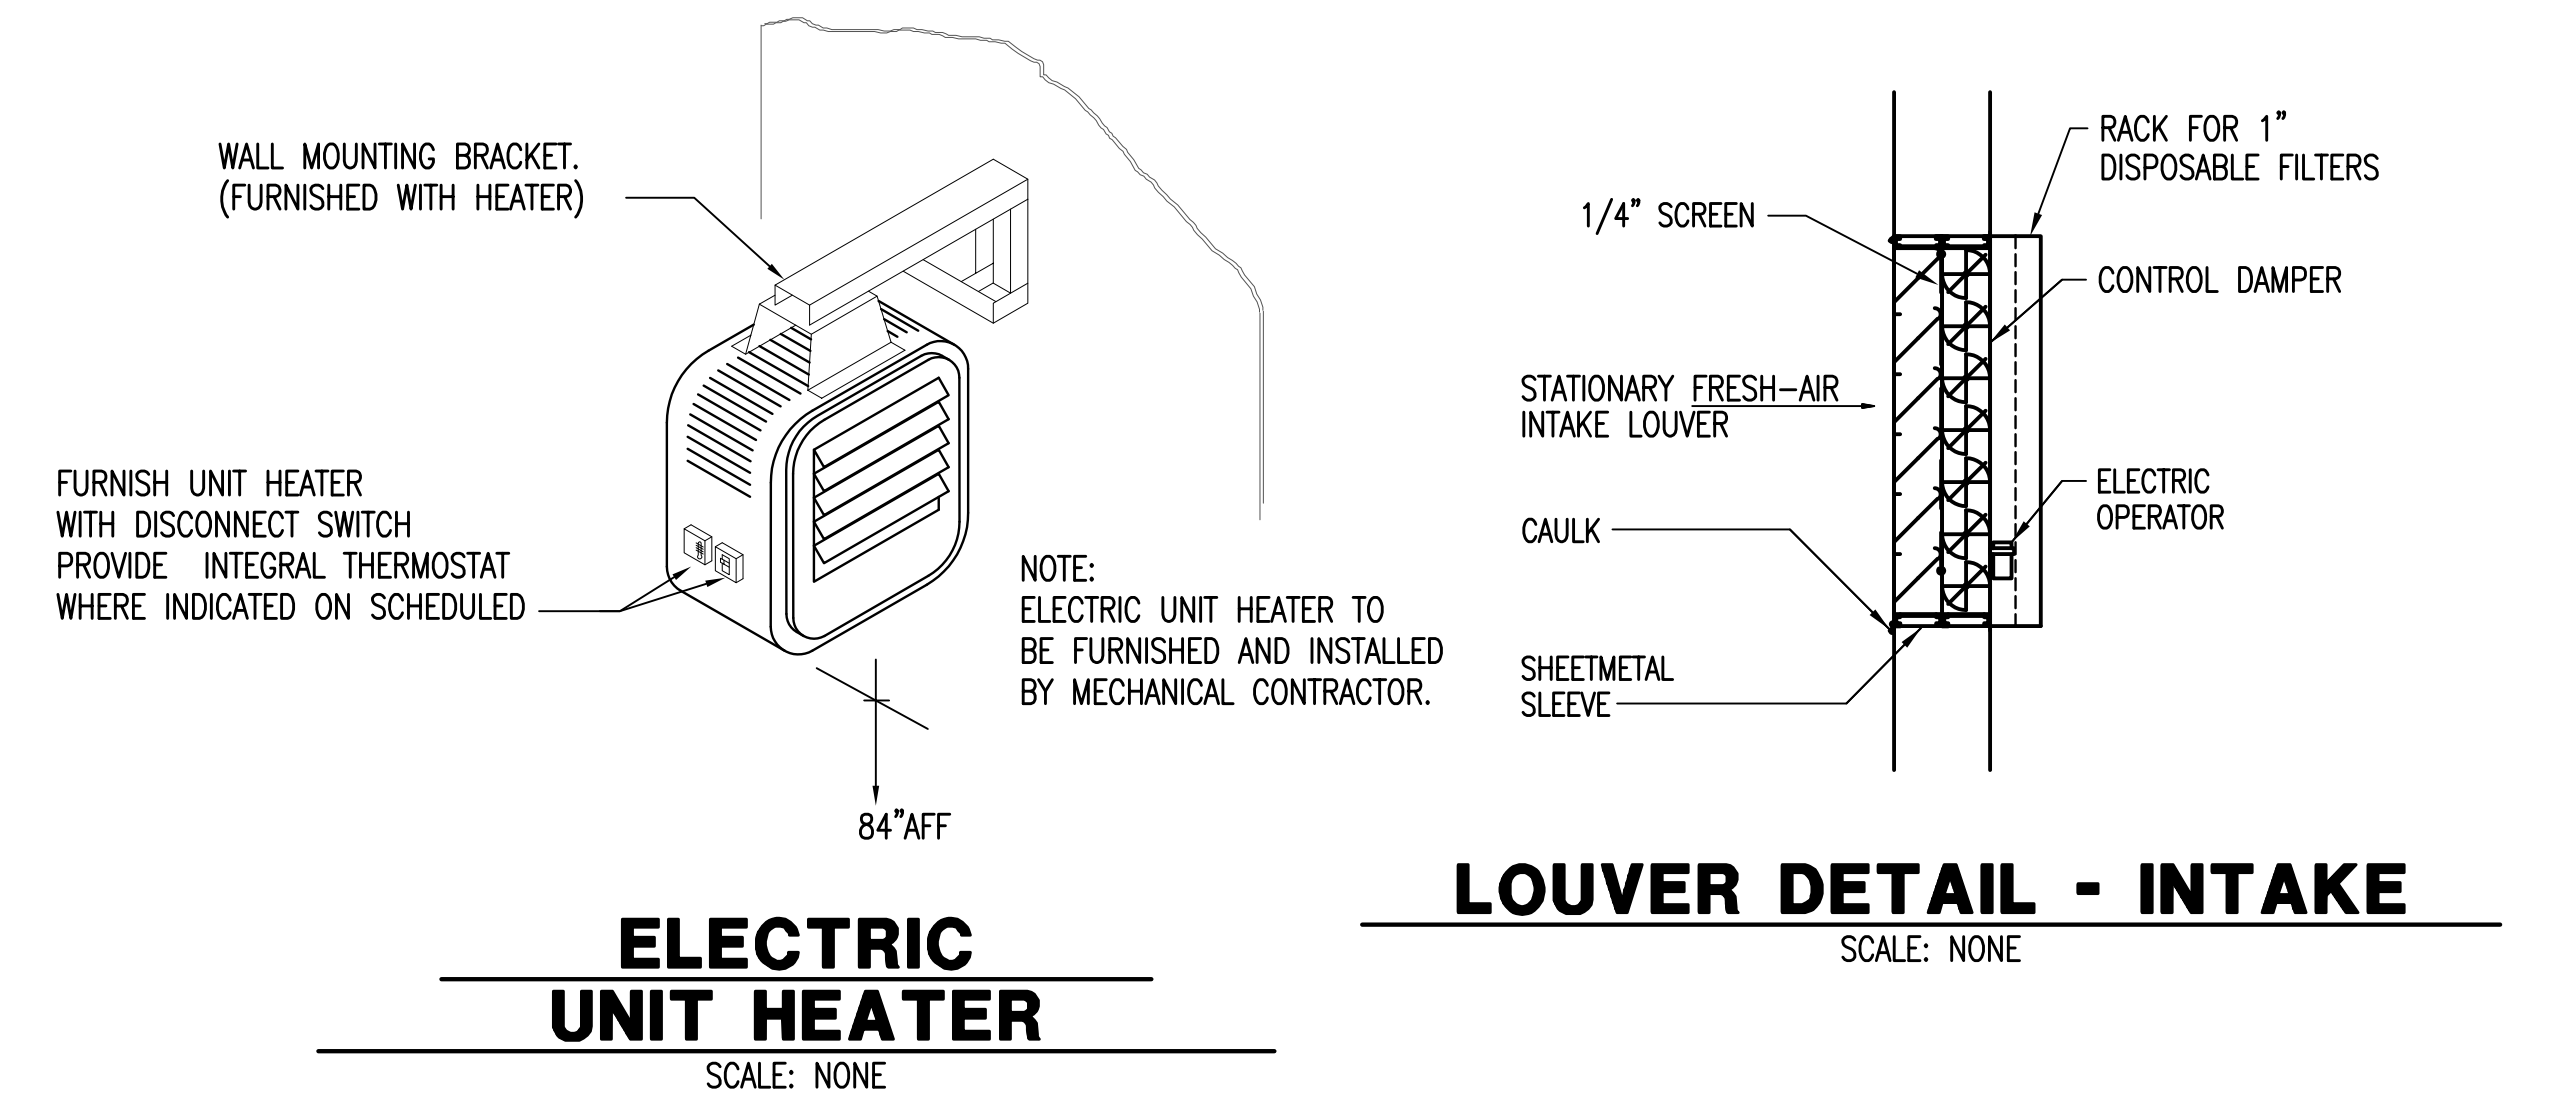

No.	Revision	By	Date
<b>PHASE II - STORM WATER DRAIN #332</b> <b>WEST PUMP STATION</b> <b>MECHANICAL PLAN AND DETAILS</b> JAMES L. ARMOUR, P.E. - CITY ENGINEER CITY OF WICHITA PROJECT NO. 468-84396 <b>Professional Engineering Consultants, P.A.</b> 303 S. TOPEKA • WICHITA, KANSAS 67202 316-262-2691 • FAX 316-262-3003			
Designed by	JBG	Job No.	35-04274-042
Drawn by	SEB	Date	SEPTEMBER 2009