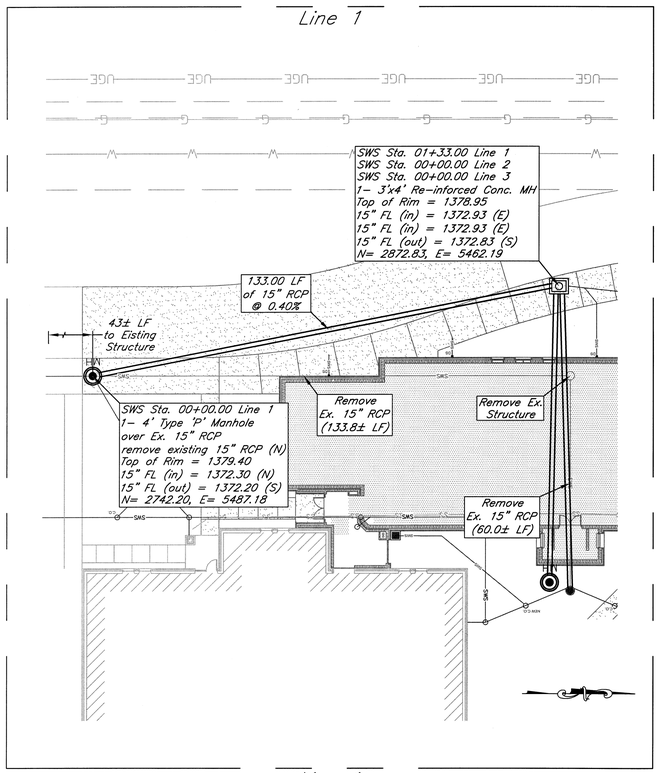

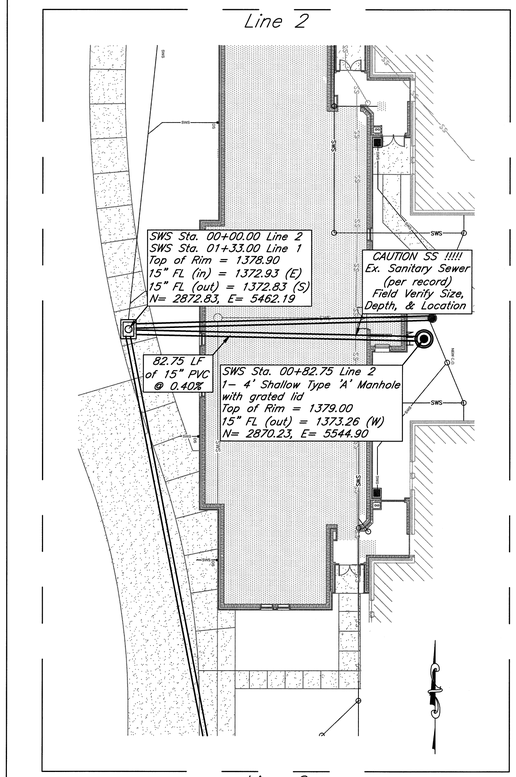

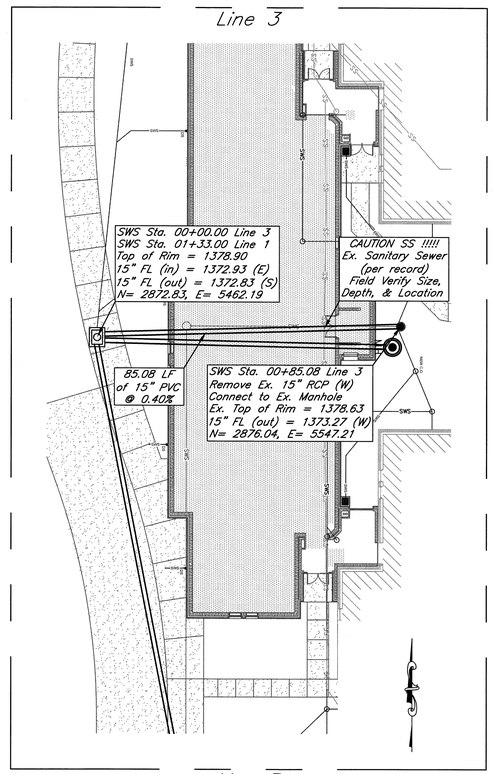

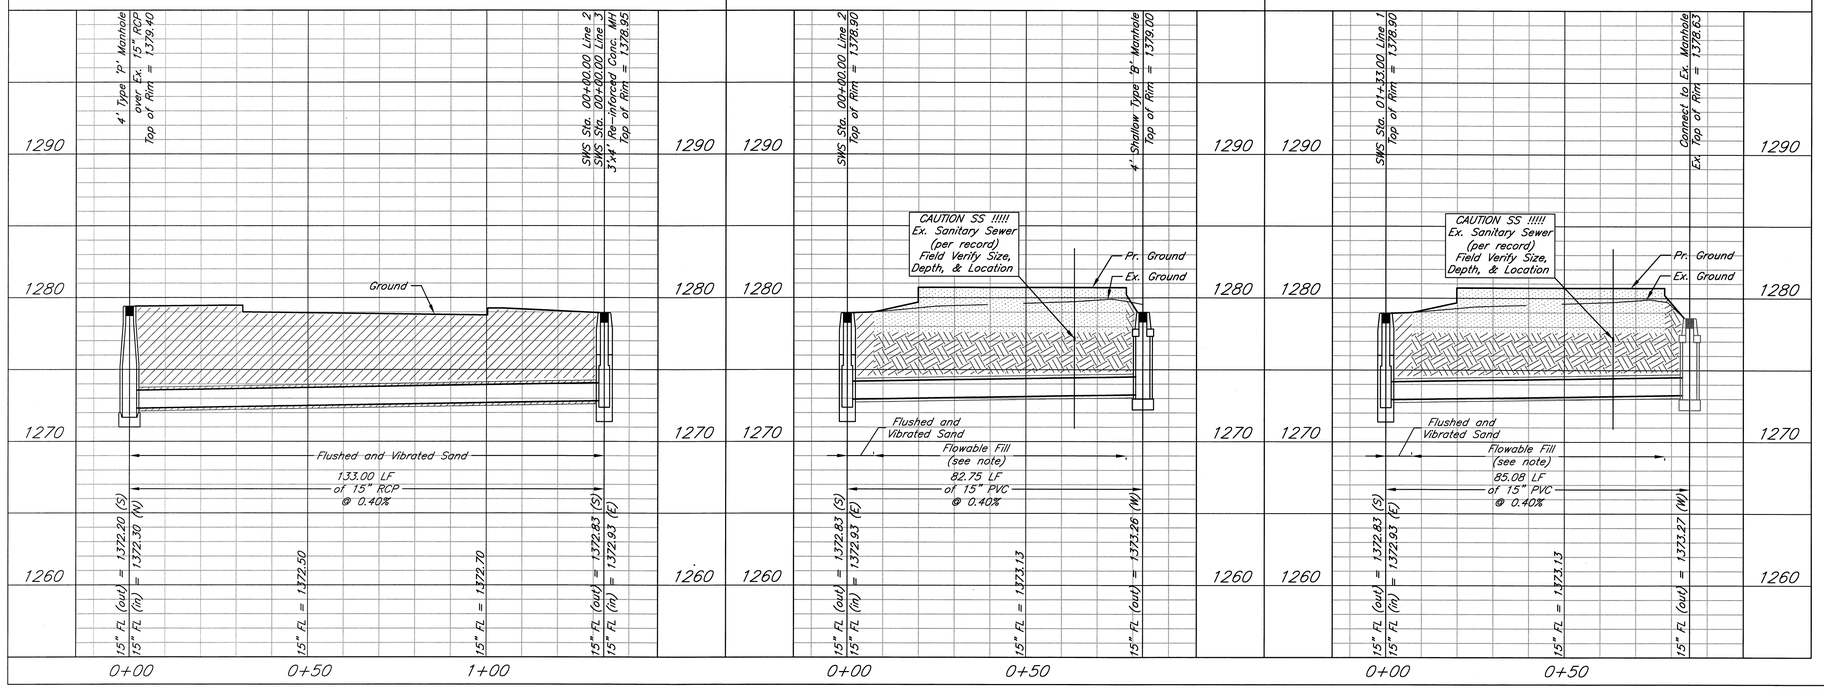

Sheet Notes

SWS Maintenance:

1. All proposed storm water sewer to be privately maintained.

Backfilling:

Flushed and Vibrated Sand:

1. All proposed storm water sewer lines under pavement / sidewalk areas to be backfilled with flushed and vibrated sand.

Flowable Fill:

1. All proposed storm water sewer lines under building areas are to be backfilled with flowable fill up to bottom of building footings.

Existing SWS Removal:

1. All existing storm water sewer lines and structures shall be remove upstream of proposed manhole as shown on station 00+00.00 Line 1, unless otherwise noted.
2. Existing SWS structure located at station 00+85.08 Line 3 shall not be removed.

Roof Drains:

1. Refer to architectural plans for locations of proposed and existing roof drains, or any SWS line under 12 inches in diameter. Said lines are not part of private project.

Vert. Scale
(IN FEET)
1 inch = 5 ft.

(IN FEET)
1 inch = 20 ft.

KIRK E. MILLER
LICENSED
11283
KANSAS
PROFESSIONAL ENGINEER

Stucky Middle School
Storm Sewer
Wichita, Kansas

kemiller engineering
516 S. Market, Wichita, KS 67202 316/264-0242

PROJECT NUMBER			
KEM NO. 10135	FILE	DATE 11/23/2010	SHEET 2
DESIGN KM	DRAWN NS	REVISED	OF 5