

FIRE HYDRANTS REQUIRED			
STATION	BURY LINE ELEVATION	TOP OF PIPE ELEVATION	FIRE HYDRANT BURY REQUIRED*
WL. NO. 11, STA. 1+48.01	106.20	102.32	4.5'


(FOR FIRE HYDRANT ASSEMBLY, SEE DETAIL, SHEET 27)

NOTES:

- UNLESS OTHERWISE INDICATED, DIMENSIONS ARE MEASURED TO CENTERLINE OF FITTINGS IN PLAN VIEW AND TOP OF PIPE IN PROFILE VIEW.
- WL. NO. 11 BASELINE = CENTERLINE OF HANDLEY AVENUE RIGHT-OF-WAY.
- REFER TO SHEET 2, NOTE NO. 8, FOR DIRECTIONAL DRILLING REQUIREMENTS.

REMOVE & REPLACE CONCRETE SIDEWALK IN KIND, THIS SHEET = 9 LF  
 REMOVE & REPLACE CONCRETE DRIVE IN KIND, THIS SHEET = 62 LF  
 REMOVE & REPLACE CONCRETE PAVEMENT IN KIND, THIS SHEET = 31 LF

WATER LINE NO. 11

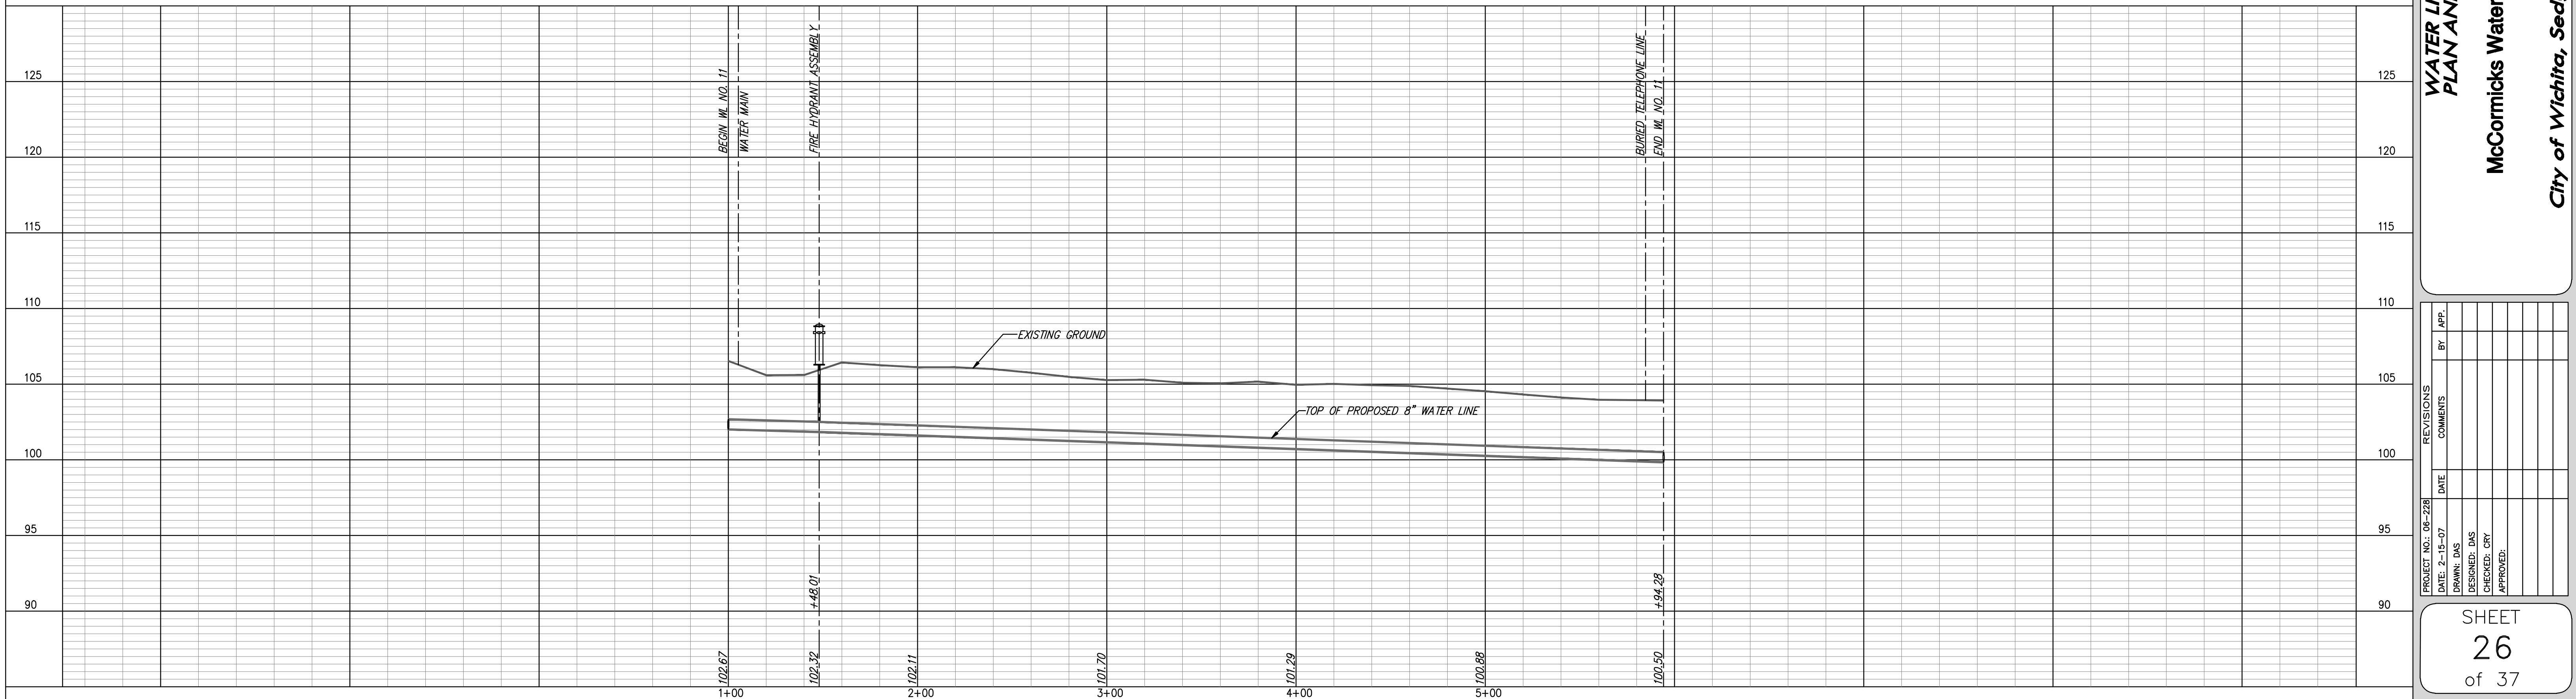

**YOUNG & ASSOCIATES, P.A.**  
 Civil and Environmental Engineers  
 100 S. Georgie, Derby, KS 67037  
 Tele: (316) 788-2552 Fax: (316) 788-4408 Email: young@yandem.com

**WATER LINE NO. 11  
 PLAN AND PROFILE**  
**McCormicks Water Main Replacement**  
 City of Wichita, Sedgwick County, Kansas

PROJECT NO.	DATE	DESIGNED	CHECKED	APPROVED
06-228	2-15-07	DMS	DAS	CRY