



TYPICAL SECTION
 119th St. Sta. 203+65 to Sta. 233+66
 119th St. Sta. 236+80 to Sta. 240+37.34

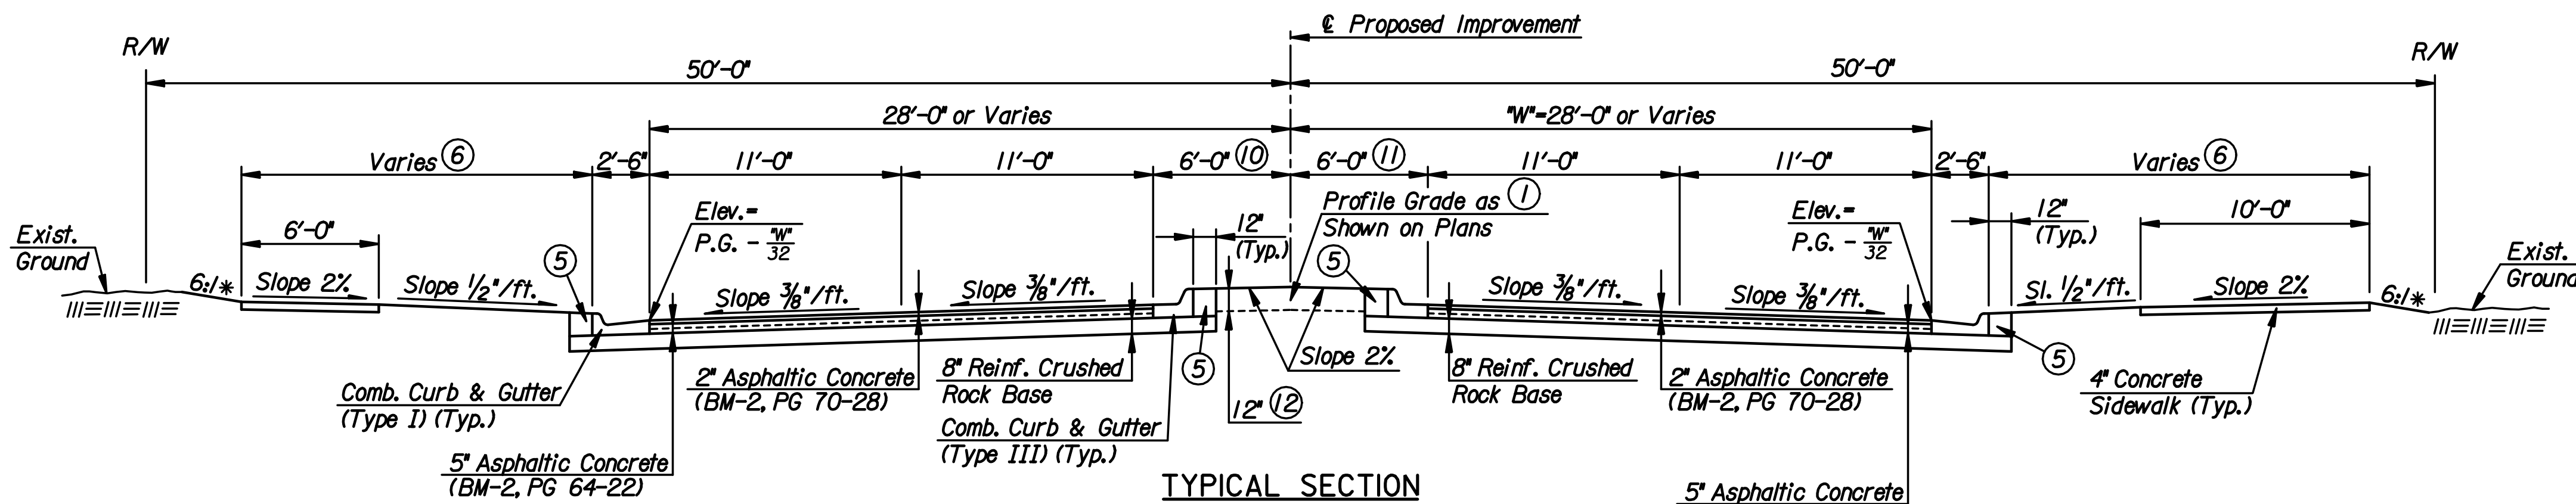


TYPICAL SECTION
 119th St. Sta. 233+66 to Sta. 236+80
 119th St. Sta. 240+37.34 to Sta. 242+84

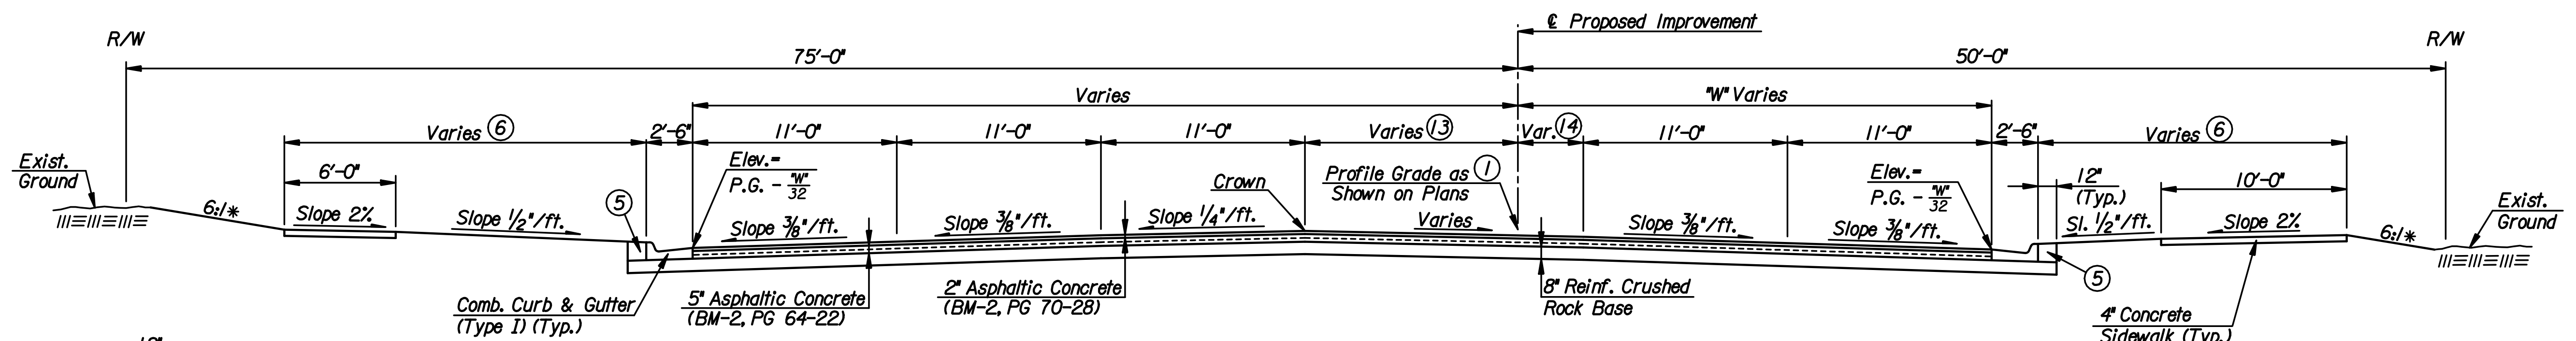

TYPICAL SECTION
 119th St. Sta. 242+84 to Sta. 244+50

- * See Cross Sections for Variations.
- ① Profile Grade is the theoretical top of pavement elevation at CL.
- ⑤ Backfill behind curb. Quantities for this work are included in the Earthwork Summary Table.
- ⑥ Location of Sidewalk varies. See Plans.
- ⑧ Varies from 10' at Sta. 203+65 to 6' at Sta. 205+03.51. Varies from 6' at Sta. 238+06.61 to 13.23' at Sta. 240+37.34.
- ⑨ Varies from 10' at Sta. 203+65 to 6' at Sta. 205+03.51.
- ⑩ Varies from 13.23' at Sta. 240+37.34 to 22.48' at Sta. 242+84.
- ⑪ Varies from 5.55' at Sta. 240+82.76 to 3.53' at Sta. 242+84.
- ⑫ Top 12" shall be material suitable to support vegetation per compaction diagram and Landscape Details.
- ⑬ Varies from 11.47' at Sta. 242+84 to 17.70' at Sta. 244+50.
- ⑭ Varies from 3.53' at Sta. 242+84 to 1.87' at Sta. 244+50.

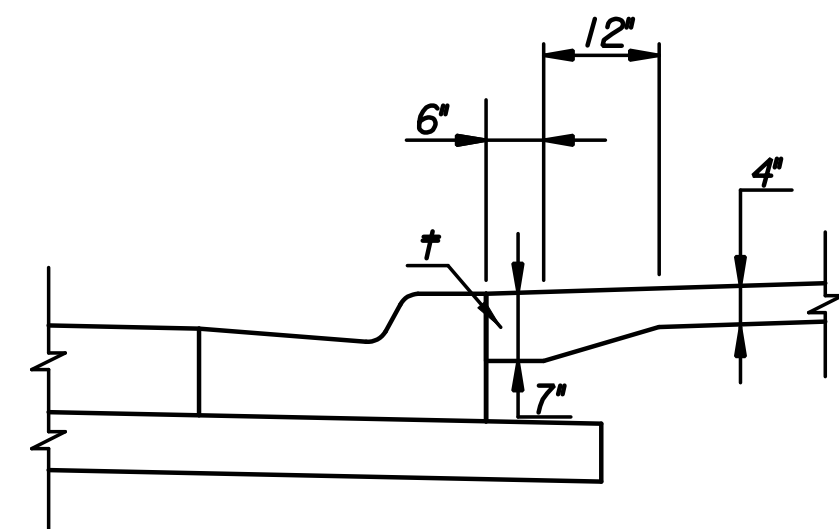

CONCRETE SIDEWALK THICKENED EDGE DETAIL
 Required when edge of sidewalk is within 12" from back of curb.

† The additional thickness of concrete adjacent to combined Curb & Gutter will not be paid for directly but is considered Subsidiary to the bid item "Concrete Sidewalk".

CRUSHED ROCK GRADATION REQUIREMENTS

PERCENT OF AGGREGATE RETAINED

2-1/2"	0
3/4"	20-60
#4	50-80
#40	80-94
#200	90-98

Rock quality shall conform to the requirements specified by the KDOT 2007 Edition Standard Specification Subsection 1102 for Durability Class I.

No.	Revision	By	Date
119TH ST.			
TYPICAL SECTIONS			
JAMES L. ARMOUR, P.E.—CITY ENGINEER CITY OF WICHITA PROJECT NO. 472-84694			
Professional Engineering Consultants, P.A. 303 S. TOPEKA • WICHITA, KANSAS 67202 316-262-2691 • FAX 316-262-3003			
Designed by	JPS	Job No.	08208
Drawn by	SVB	Date	Sept., 2010
			Sheet 3 of 149