

CAUTION !!!
High Voltage Overhead Electric (Westar Energy)

Existing 12\"/>

Existing 6\"/>

** CONTRACTOR SHALL VERIFY EXACT LOCATION AND REPORT FINDINGS TO INSPECTOR ON SITE.

6\"/>

Electric Control Panel to be removed and salvaged and delivered to the City of Benton

CAUTION!!!
Electric Pole to be removed by Westar Energy. Coordinate with Westar Energy. (Provide at least 2 weeks notice.) Removal & resetting costs to be subsidiary to existing pump station.

Demolish Building, Remove Concrete Pad, and grade to drain. Remove Existing Pump and Miscellaneous Materials and salvage to City of Benton.

Remove Rock Gravel and grade to drain.

Remove 15\"/>

Remove Asphalt Pavement and grade to drain.

OWNER: SAVANNA WEST HOMEOWNERS ASSOCIATION

OWNER: ROBERT L. & JULIE A. KISER

Demolish Concrete Water Meter Vault, Remove Concrete Vault, and grade to drain. Remove Existing Meter and Miscellaneous Materials and salvage to City of Benton.


Install Sediment Barrier

Remove Water Marker and salvage to City of Benton.

Close Valve and Remove Valve Box (Salvage to City)

LEGEND

- PAVEMENT AND CULVERT REMOVAL
- BUILDING TO BE DEMOLISHED
- WATERLINE REMOVAL/ABANDONMENT
- CAP/PLUG TO BE INSTALLED
- PROPERTY LINE/RIGHT OF WAY LINE
- SEDIMENT BARRIER

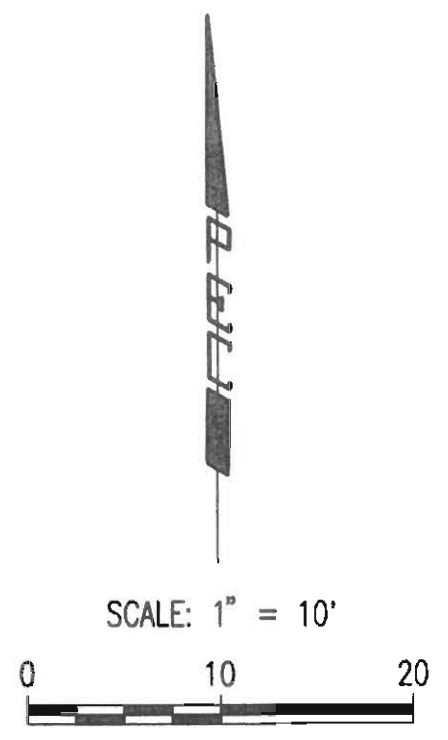

* CONTRACTOR SHALL EXCAVATE EXISTING 12\"/>

ALL WORK ASSOCIATED WITH THIS PLAN, INCLUDING TIE IN OF THE EXISTING PIPE, ABANDONMENT OF EXISTING PIPING/PUMP STATION/METER SHALL BE PERFORMED AFTER THE PROPOSED PUMP STATION IS FULLY IN SERVICE AND OPERATIONAL. ALL PROPERTIES WHOSE WATER SERVICE SHALL BE INTERRUPTED SHALL BE NOTIFIED AT LEAST 72 HOURS PRIOR TO INTERRUPTION. NO WATER SERVICE SHALL BE INTERRUPTED FOR MORE THAN 8 HOURS. CONTRACTOR SHALL UTILIZE CLEAN SWABBED PIPE FOR THE NEW CONNECTIONS, AND SHALL FURNISH ANY REQUIRED TEMPORARY THRUST RESTRAINT/BLOCKING AS REQUIRED.

ABANDONMENT/DEMOLITION NOTES:

1. WATERLINE PIPE TO BE ABANDONED SHALL BE CAPPED OR PLUGGED WITH MJ CI CAPS/PLUGS. CAP SHALL BE PLACED 5' OUTSIDE OF THE EXISTING BUILDING FOOTPRINT.
2. ALL VALVES TO BE ABANDONED SHALL BE CLOSED AND VALVE BOXES REMOVED AND DISCARDED AS DIRECTED BY THE CITY.
3. THE FOOTING OF THE EXISTING BUILDING SHALL BE EXCAVATED AND REMOVED TO A DEPTH OF 3' BELOW EXISTING GROUND.
4. EXCAVATED AREAS SHALL BE BACKFILLED WITH JETTED SAND (OUTSIDE OF PAVED AREAS) OR FLOWABLE FILL (UNDER PAVED AREAS).
5. CONTRACTOR SHALL CONTACT KANSAS ONE CALL PRIOR TO PERFORMING ANY WORK AT THE EXISTING PUMP STATION SITE. CONTRACTOR SHALL COORDINATE THE TERMINATION OF SERVICE (AS NECESSARY) WITH THE CITY OF BENTON.
6. ALL DISTURBED AREAS SHALL BE SEEDED/MULCHED IN ACCORDANCE WITH THE GENERAL NOTES AND SPECIFICATIONS TO MATCH EXISTING GRASS TYPES.
7. ALL WORK IDENTIFIED ON THIS SHEET INCLUDING ALL MATERIALS, LABOR AND INCIDENTALS NECESSARY, SHALL BE CONSIDERED SUBSIDIARY TO THE LUMP SUM PRICE BID FOR "EXISTING BOOSTER PUMP STATION DEMOLITION".
8. WATER METER SHALL BE SALVAGED TO THE CITY OF WICHITA. ALL OTHER MATERIALS TO BE SALVAGED AS DIRECTED BY THE CITY OF BENTON.
9. CONTRACTOR SHALL GRADE SITE TO DRAIN AS INDICATED BY THE CONTOURS ON THIS SHEET.

Saved: 06-20-2011 3:10:28 PM by CSL
 Plot Scale: 1:10 06-20-2011 3:11:02 PM by CSL
 Q:\2010\10093\10093-C-BPS-Demo Plan



No.	Revision	By	Date
CITY OF BENTON BUTLER COUNTY, KANSAS EXISTING BOOSTER PUMP STATION DEMOLITION PLAN MAIN BOOSTER PUMP STATION			
PROFESSIONAL ENGINEERING CONSULTANTS, P.A. 303 SOUTH TOPEKA WICHITA, KS 67202 316-282-2691 www.pec1.com			
Designed by	MDK, JDG	Job No.	35-10093-1558
Drawn by	JAN	Date	September 2010
			Sht. 9 of 18