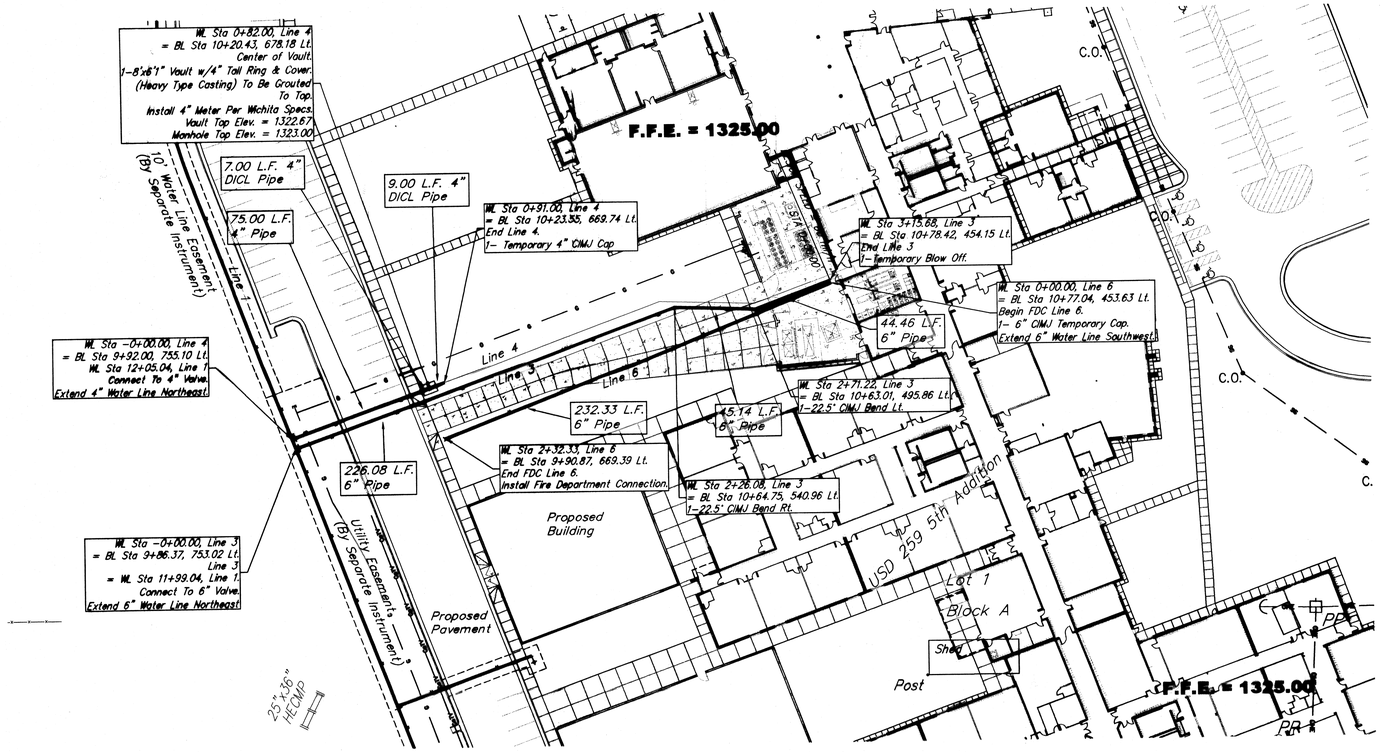

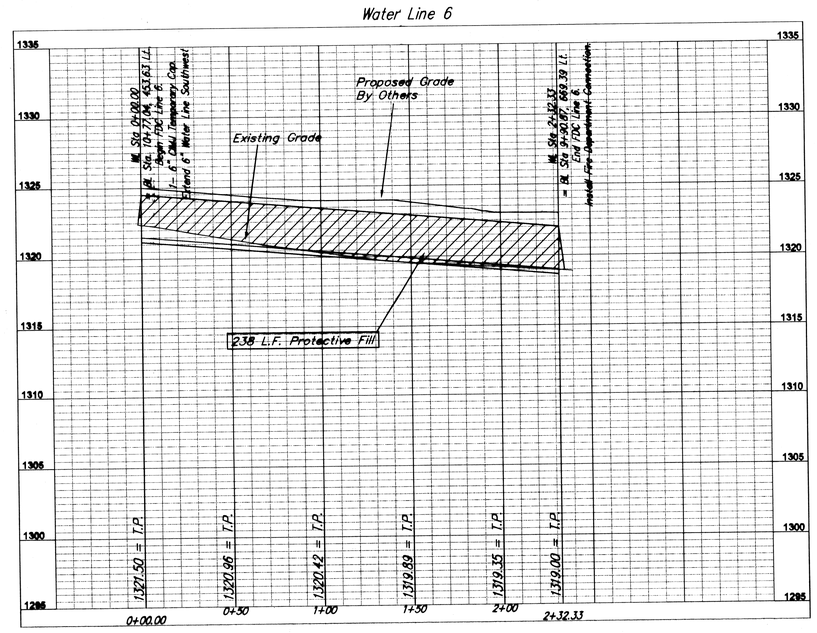

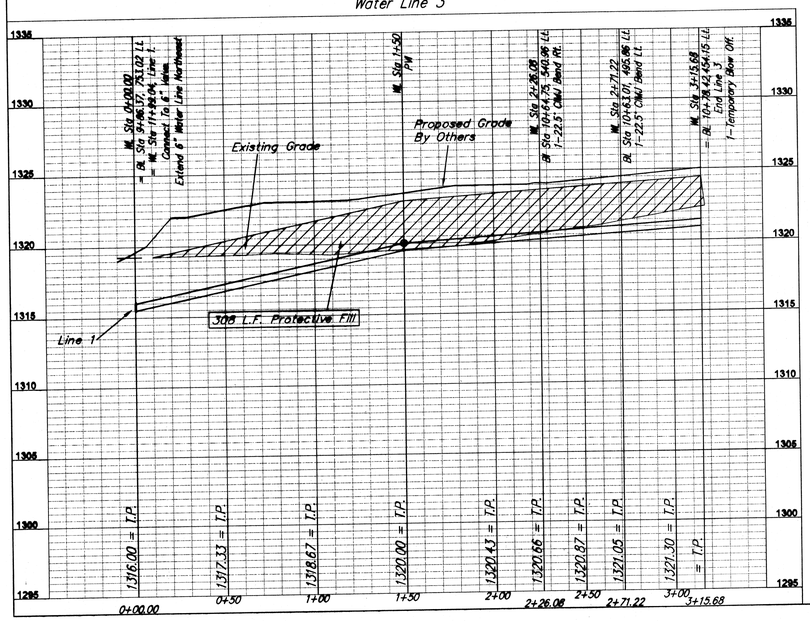

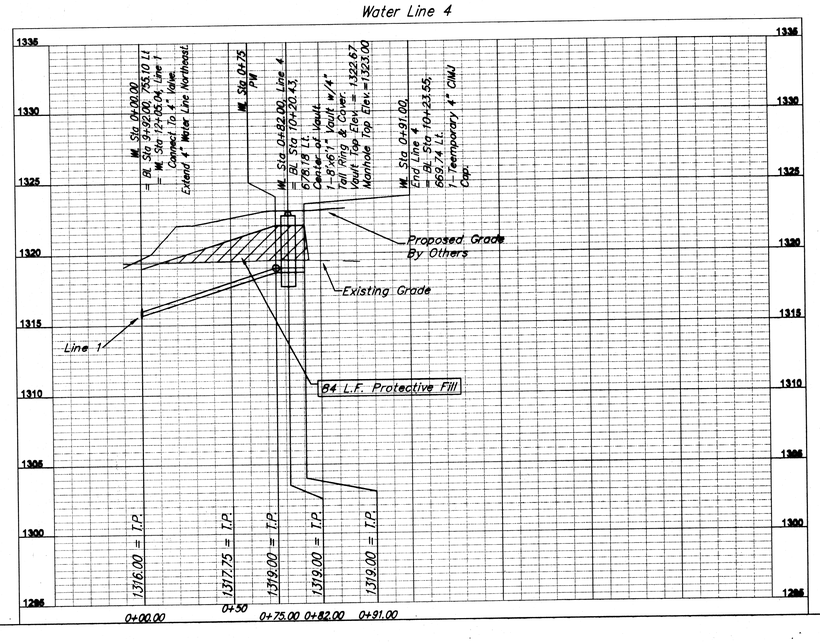

Contractor Shall Follow All Applicable Best Management Practices (BMP) For Erosion Control.

Contractor To Use Extreme Caution When Excavating Near Utility Lines. Contractor To Hand Dig To Expose All Utility Lines Prior To Construction. Verify Depth To Determine Conflict If Any.

NOTE: Contractor Shall Sand Backfill, Flush, & Vibrate Water Lines When Pipe Is Under Pavement.



Benchmarks

Site Benchmark – 1:
Railroad Spike in Power Pole.
Elevation = 1313.69 (NAVD 88)

Baughman

USD #259 Fifth Addition
WATER LINES 3, 4, & 6
Private Water Line Improvements

Baughman Company, P.A. 315 Ellis St. Wichita, KS 67211 P 3162637271 F 3162630169
ENGINEERING | SURVEYING | PLANNING | LANDSCAPE ARCHITECTURE

PROJECT NUMBER: 1555 PPW (607853)

REVISIONS:

DESIGN: PSB
DRAWN: PSB/LU
APPROVED: LU
DATE: 9/2010
SCALE: 1" = 40'
SHEET: 6 OF 7

E:\Projects\USD 259 5th Addition\Engineering\PPW\PPW 10-04-E485