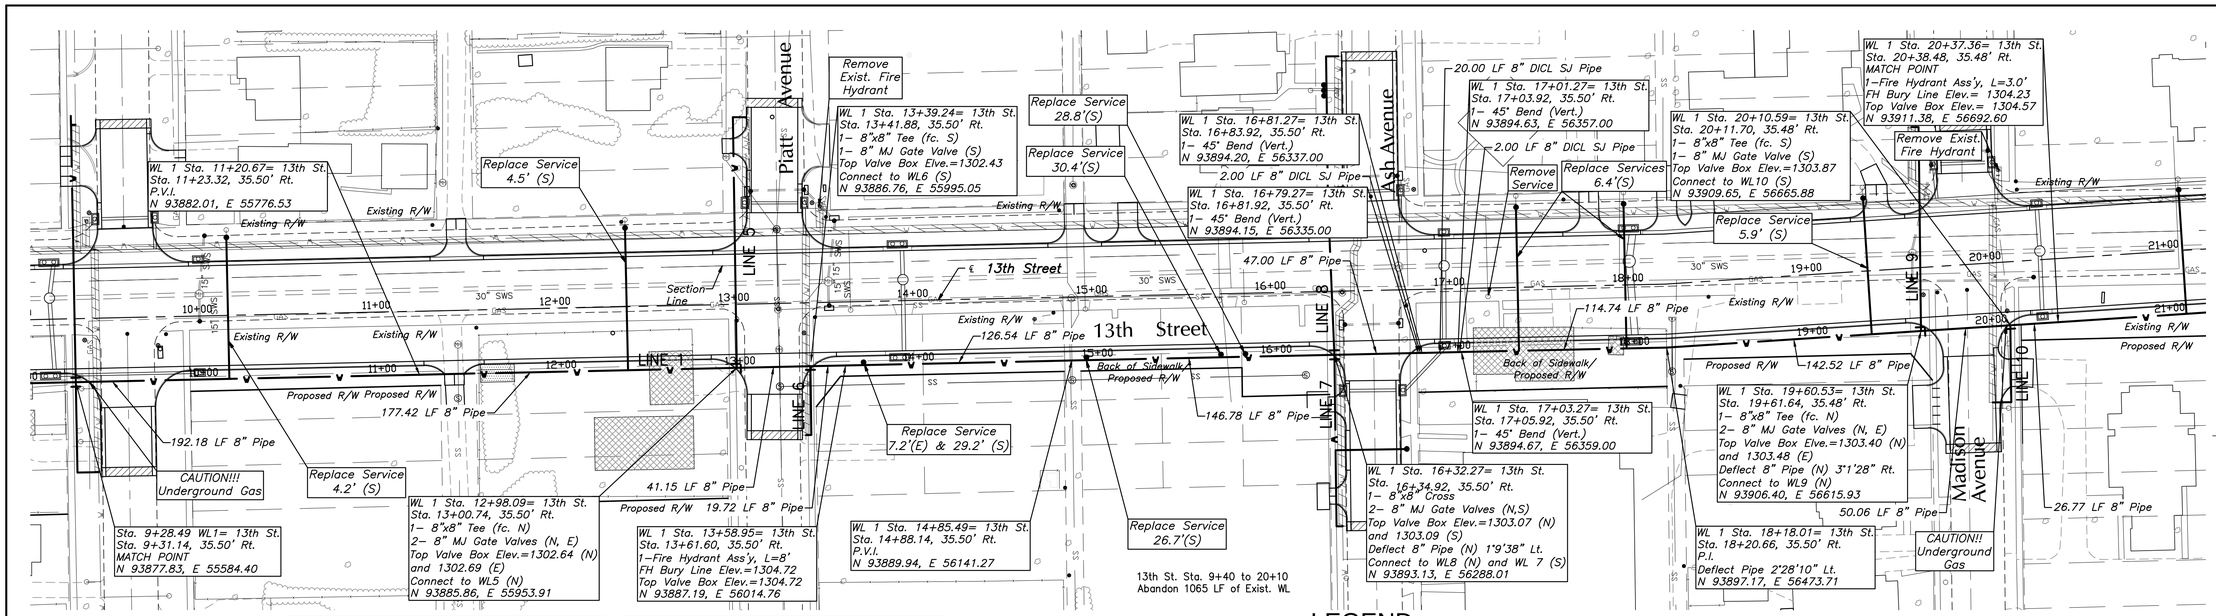

NOTES:
1. Contractor to Field Verify location and Depth of All Utilities Prior to Construction and Report Findings to Project Engineer.

Unless otherwise noted elevations shown are to top of pipe.

Line #	Station	Approximate Length
1	10+14.39	79 LF (Long)
1	12+37.31	80 LF (Long)
1	13+68.95	2 LF (Short)
1	14+93.58	2 LF (Short)
1	15+68.83	2 LF (Short)

Line #	Station	Approximate Length
1	15+82.50	2 LF (Short)
1	17+35.49	80 LF (Long)
1	17+95.64	81 LF (Long)
1	19+32.94	76 LF (Long)

LINE NO. 1

LEGEND:

Tree Removal

Existing Building to be Removed by Others

Water Main to be Removed or Abandon in Place

Remove Trees Only as Needed for Construction. Cost Shall be Subsidiary to Site Clearing.

GRAPHIC SCALE

HORIZ. (IN FEET) 1 INCH = 40 FT.

VERT. (IN FEET) 1 INCH = 5 FT.

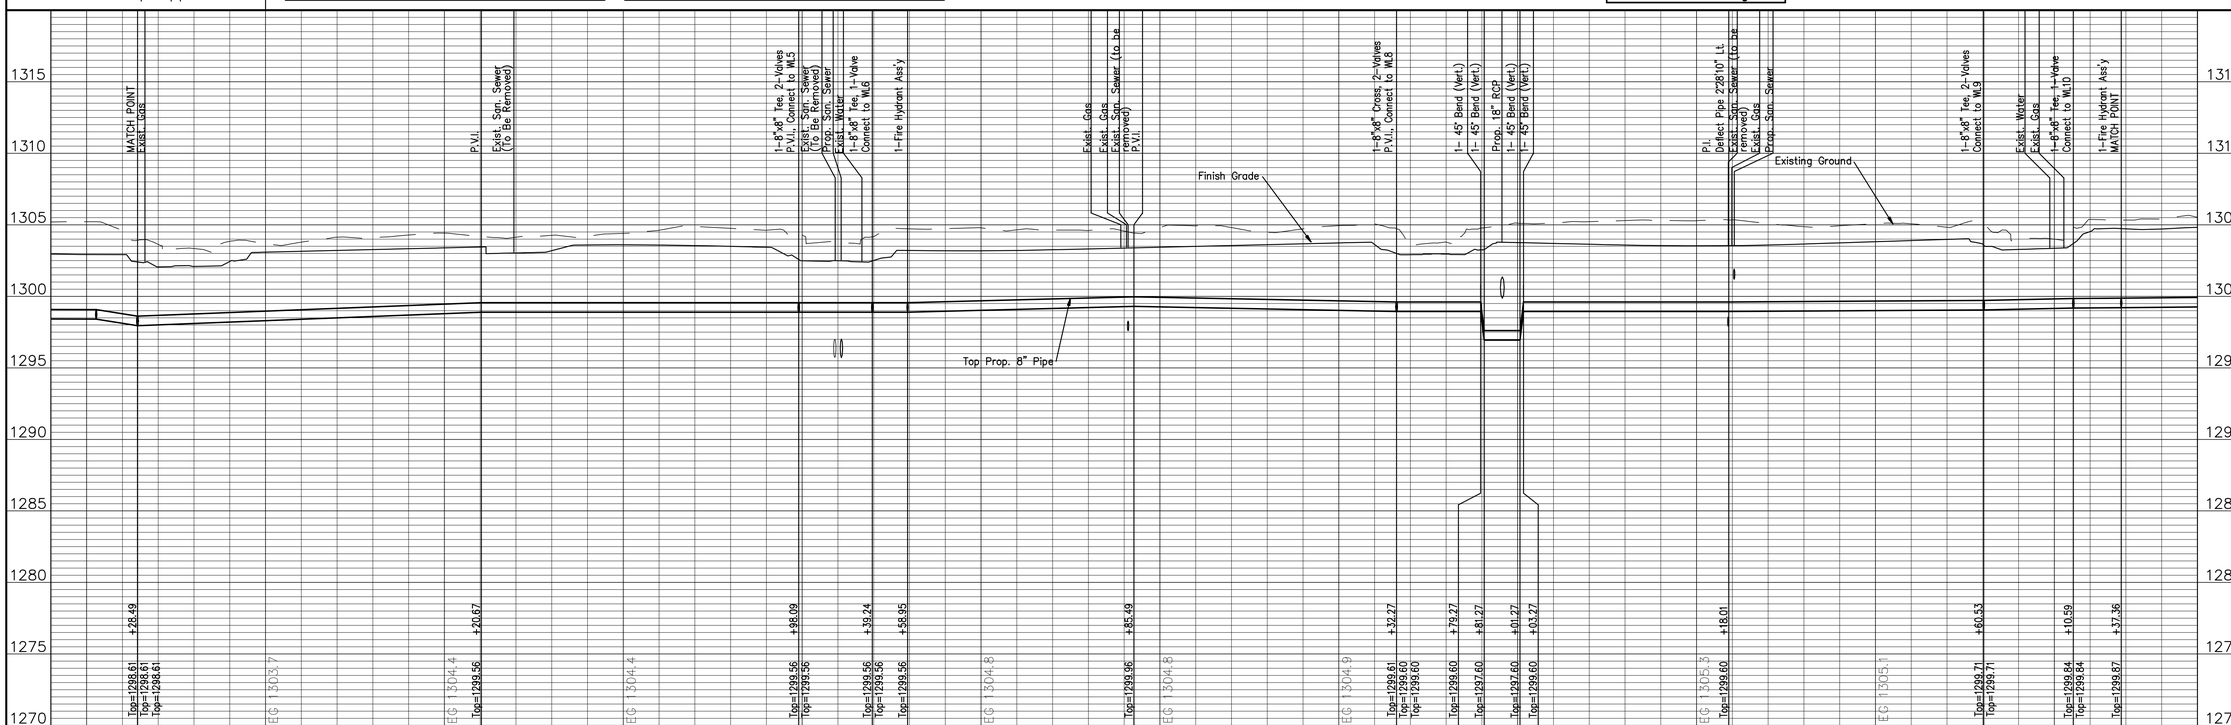

No.	Date	By	Approved	Revision

13th STREET NORTH FROM KANSAS TO OLIVER
WATER SUPPLY IMPROVEMENTS
WATER PLAN & PROFILE
CITY OF WICHITA, KANSAS
JAMES L. ARMOUR, P.E. – CITY ENGINEER
C.O.W. Proj. # 448–90551 O.C.A. # 635803

JAMES P. DICKMAN LICENSED 18137 KANSAS PROFESSIONAL ENGINEER
16 April 2012

POE & ASSOCIATES, INC.
CONSULTING ENGINEERS
5940 E. Central, Suite 200 Wichita, KS 67208–4242
Phone 316/685–4114 FAX 316/685–4444

FINAL

Engineer: J. DICKMAN
Designer: M. TUCKER
Poe Job No.: 1871
Date: MARCH 2012