

BENCHMARK:
 BM #108 - Chiseled "+" in the Flowline of the Curb on the East Side of Meadowview between #5042 & #5046. Elev. = 1268.20 (NAVD 88)

Sta. 5+43.86, Water Line 8 = B.L. Sta. 6+91.70, 15.40' Lt. Deflect Pipe 4' 00" (Lt.)

Sta. 6+23.86, Water Line 8 = B.L. Sta. 7+72.65, 15.29' Lt. Deflect Pipe 4' 00" (Lt.)


Sta. 7+23.86, Water Line 8 = B.L. Sta. 8+73.84, 15.26' Lt. Deflect Pipe 4' 00" (Lt.)

Sta. 7+45.00, Water Line 8 = B.L. Sta. 8+95.23, 15.75' Lt. Install 1-Fire Hydrant Assy. (W) L = 4.00' Bury Line Elev. = 1269.4 Valve Box Elev. = 1269.2

Sta. 8+93.86, Water Line 8 = B.L. Sta. 10+45.83, 15.14' Lt. Deflect Pipe 3' 00" (Lt.)

Sta. 9+53.86, Water Line 8 = B.L. Sta. 11+06.53, 15.20' Lt. Deflect Pipe 3' 00" (Lt.) Match Point

SCALE:
 HORIZONTAL: 1" = 20'
 VERTICAL: 1" = 5'

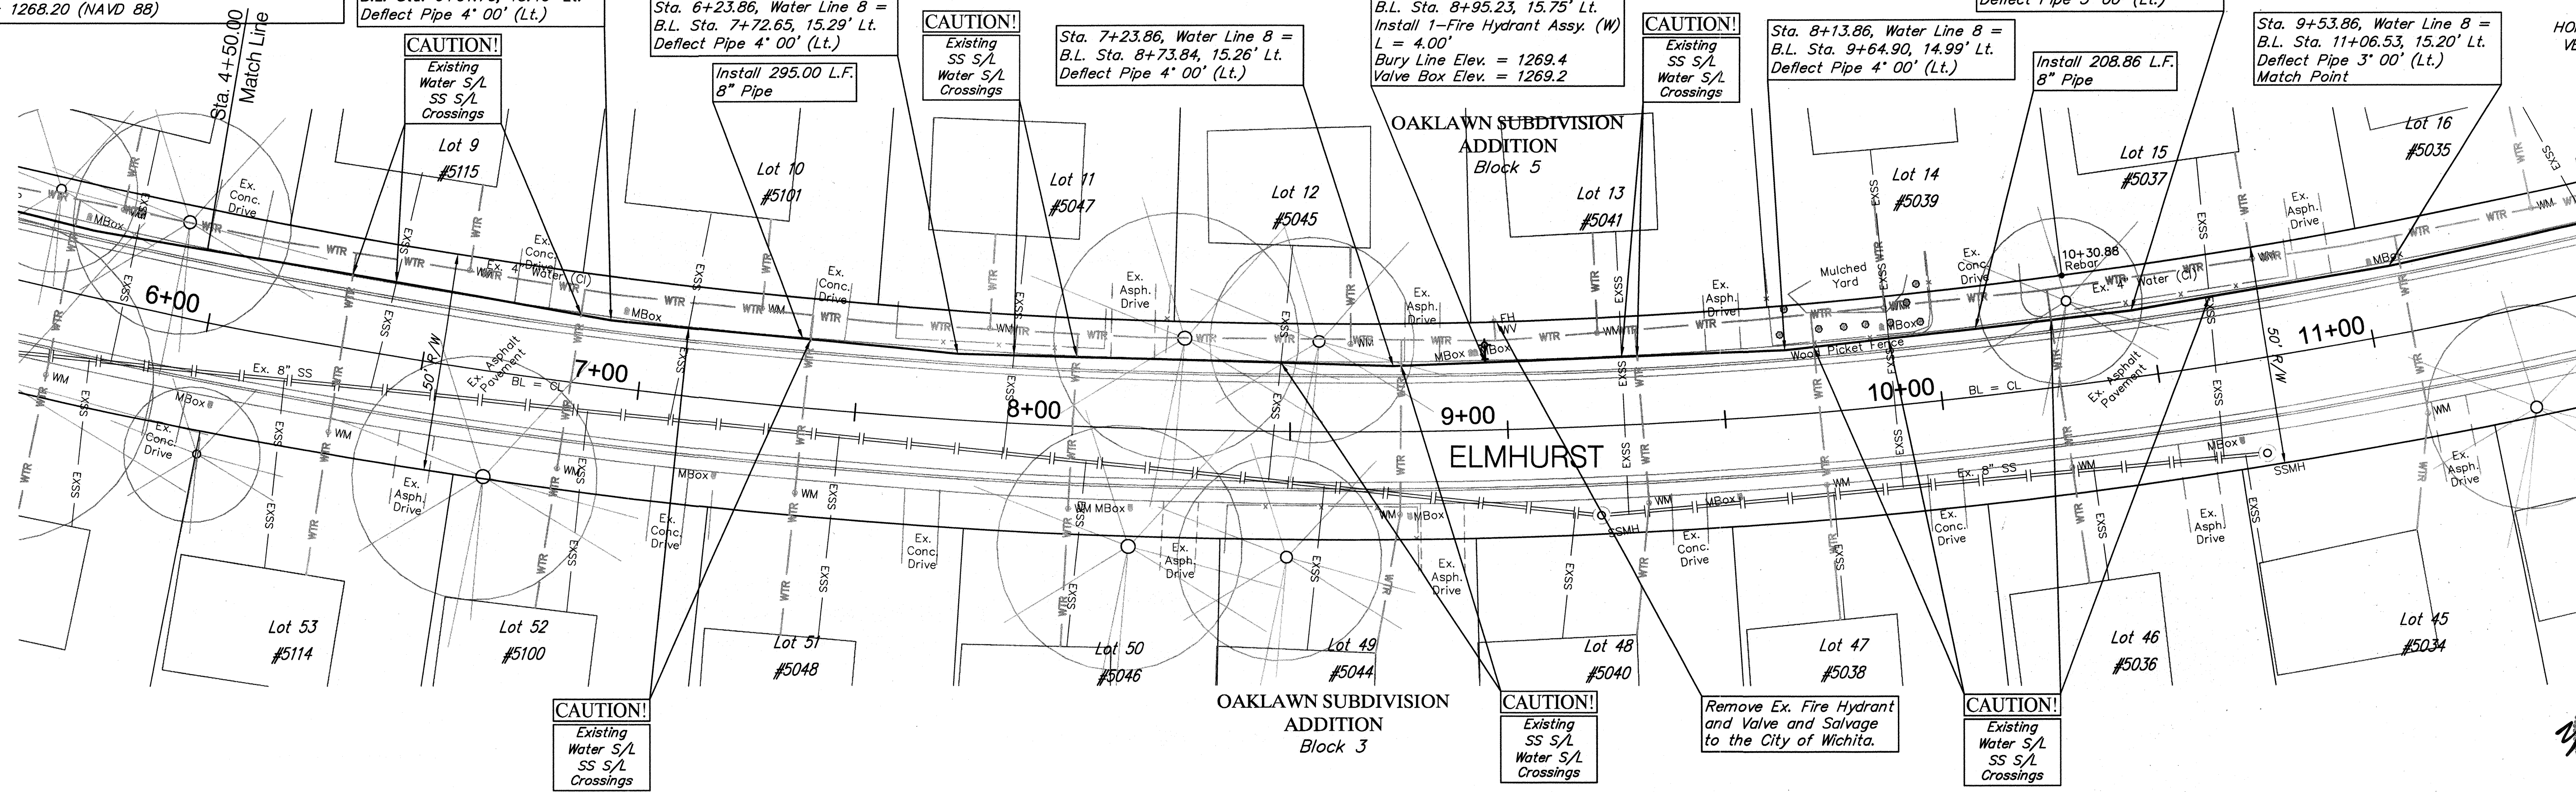

Water Line 8

