



GROUNDING NOTE: TOWERS SHALL BE GROUNDED BY MEANS OF A NO. 6 A.W.G. STRANDED BARE COPPER GROUND WIRE ATTACHED TO THE INTERNAL GROUNDING LUG WITHIN THE TOWER. GROUND WIRE SHALL BE CONNECTED TO THE GROUND ROD BY MEANS OF A GROUND ROD CLAMP.

LIGHT TOWER GROUNDING AND CONDUIT ENTRANCE DETAIL

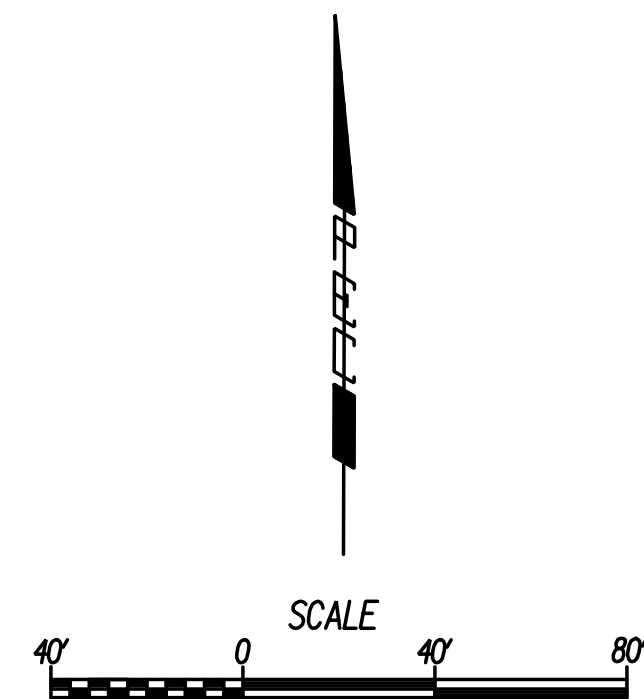

All existing utilities shall be field verified along cable path for conflicts and route direct buried power cable to miss existing utilities.

| | | | |
|---|----------|---------|-----------------|
| No. | Revision | By | Date |
| K-96 AND GREENWICH ROAD | | | |
| LIGHTING PLAN RAMP | | | |
| GARY JANZEN, P.E.-CITY ENGINEER CITY OF WICHITA PROJECT NO. 472-85066 | | | |
|  PECC PROFESSIONAL ENGINEERING CONSULTANTS, P.A. 303 SOUTH TOPEKA WICHITA, KS 67202 316-262-2691 www.pec1.com | | | |
| Designed by | SMS | Job No. | 09521 |
| Drawn by | WAN | Date | Jan., 2014 |
| | | | Sht. 150 of 388 |