


HG-3 & HG-4
(NOT TO SCALE)

SUMP DEPTH TABLE			
STRUCTURE	STORM SEWER LINE NO.	STATION	MIN. SUMP DEPTH
HG-3	11	0+54.04	6'-4"
HG-4	12	0+10.04	6'-4"

U.S. Patent No. 6,951,619.

Dimensions in inches
 Permanent Pool Volume = 2500 US gallons
 The Hydroguard must be cleaned after the construction period if it is used as a sediment and erosion control measure
 The Hydroguard should be inspected once per year for stabilized sites
 Inspection will determine the maintenance frequency (annual maintenance or once every two years typical for stabilized sites)
 Sites with unstable conditions (exposed soil or materials storage) will require more frequent inspection and maintenance

Hydroworks, LLC
 50 S. 21st St., Kenilworth, NJ 07033
 Phone: 888-290-7900 Fax: 888-783-7271
 Web: www.hydroworks.com

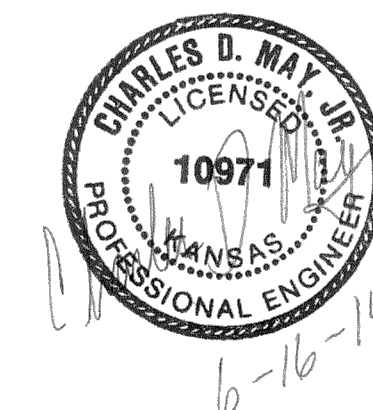

CITY OF WICHITA				
HYDROGUARD DETAILS				
		8615 W. Frazier Lane, Suite 2 Wichita, KS 67212 Phone: 316-722-4472		
DESIGNED	ABS	DRAWN	JWB	SCALE
CHECKED	ABS/CDM	DATE	02/14	No Scale
				SHEET NO. 59A