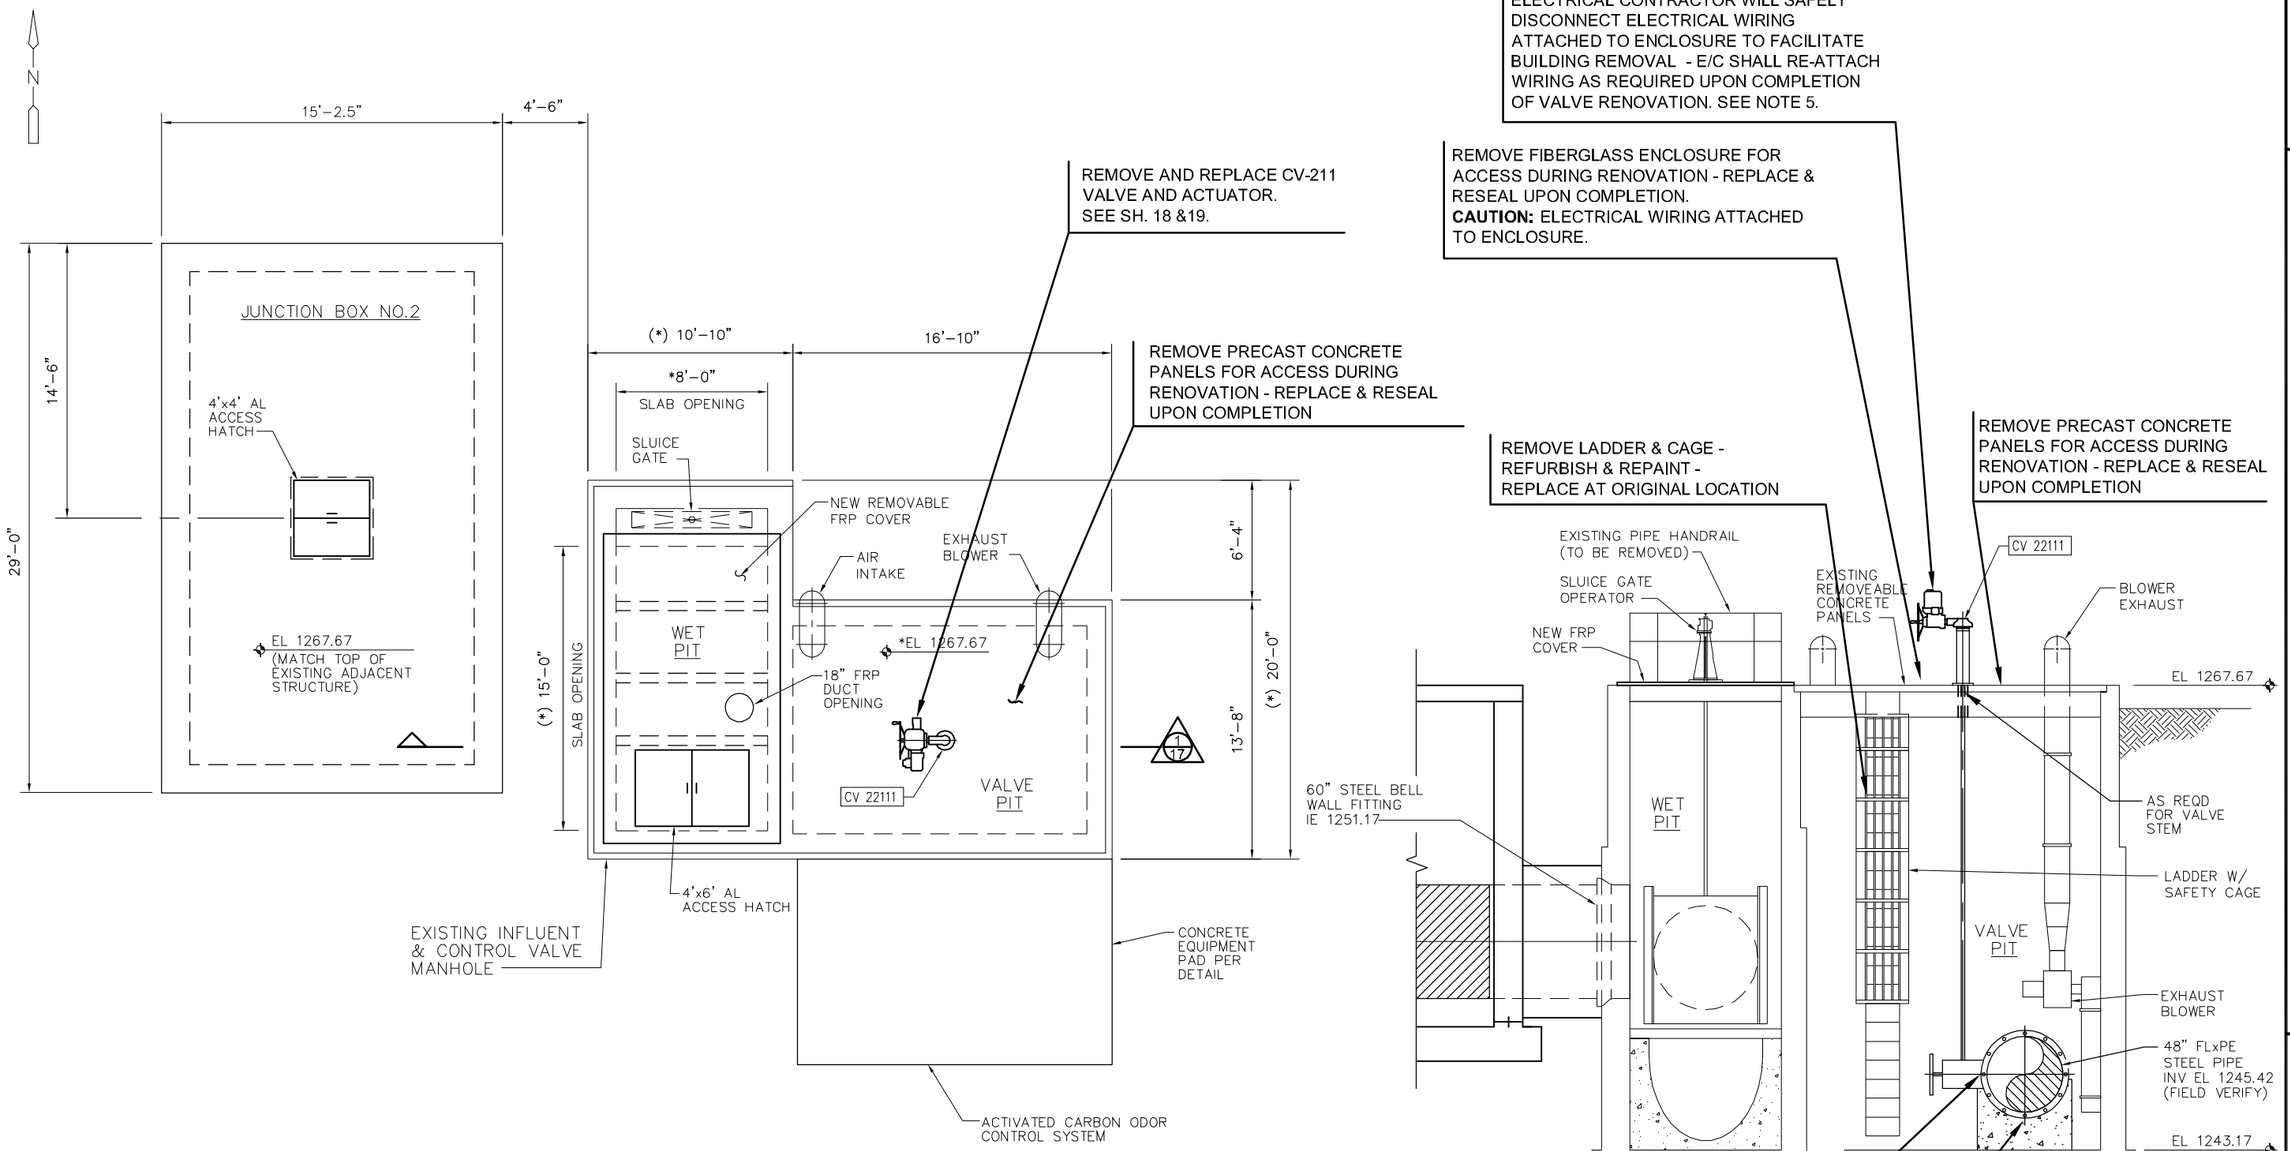

JUNCTION BOX NO. 2 AND INFLUENT MANHOLE VIEW AT EL 1270.00

PLAN

1/17 SECTION

NOTES:

1. CONTRACTOR WILL BE RESPONSIBLE FOR COORDINATING OUTAGE FOR REPLACEMENT OF THE 48" INFLUENT CONTROL VALVE WITH ENGINEER AND OWNER.
2. ELECTRICAL CONTRACTOR WILL DISCONNECT POWER & CONTROL WIRING TO 48" BUTTERFLY VALVE.
3. MECHANICAL CONTRACTOR WILL REPLACE VALVE & ACTUATOR.
4. ELECTRICAL CONTRACTOR WILL RECONNECT CONTROL WIRING TO TO NEW VALVE ACTUATOR. ELECTRICAL CONTRACTOR WILL VERIFY OPERATION OF VALVE WITH PLANT OPERATIONS.
5. FOR ELECTRICAL REFERENCE SEE SH. 18 & 19.

MKEC
Wichita, KS · 316.684.9600

CITY OF WICHITA, KANSAS

WASTEWATER TREATMENT PLANT #2

HEADWORKS IMPROVEMENTS

©2014
MKEC Engineering
All Rights Reserved
www.mkec.com
These drawings and their contents, including, but not limited to, all concepts, designs, & ideas are the exclusive property of MKEC Engineering (MKEC), and may not be used or reproduced in any way without the express consent of MKEC.

CONTROL VALVE MANHOLE 2000

PROJECT NO.	1401010275
DATE	07/31/14
SCALE	N.T.S.

DESIGNED	DRAWN	CHECKED
KJS	DPG	KJS

NO.	REVISION	DATE
0	ISSUED FOR CONSTRUCTION	09/18/14

KEITH T. SCARBERRY LICENSED 21496 09/19/2014 KANSAS PROFESSIONAL ENGINEER

ALTERNATE #2
ENTIRE SHEET

SHEET NO.
17 OF 19