



3" PVC (SCH. 80)
TO BE INSTALLED

STATION	LOCATION	LIN. FT.
Sta. 821+70	K-96, 110' Lt.	45
Sta. 128+45	HOOVER RD.	50
	TOTAL	95

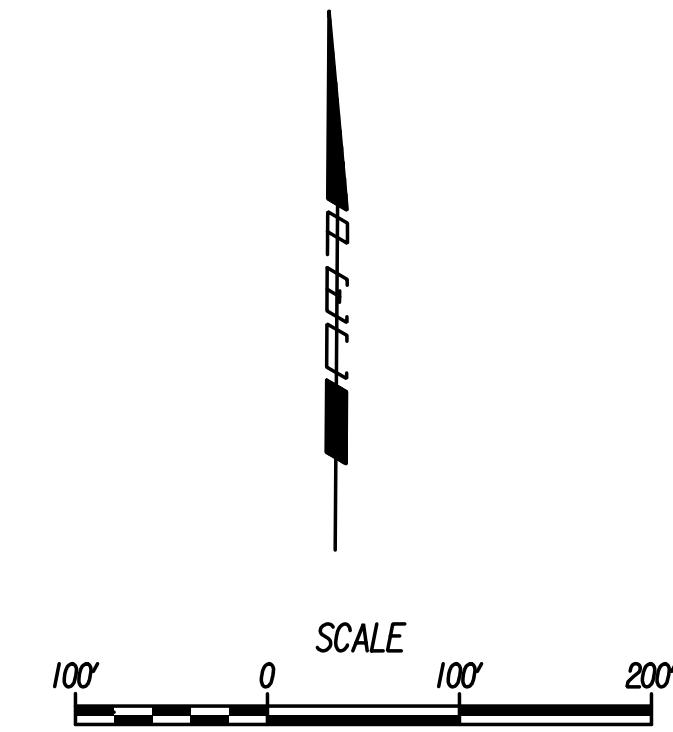


NOTE:

Prior to construction, the Contractor shall contact the Westar Energy Electric Service Clerk at (316) 261-6512 to schedule new service for the enclosure. The contractor shall be responsible for all fees imposed by Westar Energy for service hookup.

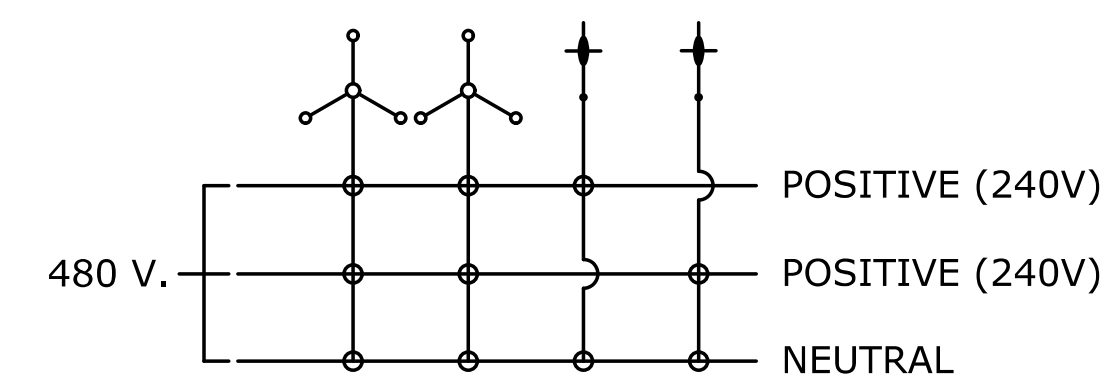

MAIN BREAKER	50 AMP
SECONDARY BREAKER	
CIRCUIT NO. 1	15 AMP
CIRCUIT NO. 2	-- AMP
CIRCUIT NO. 3	-- AMP
CIRCUIT NO. 4	-- AMP
ELECTRICALLY HELD CONTACTORS	
CIRCUIT NO. 1	15 AMP
CIRCUIT NO. 2	-- AMP
CIRCUIT NO. 3	-- AMP
CIRCUIT NO. 4	-- AMP

No.	Revision	By	Date
K-96 AND HOOVER ROAD			
LIGHTING PLAN			
GARY JANZEN, P.E.-CITY ENGINEER CITY OF WICHITA PROJECT NO. 472-84780			
 PEC PROFESSIONAL ENGINEERING CONSULTANTS, P.A. 303 SOUTH TOPEKA WICHITA, KS 67202 316-262-2691 www.pec1.com			
Designed by	SAC	Job No.	08807-001
Drawn by	SVB	Date	Jan., 2015
			Sh. 76 of 227

Plotted By: drp Date: 1/15/2015 3:28:52 PM
 FILE: I:\2008\08807\001\Lighting\08807-001\Lighting Plan.dgn

