

CL ROAD STA 1+01.78, 18.38' LT
 = BOL LINE 3 STA 0+00.00
 INSTALL - 1 FIRE HYDRANT ASSY(S)
 L = 4.43'
 INSTALL 8" RESTRAINED PLUG (W)
 ON FHA TEE

CONTRACTOR SHALL
 DEFLECT AROUND
 LIGHT POLE, BRACE
 AS NECESSARY


CL ROAD STA 4+85.64, 23.17' LT
 = LINE 3 STA 3+83.82
 = LINE 1 STA 11+35.93
 CONNECT TO LINE 1

Millimeters
 Scale For Microfitting

Inches



- NOTE:**
- REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
 - INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
 - FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.
 - CONTRACTOR TO VERIFY METER LOCATION NOT PICKED UP BY SURVEY.

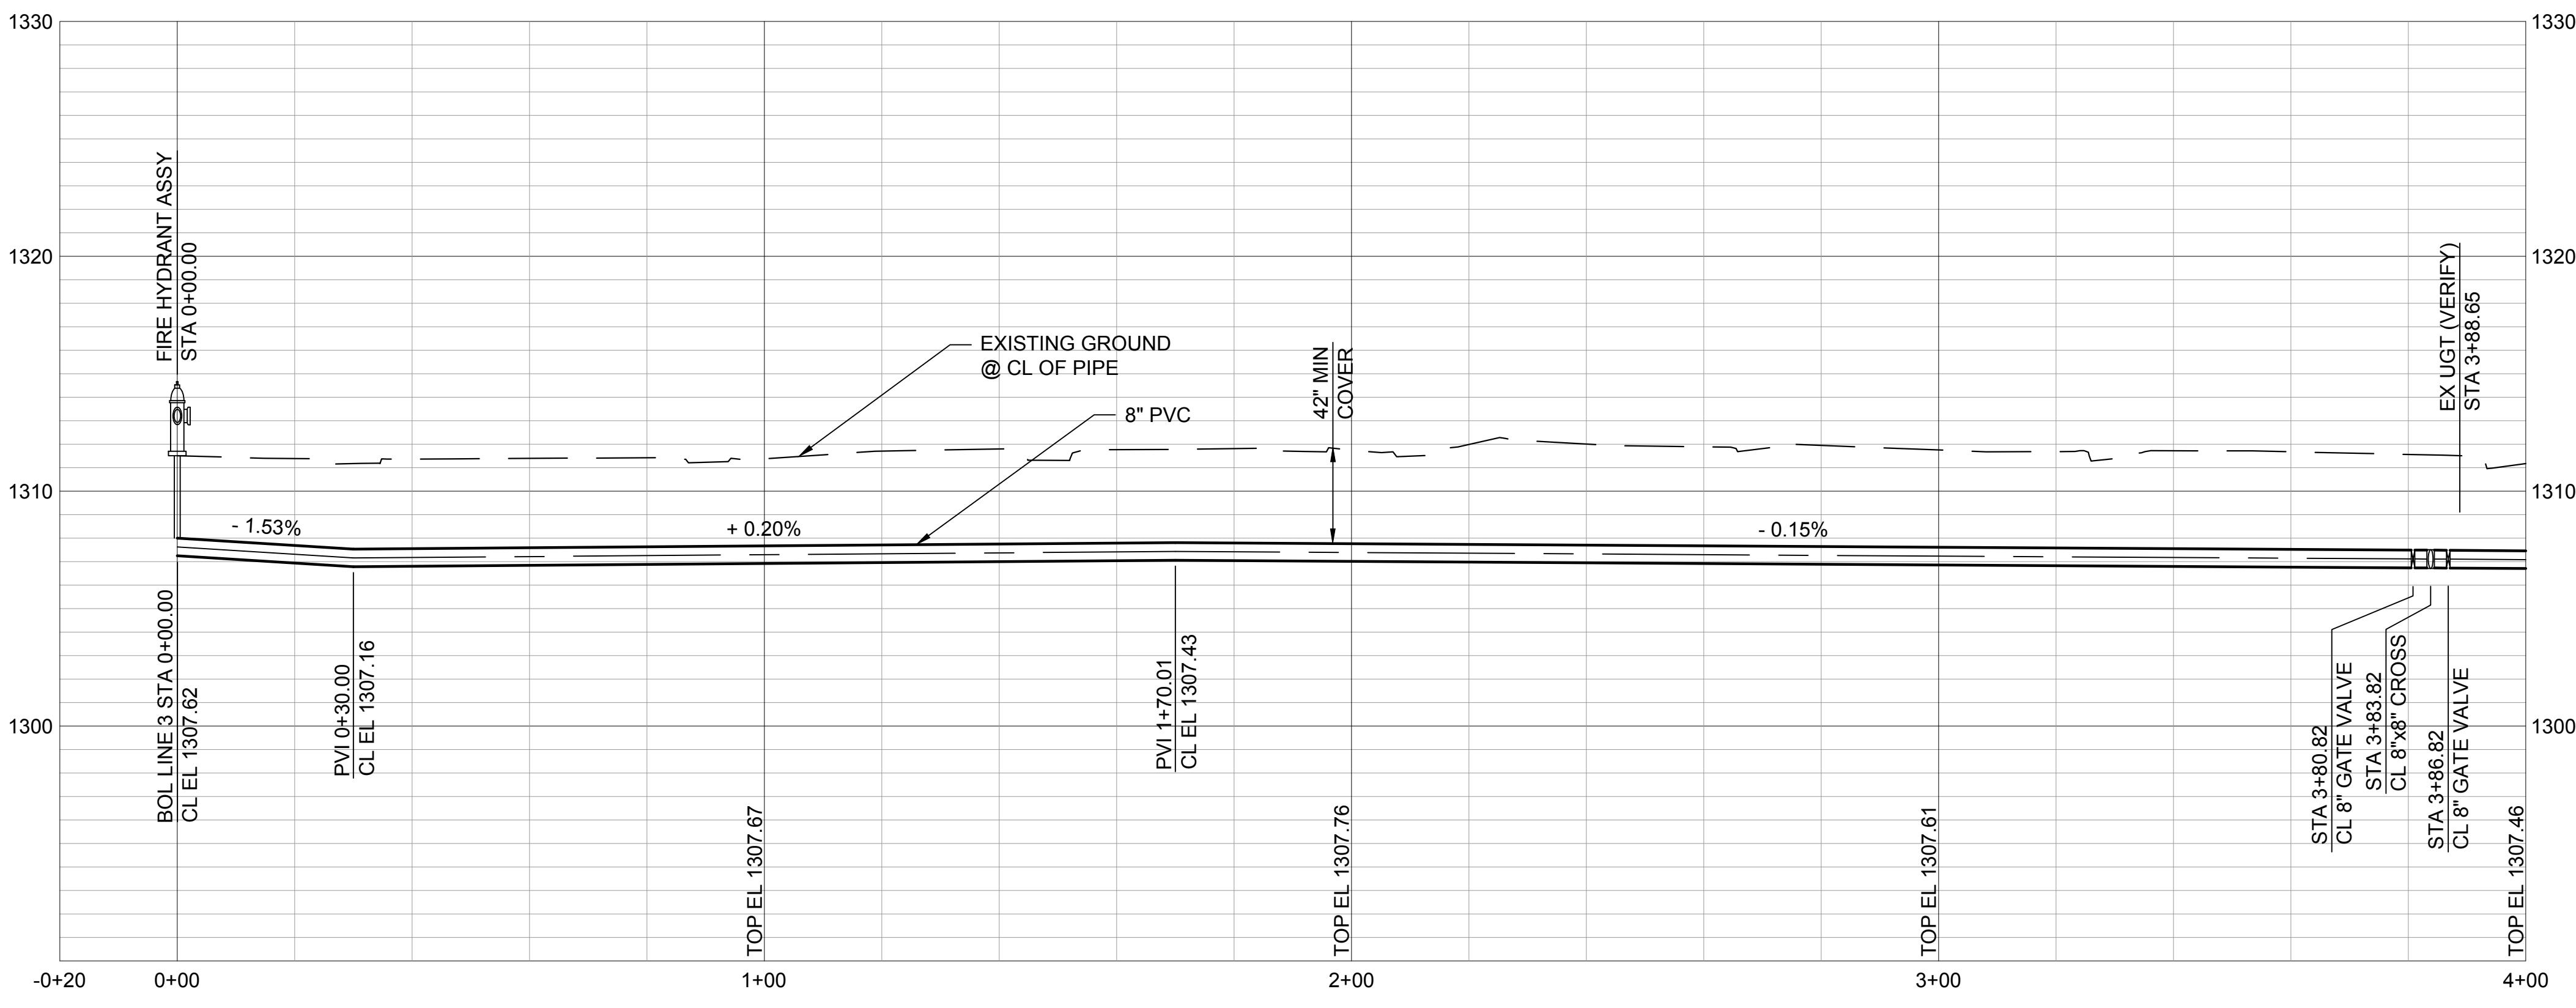

Burns & McDonnell
 SINCE 1898
 9400 WARD PARKWAY
 KANSAS CITY, MO 64114
 816-333-9400
 LICENSEE NO. 000165

date	APRIL 24, 2014	detailed	M. CHARRETTE
designed	J. MCNIFF	checked	S. WILSON



**ETHEL NEIGHBORHOOD
 WATER MAIN REPLACEMENT
 LINE 3 - E 23RD STREET N**

project	77025	contract	448-90612
drawing	C009 - 0		
sheet	16	of	101 sheets
file	LINE 3.dwg		

This document has been digitally signed.
 05/08/15 9:39 AM

Name
 Discipline
 License No.