



Scale For Microfitting
Millimeters
Inches

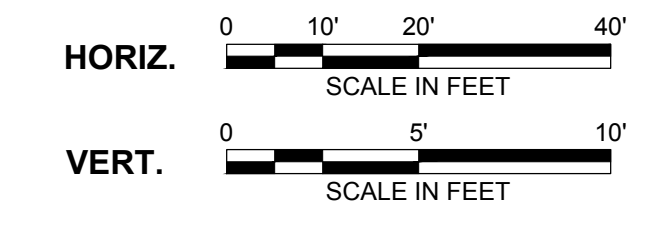

- NOTE:**
- REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
 - INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
 - FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.
 - CONTRACTOR TO VERIFY METER LOCATION NOT PICKED UP BY SURVEY.

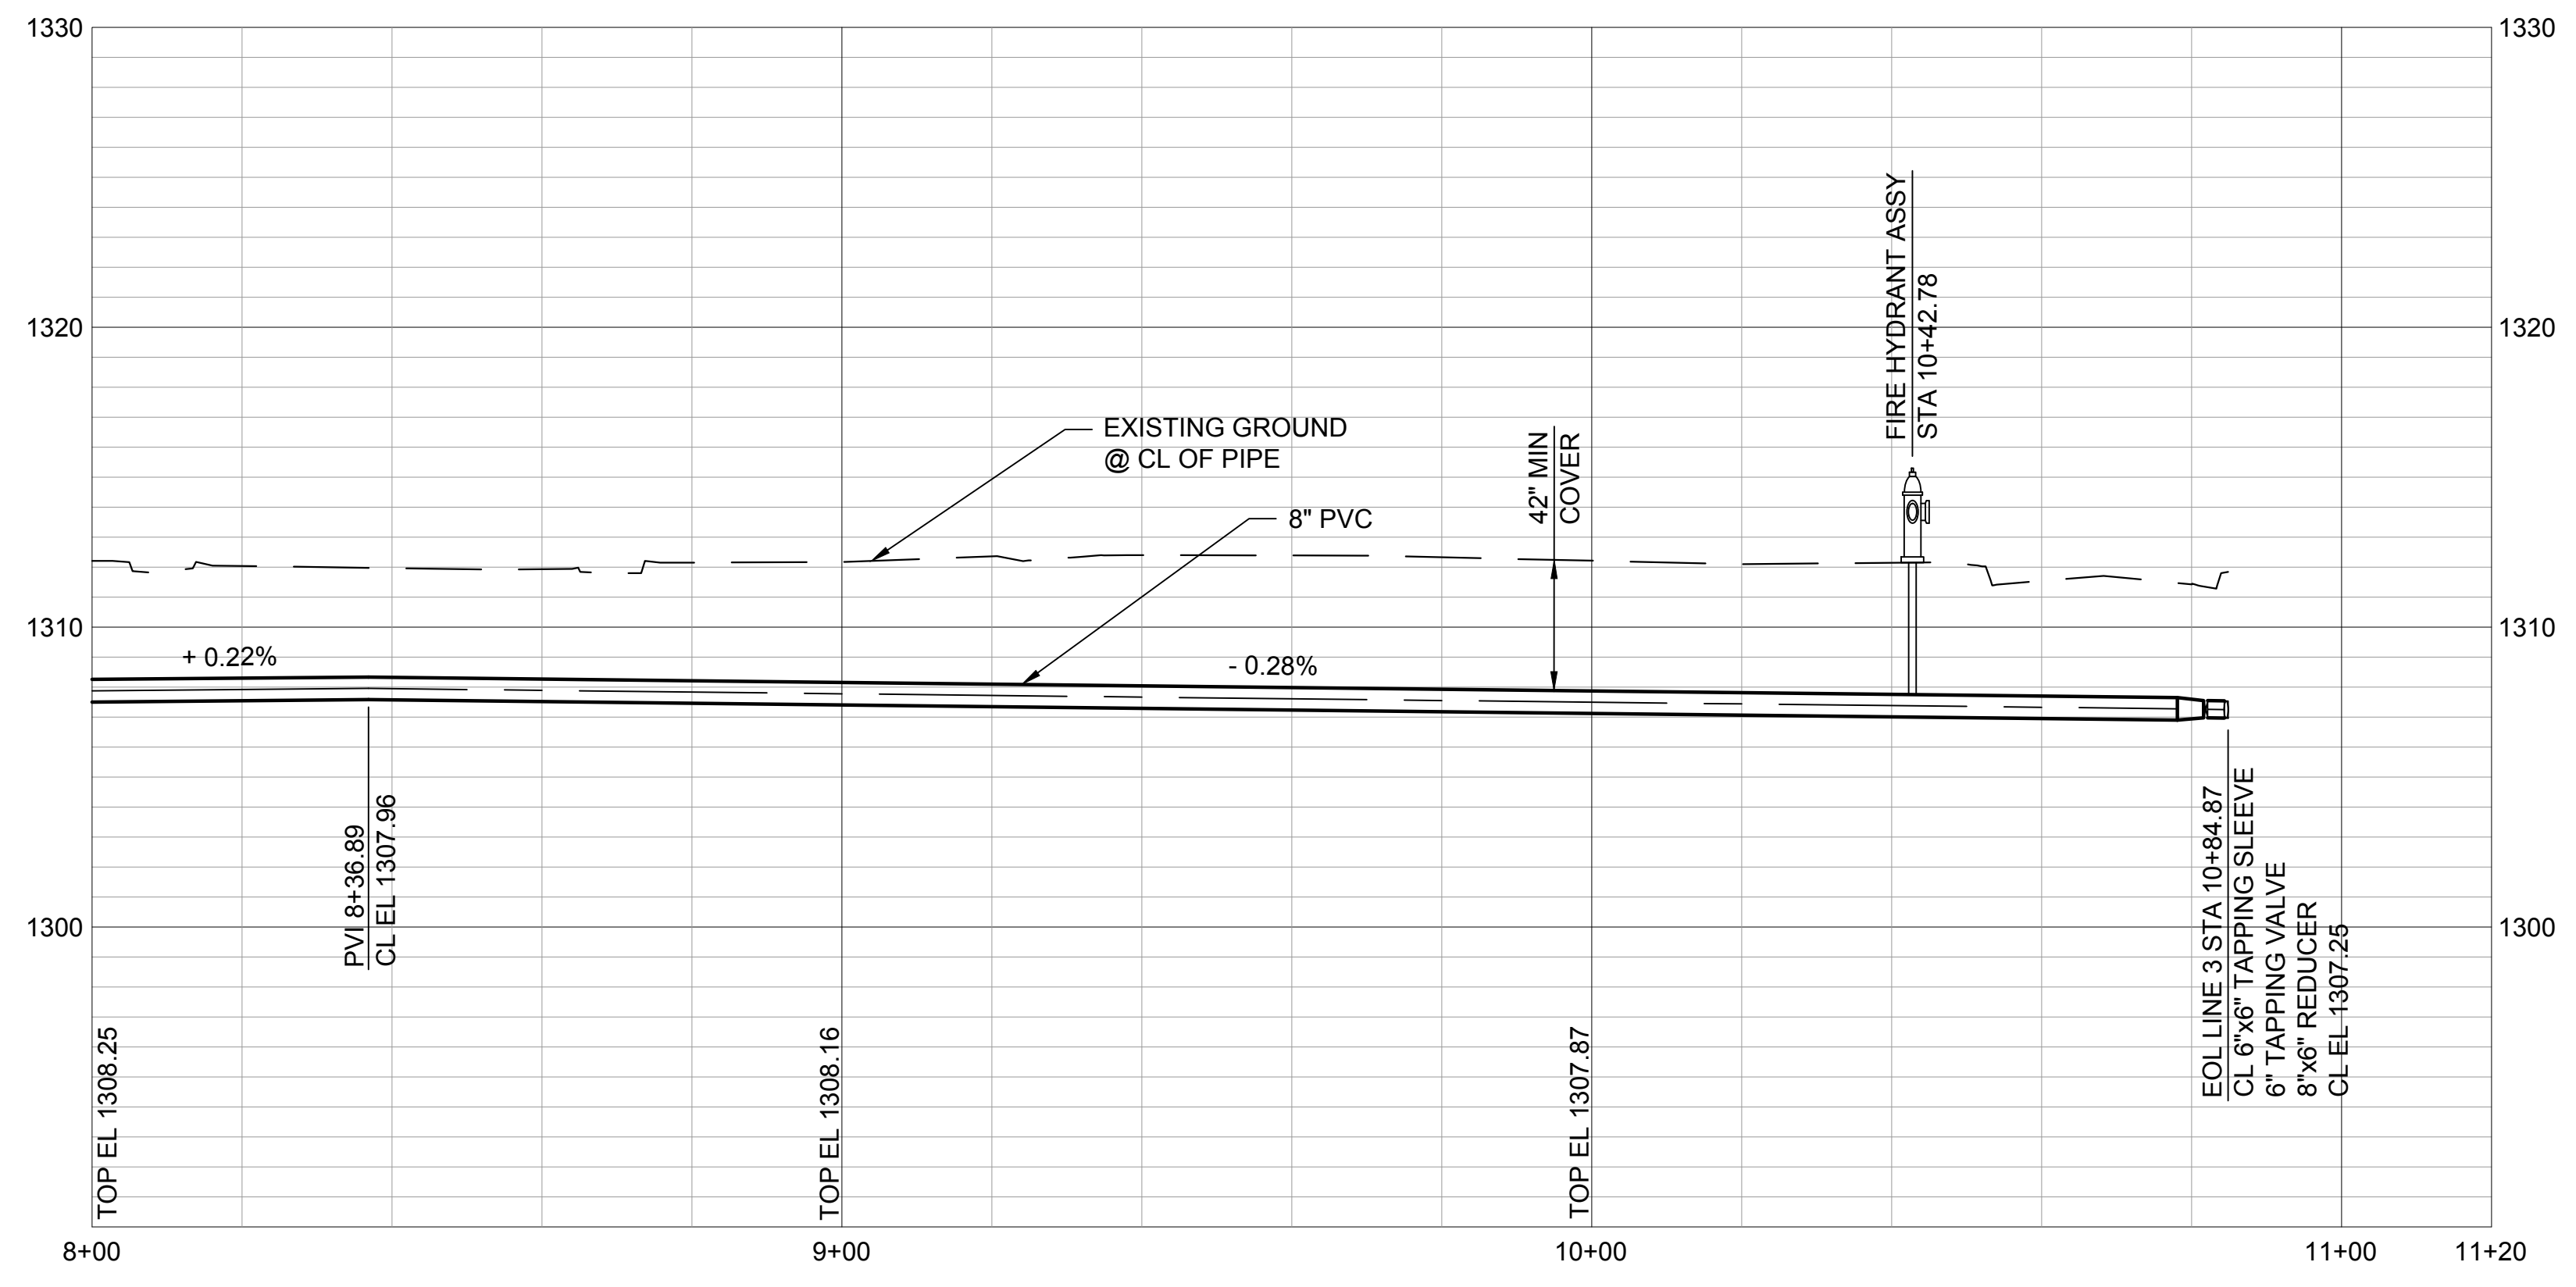

no.	date	by	ckd	description
-----	------	----	-----	-------------

no.	date	by	ckd	description
-----	------	----	-----	-------------




9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-333-9400
LICENSEE NO. 000165

date APRIL 24, 2014	detailed M. CHARRETTE
designed J. MCNIFF	checked S. WILSON



**ETHEL NEIGHBORHOOD
WATER MAIN REPLACEMENT
LINE 3 - E 23RD STREET N**

project 77025	contract 448-90612
drawing C011 - 0	
sheet 18	of 101 sheets
file LINE 3.dwg	

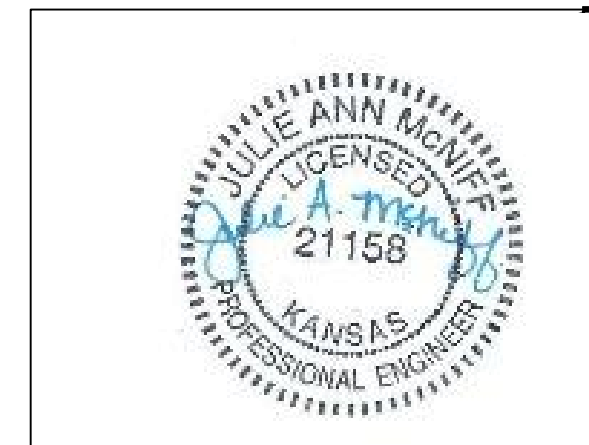

This document has been digitally signed.
05/08/15 9:39 AM

Name
Discipline
License No.