


Scale For Microfitting
Millimeters

Inches

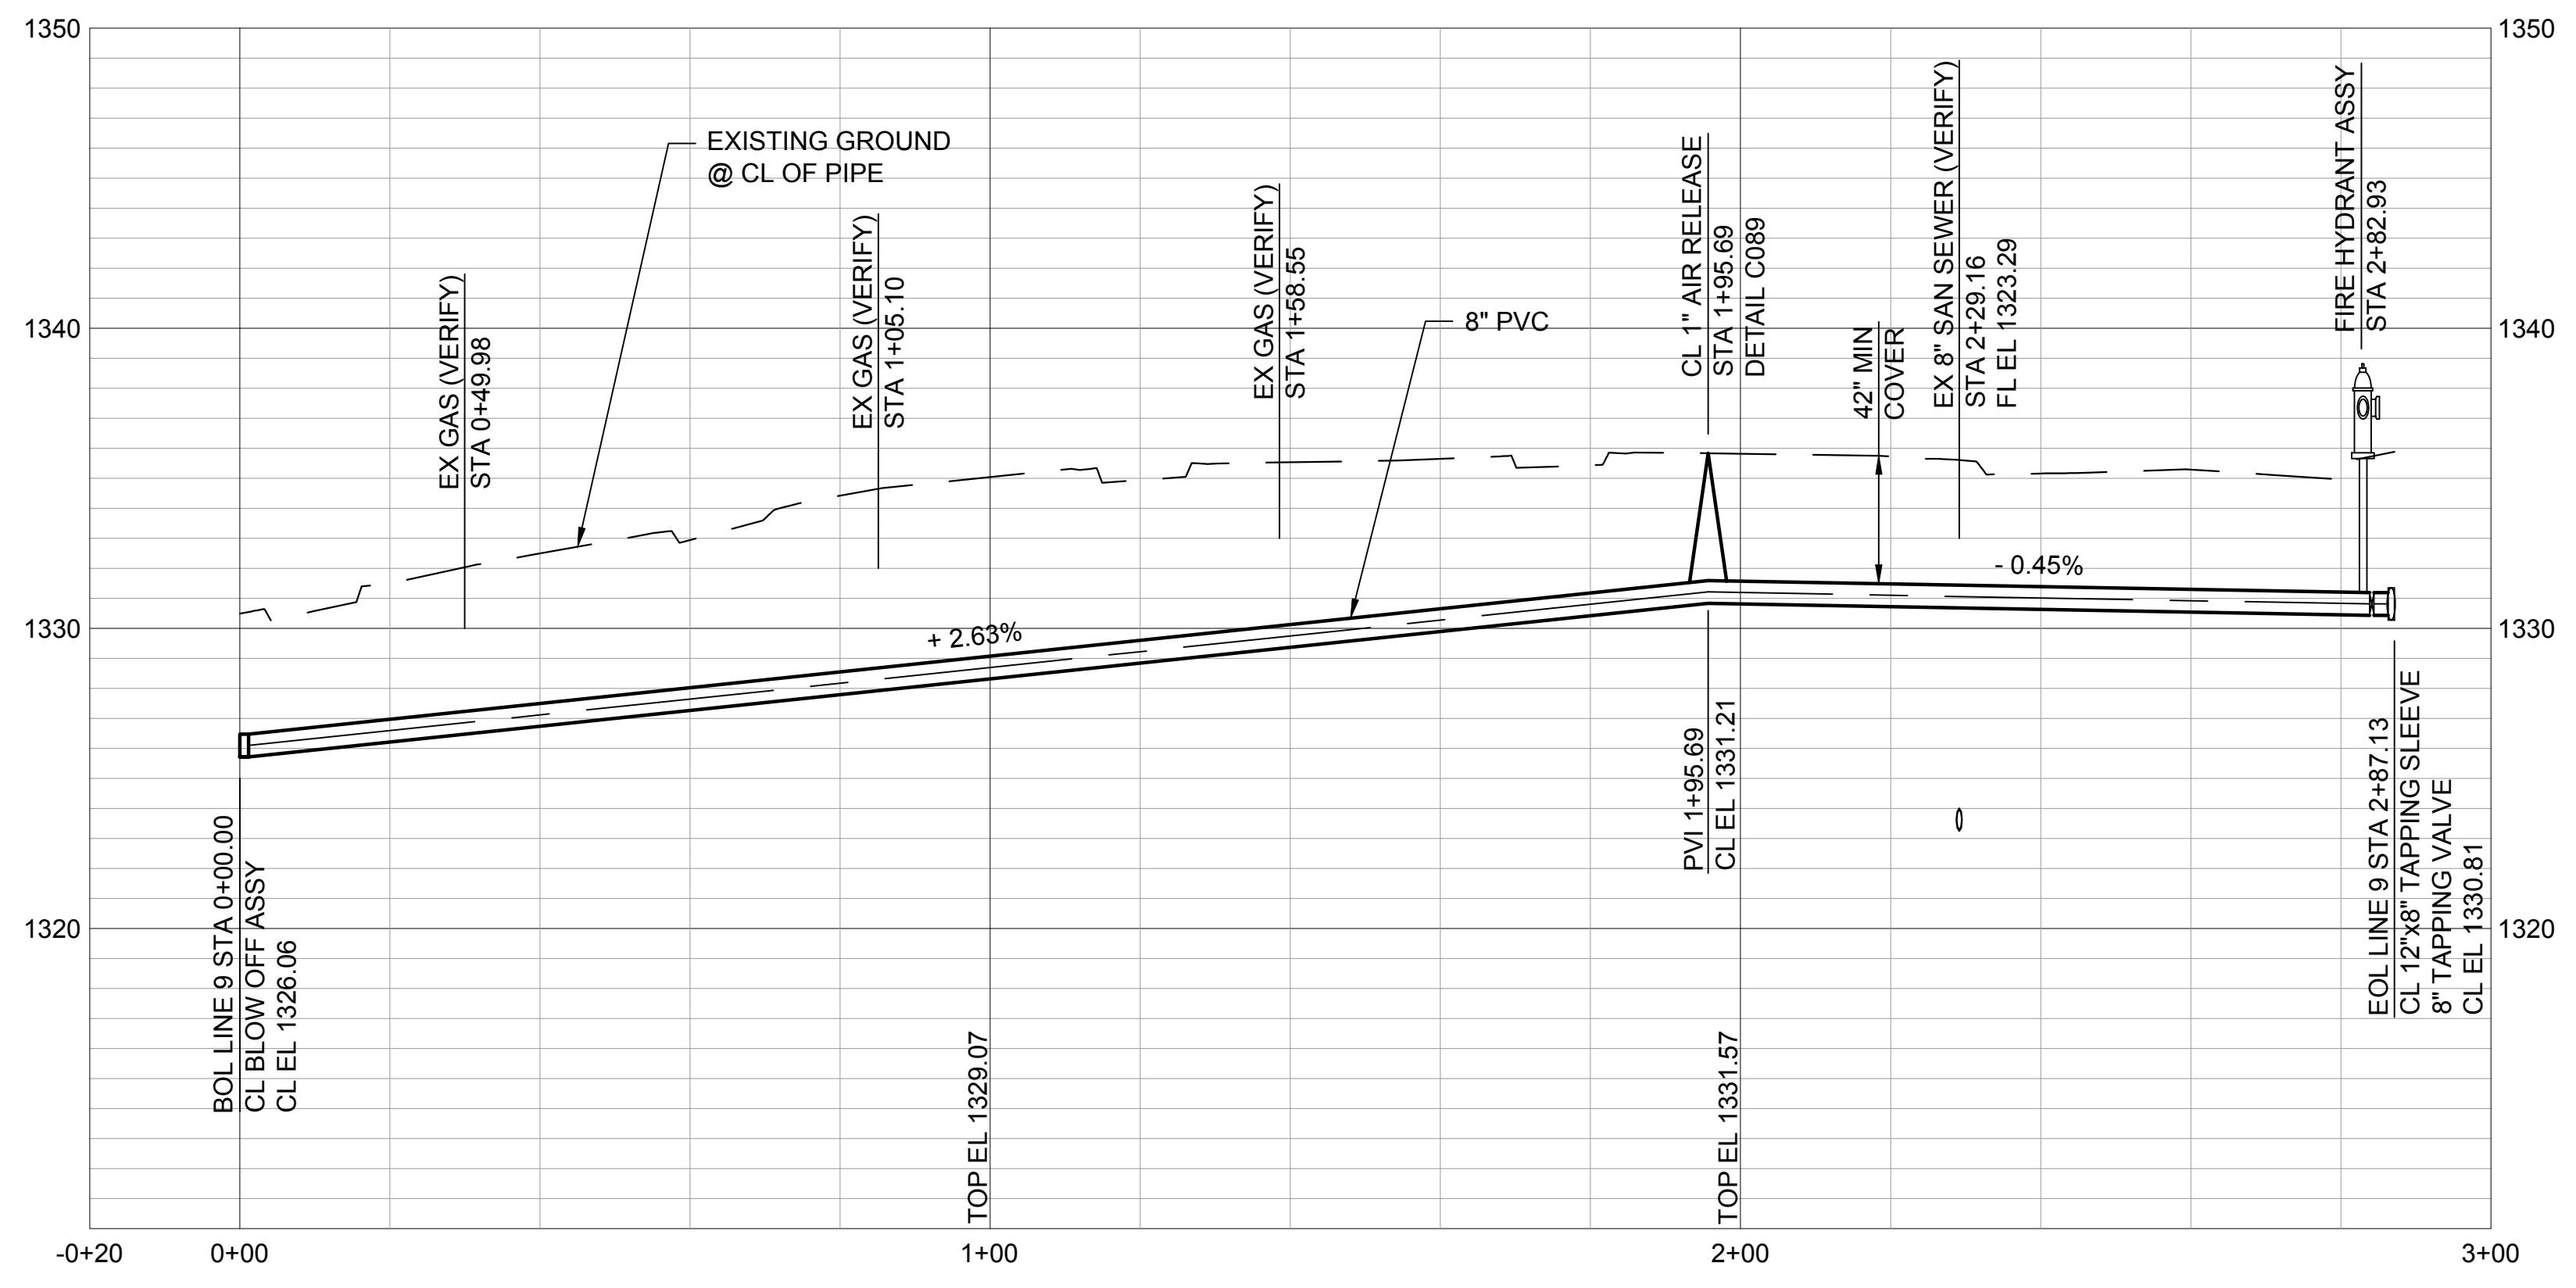

NOTE:

- REFER TO THE WATER SERVICE TRANSFER TABLES, DRAWINGS C092 - C093 FOR METER RELOCATES.
- INSTALL WATERMAIN BY DIRECTIONAL DRILLING UNLESS OTHERWISE NOTED.
- FOR SANITARY SEWER CROSSINGS LESS THAN 24" VERTICAL CLEARANCE FROM WATERMAIN, REBUILD SANITARY SEWER PER SPECIFICATION 803.4a.
- CONTRACTOR SHALL FIELD VERIFY LOCATION OF EX 2" BLOWOFF ASSEMBLY (B.O.# 40368) AT FENCE LINE NOT PICKED UP BY SURVEY. REMOVE EX BLOWOFF ASSEMBLY AND CONNECT TO EX 8" MAIN. CONTRACTOR SHALL VERIFY DEPTH AND PROVIDE ALL APPURTENANCES TO MAKE CONNECTION AT NO ADDITIONAL COST TO OWNER.
- CONTRACTOR SHALL VERIFY METER LOCATION FOR 2449 N 24TH ST E.



no.	date	by	ckd	description
-----	------	----	-----	-------------



9400 WARD PARKWAY
KANSAS CITY, MO 64114
816-333-9400
LICENSEE NO. 000165

date	APRIL 24, 2014	detailed	M. CHARRETTE
designed	J. MCNIFF	checked	S. WILSON



**ETHEL NEIGHBORHOOD
WATER MAIN REPLACEMENT
LINE 9 - E 24TH STREET N
(AT GROVE STREET)**

project	77025	contract	448-90612
drawing	rev. 0		
sheet	31	of	101 sheets
file	LINE 9.dwg		



This document has been digitally signed.
05/08/15 9:45 AM

Name
Discipline
License No.